



Paradise Business Centre

Lot 1, Block 1,
Paradise Valley Second Addition

Buildings 1, 2, 3, & 4

INDEX OF DRAWINGS

COVER:
Index of Drawings, Project Directory

CIVIL:
C-1 Cover Sheet
C-2 General Notes & Legend
C-3 Survey Overlay & Demolition Plan
C-4 Overall Site Plan
C-5 Utility Plan
C-6 Grading Plan
C-7 Erosion & Sediment Control Plan
C-8 Details
C-9 Details
L-1 Landscaping Plan

BUILDING 1

STRUCTURAL:
S1.1 Foundation Plan, General Structural Notes, Sections & Details
S3.1 Roof Framing Plan, Sections & Details

ARCHITECTURAL:
A3.0 Floor Plan, Code Research Summary, Planning and Zoning, Key Plan, Door and Frame Types/Schedule, Wall Types, Window Types, Notes, ADA Mounting Heights, Details
A3.1 Mechanical and Electrical Design-Build Plan, Notes, Enlarged Plan
A4.0 Elevations, Material Legend, Roof Plan, Notes
A4.1 Building Section, Wall Sections, Section Details

BUILDING 2

STRUCTURAL:
S1.1 Foundation Plan, General Structural Notes, Sections & Details
S3.1 Roof Framing Plan, Sections & Details

ARCHITECTURAL:
A3.0 Floor Plan, Code Research Summary, Planning and Zoning, Key Plan, Door and Frame Types/Schedule, Wall Types, Window Types, Notes, ADA Mounting Heights, Details
A3.1 Mechanical and Electrical Design-Build Plan, Notes, Enlarged Plan
A4.0 Elevations, Material Legend, Roof Plan, Notes
A4.1 Building Section, Wall Sections, Section Details

BUILDING 3

STRUCTURAL:
S1.1 Foundation Plan, General Structural Notes, Sections & Details
S3.1 Roof Framing Plan, Sections & Details

ARCHITECTURAL:
A3.0 Floor Plan, Typical Toilet Room, Plan Detail, Wall Types, Door and Frame Schedule, Window/Door/Frame Types, Planning and Zoning, Code Research Summary, Notes, Key Plan, Details
A3.1 Mechanical and Electrical Design-Build Plan, Notes, Enlarged Plan, ADA Mounting Heights
A4.0 Elevations, Material Legend, Roof Plan, Notes
A4.1 Building Section, Wall Sections, Section Details

BUILDING 4

STRUCTURAL:
S1.1 Foundation Plan, General Structural Notes, Sections & Details
S3.1 Roof Framing Plan, Sections & Details

ARCHITECTURAL:
A3.0 Floor Plan, Typical Toilet Room, Plan Detail, Wall Types, Door and Frame Schedule, Window/Door/Frame Types, Planning and Zoning, Code Research Summary, Notes, Key Plan, Details
A3.1 Mechanical and Electrical Design-Build Plan, Notes, Enlarged Plan, ADA Mounting Heights
A4.0 Elevations, Material Legend, Roof Plan, Notes
A4.1 Building Section, Wall Sections, Section Details

Revision Schedule		
△	Addendum	01/03/2025

PROJECT DIRECTORY

Design - Builder	Civil Engineer	Structural Engineer
wild crg 500 2nd Avenue North, Suite 514 Fargo, ND 58102 Office (701) 293-8106	Lowry Engineering 5306 51st Avenue South, Suite A Fargo, ND 58104 Office (701) 235-0199	Sollien & Larson Engineering 3330 Flechtner Dr S # 206 Fargo, ND 58103 Office (701) 235-5593

Each set of drawings contains the above noted sheets. If any sheets are omitted, contact the office of Wild/CRG immediately for a replacement set of drawings.


wild | crg

500 2nd Avenue North | Suite 514
Fargo, North Dakota 58102

architecture | construction

Phone 701 | 293 | 8106
wildcrg.com

DATE:	2/27/2024
PROJECT #:	2344
DRAWN:	APJ
CHECKED:	AEK
APPROVED:	AEK
© Copyright 2024	WildCRG, Ltd.

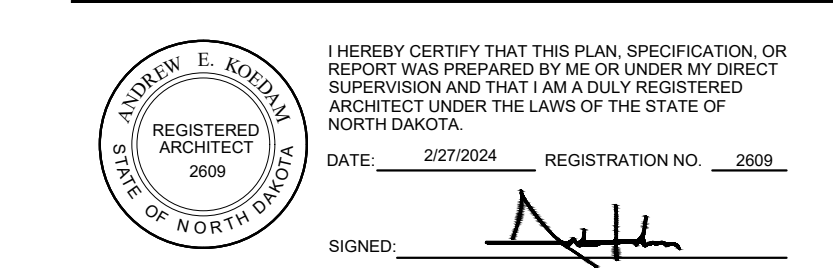

COVER

SHEET

PARADISE VALLEY BUSINESS CONDOS

3604 RUTLAND DRIVE
BISMARCK, BURLEIGH COUNTY, ND




Paradise Business Centre

Lot 1, Block 1,
Paradise Valley Second Addition

OWNER'S REPRESENTATIVE
WILD CRG
ANDREW KOEDAM, AIA
500 2ND AVENUE NORTH, SUITE 514
FARGO, ND
PH: 701-293-8106
EMAIL: AKOEDAM@WILDCRG.COM

CIVIL ENGINEER
LOWRY ENGINEERING
HANNA BOESE, PE
2718 GATEWAY AVE, SUITE 302
BISMARCK, ND 58503
PH: 701-235-0199
EMAIL: HBOESE@LOWRYENG.COM


SITE INFORMATION		
SITE COVERAGE		
ITEM	AREA (SF)	AREA (%)
BUILDING	91,012	34.12
PARKING & DRIVES	135,060	50.64
TOTAL IMPERVIOUS	226,072	84.76
GREEN SPACE	40,659	15.24
TOTAL AREA	266,731	100
PARKING		
STALL TYPE	NUMBER	
9X18 STALLS OFF-STREET	213	
ADA STALLS	7	
10X20 STALLS ON-STREET, FISHER LANE	31	
10X20 STALLS ON-STREET, RUTLAND DRIVE	14	
TOTAL PROVIDED	265	
TOTAL REQUIRED	257	
ZONING INFORMATION		
CURRENT ZONE:	CG COMMERCIAL	
DIMENSIONAL STANDARDS		
BUILDING SETBACKS		
FRONT YARD	15'	
INTERIOR SIDE YARD	0'	
STREET SIDE YARD	0'	
REAR YARD	10'	
SURVEY INFORMATION		
DATE OF SURVEY		
COORDINATE SYSTEM	NAD83 STATE PLANE SOUTH ZONE	
DRAWING UNITS	INTERNATIONAL FEET	
VERTICAL DATUM	NAVD 88	

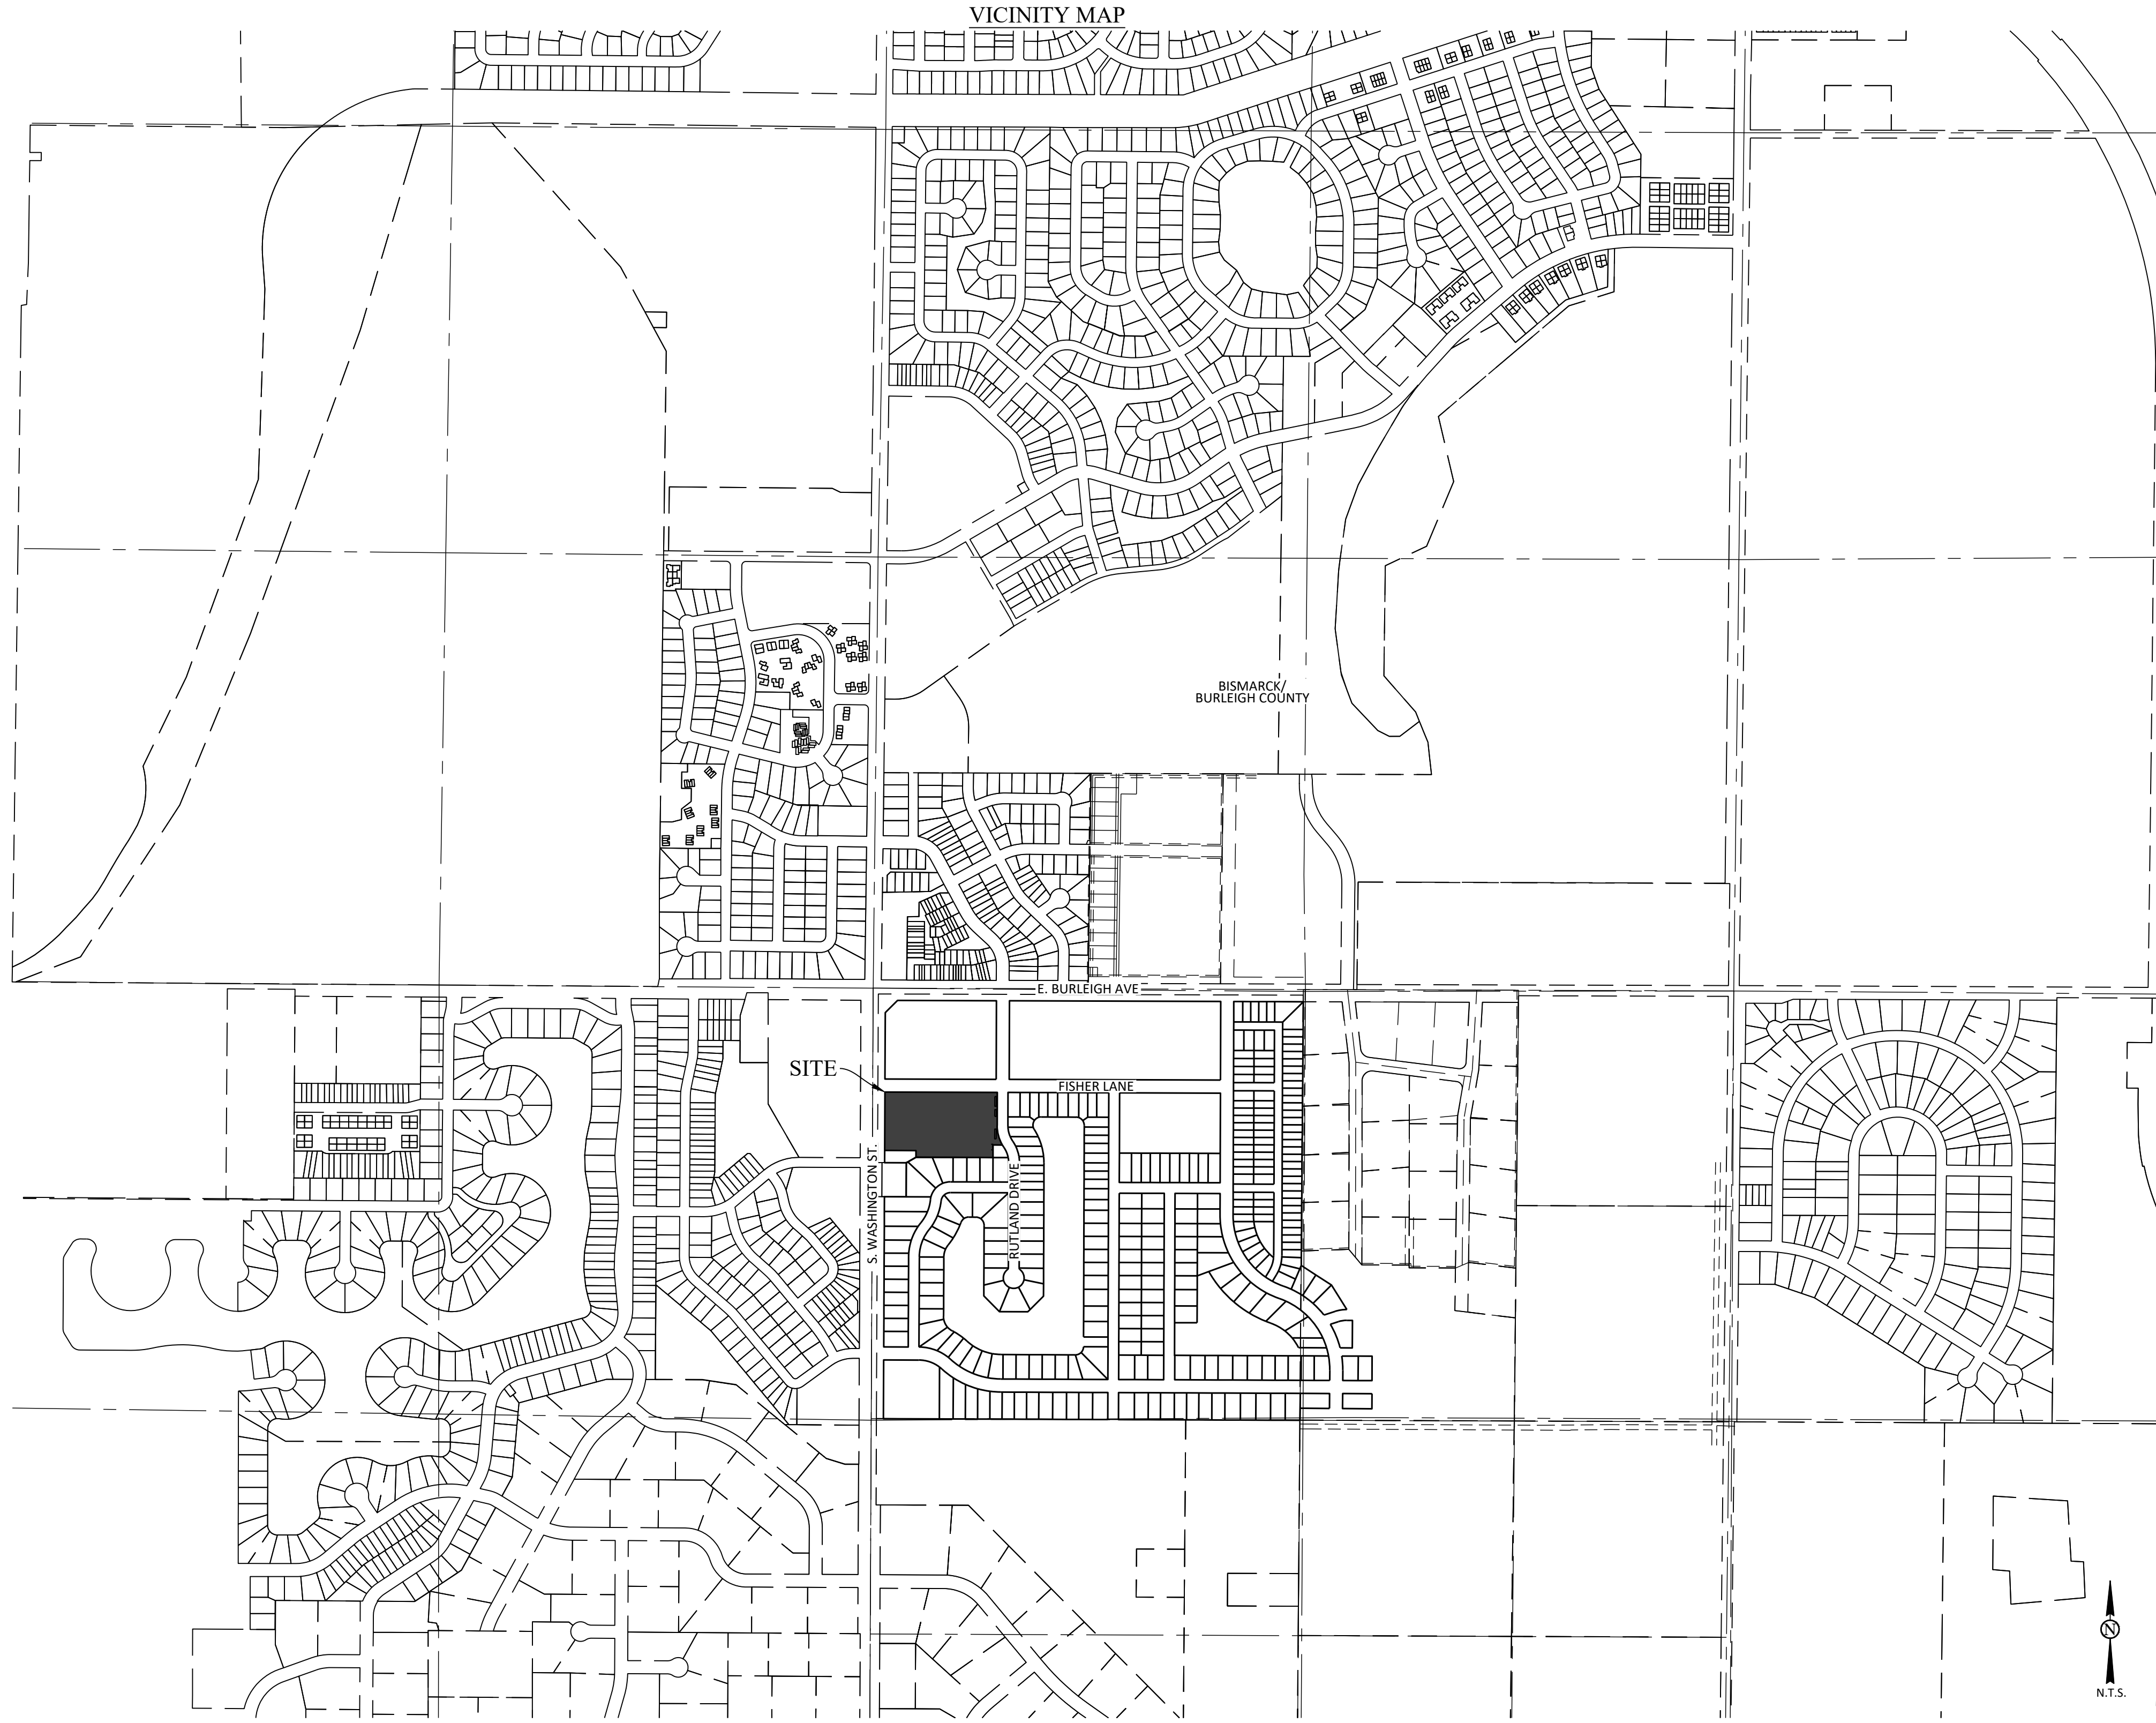


SHEET INDEX	
C-1	COVER SHEET
C-2	GENERAL NOTES & LEGEND
C-3	SURVEY OVERLAY & DEMOLITION PLAN
C-4	OVERALL SITE PLAN
C-5	UTILITY PLAN
C-6	GRADING PLAN
C-7	EROSION & SEDIMENT CONTROL PLAN
C-8	TYPICAL DETAILS
C-9	TYPICAL DETAILS
L-1	LANDSCAPE PLAN

BENCHMARK: TOP NUT OF HYDRANT LOCATED NEAR THE SOUTHEAST CORNER OF THE INTERSECTION OF SOUTH WASHINGTON STREET AND E. BURLEIGH AVE.
ELEV=1640.98 (NAVD 88)
*THIS HYDRANT WILL LIKELY BE DISTURBED DURING THE SOUTH WASHINGTON STREET PROJECT. CONTRACTOR SHALL COORDINATE WITH ENGINEER ON ALTERNATIVE BENCHMARK PRIOR TO STARTING CONSTRUCTION.

BASIS OF BEARING: ND STATE PLANE SOUTH ZONE NAD83 (33002) ADJUSTMENT 1986.

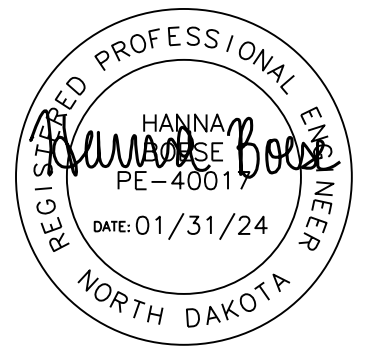


wild | crg
architecture | construction
200 2nd Avenue North | Suite 514
Fargo, North Dakota 58102
Phone 701 | 293 | 8106
wildcrg.com

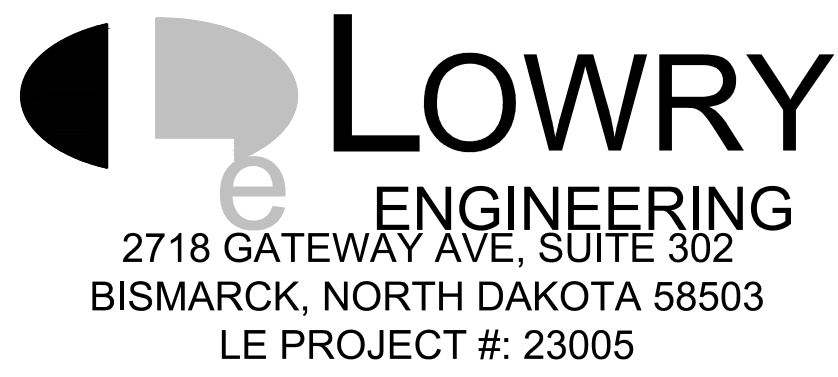

CALL BEFORE YOU DIG
NORTH DAKOTA
UTILITIES UNDERGROUND LOCATION SERVICE
1-800-795-0555


© Copyright 2024 WILDCRG, L.L.C.
Date: 01/09/2024
Project Number: 2344
Drawn By: PWB
Checked By: AJT
Approved By: HJB
Sheet
C-1

 - REMOVAL AREAS

DEMOLITION CALLOUTS		
ITEM	QUANTITY	UNIT
SAW CUT & REMOVE EX. CURB & GUTTER	90	LF
PATCH EX. CURB & GUTTER AND ASPHALT PAVEMENT	1	LS

NOTE:

1. CONTRACTOR SHALL DETERMINE HOW BIG REMOVAL / PATCHING AREA NEEDS TO BE FOR CONNECTION OF THE NEW 30" STORM SEWER TO THE EXISTING INLET IN RUTLAND DRIVE. AREA SHOWN ON PLANS IS FOR GENERAL LOCATION PURPOSES ONLY AND MAY NOT REPRESENT THE SIZE OF THE ACTUAL PATCH. PATCH ITEM SHALL INCLUDE CURB & GUTTER AND ASPHALT PAVEMENT REMOVAL, AS WELL AS GRAVEL, FABRIC, AND ASPHALT PAVEMENT REPLACEMENT.


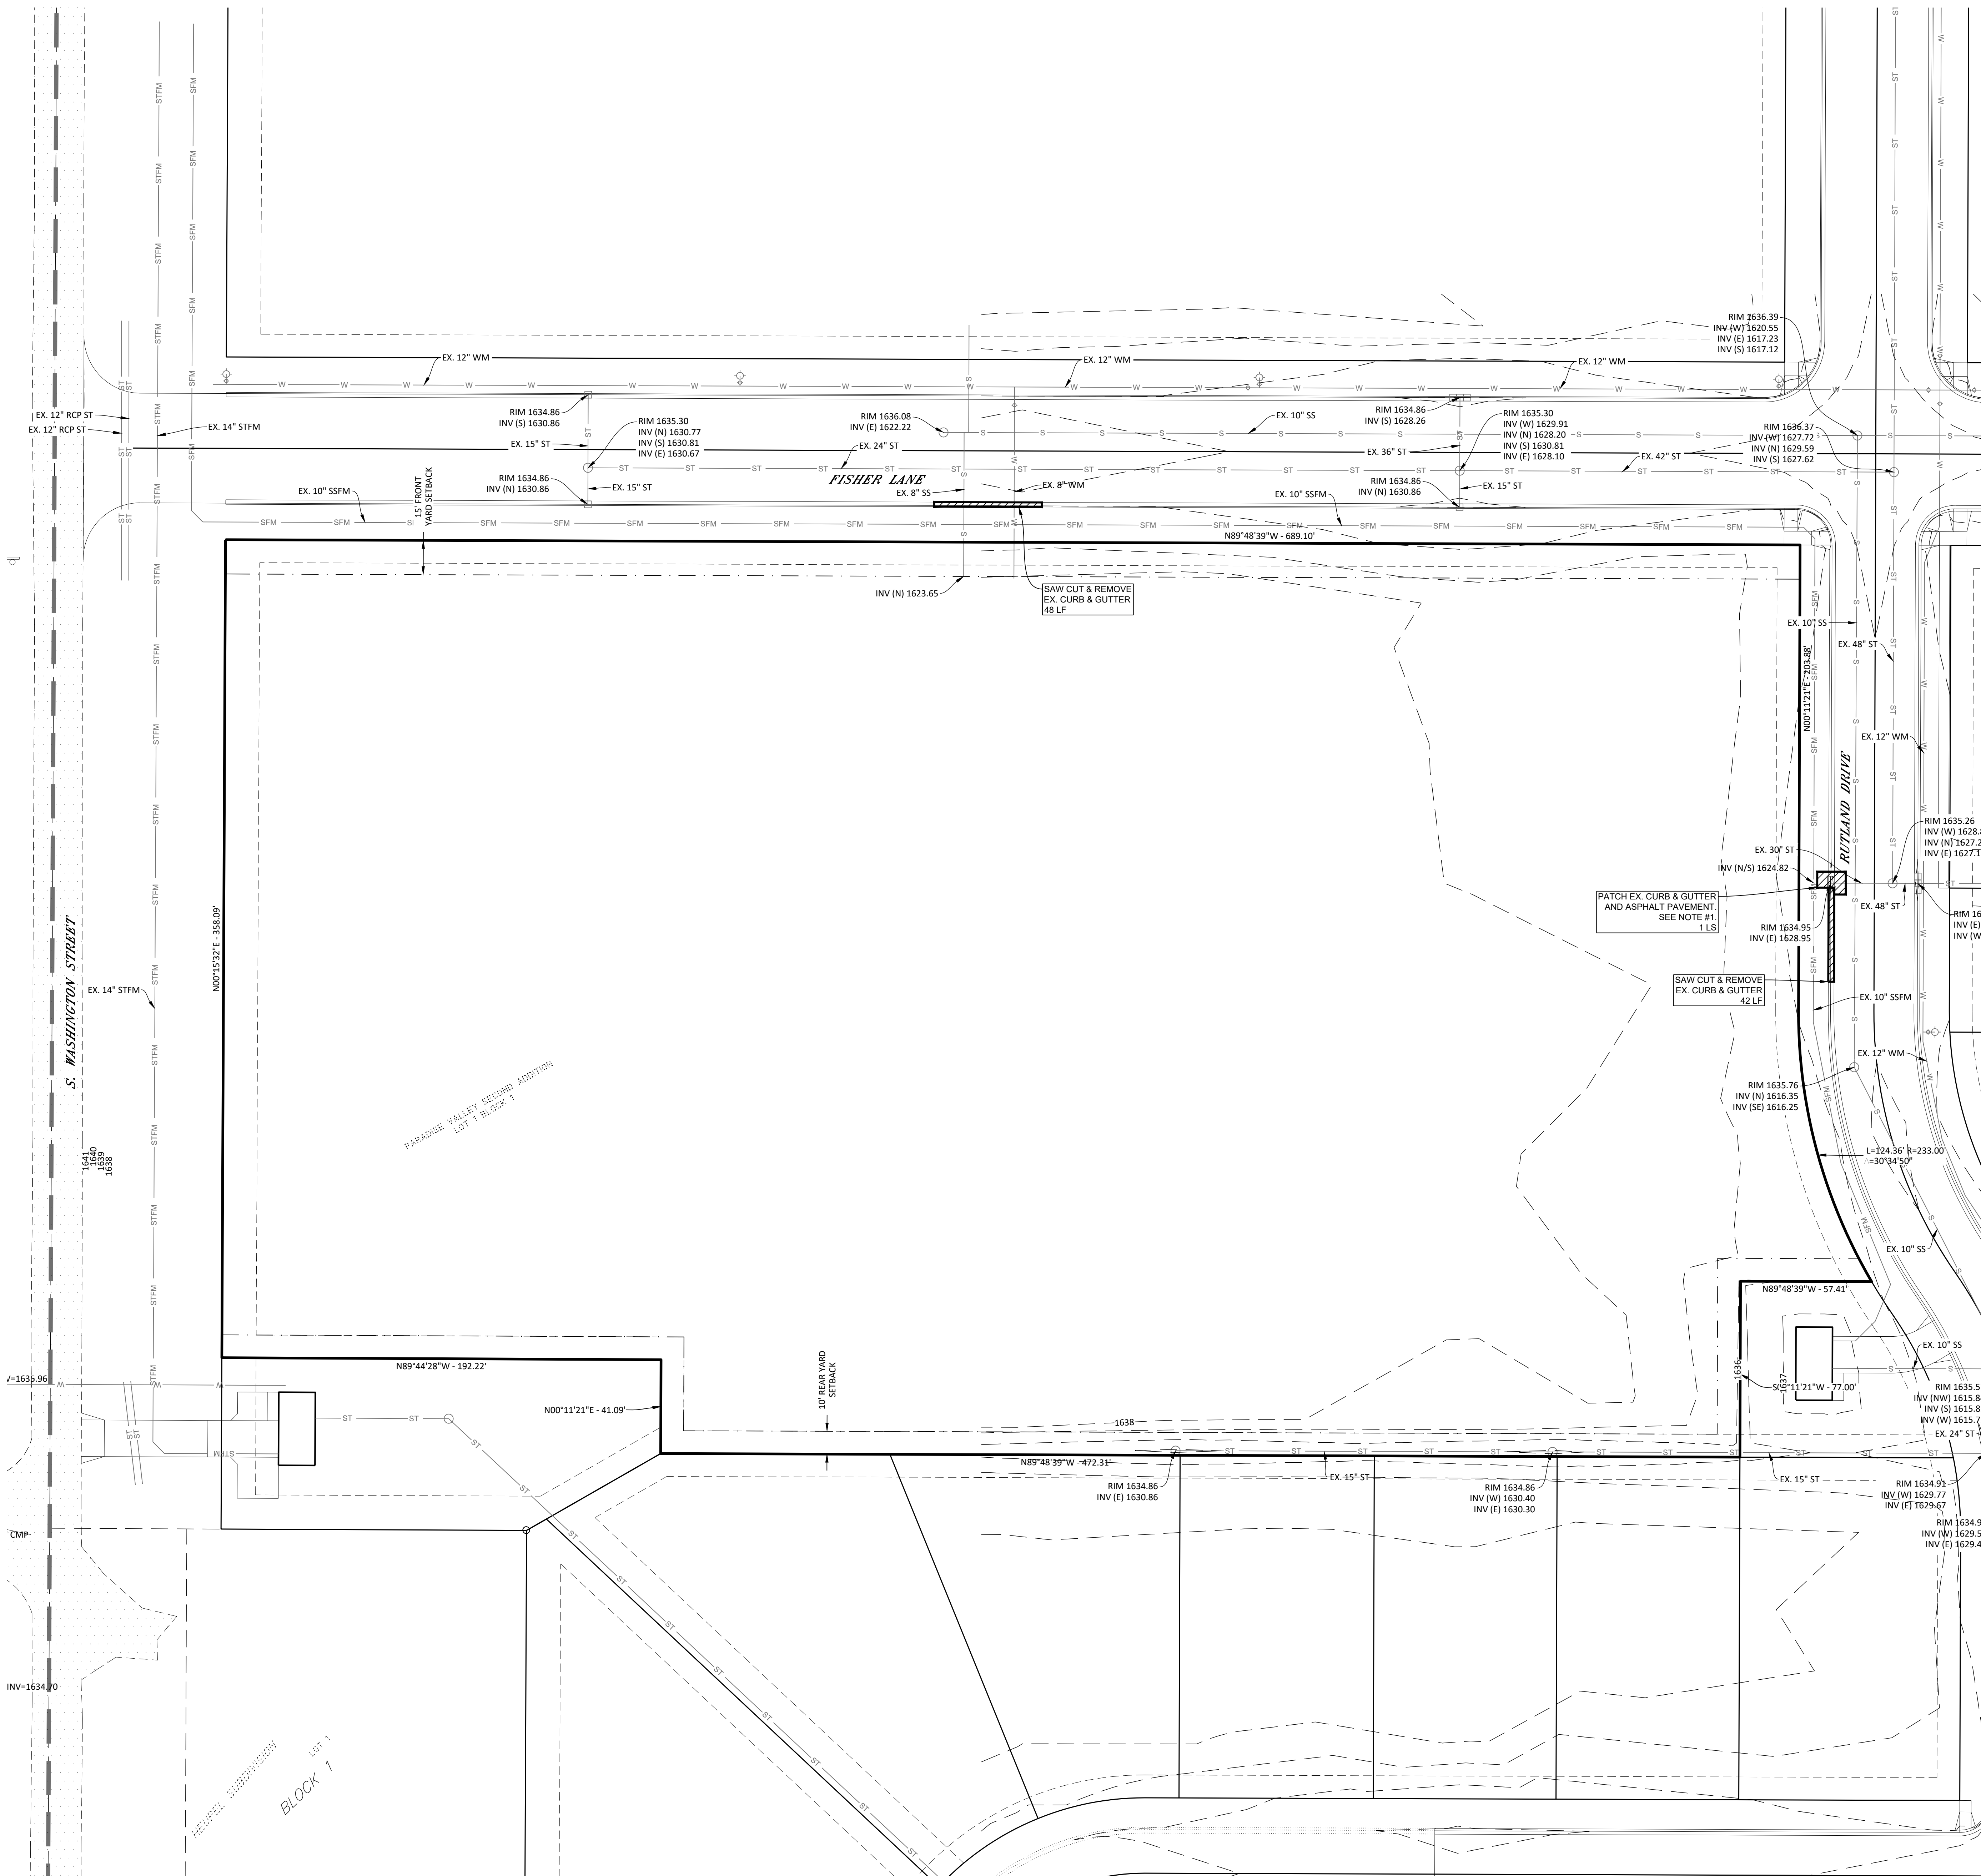


PATCH EX. CURB & GUTTER AND ASPHALT PAVEMENT SEE NOTE #1 1 LS

SAW CUT & REMOVE EX. CURB & GUTTER 42 LF

SAW CUT & REMOVE EX. CURB & GUTTER 48 LF

BENCHMARK: TOP NUT OF HYDRANT LOCATED NEAR THE SOUTHEAST CORNER OF THE INTERSECTION OF SOUTH WASHINGTON STREET AND E. BURLEIGH AVE. ELEV=1640.98 (NAVD 88)
 *THIS HYDRANT WILL LIKELY BE DISTURBED DURING THE SOUTH WASHINGTON STREET PROJECT. CONTRACTOR SHALL COORDINATE WITH ENGINEER ON ALTERNATIVE BENCHMARK PRIOR TO STARTING CONSTRUCTION.
 BASIS OF BEARING: ND STATE PLANE SOUTH ZONE NAD83 (3302) ADJUSTMENT 1986.

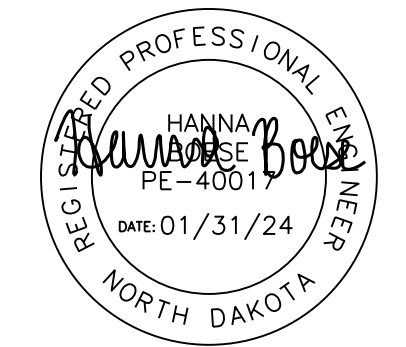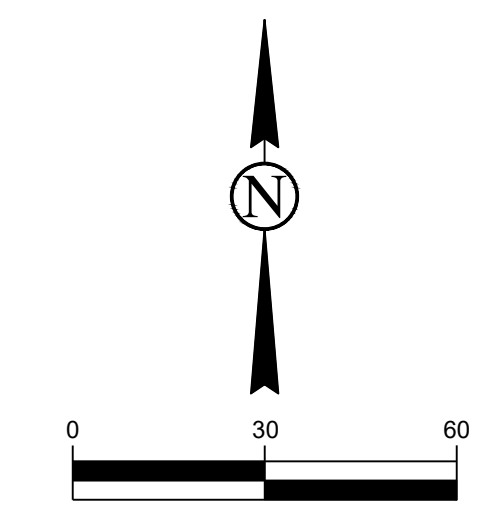

wild|crg
 architecture | construction
 200 2nd Avenue North | Suite 514
 Fargo, North Dakota 58102
 Phone 701 | 293 | 8106
 wildcrg.com

SURVEY OVERLAY
 DEMOLITION PLAN



© Copyright 2024 W|C|RG, Ltd.

Date:	01/09/2024	Sheet
Project Number:	2344	C-3
Drawn By:	PWB	
Checked By:	AJT	
Approved By:	HJB	


CALL BEFORE YOU DIG
 NORTH DAKOTA
 UTILITIES UNDERGROUND LOCATION SERVICE
 1-800-795-0555

ESTIMATED SITE QUANTITIES		
ITEM	QUANTITY	UNIT
CONCRETE FLATWORK - 4"	596	SY
CONCRETE FLATWORK - 6"	14,572	SY
CONCRETE FLATWORK - 8"	325	SY
SUBGRADE PREPARATION	15,123	SY
NDDOT GEOSYNTHETIC FARBRRIC TYPE R1	15,123	SY
NDDOT CLASS 5 OR CRUSHED CONCRETE	2,521	CY
PAVEMENT MARKING - PAINTED 4" LINE	8,131	LF
PAVEMENT MARKING - ADA SYMBOL	7	EA
ADA PARKING SIGN	7	EA
BOLLARD	16	EA
PARKING BUMPER	3	EA
6" COMPOSITE FENCE FOR DUMPSTER ENCLOSURE	1	LS

- NOTES:
- DUE TO AN ADJACENT CONSTRUCTION PROJECT ON FISHER LANE AND RUTLAND DRIVE, CONTRACTOR SHALL CONSTRUCT TEMPORARY CONSTRUCTION ACCESS CENTERED ON MIDDLE OF SITE TO SOUTH WASHINGTON STREET. CONTRACTOR SHALL NOT ACCESS SITE FROM FISHER LANE OR RUTLAND DRIVE UNLESS GIVEN PERMISSION BY OWNER AND CITY. TEMPORARY ACCESS SHALL BE GRAVEL SURFACING AND SHALL INCLUDE A TEMPORARY CULVERT TO ALLOW FOR CONVEYANCE OF STORMWATER IN THE DITCHES ON THE EAST SIDE OF SOUTH WASHINGTON STREET. AT THE COMPLETION OF CONSTRUCTION, CONTRACTOR SHALL REMOVE THE TEMPORARY CONSTRUCTION ACCESS AND RESTORE THE AREA TO ITS ORIGINAL CONDITION.
 - CONTRACTOR SHALL DETERMINE HOW BIG REMOVAL / PATCHING AREA NEEDS TO BE FOR CONNECTION OF THE NEW 30" STORM SEWER TO THE EXISTING INLET IN RUTLAND DRIVE. AREA SHOWN ON PLANS IS FOR GENERAL LOCATION PURPOSES ONLY AND MAY NOT REPRESENT THE SIZE OF THE ACTUAL PATCH. PATCH ITEM SHALL INCLUDE CURB & GUTTER AND ASPHALT PAVEMENT REMOVAL, AS WELL AS GRAVEL, FABRIC, AND ASPHALT PAVEMENT REPLACEMENT.

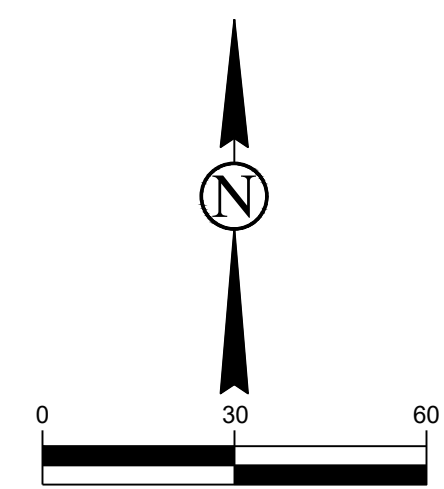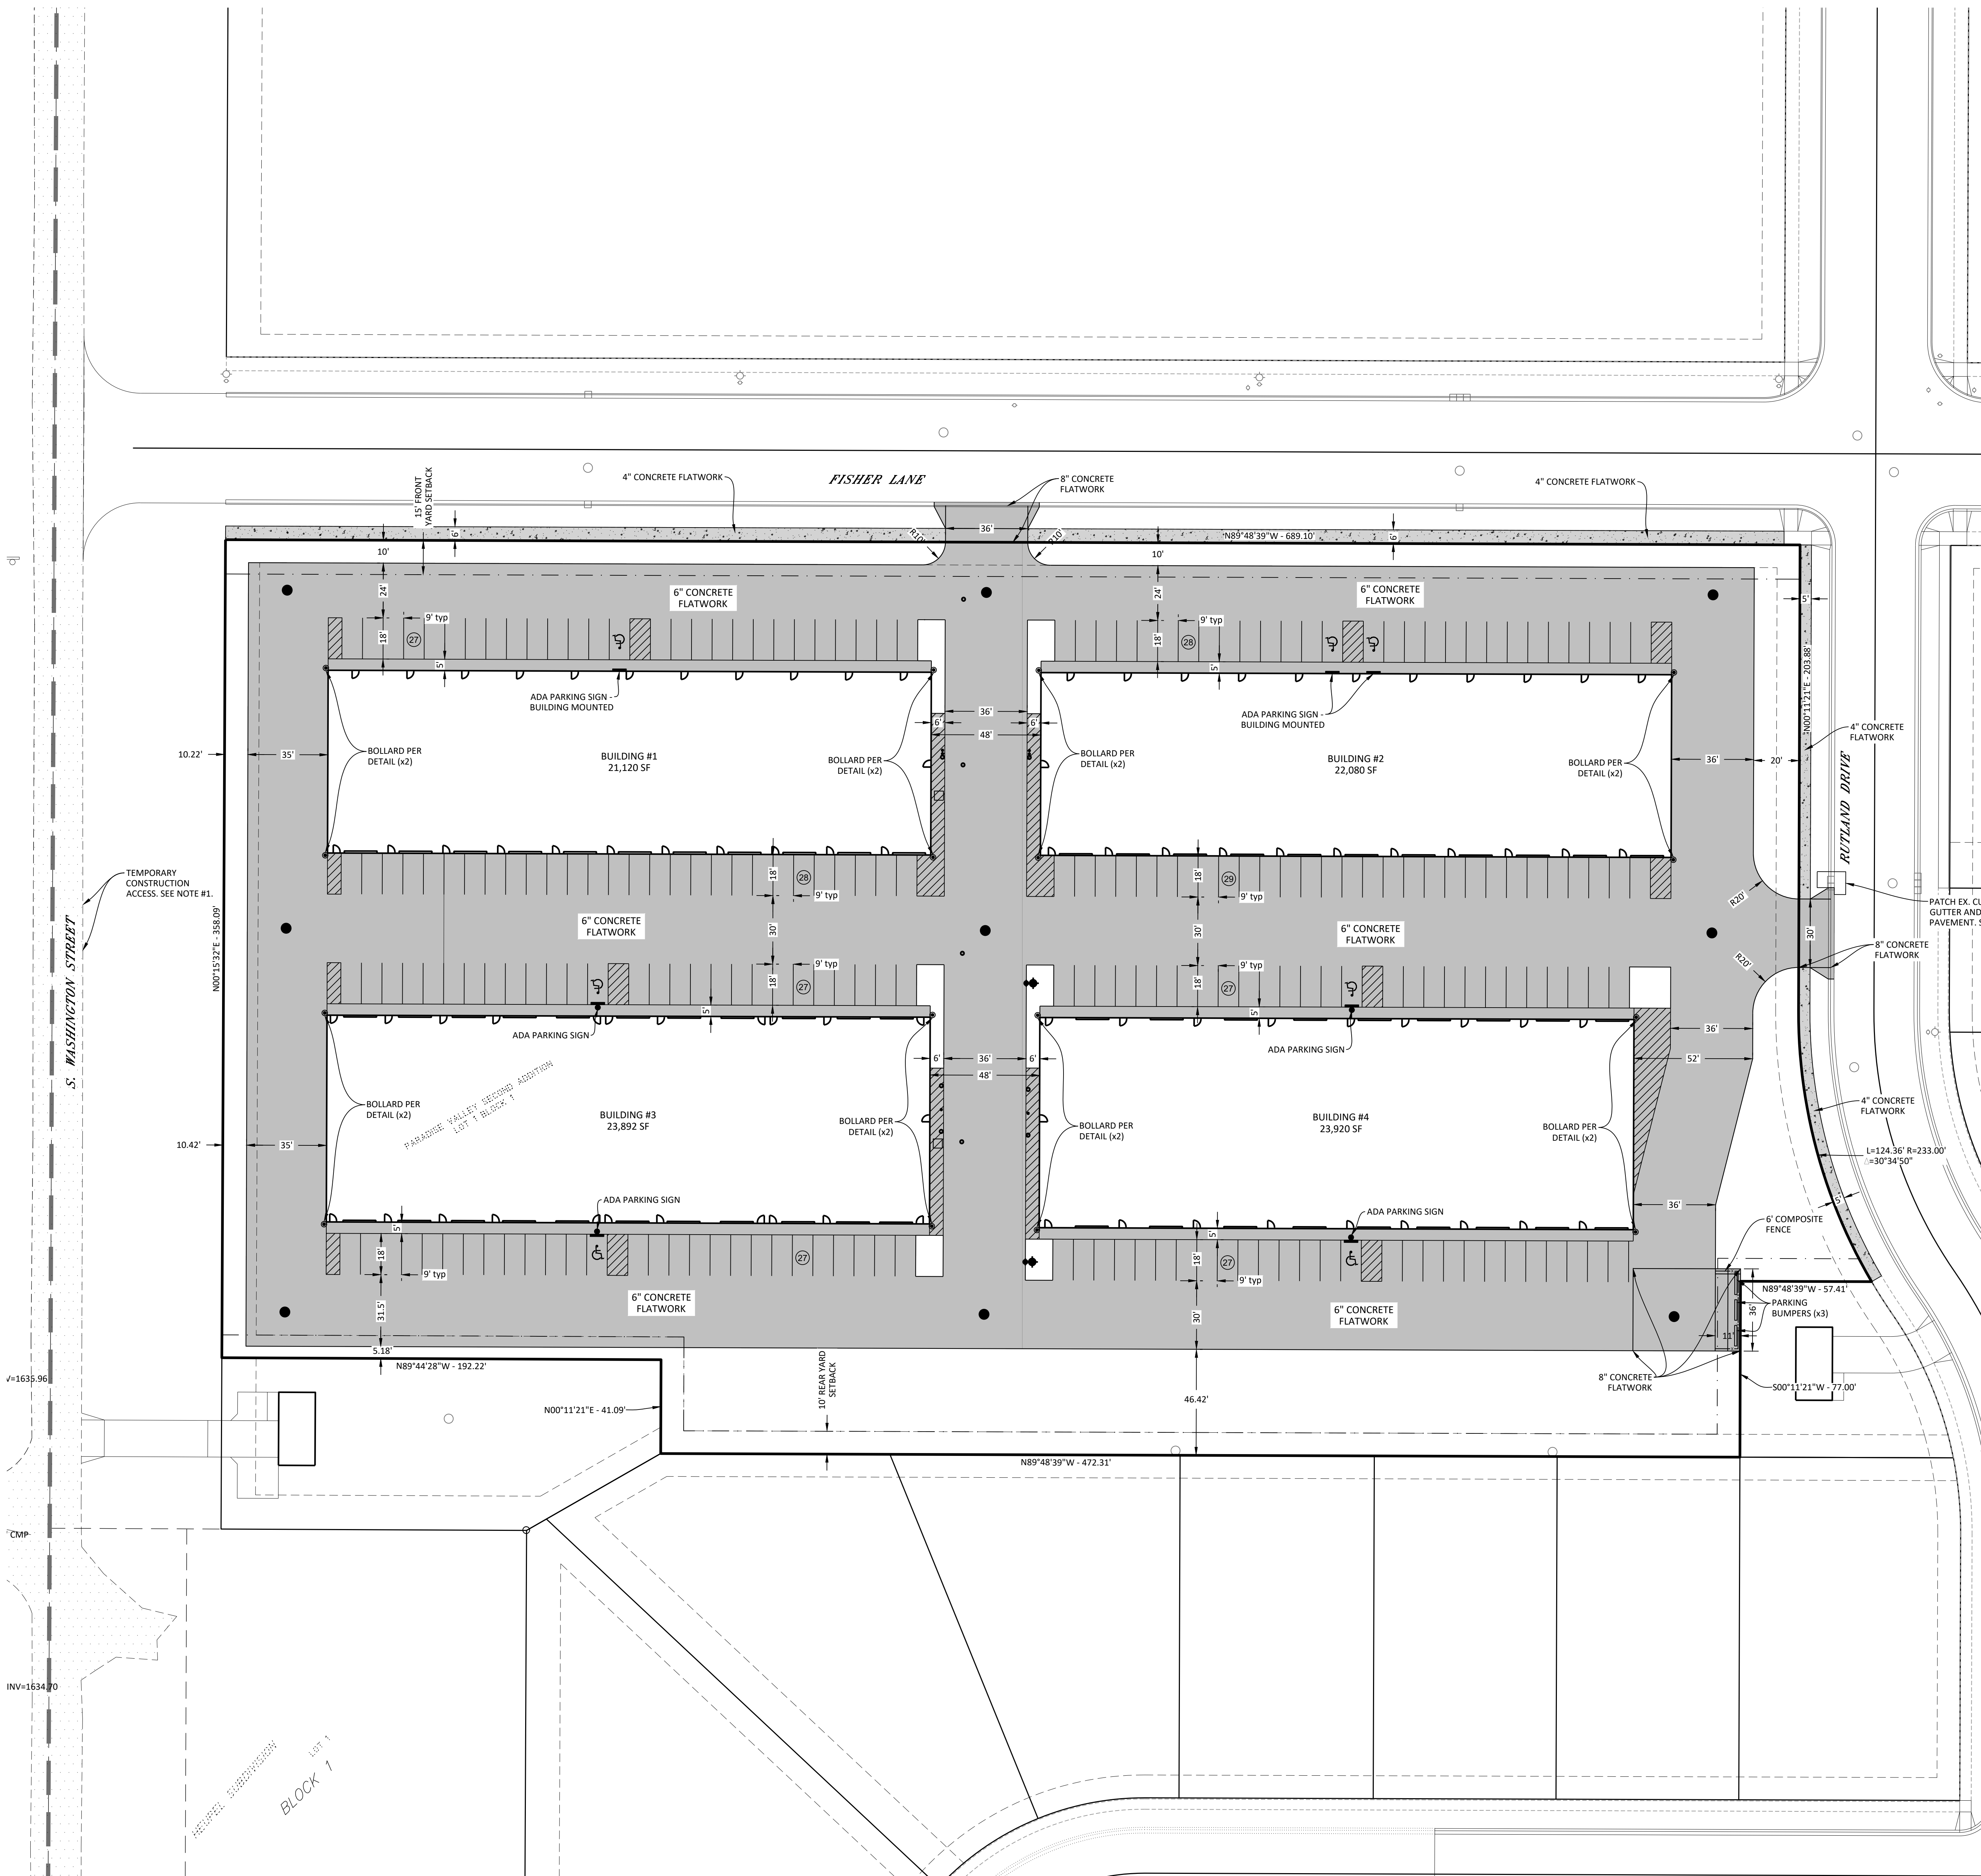

CALL BEFORE YOU DIG
NORTH DAKOTA
UTILITIES UNDERGROUND LOCATION SERVICE
1-800-795-0555

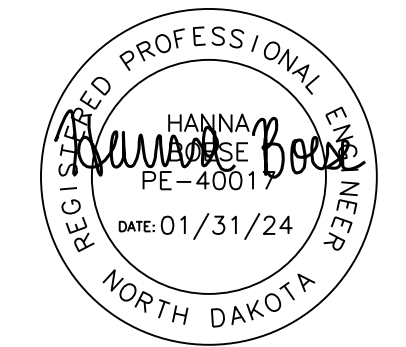

wild | crg
architecture | construction


200 2nd Avenue North | Suite 514
Fargo, North Dakota 58102
Phone 701 | 293 | 8106
wildcrg.com

OVERALL
SITE
PLAN

© Copyright 2024 WILDCRG, Ltd.

Date:	01/09/2024	Sheet
Project Number:	2344	
Drawn By:	PWB	
Checked By:	AJT	
Approved By:	HJB	

C-4

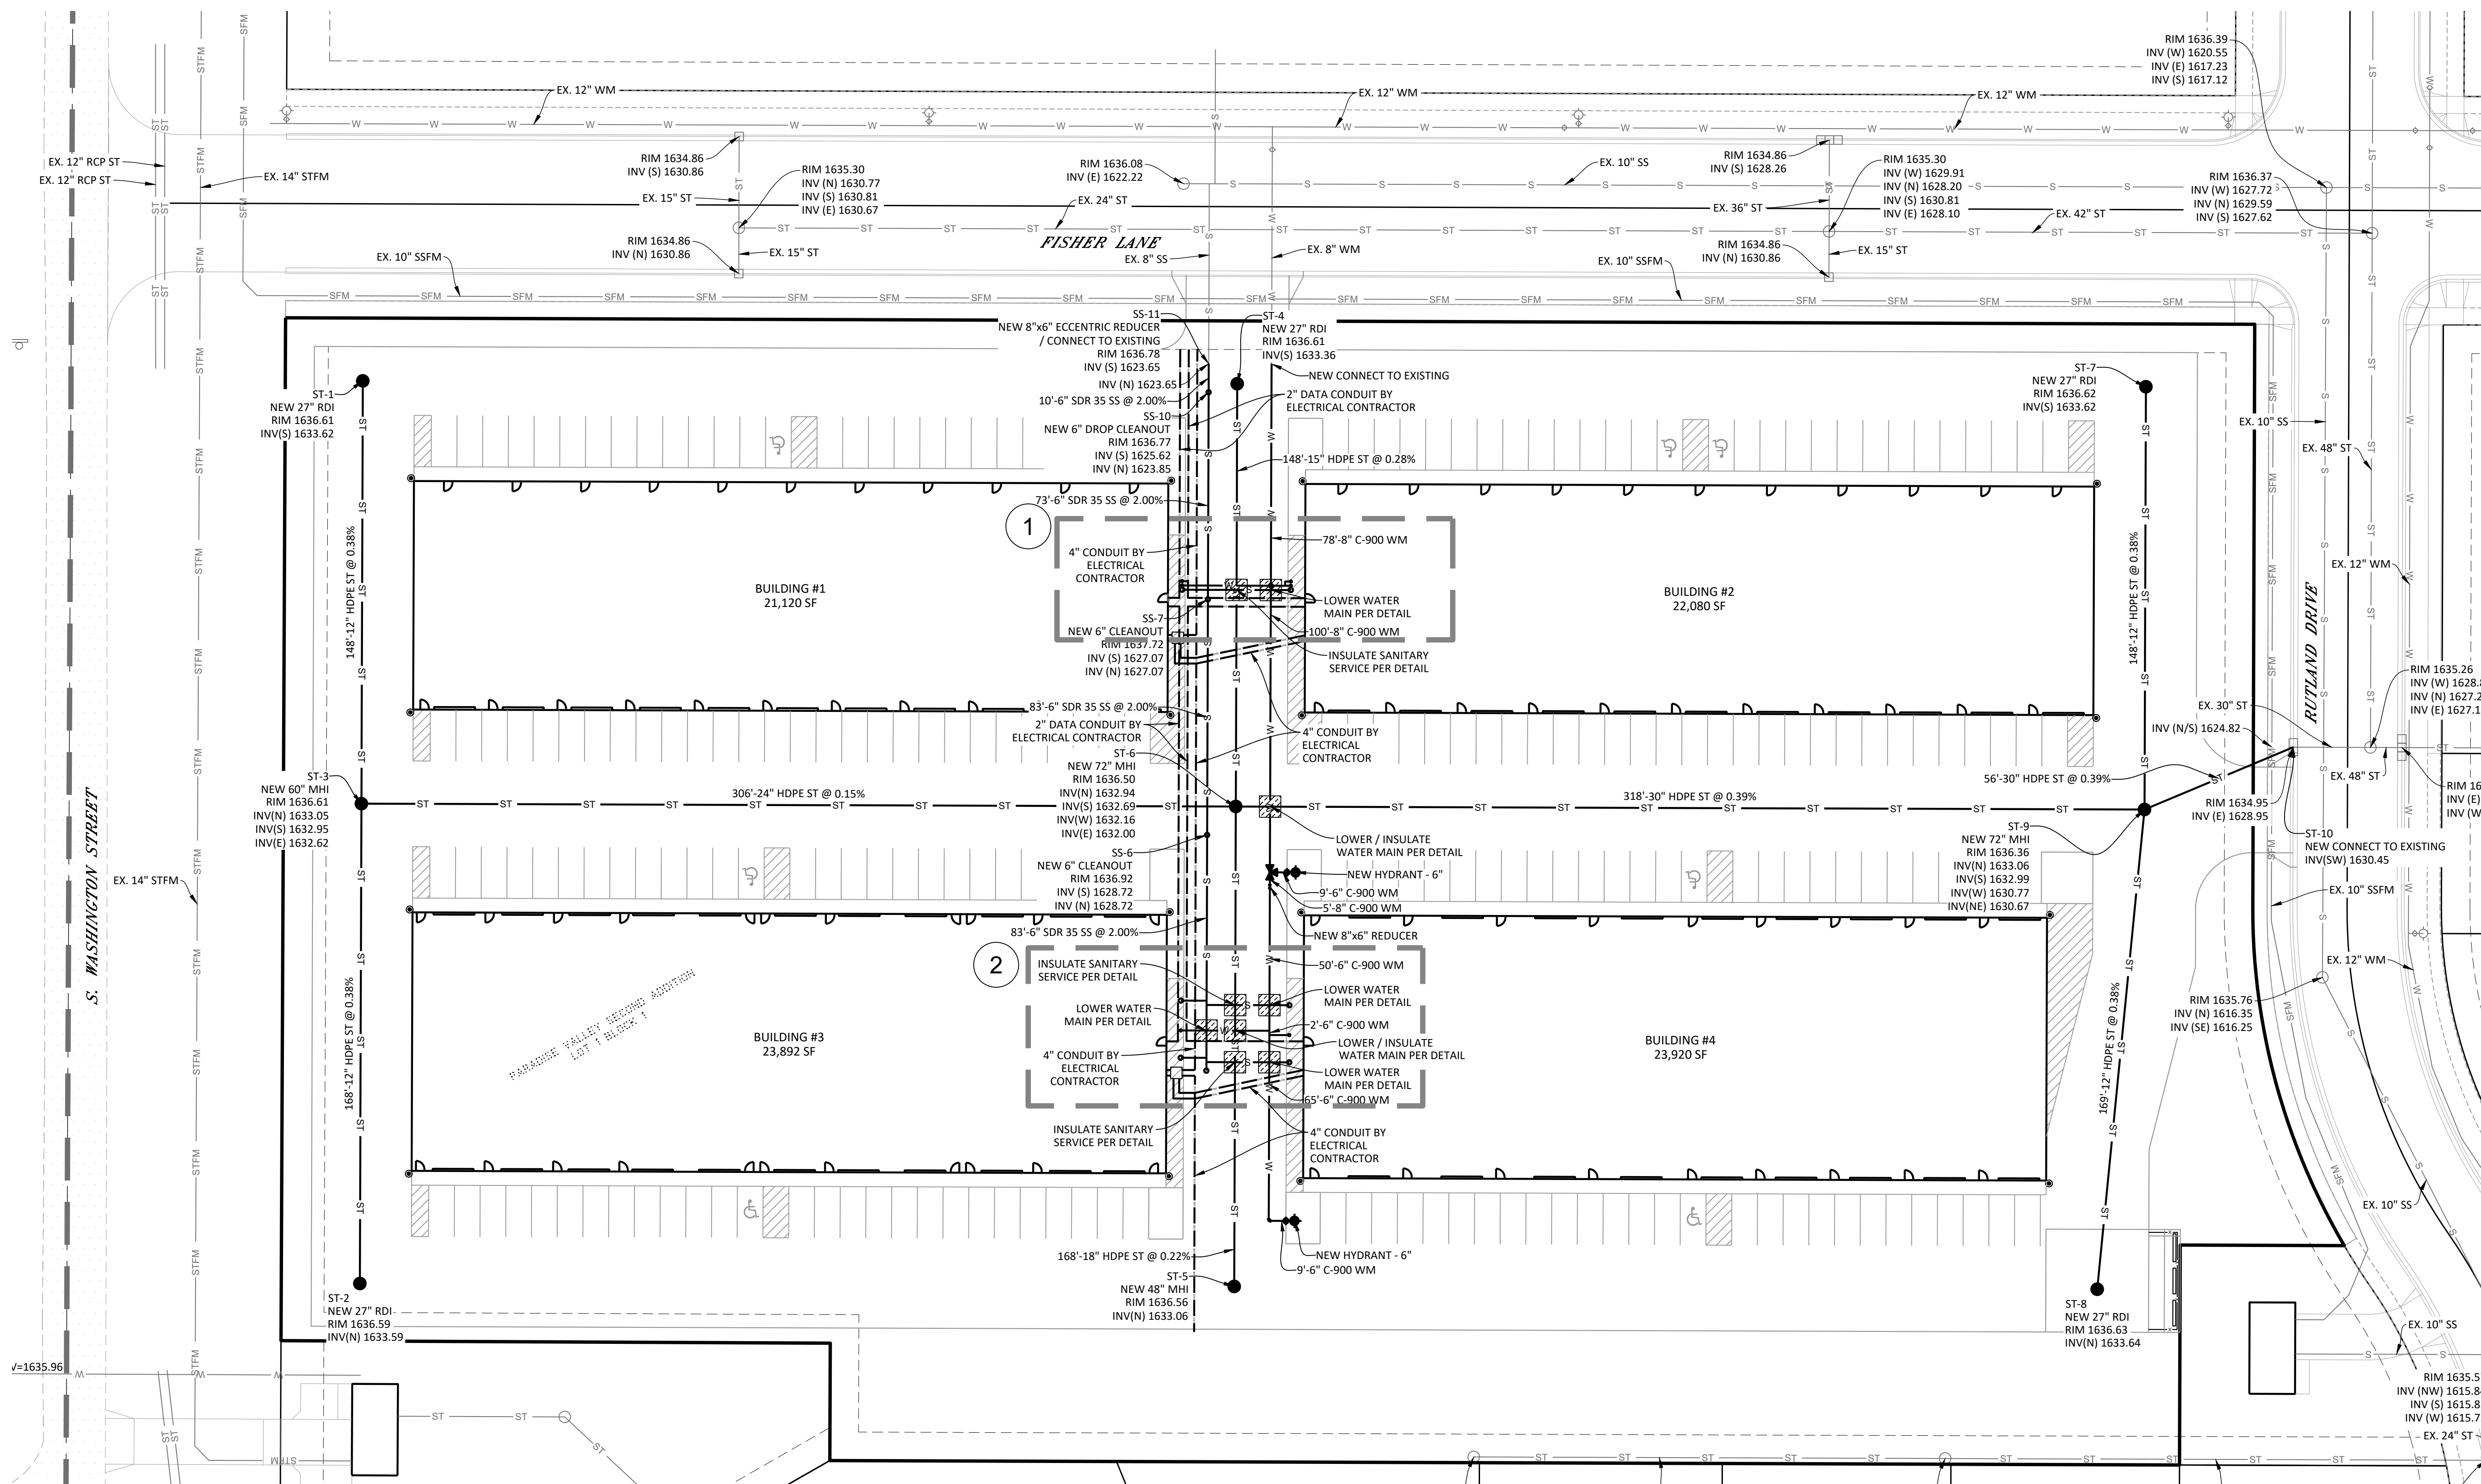


ESTIMATED WATER QUANTITIES		
ITEM	QUANTITY	UNIT
2" POLY CLASS 200 WS	45	LF
4" C-900 WM	38	LF
6" C-900 WM	135	LF
8" C-900 WM	183	LF
2" CURB STOP	4	EA
4" GATE VALVE	2	EA
6" GATE VALVE	2	EA
HYDRANT - 6"	2	EA
CONNECT TO EXISTING	1	EA

ESTIMATED SANITARY QUANTITIES		
ITEM	QUANTITY	UNIT
4" SCHD 40 SS	114	LF
6" SDR 35 SS	248	LF
4" CLEANOUT	6	EA
6" CLEANOUT	3	EA
6" DROP CLEANOUT	1	EA
8"x6" ECCENTRIC REDUCER / CONNECT TO EXISTING	1	EA


ESTIMATED STORM QUANTITIES		
ITEM	QUANTITY	UNIT
12" HDPE ST	633	LF
15" HDPE ST	148	LF
18" HDPE ST	168	LF
24" HDPE ST	306	LF
30" HDPE ST	374	LF
27" RDI	5	EA
48" MANHOLE INLET	1	EA
60" MANHOLE INLET	1	EA
72" MANHOLE INLET	2	EA
CONNECT TO EXISTING	1	EA

- INSULATE SANITARY SERVICE PER DETAIL
 - LOWER / INSULATE WATER MAIN PER DETAIL



- NOTES:
- ALL EXISTING SANITARY, WATER, AND STORM UTILITIES ARE DRAWN PER THE ORIGINAL DESIGN FILE. CONTRACTOR SHALL FIELD VERIFY DEPTH AND LOCATION OF ALL EXISTING UTILITIES.
 - THE WATER SERVICE, SANITARY SERVICE, AND STORM SEWER CONNECTIONS TO EXISTING SHALL NOT BE MADE UNTIL CONSTRUCTION OF CITY UTILITIES IN FISHER LANE AND RUTLAND DRIVE IS COMPLETE.
 - ALL STORM RDIS AND MANHOLES SHALL UTILIZE AN EIJM 1205 CASTING WITH A TYPE M FLAT GRATE OR APPROVED EQUAL.

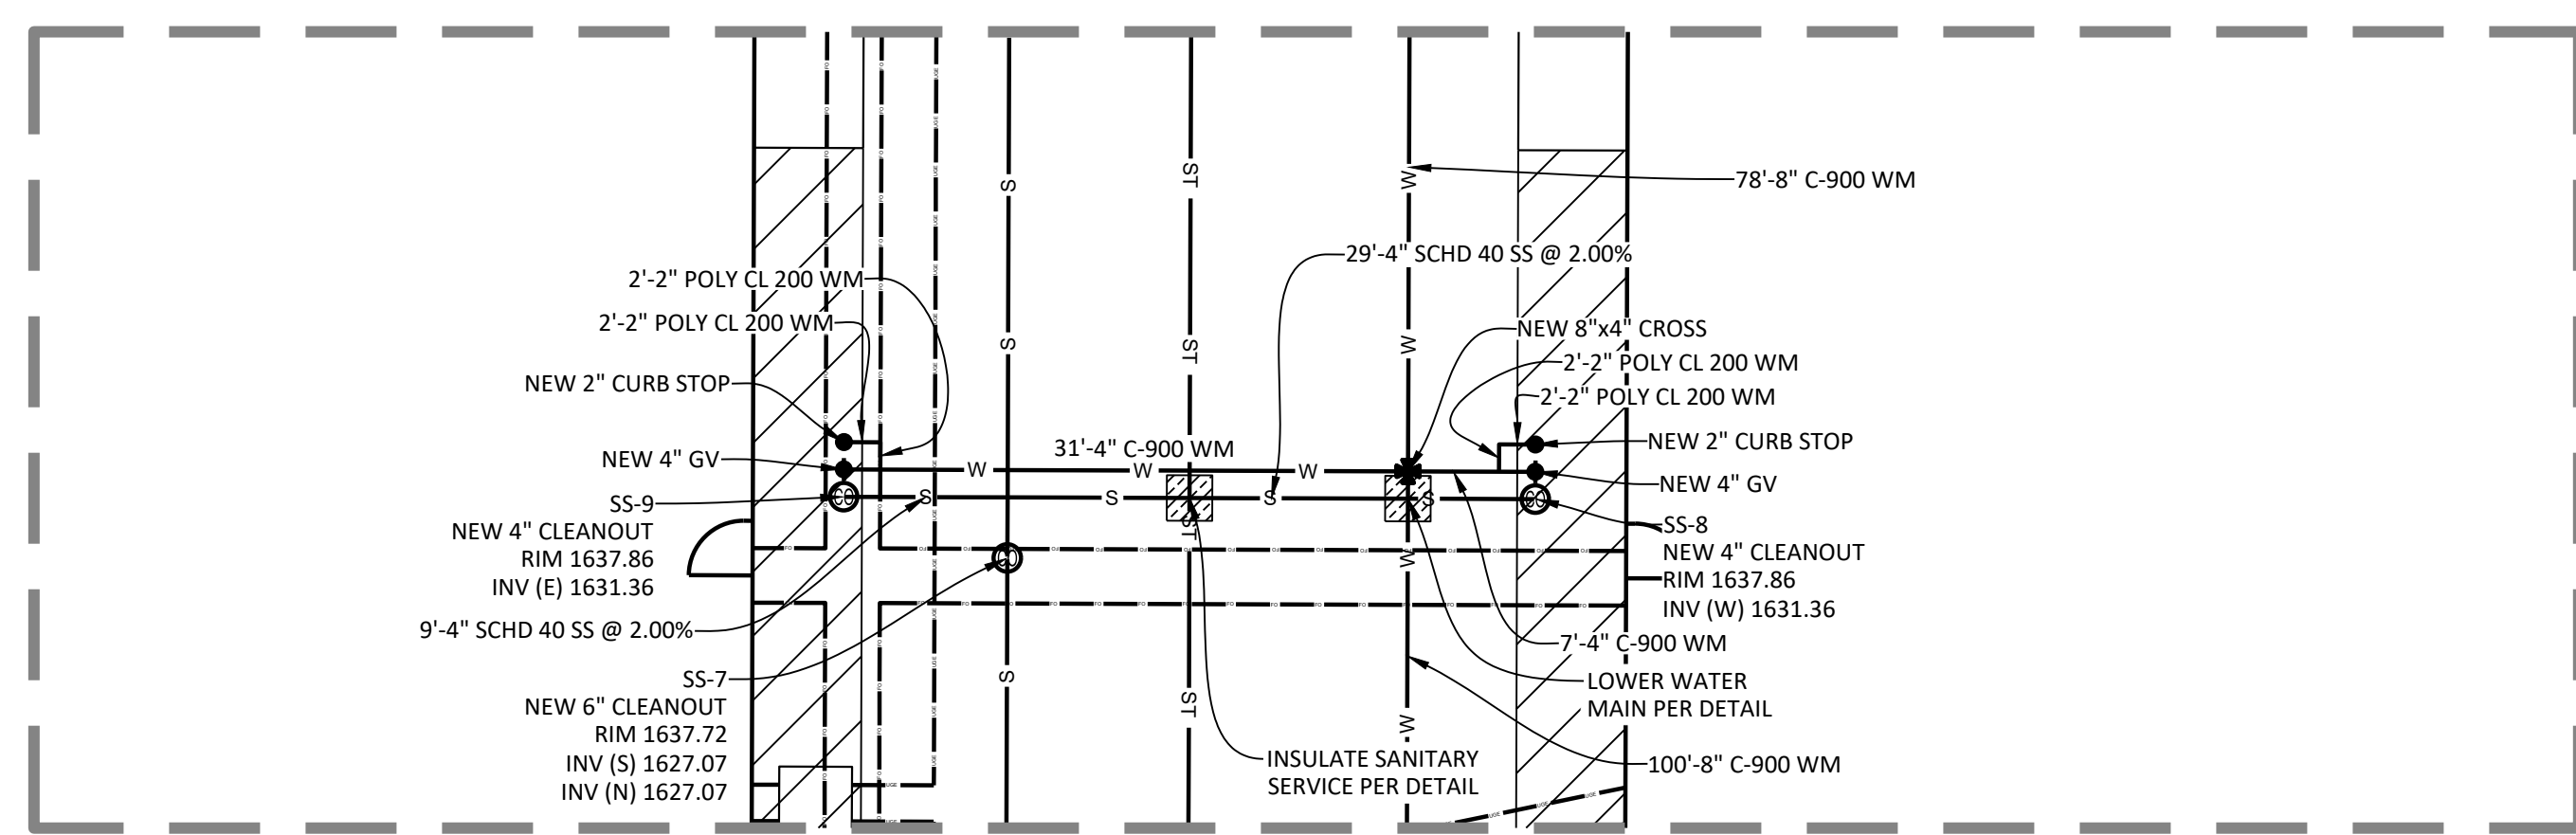

BUILDING # 1 & 2
SERVICE CONNECTIONS DETAIL
1"=10'

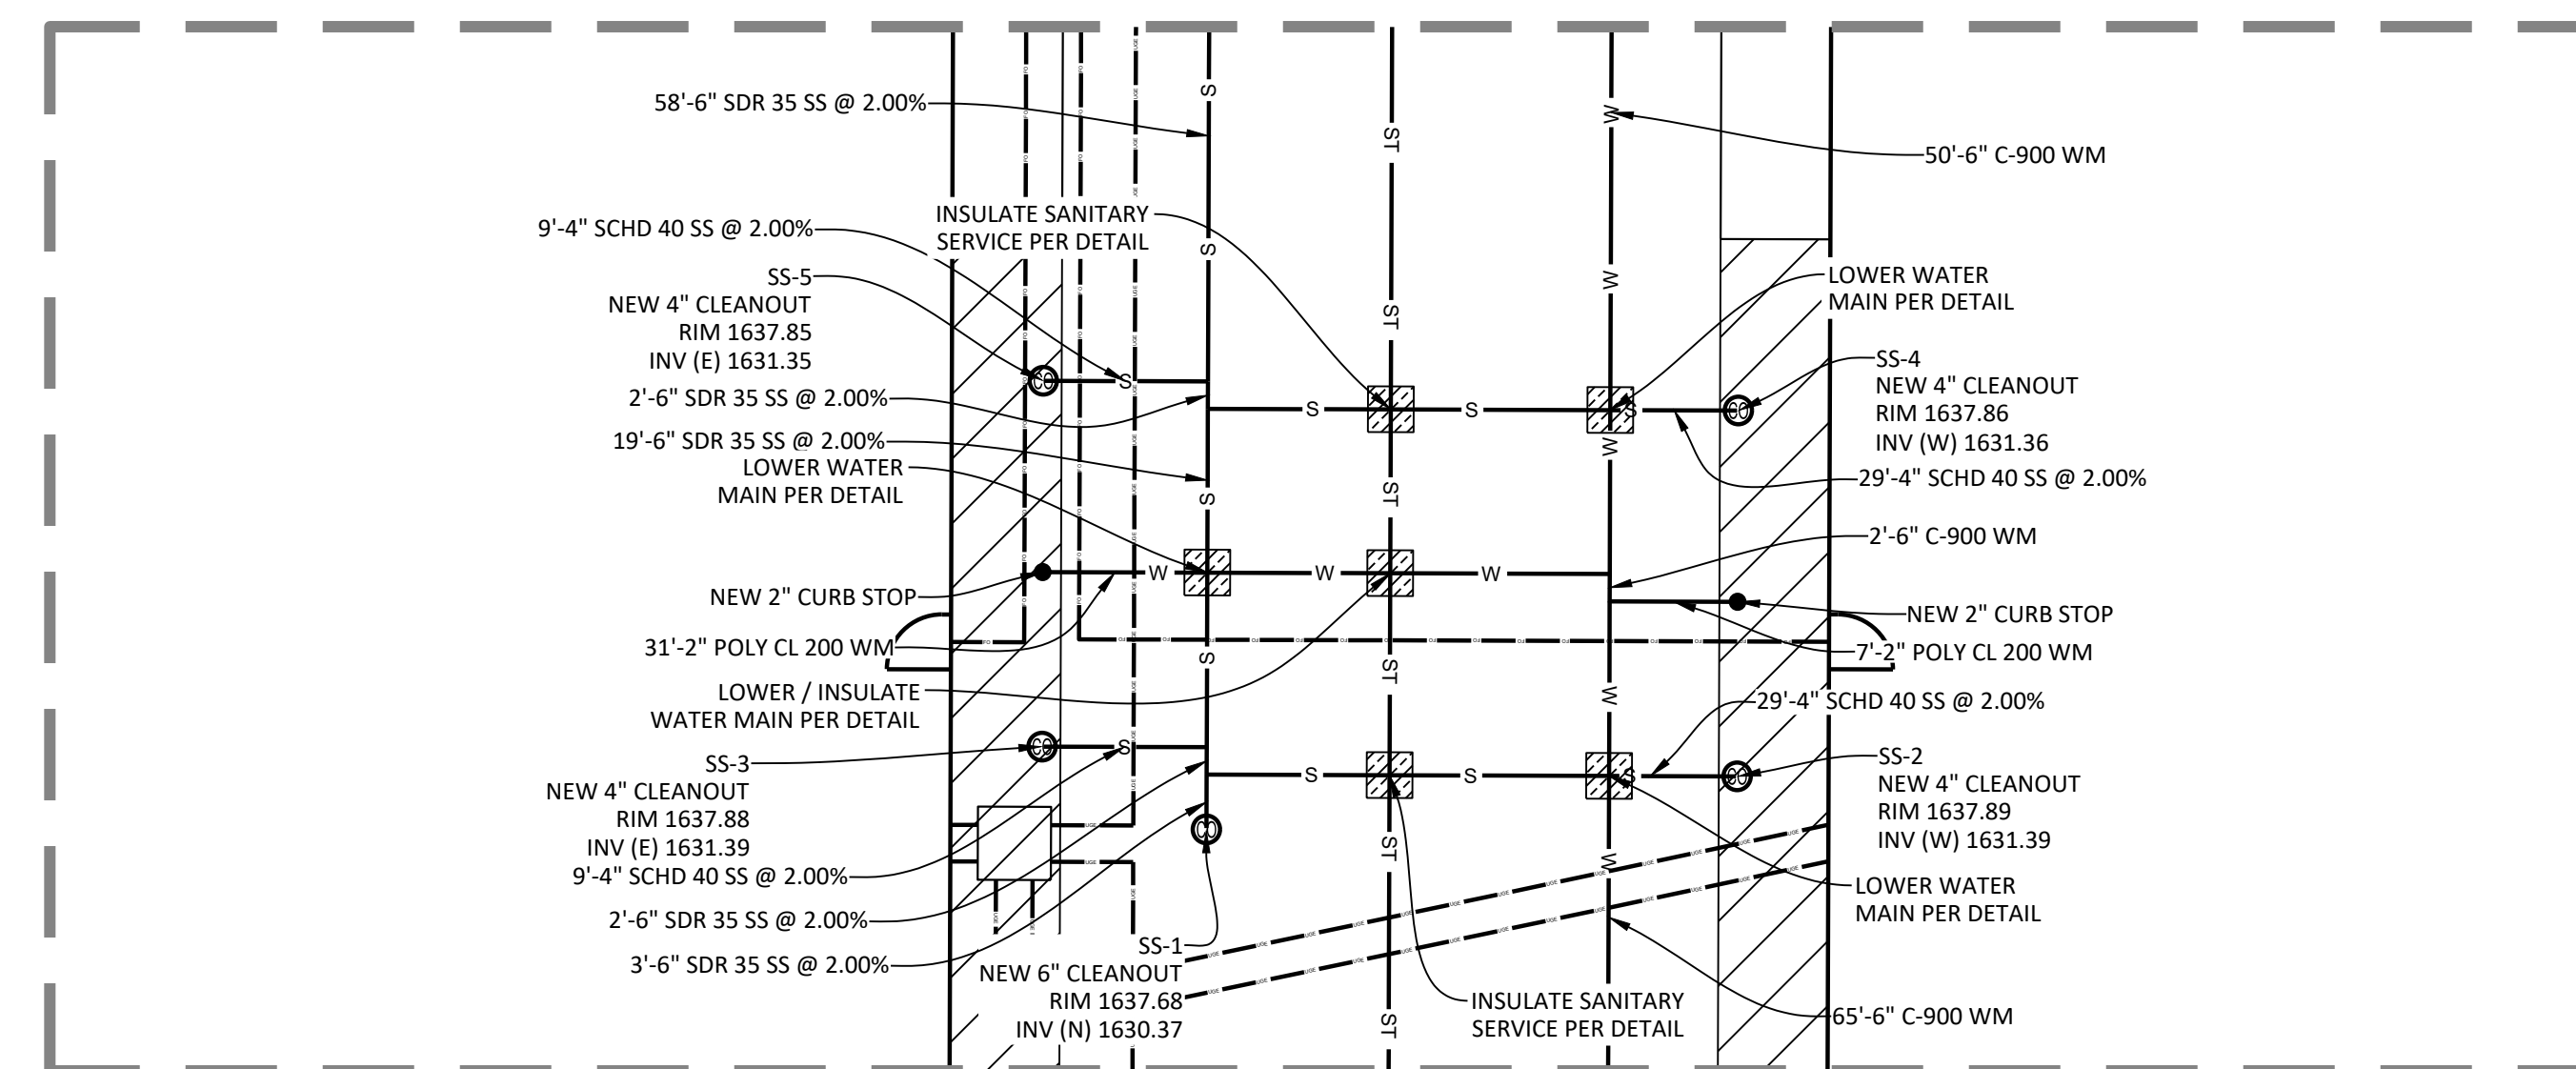


BUILDING # 3 & 4
SERVICE CONNECTIONS DETAIL
1"=10'

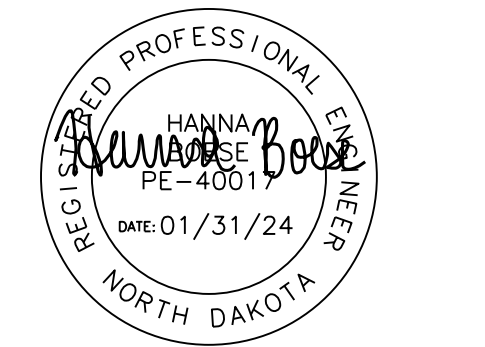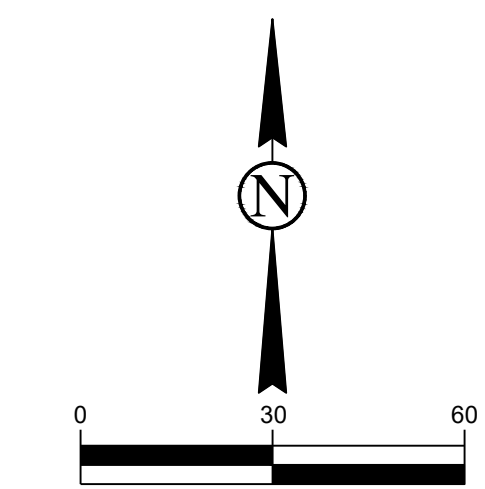

wild|crg
architecture | construction
200 2nd Avenue North | Suite 514
Fargo, North Dakota 58102
Phone 701 | 293 | 8106
wildcrg.com


UTILITY PLAN

CALL BEFORE YOU DIG
NORTH DAKOTA
UTILITIES UNDERGROUND LOCATION SERVICE
1-800-795-0555

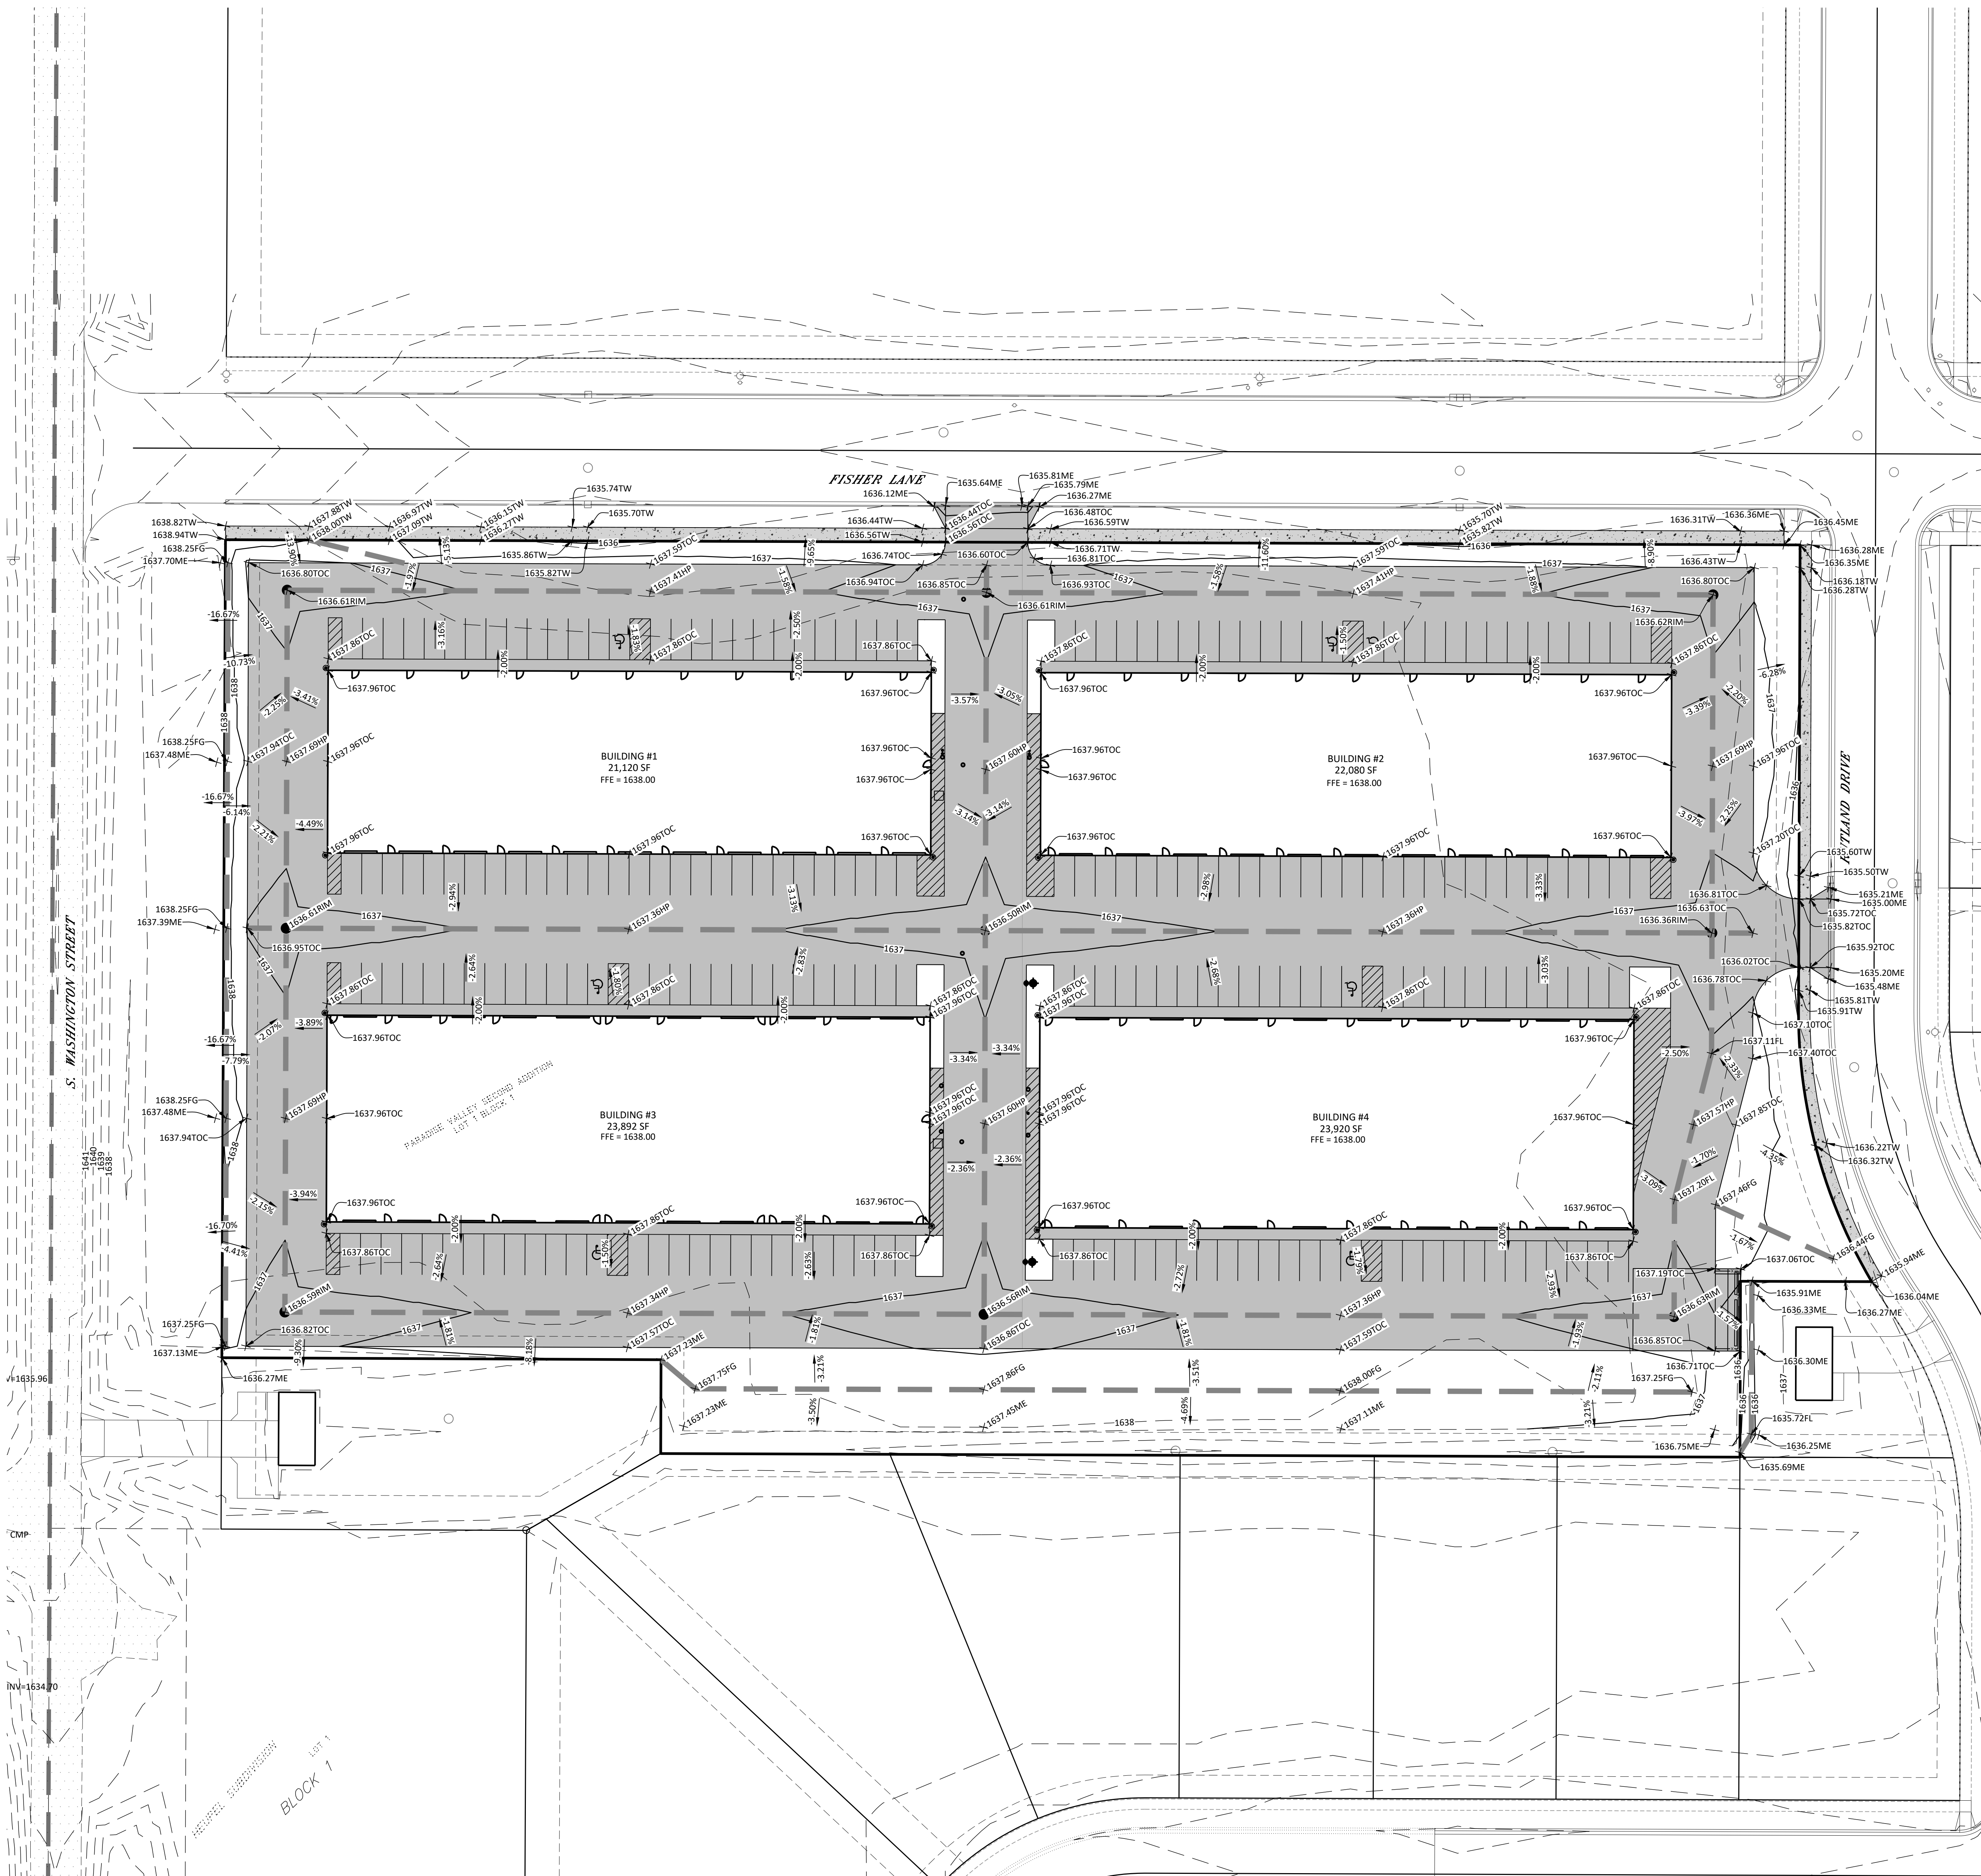


- NOTES:
- EXISTING SURFACE IS BASED ON ORIGINAL DESIGN FILE. CONTRACTOR SHALL FIELD VERIFY ELEVATIONS AT THE IN LOCATIONS PRIOR TO POURING CONCRETE.
 - SIDEWALK IN CITY RIGHT-OF-WAY SHALL NOT BE INSTALLED UNTIL PAVING PROJECTS IN FISHER LANE AND RUTLAND DRIVE ARE COMPLETE.

	NEW CURB(IN-FLOW)
	NEW CURB(OUT-FLOW)
	GRADE BREAK/FLOWLINE
	FINISH GROUND
	FLOWLINE
	HIGH POINT
	STRUCTURE INVERT ELEVATION
	LOW POINT
	MIDPOINT OF CURVE
	MATCH EXISTING GROUND
	POINT OF CURVATURE
	STRUCTURE RIM ELEVATION
	TOP OF CURB/THICKENED EDGE
	TOP OF CONCRETE
	TOP OF WALK
	TOP OF WALL
	BOTTOM OF WALL

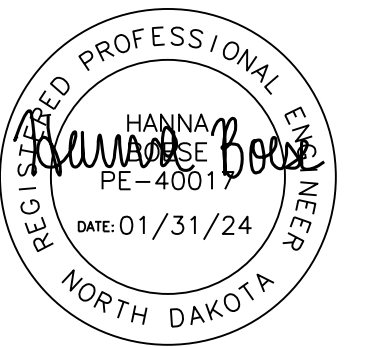

wild|crg
architecture | construction

200 2nd Avenue North | Suite 514
 Fargo, North Dakota 58102
 Phone 701 | 293 | 8106
 wildcrg.com

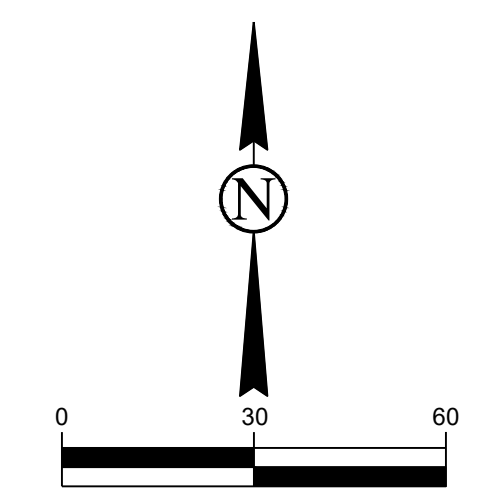

CALL BEFORE YOU DIG
NORTH DAKOTA
UTILITIES UNDERGROUND LOCATION SERVICE
1-800-795-0555

GRADING PLAN



© Copyright 2024 W|C|RG, Ltd.

Date:	01/09/2024	Sheet
Project Number:	2344	
Drawn By:	PWB	
Checked By:	AJT	
Approved By:	HUB	

C-6


EROSION CONTROL LEGEND		
	SILT FENCE	2,005 LF
	SEEDING & HYDROMULCH	2,579 SY
	SEEDING WITH EROSION CONTROL BLANKET (NDDOT ECB 1)	160 SY
	STANDARD INLET PROTECTION	14 EA
	VEHICLE TRACKING PAD	1 EA
	LANDSCAPE ROCK	1 LS

- NOTES:
- CONTRACTOR SHALL FOLLOW NDDOT STORMWATER POLLUTION PREVENTION STANDARDS FOR ALL EROSION CONTROL DURING CONSTRUCTION.
 - A FODS TRACKOUT CONTROL MAT MAY BE USED AS AN APPROVED EQUAL TO THE VEHICLE TRACKING PAD. CONTRACTOR SHALL SUBMIT PROPOSED MAT LAYOUT TO ENGINEER FOR REVIEW PRIOR TO INSTALLING.

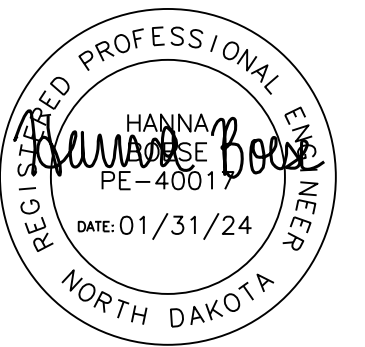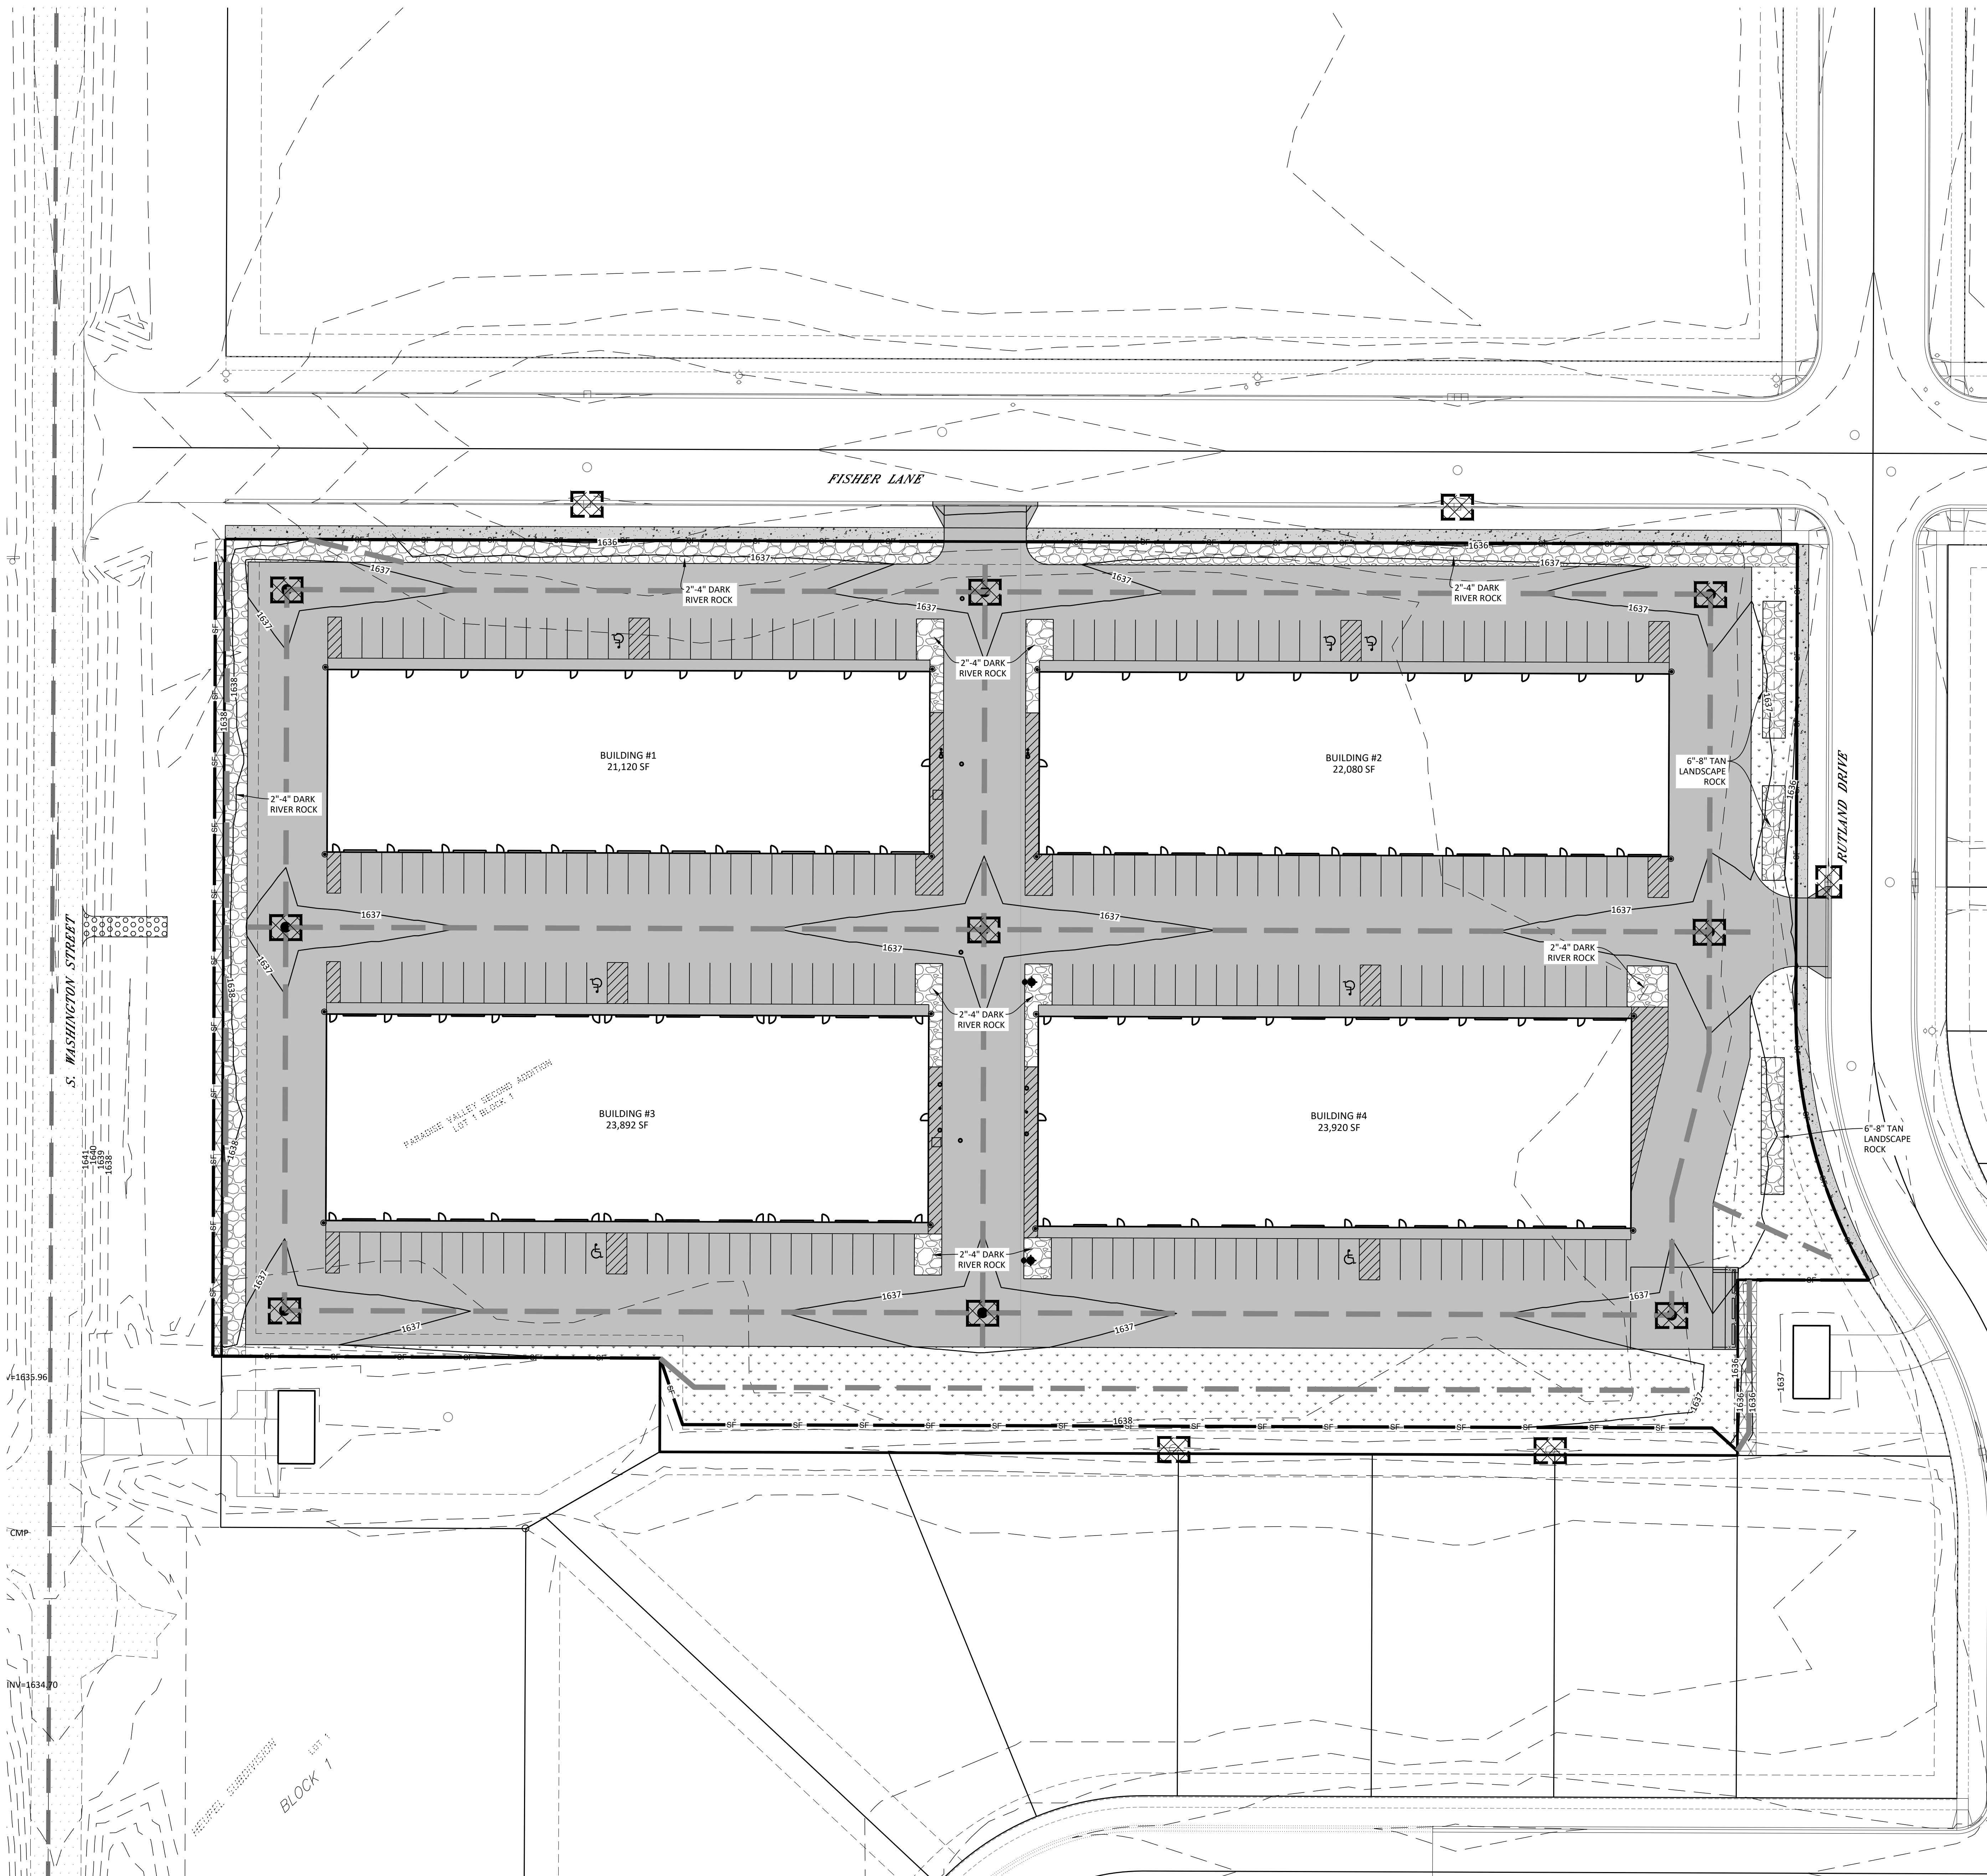

wild | crg
architecture | construction

200 2nd Avenue North | Suite 514
 Fargo, North Dakota 58102
 Phone 701 | 293 | 8106
 wildcrg.com

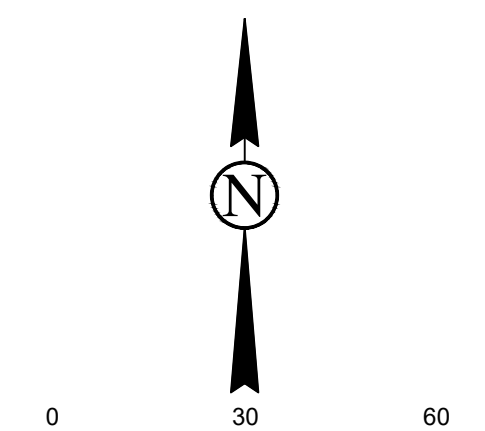


CALL BEFORE YOU DIG
NORTH DAKOTA
UTILITIES UNDERGROUND LOCATION SERVICE
1-800-795-0555


EROSION & SEDIMENT CONTROL PLAN

© Copyright 2024 WildCRG, Ltd.

Date:	01/09/2024	Sheet
Project Number:	2344	C-7
Drawn By:	PWB	
Checked By:	AJT	
Approved By:	HJB	


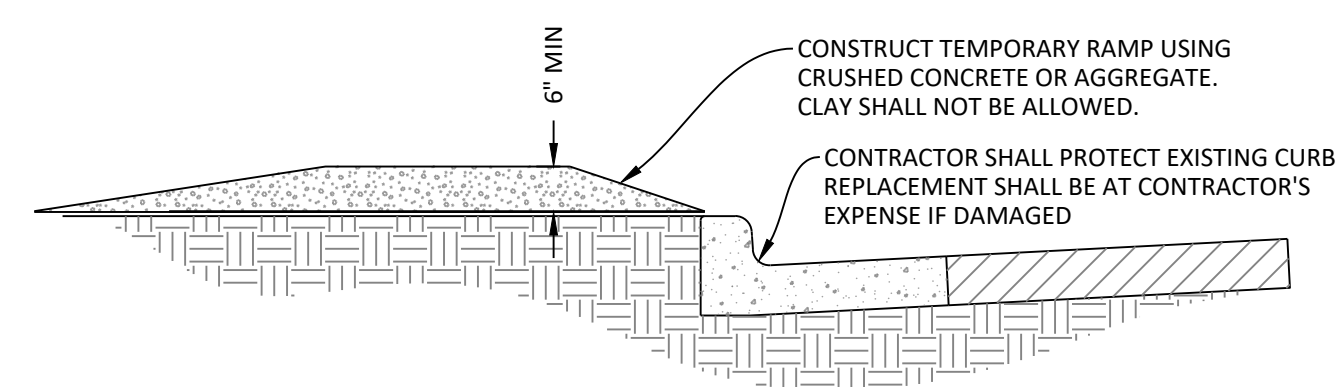


TEMPORARY ACCESS OVER CURB & GUTTER

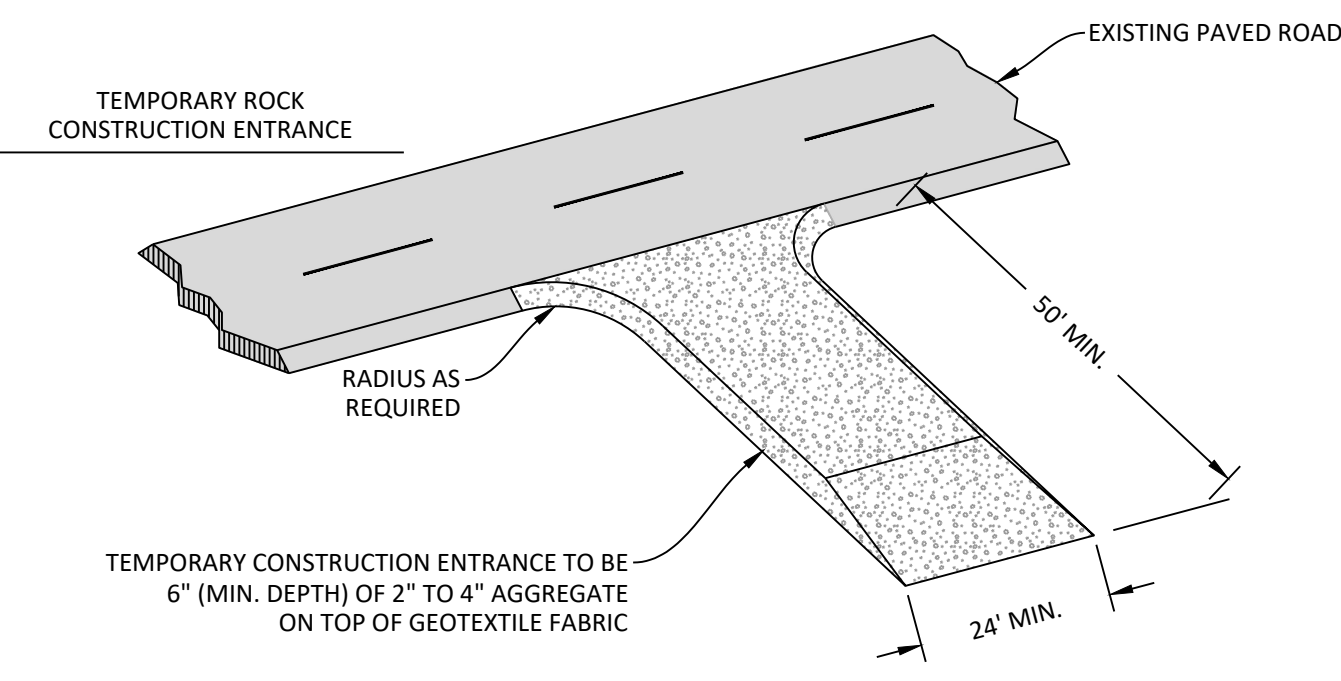


- NOTES:
1. A TEMPORARY CONSTRUCTION ENTRANCE SHALL BE CONSTRUCTED AT ALL LOCATIONS WHERE CONSTRUCTION VEHICLES OR EQUIPMENT ENTER OR EXIT THE CONSTRUCTION SITES.
 2. UPON COMPLETION OF THE PROJECT, THE CONTRACTOR SHALL REMOVE THE TEMPORARY CONSTRUCTION ENTRANCE UNLESS NOTED OTHERWISE, AND THE SITE SHALL BE RESTORED TO ITS PREVIOUS CONDITION. ENTRANCES SHALL BE MAINTAINED IN A MANNER TO MINIMIZE THE TRACKING OF SEDIMENT ONTO PAVED SURFACES.
 3. TEMPORARY ACCESS OVER EXISTING CURB AND GUTTER SHOULD BE LOCATED AT HIGH POINTS IN THE STREET IF POSSIBLE TO MAINTAIN STREET DRAINAGE.
 4. REMOVE TOPSOIL BEFORE CONSTRUCTION OF STABILIZED CONSTRUCTION ACCESS.

1 VEHICLE TRACKING PAD
N.T.S.

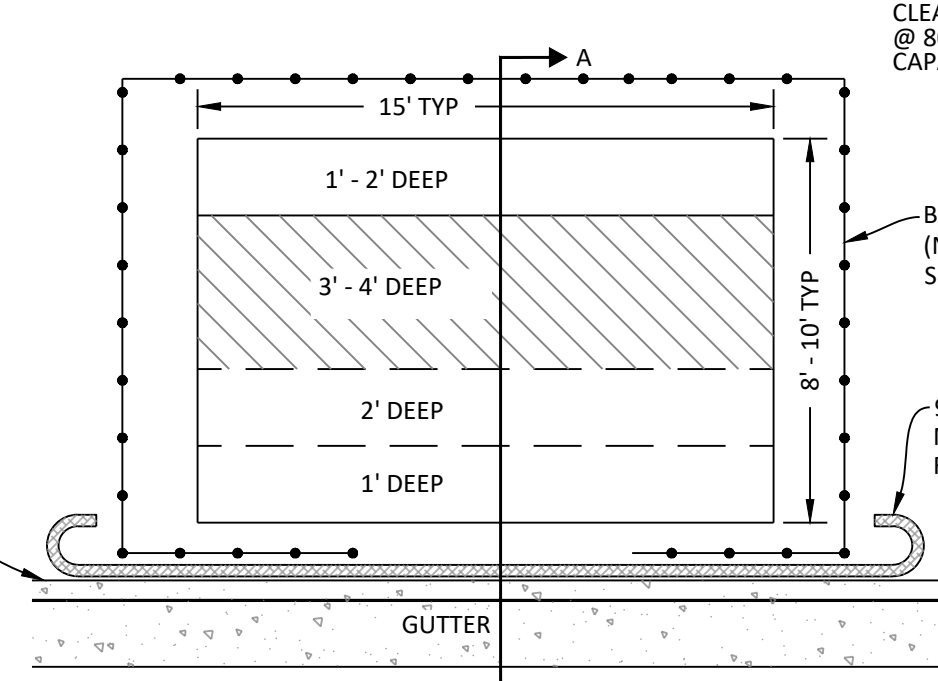
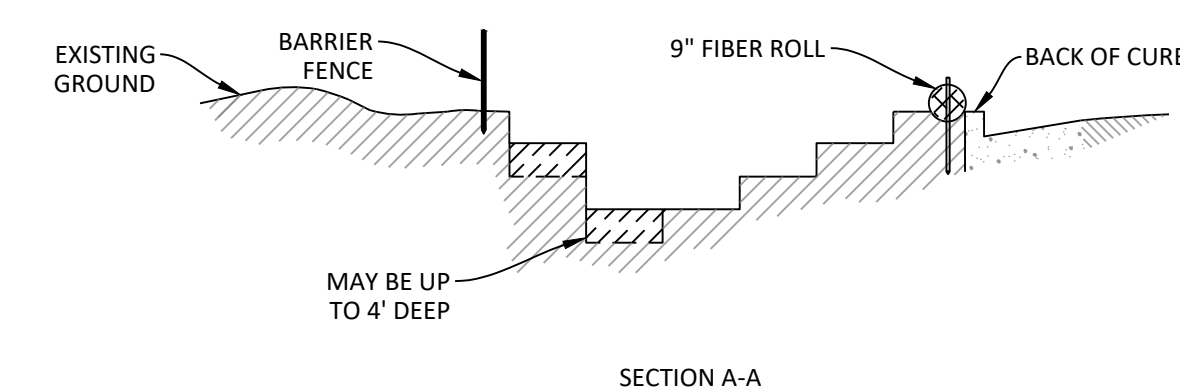


2 CONCRETE WASHOUT
N.T.S.

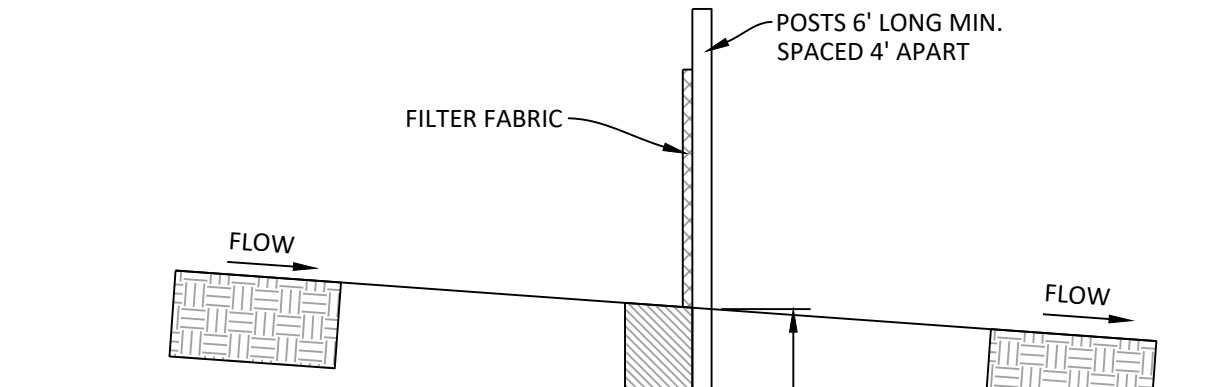


- NOTES:
1. POSTS SHALL BE 2 INCH DIAMETER ROUND WOOD, 1.5 INCH RECTANGULAR WOOD, OR STEEL WITH A MINIMUM OF 0.85 POUNDS PER FOOT AND HAVE PROJECTIONS FOR FASTENING WIRE OR FABRIC.
 2. FILTER FABRIC SHALL BE AS SPECIFIED IN AASHTO M 288 WITH A MINIMUM WIDTH OF 36 INCHES.
 3. SILT FENCE SHALL BE INSTALLED ALONG THE CONTOURS OF THE SITE SO WATER CANNOT FLOW AROUND THE END OF THE FENCE.
 4. IF JOINING TWO SECTIONS OF FILTER FABRIC, OVERLAP AT SUPPORT POSTS A MINIMUM OF 18 INCHES IN SUCH A MANNER THAT PREVENTS SILT FROM PASSING THROUGH THE FENCE.
 5. REMOVE SEDIMENT FROM SILT FENCE WHEN IT REACHES 1/3 OF THE EXPOSED HEIGHT OF ANY SECTION, OR AS DIRECTED BY THE ENGINEER. THE ENGINEER MAY DIRECT THE INSTALLATION OF ADDITIONAL SILT FENCE IF REMOVING THE SEDIMENT DEPOSIT IS NOT FEASIBLE.

3 SILT FENCE INSTALLATION
N.T.S.

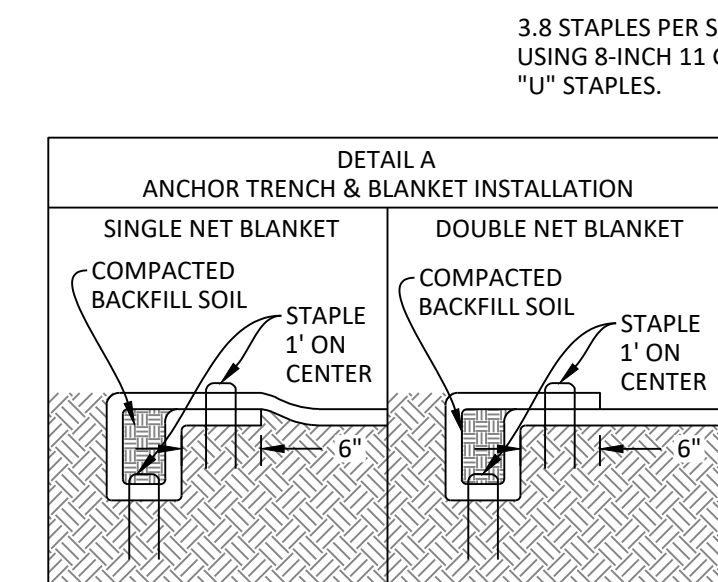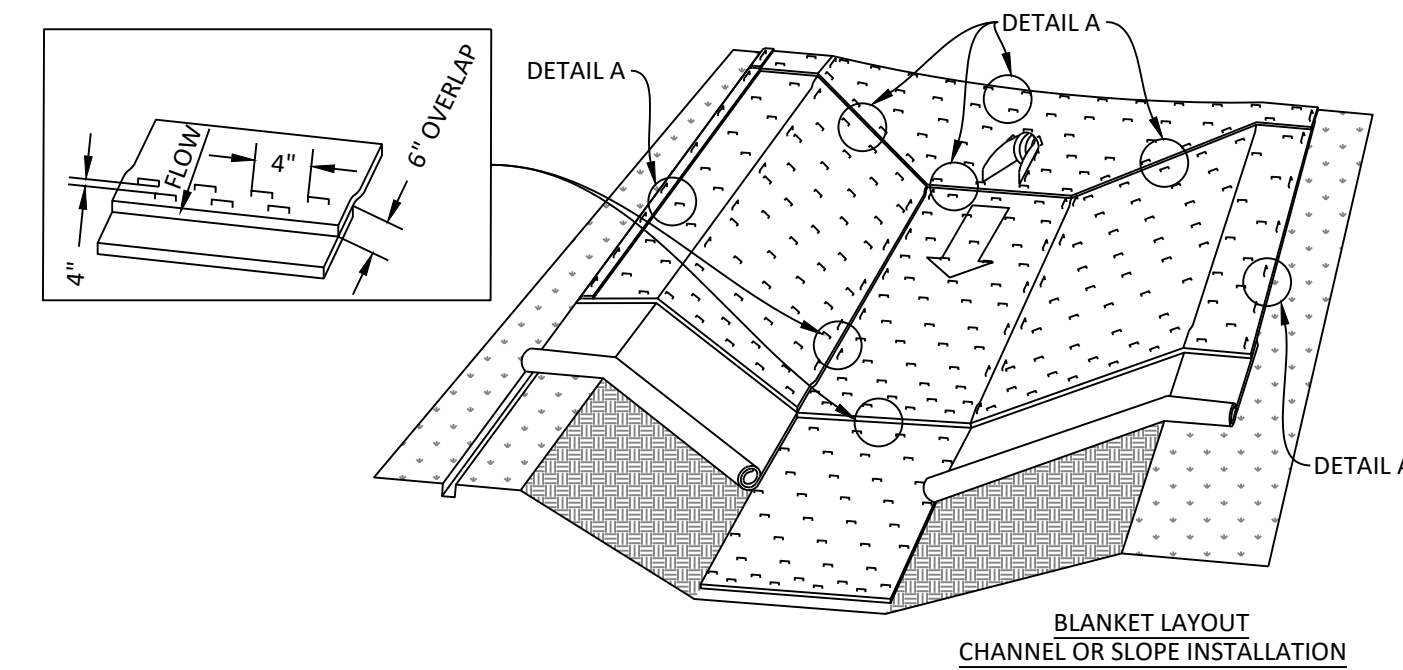


- NOTES:
1. IF A SINGLE NET BLANKET IS USED THE SIDE WITH THE NETTING SHOULD BE ON THE TOP ONCE THE BLANKET IS INSTALLED.

4 EROSION CONTROL BLANKET
N.T.S.

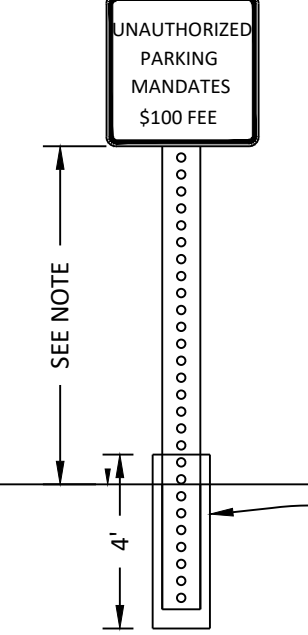


- NOTE:
1. VERIFY SIGNAGE WITH ALL STATE AND LOCAL CODES.
 2. USE 3/4\" PLYWOOD ON BACK OF ALL SIGNS ATTACHED TO BUILDINGS.
 3. SIGNS MUST BE PLACED A MINIMUM OF 60\" HIGH MEASURED FROM THE GROUND TO BOTTOM OF SIGN. A MINIMUM OF 80\" IS REQUIRED ABOVE CIRCULATION PATHS.
 4. VERIFY AMOUNT OF FINE W/ LOCAL AUTHORITY.
 5. POST SHALL BE GALVANIZED TELESCOPING PERFORATED TUBE.


5 ADA PARKING SIGN - VAN ACCESSIBLE
N.T.S.

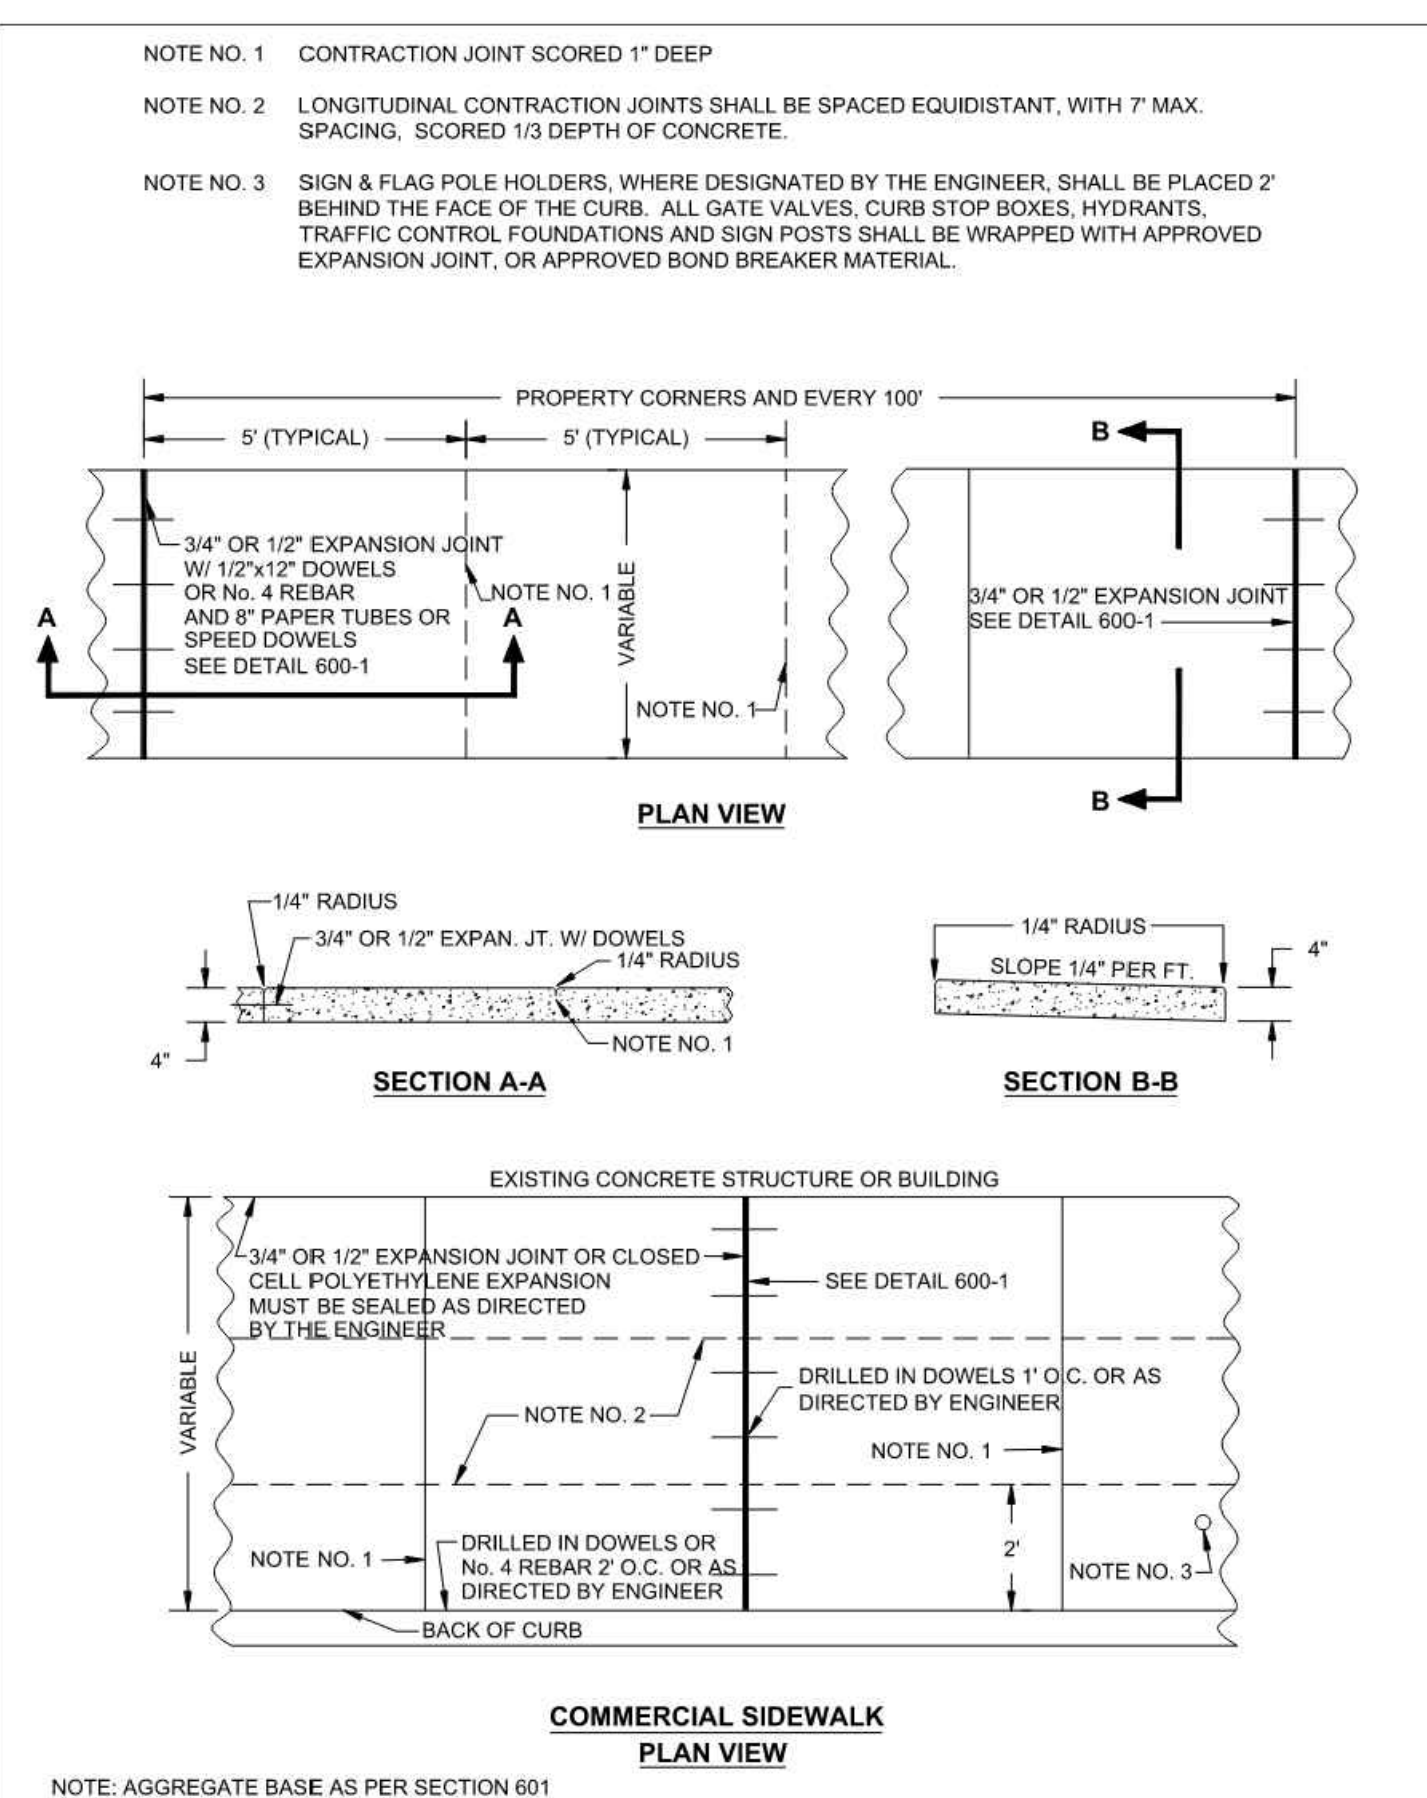

COMMERCIAL CONCRETE SIDEWALK
SCALE: Not to Scale
DATE: 2/2/2023
STANDARD DETAIL NO: 600-2

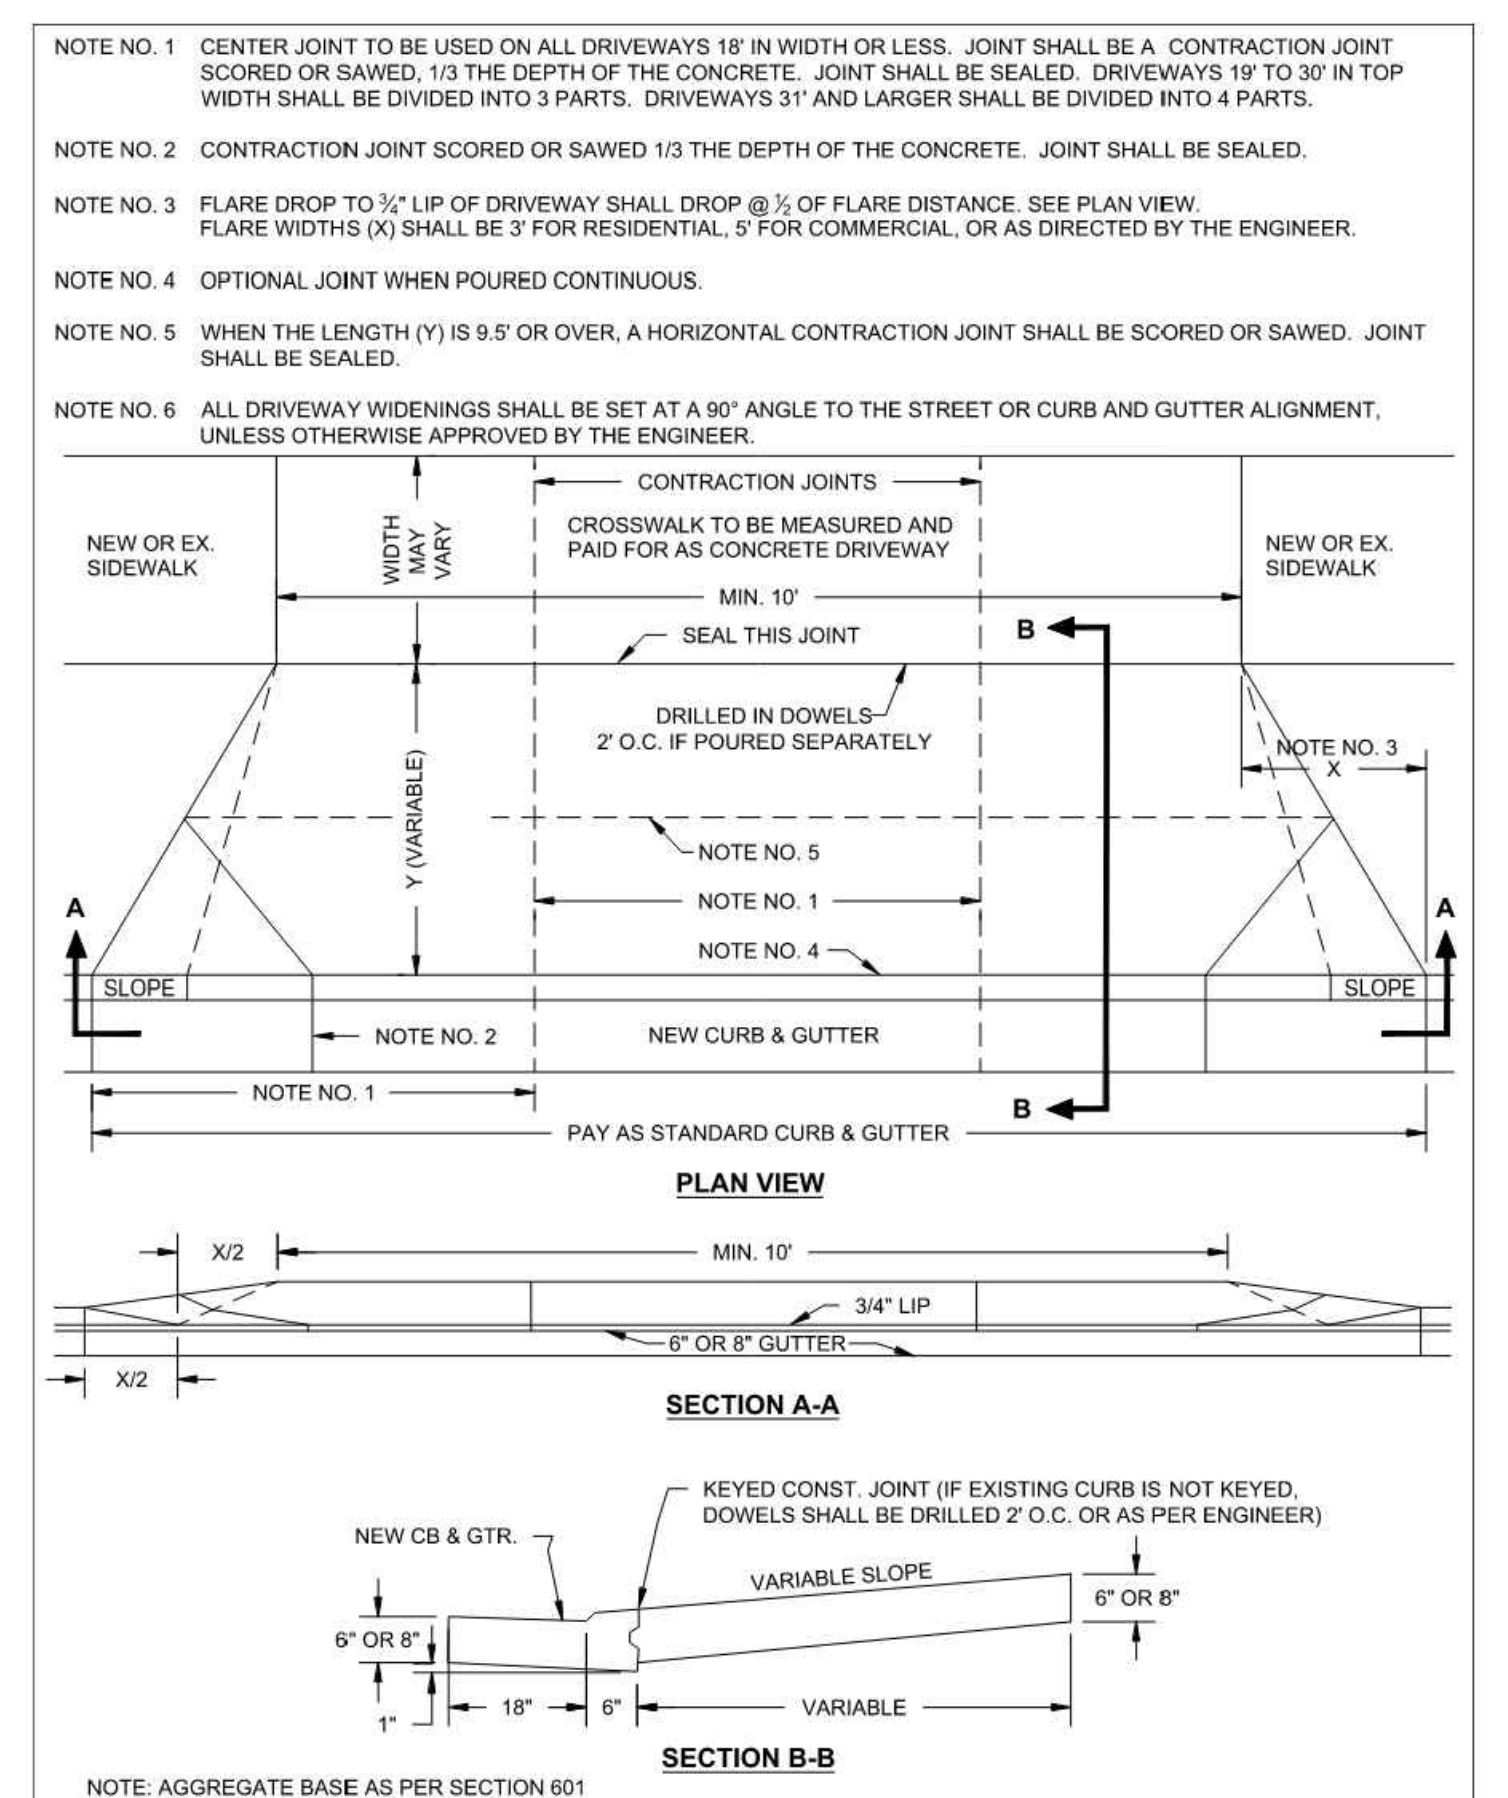


DROP CURB DRIVEWAY
RESIDENTIAL & COMMERCIAL
SCALE: Not to Scale
DATE: 2/2/2023
STANDARD DETAIL NO: 600-6

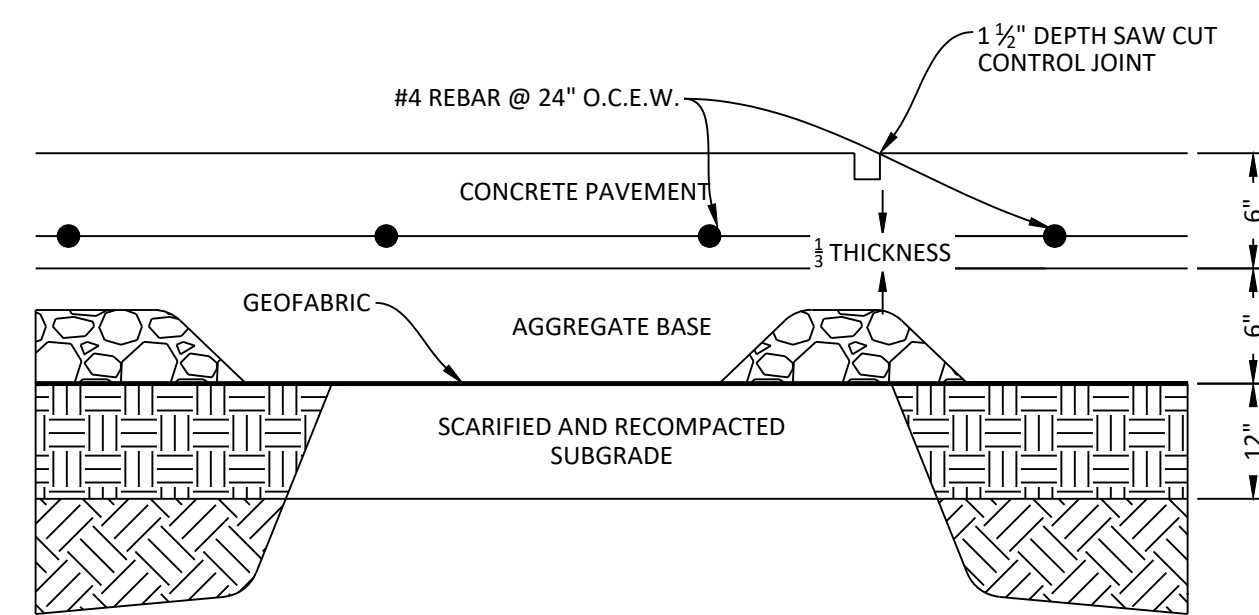


- NOTES:
1. PROVIDE SAWCUT CONTROL JOINTS AT 12\" MAXIMUM SPACING EACH WAY.
 2. PROVIDE 18\" EPOXY COATED #4 REBAR @ 24\" O.C. AT CONNECTION TO CURB & GUTTER, THICKENED EDGE SIDEWALK, EXISTING CONCRETE, AND CONSTRUCTION JOINTS.
 3. WHITE CONCRETE CURING COMPOUND SHALL BE APPLIED PER MANUFACTURERS INSTRUCTIONS ON ALL EXTERIOR CONCRETE SURFACES.
 4. PROVIDE 1/2\" EXPANSION MATERIAL ADJACENT TO BUILDINGS AND ANY OTHER FIXED OBJECTS SUCH AS LIGHT POLE BASES, SIGN FOUNDATIONS, ETC. AND AT CONNECTIONS TO EXISTING CONCRETE.
 5. NDOT TYPE R1 FABRIC SHALL BE PLACED UNDER AGGREGATE BASE PER NDOT SPECIFICATIONS.
 6. REBAR SHALL BE SUPPORTED BY CHAIRS.

6 REINFORCED CONCRETE CROSS SECTION - 6"
N.T.S.

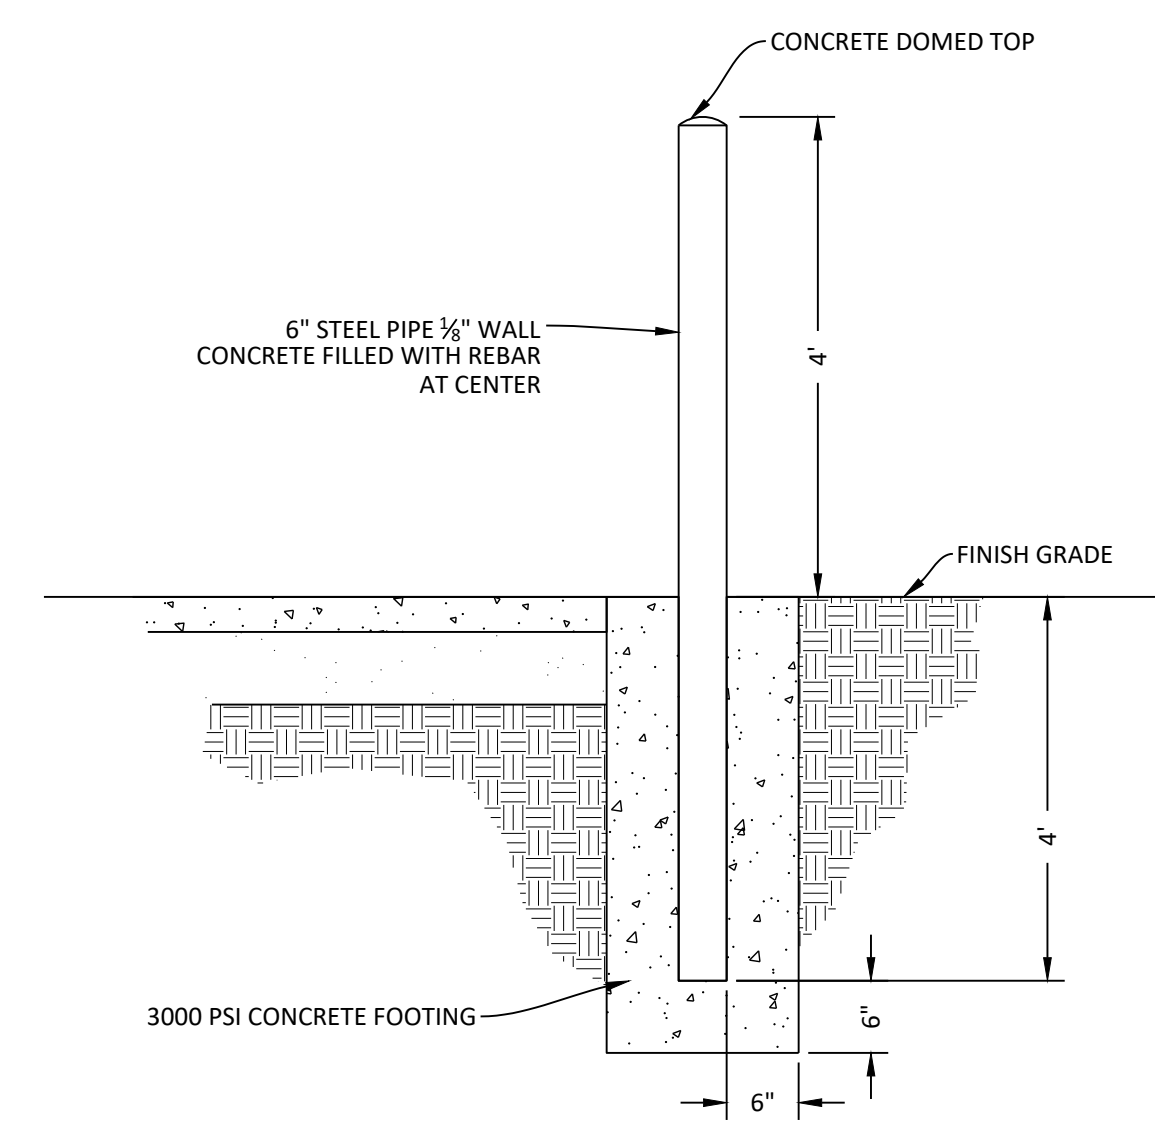


- NOTES:
1. GALVANIZED PAINT SHALL BE USED ON ALL METAL: ONE COAT METAL PRIMER AND TWO COATS YELLOW METAL ENAMEL OR INSTALL E2 SLEEVE BY STRIKE PRODUCTS OR APPROVED EQUAL.
 2. CONTRACTOR MAY INSTALL STEEL PIPE BY AUGURING TO A DEPTH OF 4\" BELOW GRADE IN LIEU OF OVER-EXCAVATION WITH CONCRETE FOOTING.

7 BOLLARD DETAIL
N.T.S.

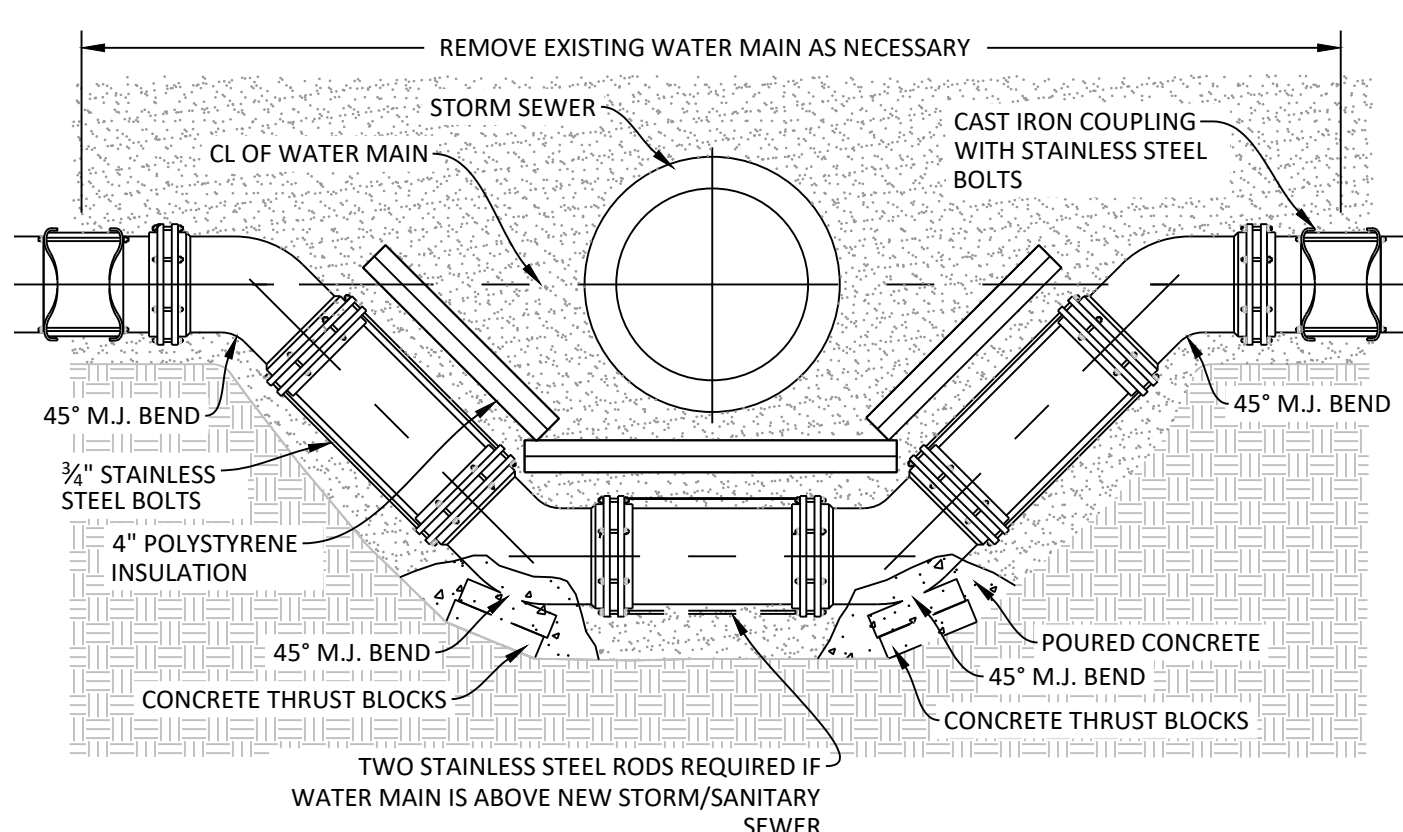


- NOTE:
1. ALL FITTINGS TO BE WRAPPED IN POLYETHYLENE PLASTIC (8 MIL MIN.) AND BE SECURED WITH POLYETHYLENE TAPE (NOT DUCT TAPE).
 2. BELLS AND BOLTS TO BE KEPT FREE OF CONCRETE.
 3. A VERTICAL SEPARATION OF 18\" MUST BE MAINTAINED BETWEEN WATER MAIN AND ANY STORM SEWER.
 4. INSULATION SHALL BE RIGID AND RATED FOR A MINIMUM OF 40 PSI.
 5. INSULATION SHALL BE LAID IN FULL 8\" SHEETS PERPENDICULAR TO WATER MAIN. I.E. 6-4X8\" SHEETS WOULD BE USED FOR THE ABOVE CROSSING.
 6. CONTRACTOR HAS THE OPTION OF GRADUALLY LOWERING THE MAIN BEFORE THE CONFLICT AND THEN GRADUALLY RAISING IS AFTER THE CONFLICT HAS BEEN CLEARED. THE 4-45 DEGREE BENDS WILL NOT BE PAID FOR IF THEY CHOOSE TO DO THIS WAY.

8 WATER/STORM SEWER CROSSING
N.T.S.

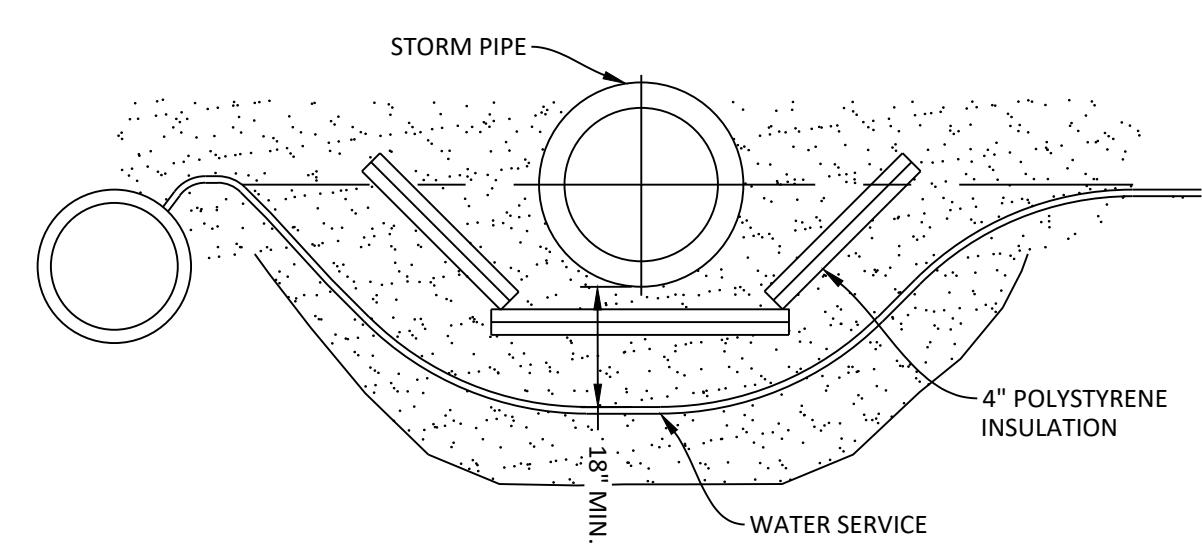


- NOTES:
1. INSULATION REQUIRED ANYTIME WATER SERVICE CROSSING IS 3\" OR CLOSER TO A STORM PIPE.
 2. LOWERING WILL BE REQUIRED ANYTIME WATER SERVICE CROSSING IS 18\" OR CLOSER TO A STORM PIPE.
 3. WATER SERVICE SHALL AT NO TIME BE CLOSER THAN 18\" TO STORM PIPE.
 4. IF WATER SERVICE CLEARANCE TO STORM PIPE IS 18\" TO 36\", INSULATION SHALL BE PLACED BETWEEN THE PIPES.
 5. INSULATION SHALL BE RIGID AND RATED FOR A MINIMUM OF 40 PSI.
 6. INSULATION SHALL BE LAID IN FULL 8\" SHEETS PERPENDICULAR TO WATER SERVICE. I.E. 6-4X8\" SHEETS WOULD BE USED FOR THE ABOVE CROSSING.
 7. SERVICE PIPE MAY ONLY BE INSTALLED ABOVE STORM PIPE IF IT CAN MAINTAIN 18\" OF CLEARANCE OVER THE TOP AND IS MORE THAN 5.5\" FROM FINISHED GROUND. IF BETWEEN 5.5\" AND 7.5\" FROM FINISH GROUND, INSULATION WILL BE REQUIRED OVER SERVICE PIPE AS WELL.

9 WATER SERVICE/
STORM SEWER CROSSING
N.T.S.

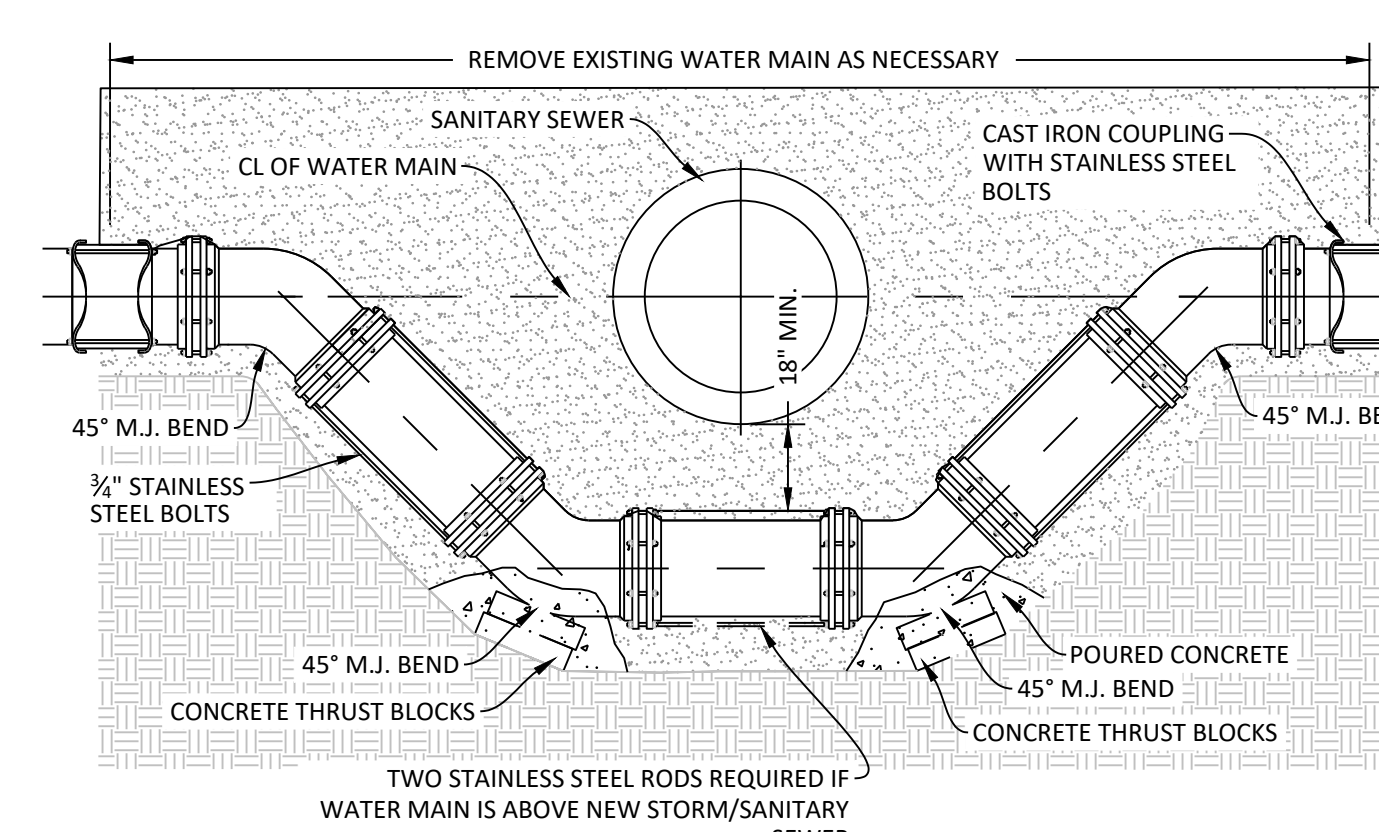


- NOTE:
1. ALL FITTINGS TO BE WRAPPED IN POLYETHYLENE PLASTIC (8 MIL MIN.) AND BE SECURED WITH POLYETHYLENE TAPE (NOT DUCT TAPE).
 2. BELLS AND BOLTS TO BE KEPT FREE OF CONCRETE.
 3. WATER LINE CROSSING ANY AND ALL SANITARY SEWERS SHALL HAVE A MINIMUM VERTICAL SEPARATION OF 18\" BETWEEN THE OUTSIDE OF THE WATER MAIN PIPE AND THE SEWER PIPE. ONE FULL LENGTH OF WATER MAIN PIPE SHALL BE CENTERED AT THE POINT OF CROSSING SUCH THAT BOTH JOINTS WILL BE EQUAL DISTANCE AND AS FAR FROM THE SEWER AS POSSIBLE.
 4. CONTRACTOR HAS THE OPTION OF GRADUALLY LOWERING THE MAIN BEFORE THE CONFLICT AND THEN GRADUALLY RAISING IS AFTER THE CONFLICT HAS BEEN CLEARED. THE 4-45 DEGREE BENDS WILL NOT BE PAID FOR IF THEY CHOOSE TO DO THIS WAY.


10 WATER/SANITARY SEWER CROSSING
N.T.S.

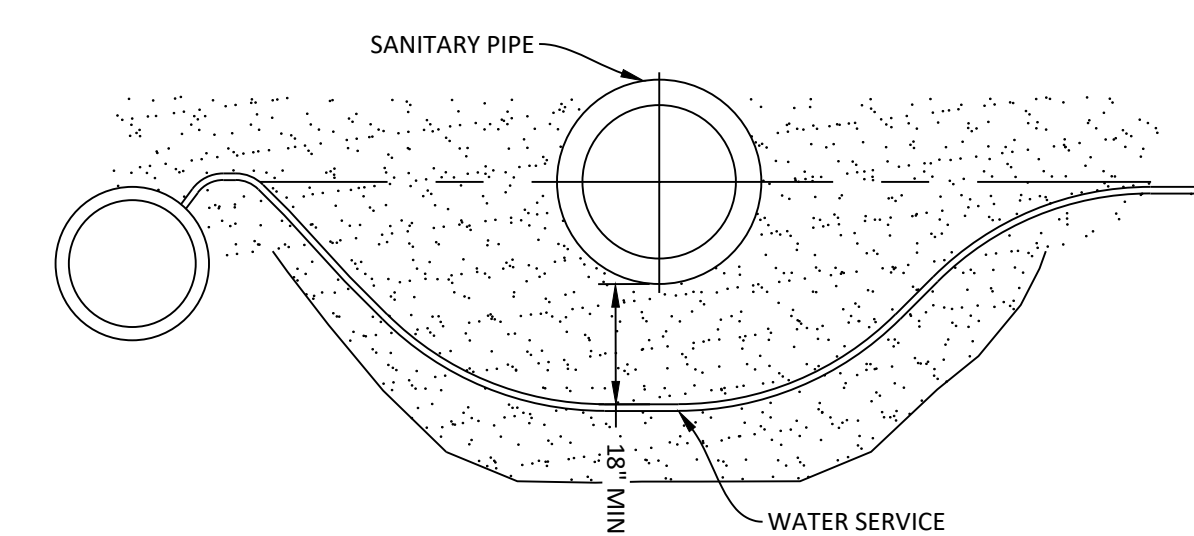


- NOTES:
1. LOWERING WILL BE REQUIRED ANYTIME WATER SERVICE CROSSING IS 18\" OR CLOSER TO A SANITARY PIPE.

11 WATER SERVICE/SANITARY CROSSING
N.T.S.

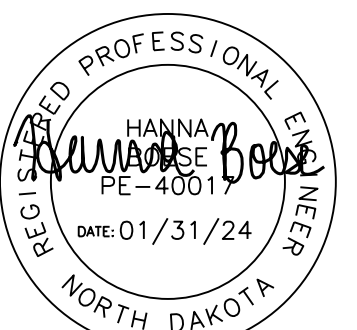

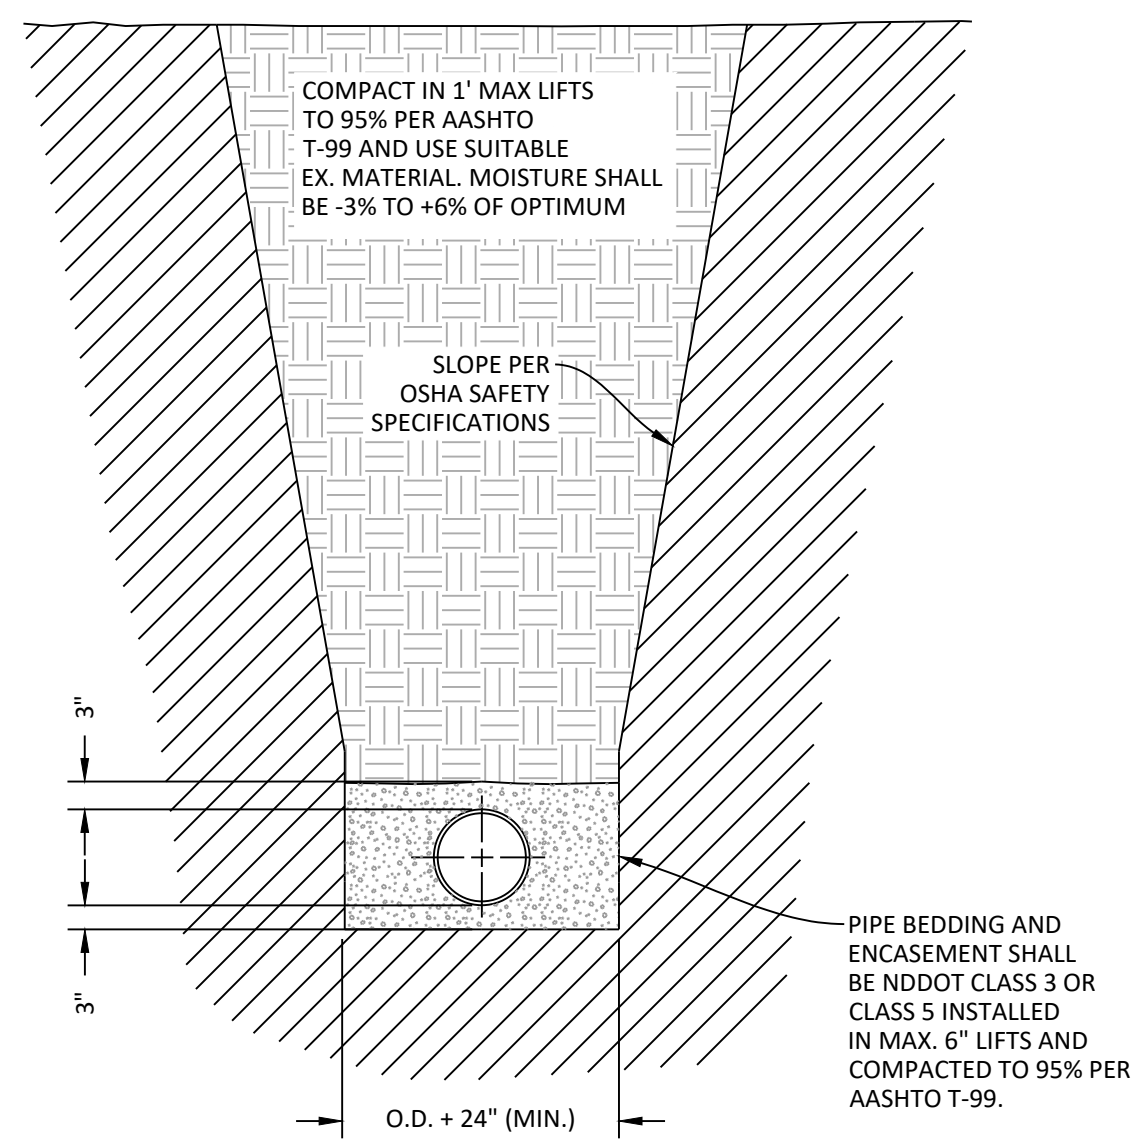


1 SANITARY TRENCH BACKFILL
N.T.S.

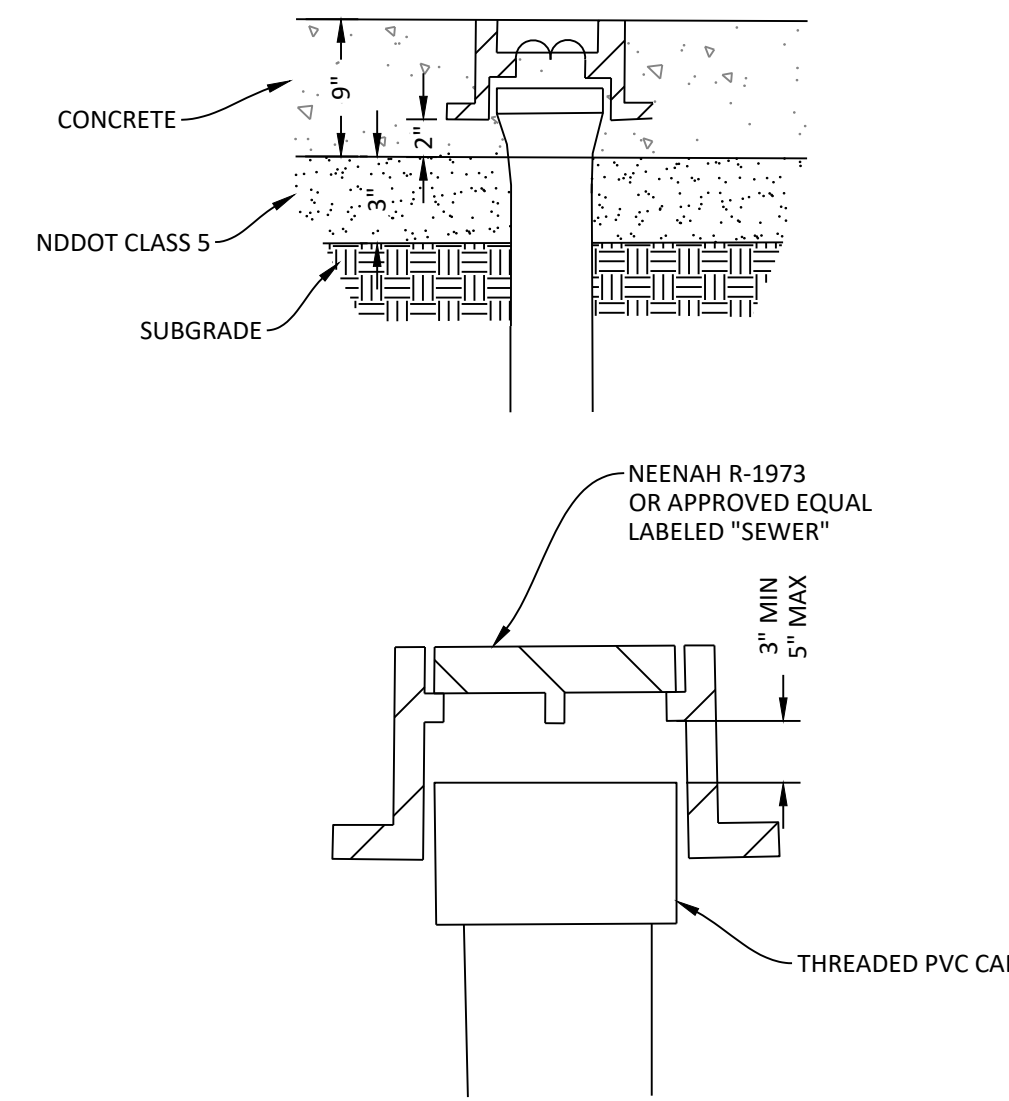


NOTE:
1. 4" OF POLYSTYRENE INSULATION SHALL BE USED AT ANYTIME A SANITARY SEWER SERVICE IS WITHIN 3' VERTICALLY OF A STORM SEWER. INSULATION SHALL BE INSTALLED BETWEEN THE STORM PIPE AND THE SANITARY SERVICE AS SHOWN IN THE ADJACENT DETAIL.


3 INSULATION CROSS SECTION
N.T.S.

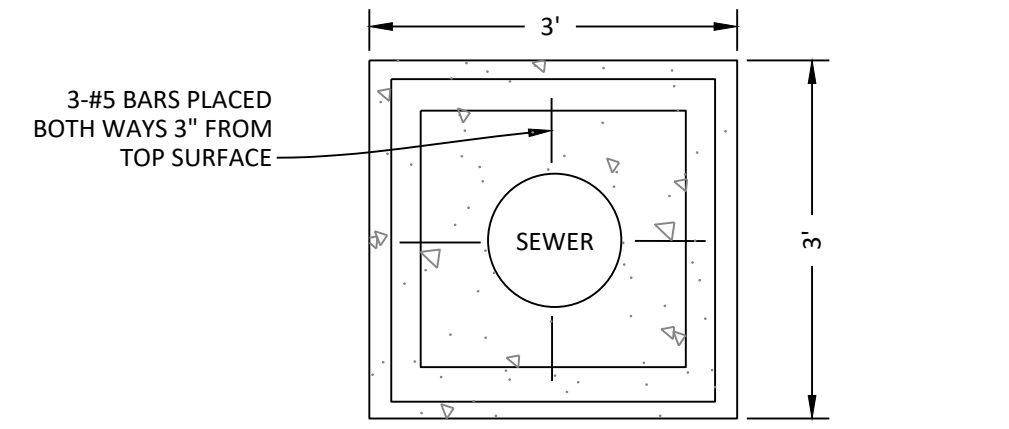

2 SANITARY SEWER CLEANOUT CASTING IN PAVEMENT
N.T.S.

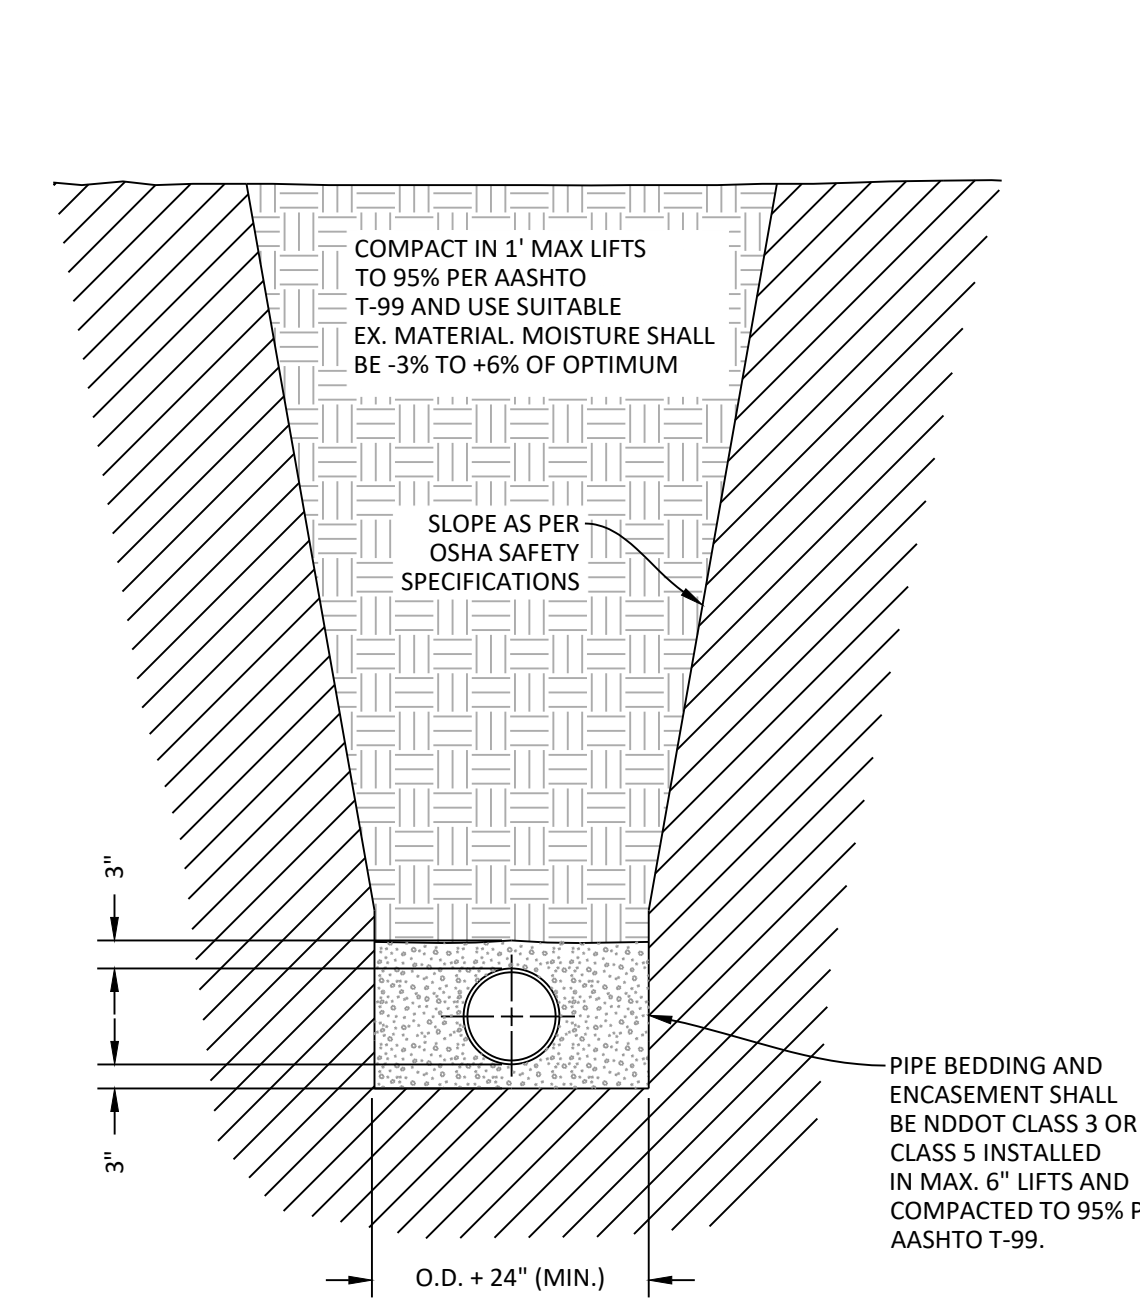


4 WATER MAIN TRENCH DETAIL
N.T.S.

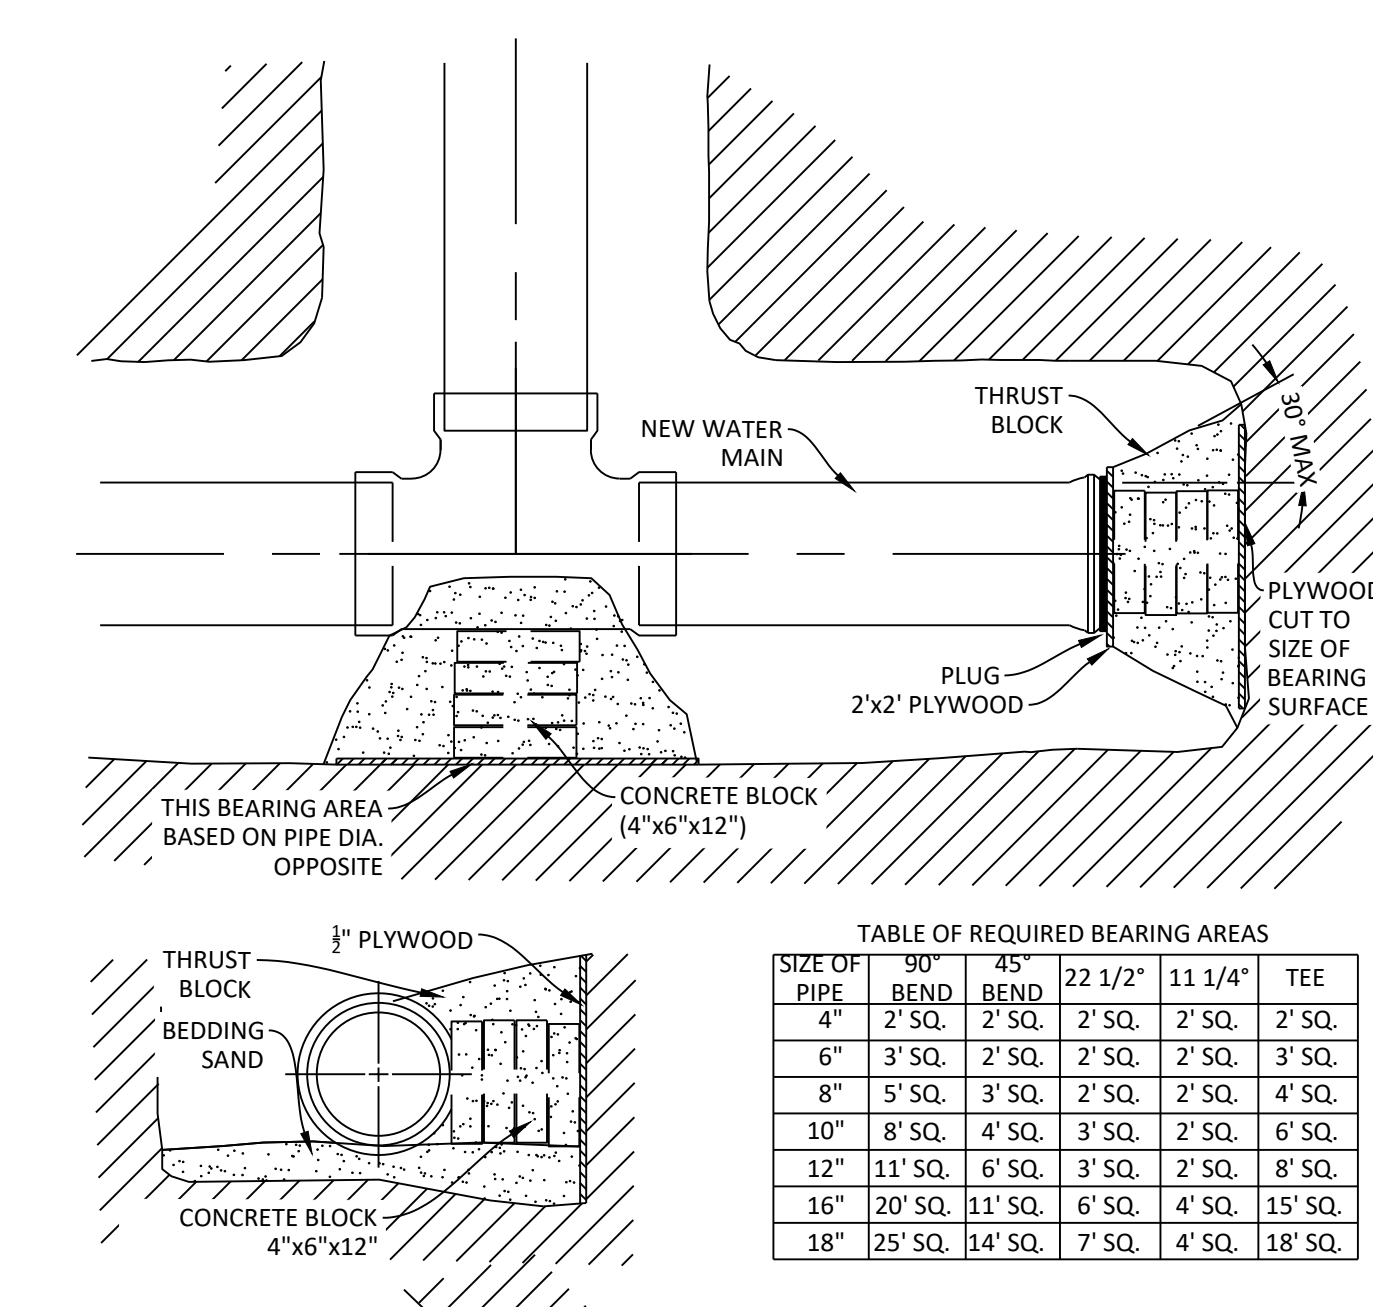


SIZE OF PIPE	90°	45°	22 1/2°	11 1/4°	TEE
4"	2' SQ.	2' SQ.	2' SQ.	2' SQ.	2' SQ.
6"	3' SQ.	2' SQ.	2' SQ.	2' SQ.	3' SQ.
8"	5' SQ.	3' SQ.	2' SQ.	2' SQ.	4' SQ.
10"	8' SQ.	4' SQ.	3' SQ.	2' SQ.	6' SQ.
12"	11' SQ.	6' SQ.	3' SQ.	2' SQ.	8' SQ.
16"	20' SQ.	11' SQ.	6' SQ.	4' SQ.	15' SQ.
18"	25' SQ.	14' SQ.	7' SQ.	4' SQ.	18' SQ.

NOTES:
1. POURED CONCRETE IS NOT REQUIRED ON PIPES 10" AND SMALLER. POURED CONCRETE IS REQUIRED ON PIPES 12" AND LARGER AND SHALL BE 3,000 PSI AND POURED AGAINST UNDISTURBED EARTH. BELLS AND BOLTS SHALL BE KEPT FREE OF CONCRETE. CONCRETE SHALL BE INCLUDED IN BID PRICE FOR WATER MAIN. BAGGED CONCRETE SUCH AS QUIKRETE IS NOT ALLOWED.
2. TEE & PLUG BLOCKING SHOWN, TAPPING SLEEVE BLOCKING SIMILAR.
3. ALL FITTINGS TO BE WRAPPED IN POLYETHYLENE (8 MIL MIN.)


5 WATER MAIN THRUST BLOCKING
N.T.S.

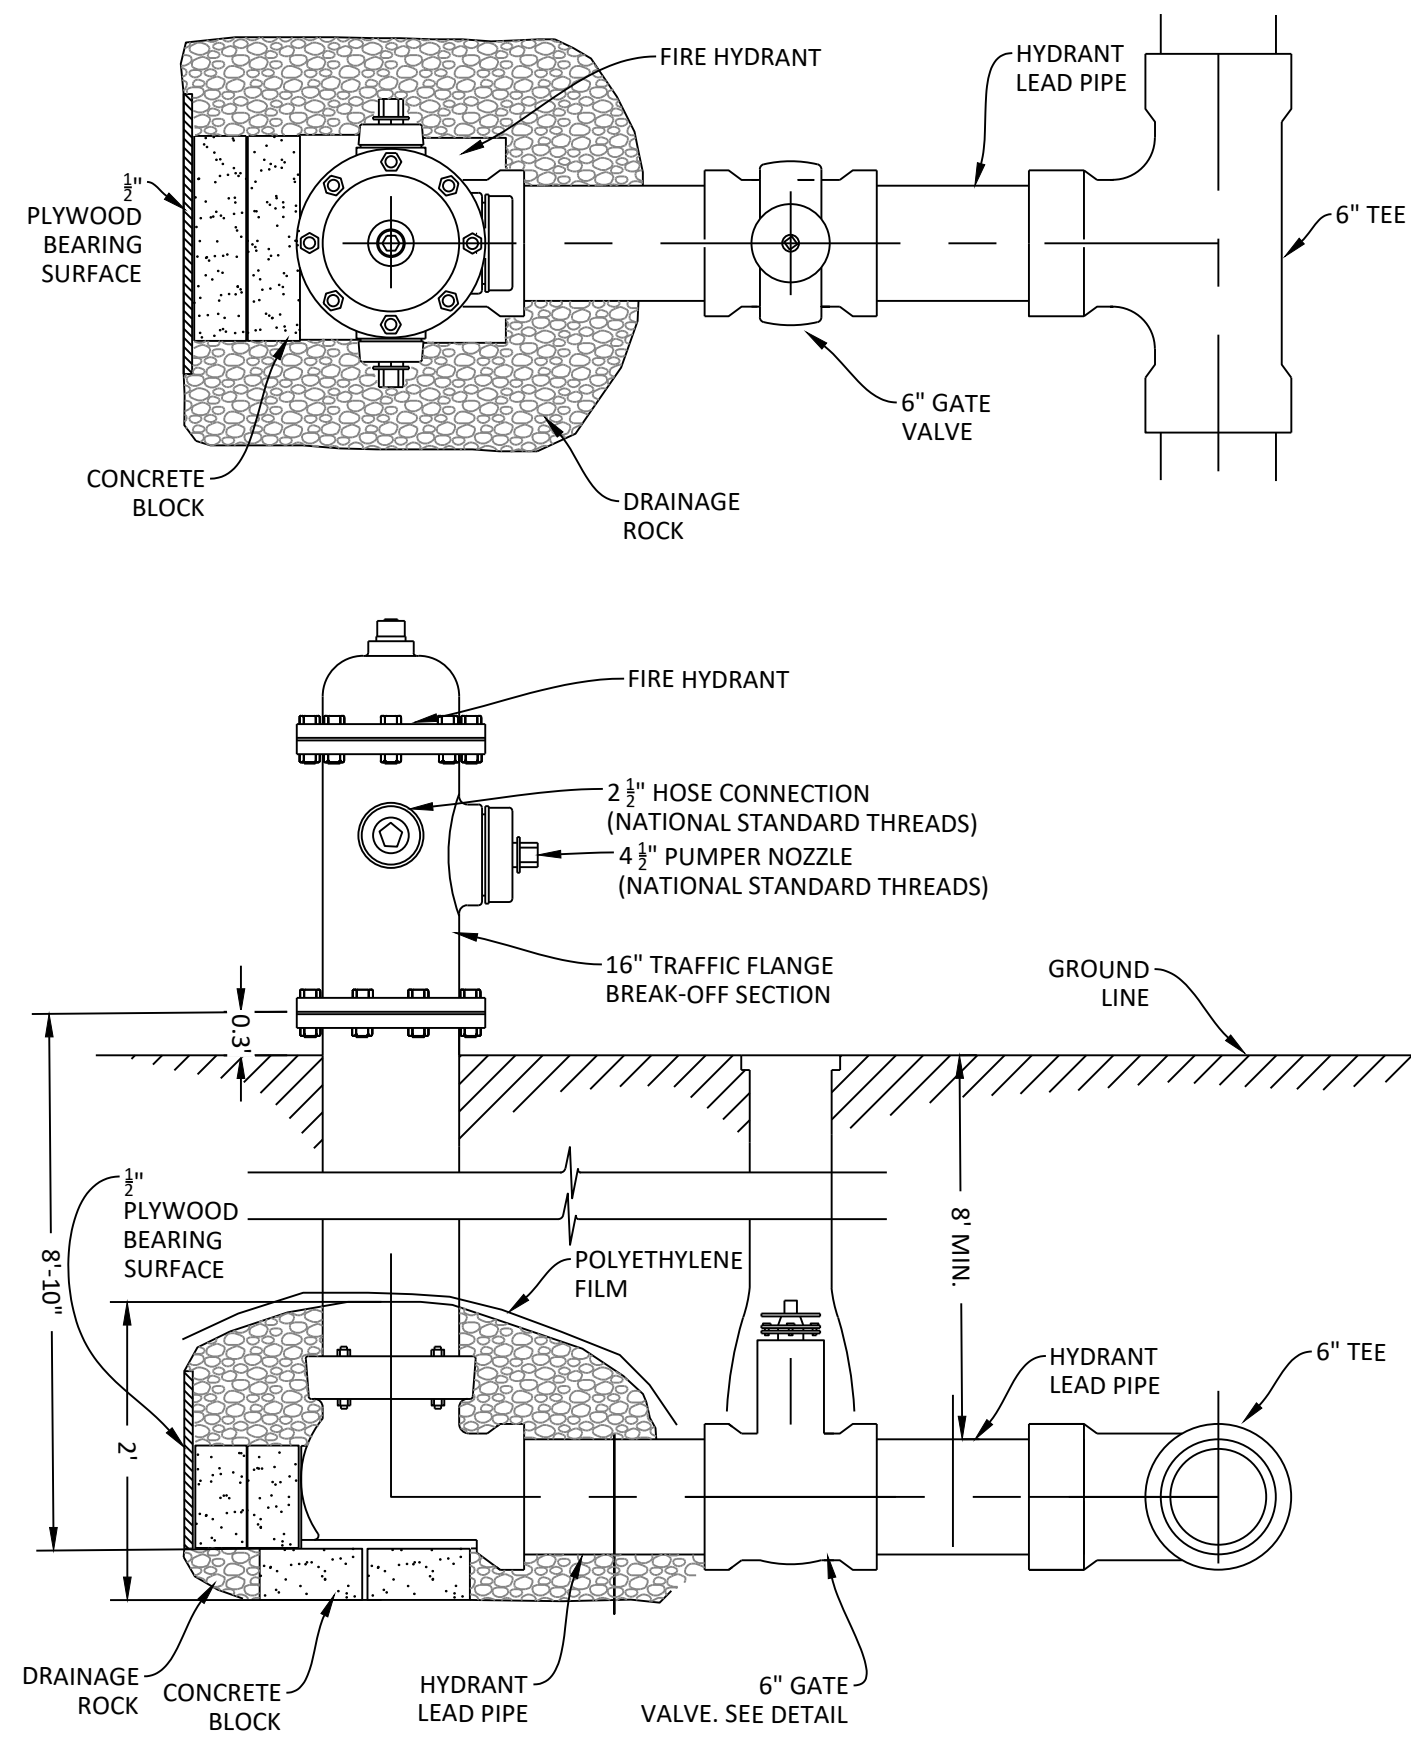


6 FIRE HYDRANT CONNECTIONS
N.T.S.

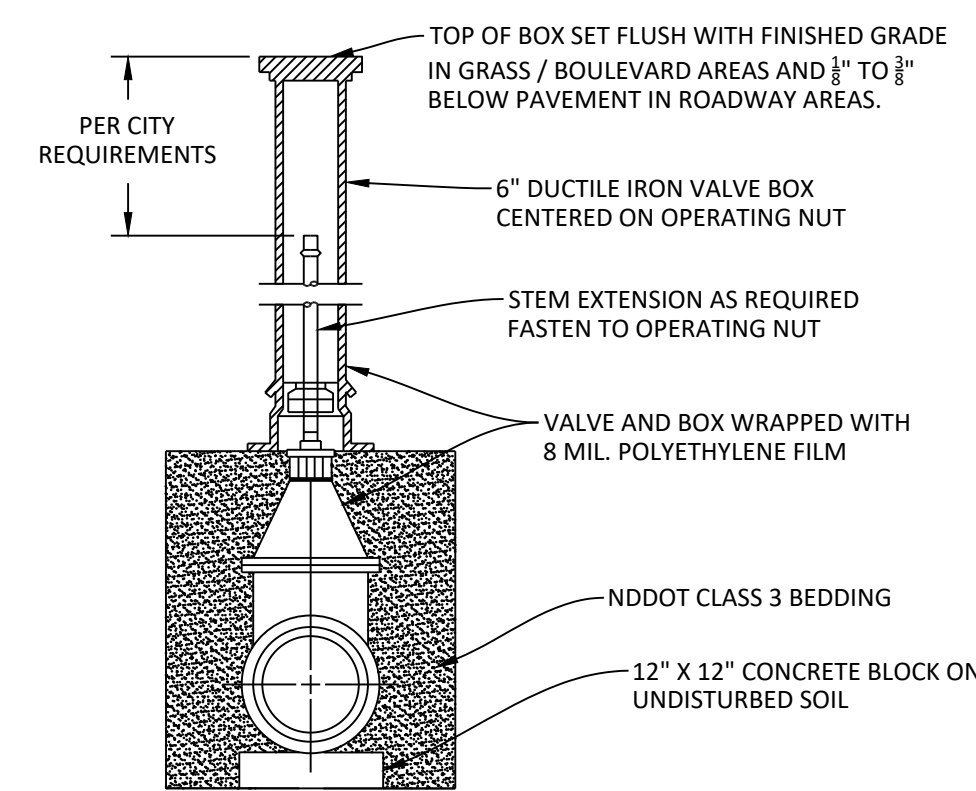

7 GATE VALVE DETAIL
N.T.S.

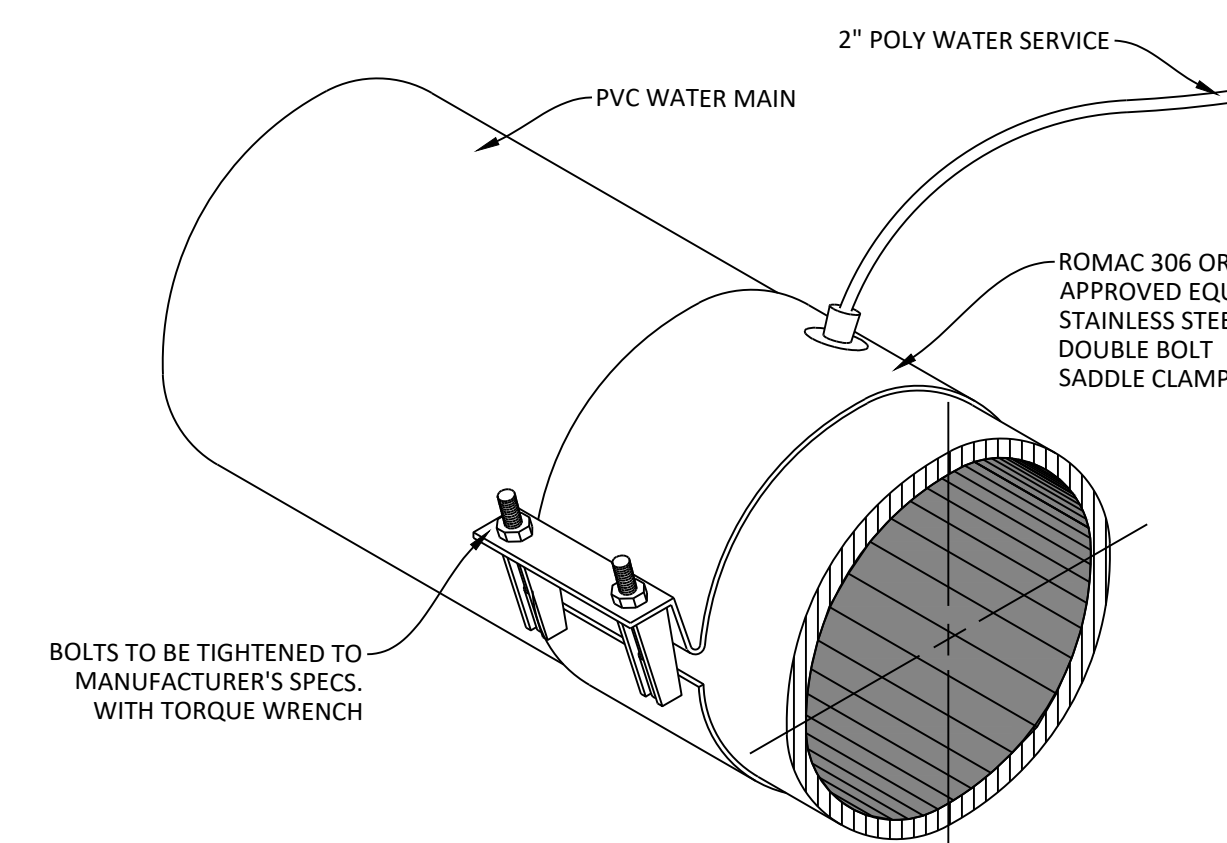


8 WATER MAIN TAPPING SADDLE
N.T.S.

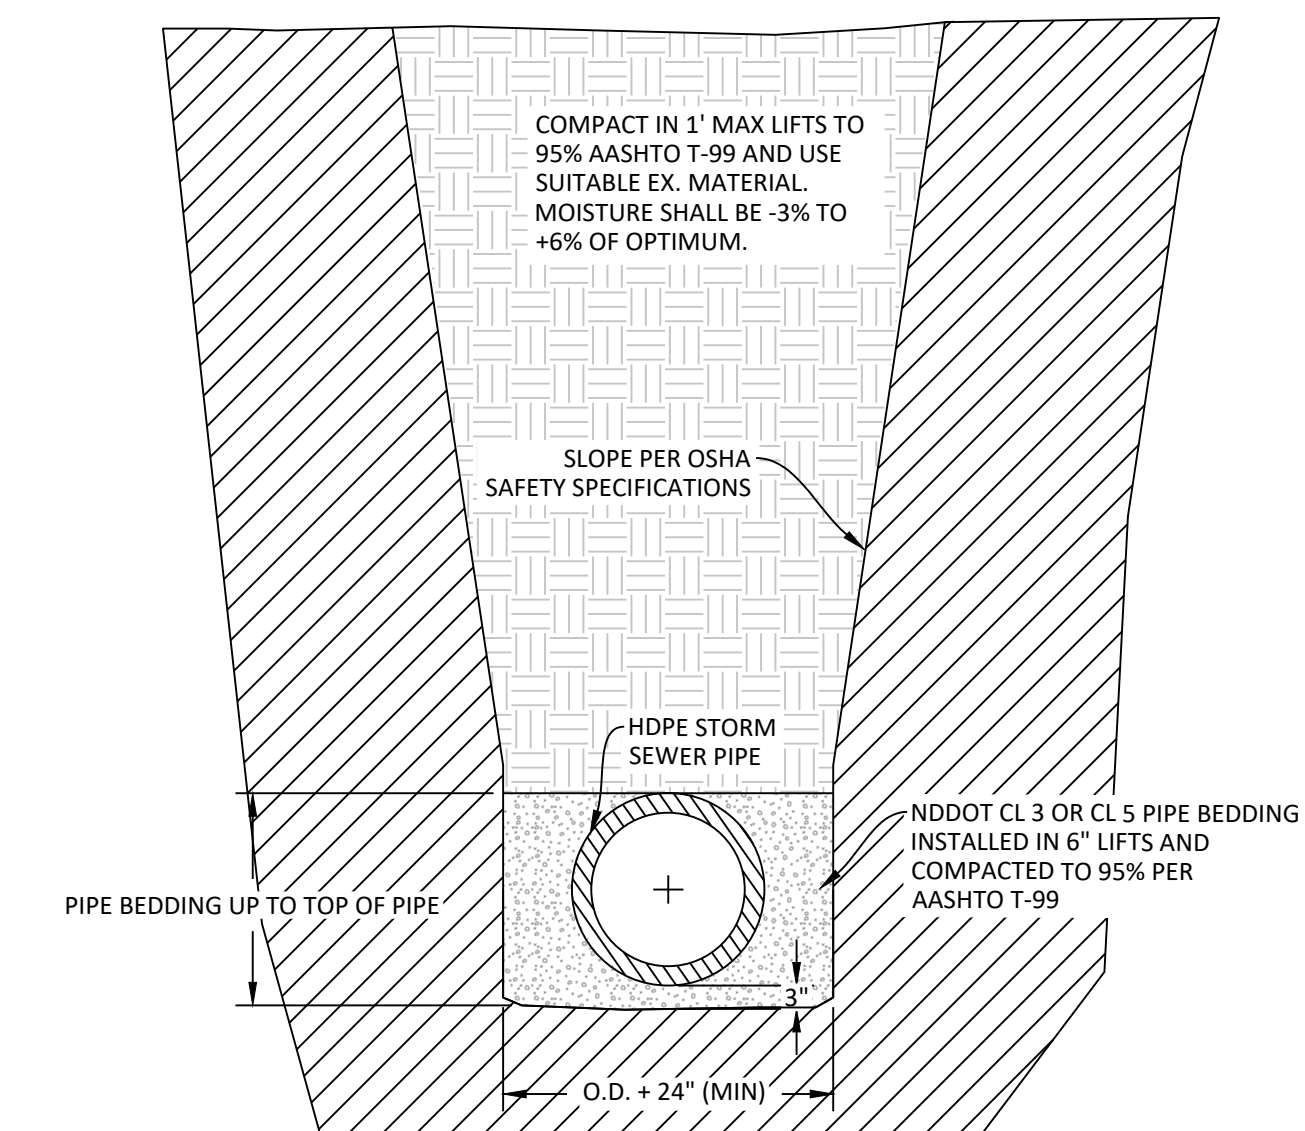


NOTES:
1. MAXIMUM TRENCH WIDTH FOR 60", 66" & 72" NOT TO EXCEED OUTSIDE DIAMETER OF PIPE + 12" FROM BOTTOM OF TRENCH TO A POINT 2' ABOVE PIPE.
2. IN CLAY SOILS, LAST 3' OF PIPE MEASURED FROM BACK OF FLARED END SECTION TO BE BEDDED IN CLAY AND NOT CLASS 5 OR CLASS 3 TO PREVENT SCOUR.

9 HDPE PIPE AND CULVERT TRENCH
N.T.S.

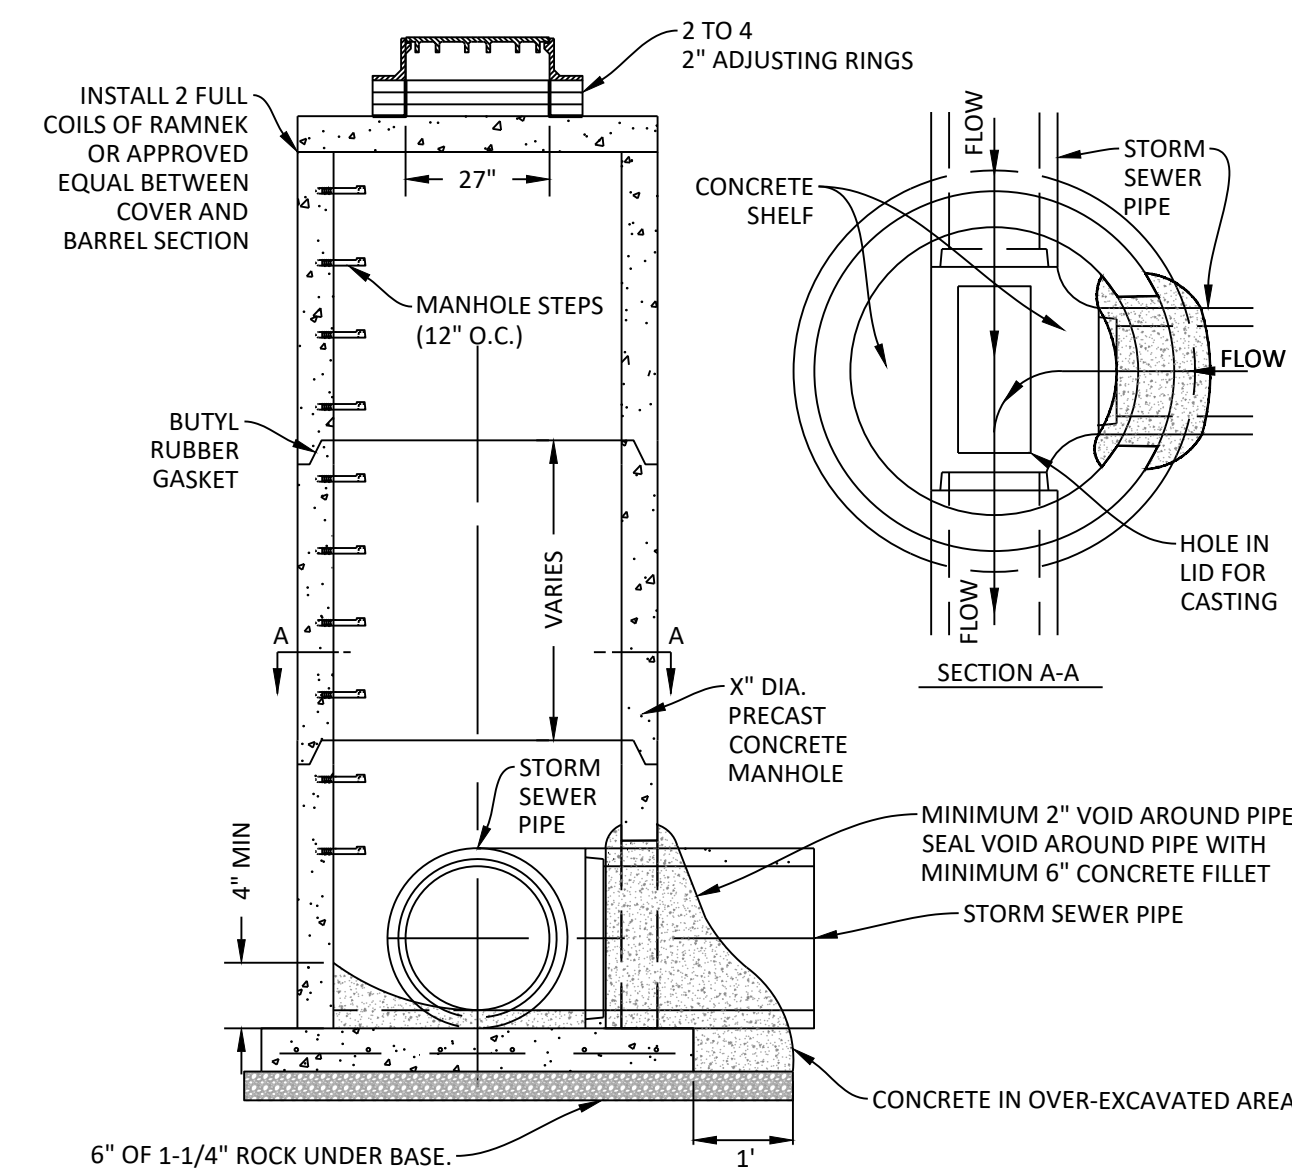


NOTES:
1. ALL ROUND MANHOLES SHALL MEET REQUIREMENTS OF ASTM C478.
2. LIFT HOLES TO BE MANUFACTURED WATER PROOF.
3. BACKFILL AROUND MANHOLE IN 1' MAX LIFTS TO 95% PER AASHTO T-99. USE EXISTING MATERIAL UNLESS NOTED OTHERWISE. MOISTURE SHALL BE -3% TO +6% OF OPTIMUM.
4. CASTING TYPE PER MANHOLE SCHEDULE.
5. SOLID COVERS SHALL BE CAST WITH THE WORD "STORM" IN THE CENTER OF THE COVER IN LETTERS 2" HIGH. CONTRACTOR MAY USE CONCRETE OR HDPE RINGS. IF HDPE RINGS ARE UTILIZED, SILICONE SEAL SHALL BE USED BETWEEN RINGS PER MANUFACTURER RECOMMENDATIONS. IF CONCRETE RINGS ARE USED, GROUT SHALL BE USED BETWEEN, OUTSIDE, AND INSIDE OF RINGS. GROUT SHALL MEET REQUIREMENTS OF ASTM C270.
6. REBAR AND WALL THICKNESS PER MANUFACTURER'S RECOMMENDATION.
7. IF MANHOLE IS USED AS A CURB & GUTTER INLET, THE MANHOLE SHALL HAVE HOLE AVAILABLE FOR CONNECTION TO CURB & GUTTER DRAIN TILE AS REQUIRED.
8. BUTYL RUBBER GASKET ON ALL JOINTS. GASKET SHALL MEET ASTM C443 REQUIREMENTS.
9. DOGHOUSE TO BE CONCRETED INSIDE AND OUT WITH 3,000 PSI CONCRETE. CONCRETE SHALL BE VIBRATED AND TROWEL FINISHED.
10. WHEN STRUCTURE IS INSTALLED IN THE CURB LINE, THE CONTRACTOR SHALL SET MANHOLE SO THAT BACK OF CASTING ALIGNS WITH CURB FLOW LINE.

10 STORM STORM MANHOLE/INLET
N.T.S.

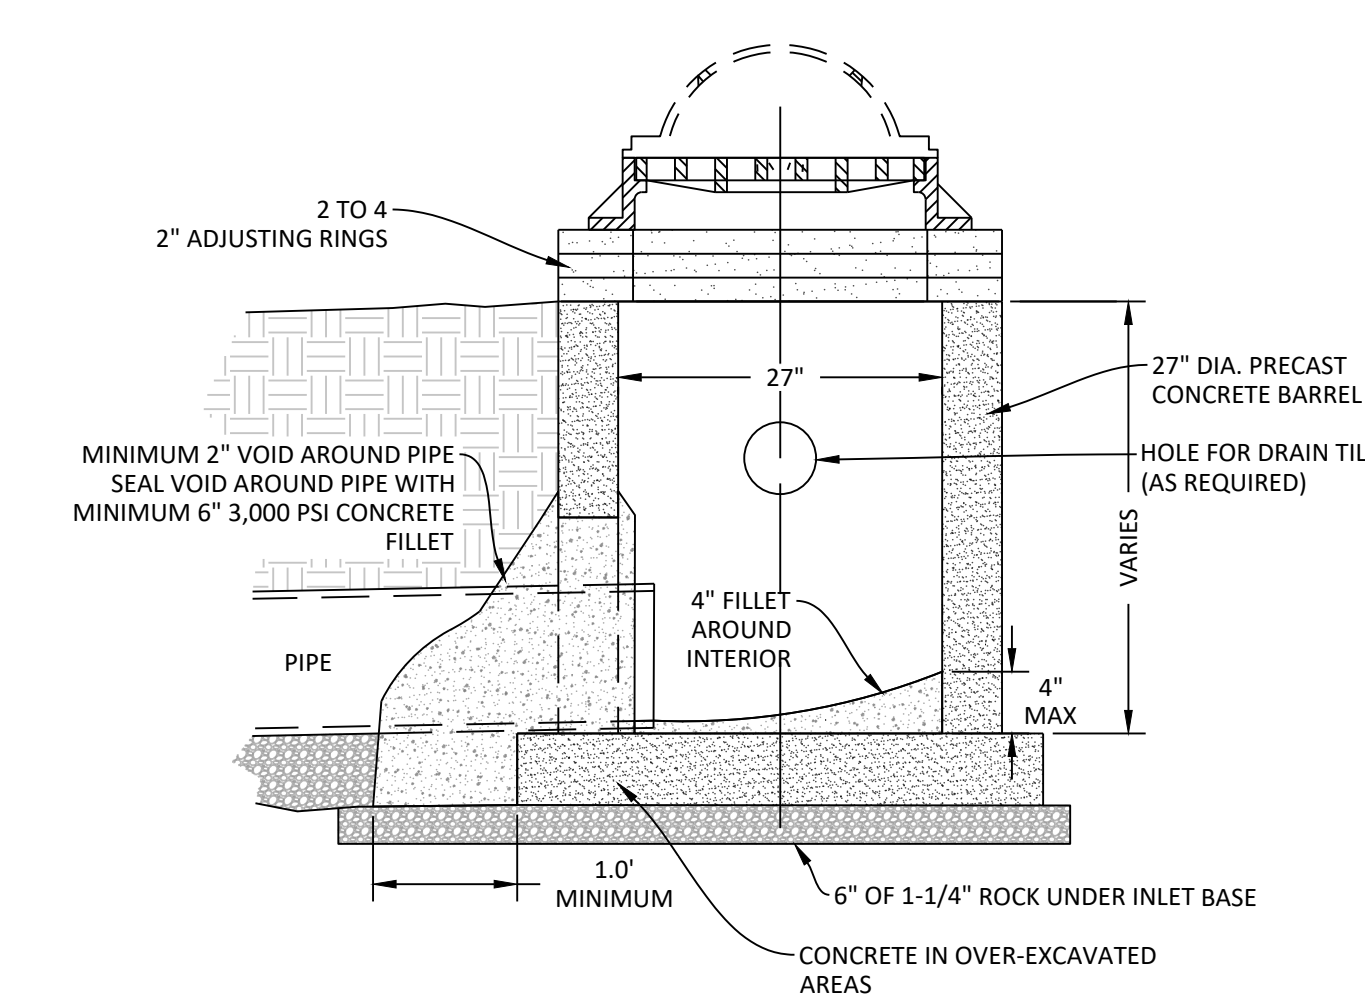

NOTES:
1. ALL ROUND MANHOLES SHALL MEET REQUIREMENTS OF ASTM C478.
2. LIFT HOLES TO BE MANUFACTURED WATER PROOF.
3. BACKFILL AROUND MANHOLE IN 1' MAX LIFTS TO 95% PER AASHTO T-99. USE EXISTING MATERIAL UNLESS NOTED OTHERWISE. MOISTURE SHALL BE -3% TO +6% OF OPTIMUM.
4. CASTING TYPE PER MANHOLE SCHEDULE.
5. CONTRACTOR MAY USE CONCRETE OR HDPE RINGS. IF HDPE RINGS ARE UTILIZED, SILICONE SEAL SHALL BE USED BETWEEN RINGS PER MANUFACTURER RECOMMENDATIONS. IF CONCRETE RINGS ARE USED, GROUT SHALL BE USED BETWEEN, OUTSIDE, AND INSIDE OF RINGS. GROUT SHALL MEET REQUIREMENTS OF ASTM C270.
6. REBAR AND WALL THICKNESS PER MANUFACTURER'S RECOMMENDATION.
7. IF MANHOLE IS USED AS A CURB & GUTTER INLET, THE MANHOLE SHALL HAVE HOLE AVAILABLE FOR CONNECTION TO CURB & GUTTER DRAIN TILE AS REQUIRED.
8. BUTYL RUBBER GASKET ON ALL JOINTS. GASKET SHALL MEET ASTM C443 REQUIREMENTS.
9. DOGHOUSE TO BE CONCRETED INSIDE AND OUT WITH 3,000 PSI CONCRETE. CONCRETE SHALL BE VIBRATED AND TROWEL FINISHED.
10. WHEN STRUCTURE IS INSTALLED IN THE CURB LINE, THE CONTRACTOR SHALL SET MANHOLE SO THAT BACK OF CASTING ALIGNS WITH CURB FLOW LINE.



11 27" PAVEMENT/YARD INLET
N.T.S.

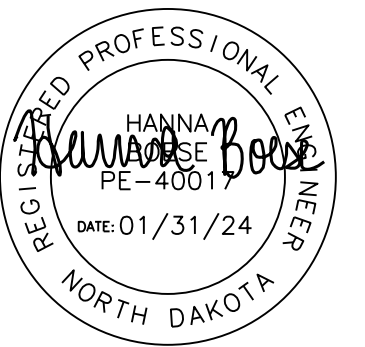


LANDSCAPING LEGEND		
SYMBOL	TYPE OF PLANT MATERIAL	PLANTING SIZE
	LARGE DECIDUOUS TREE / SHADE TREE	1.5 TO 3-INCH CALIPER - >30 FOOT MATURE HEIGHT
	LARGE UPRIGHT CONIFEROUS TREE	5/6 FOOT HEIGHT - >30 FOOT MATURE HEIGHT
	ORNAMENTAL DECIDUOUS TREE	1.5 TO 3-INCH CALIPER - 12 TO 30 FOOT MATURE HEIGHT
	SMALL UPRIGHT CONIFEROUS TREE	3 TO 4 FOOT HEIGHT - 12 TO 30 FOOT MATURE HEIGHT
	MATURE SHRUB PERENNIAL PLANTS	2 GALLON 1 GALLON 2 GALLON

LANDSCAPING REQUIREMENTS		
BUFFER YARD REQUIREMENTS		
CITY REQUIREMENTS	SITE REQUIREMENTS	PROVIDED
2 SHADE TREES AND 4 ORNAMENTAL TREES AND 3 LARGE UPRIGHT CONIFEROUS TREES AND 10 SMALL UPRIGHT CONIFEROUS TREES AND 10 SHRUBS	2 SHADE TREES AND 4 ORNAMENTAL TREES AND 3 LARGE UPRIGHT CONIFEROUS TREES AND 10 SMALL UPRIGHT CONIFEROUS TREES AND 10 SHRUBS	2 SHADE TREES AND 4 ORNAMENTAL TREES AND 3 LARGE UPRIGHT CONIFEROUS TREES AND 10 SMALL UPRIGHT CONIFEROUS TREES AND 10 SHRUBS
STREET TREE REQUIREMENTS		
CITY REQUIREMENTS	SITE REQUIREMENTS	PROVIDED
3 DECIDUOUS TREES PER 100 LF	(1,017 LF / 100) x 3 = 30.51 TREES	31 TREES
INTERIOR PARKING LOT LANDSCAPING REQUIREMENTS		
CITY REQUIREMENTS	SITE REQUIREMENTS	PROVIDED
10 SQ. FT. PER PARKING SPACE 1 SHADE TREE AND 3 SHRUBS PER 20 PARKING SPACES	220 STALLS x 10 SQ. FT. = 2,200 SQ. FT. & 11 SHADE TREES & 33 SHRUBS	2,223 SQ. FT. & 11 SHADE TREES & 33 SHRUBS
PERIMETER PARKING LOT LANDSCAPING REQUIREMENTS		
CITY REQUIREMENTS	SITE REQUIREMENTS	PROVIDED
10' LANDSCAPING WIDTH = 4 SHADE TREES OR ORNAMENTAL TREES AND 40 SHRUBS PER 100 LF	(1,002 LF / 100)*4 = 40 SHADE TREES, (1,002 LF / 100)*40 = 400 SHRUBS	40 SHADE TREES & 400 SHRUBS
20' LANDSCAPING WIDTH = 2 SHADE OR ORNAMENTAL TREES AND 10 SHRUBS PER 100 LF	(309 LF / 100)*2 = 6 SHADE TREES, (309 LF / 100)*10 = 30 SHRUBS	6 SHADE TREES, 30 SHRUBS


- LANDSCAPING NOTES:
1. AT THE TIME OF PLANTING TREES SHALL HAVE A MIN. OF 2" CALIPER TRUNK.
 2. ALL STREET TREES SHALL HAVE A MINIMUM 3' RADIUS MULCH RINGS INSTALLED AT THE TIME OF PLANTING. THIS SHALL NOT APPLY TO TREES WITHIN THE SITE.
 3. CONTRACTOR SHALL PROVIDE A 1 YEAR WARRANTY ON ALL LANDSCAPE MATERIAL TO INCLUDE WORKMANSHIP FOR INSTALLATION FROM DATE OF FINAL ACCEPTANCE.
 4. CONTRACTOR TO COORDINATE WITH MECHANICAL REGARDING LANDSCAPING IN AND AROUND AIR INTAKE OR EXHAUST UNITS.
 5. CONTRACTOR TO ALLOW 5' CLEARANCE FROM UNDERGROUND UTILITY PIPING TO PLANTINGS.
 6. ALL OTHER PLANTING / LANDSCAPE REQUIREMENTS PER FRANCHISE REQUIREMENTS.
 7. ALL TREES SHALL BE APPROVED BY CITY FORESTER.
 8. CONTRACTOR SHALL PROVIDE SAMPLE AND RECEIVE APPROVAL OF COLOR OF DARK GRAY Poured LONG EDGING FROM ARCHITECT PRIOR TO POURING.

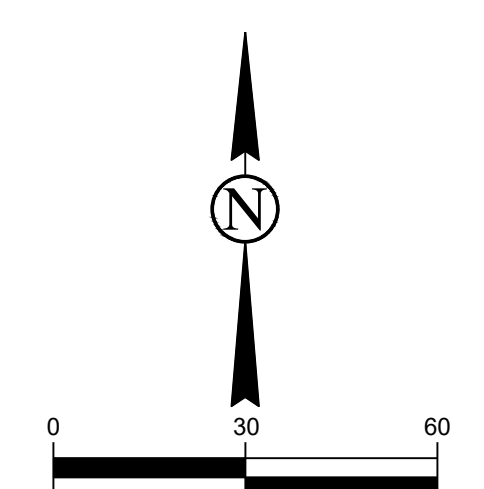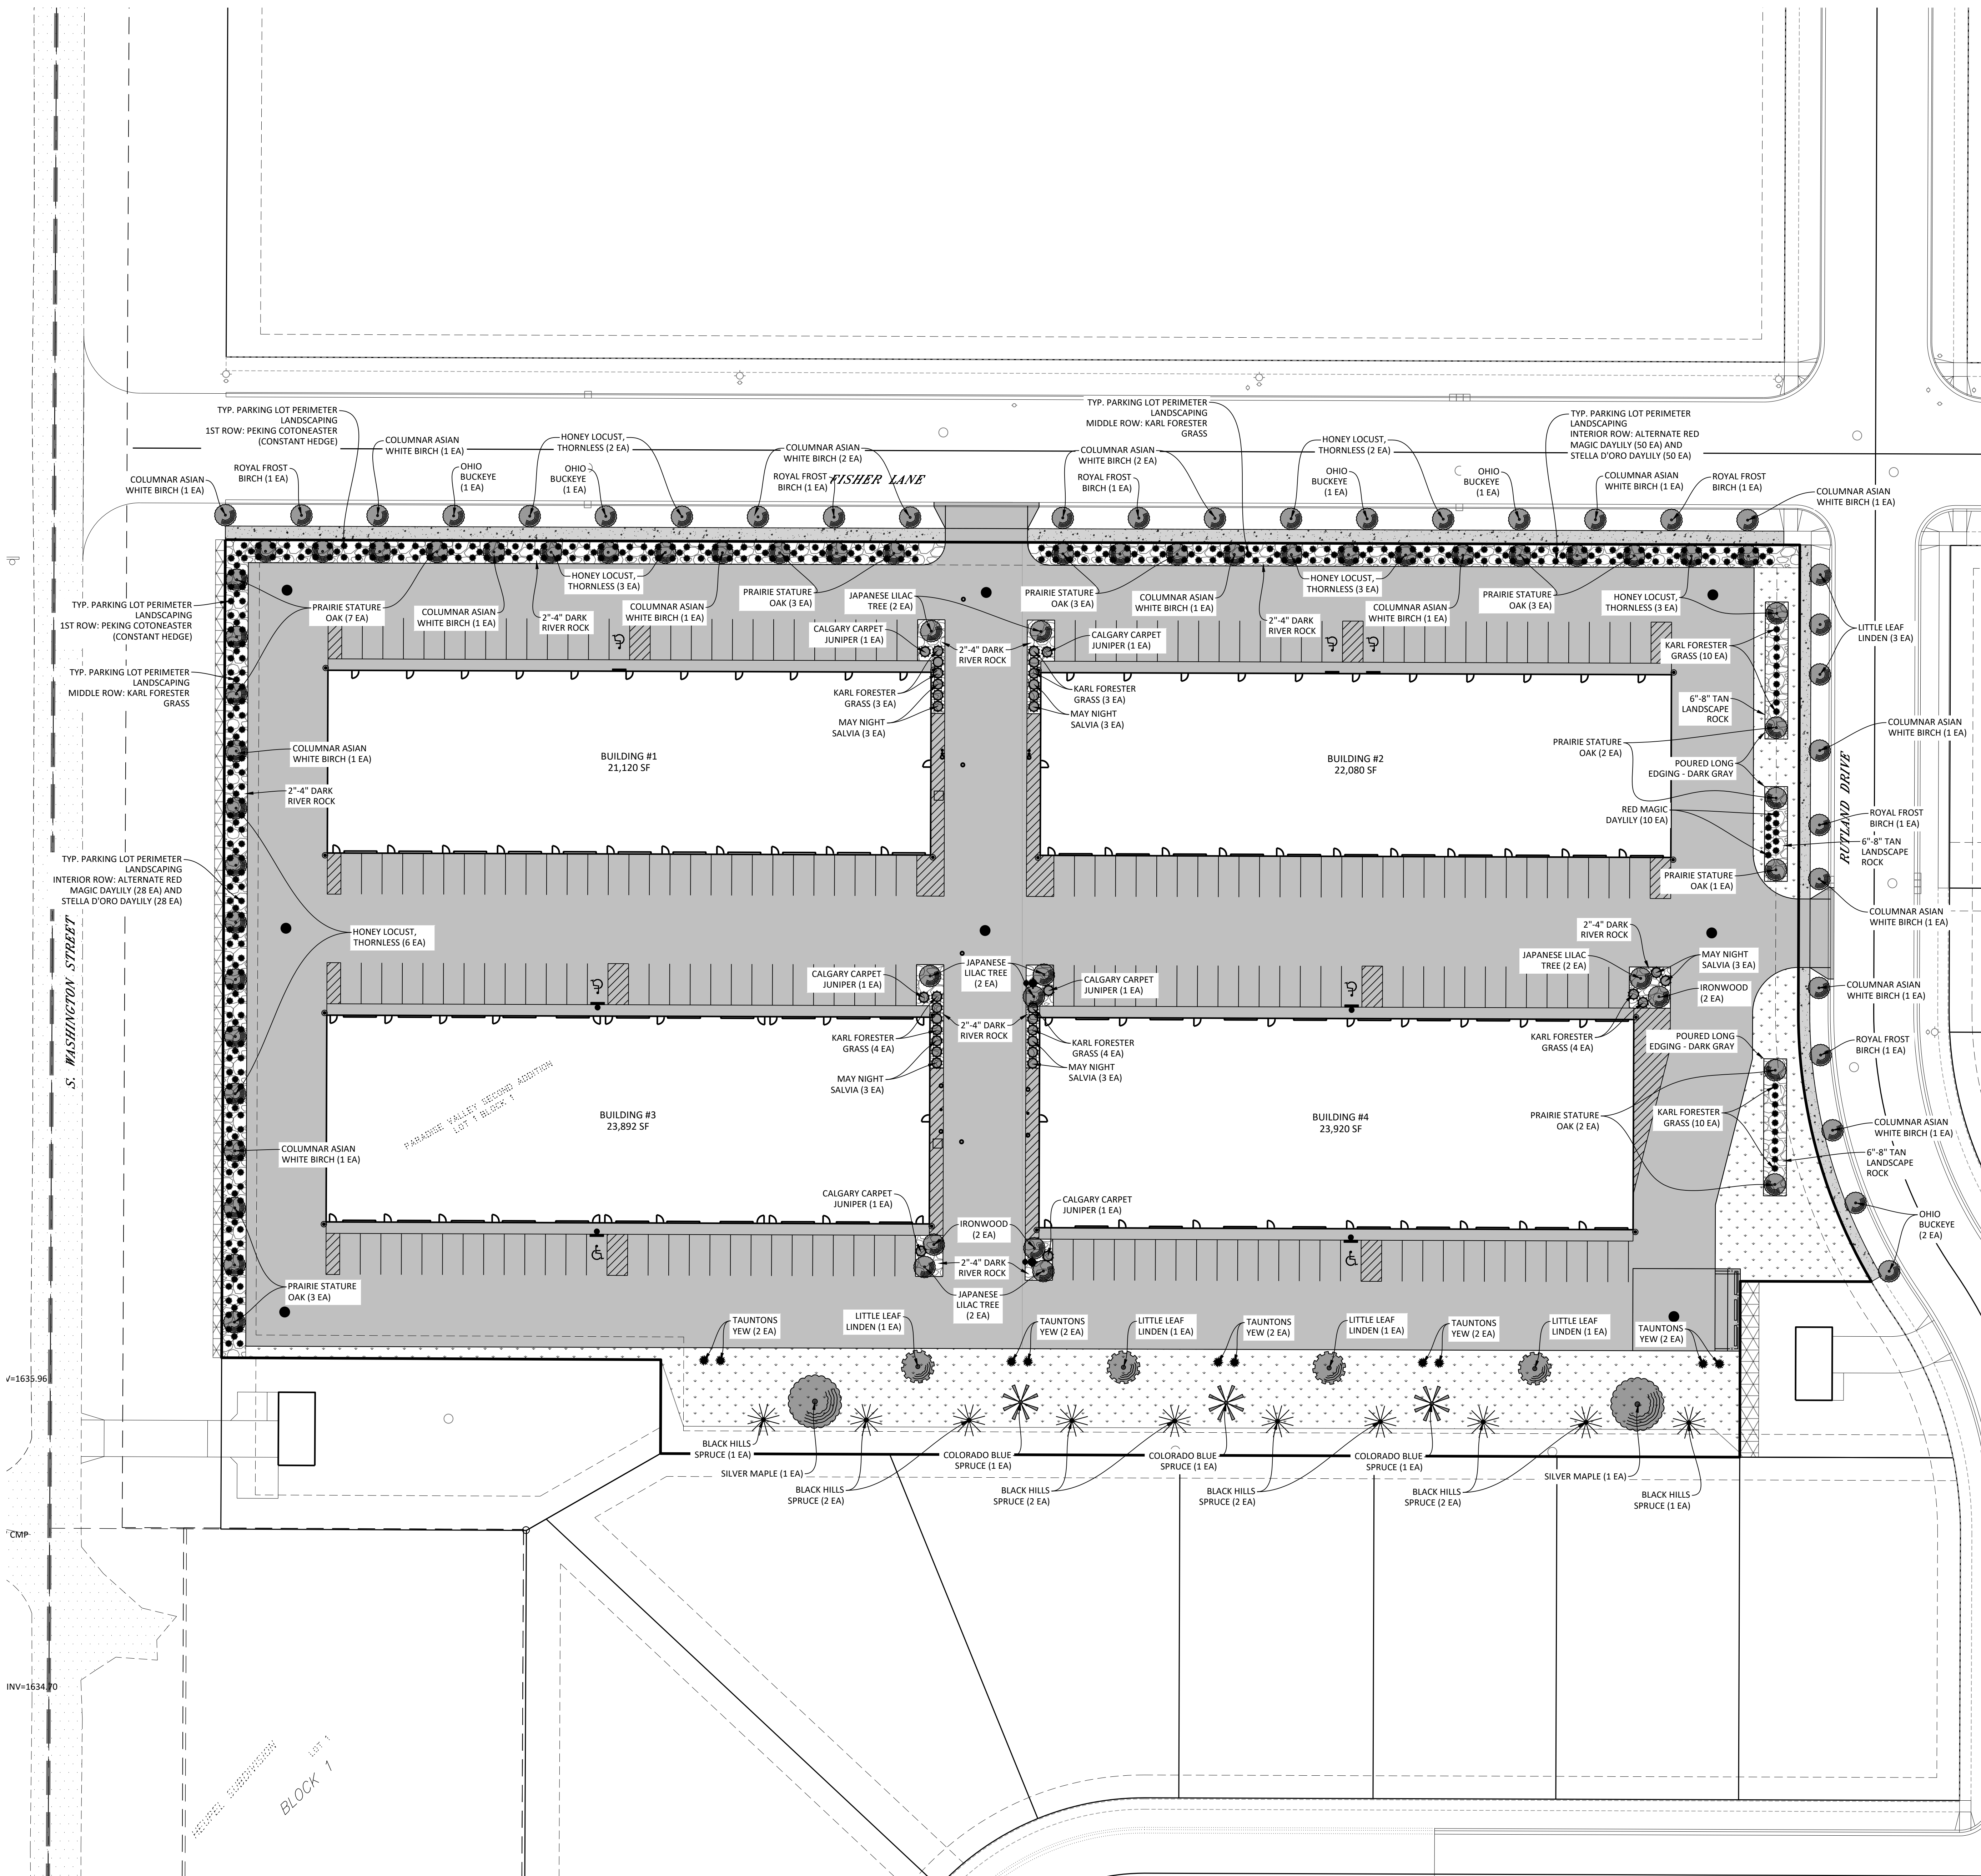

CALL BEFORE YOU DIG
NORTH DAKOTA
UTILITIES UNDERGROUND LOCATION SERVICE
1-800-795-0555

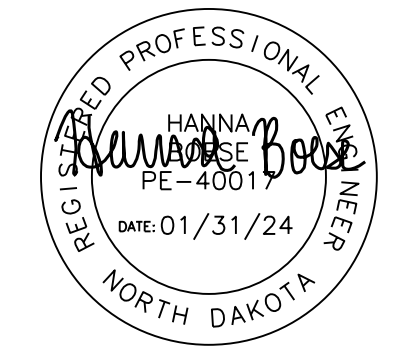

wild|crg
architecture | construction
200 2nd Avenue North | Suite 514
Fargo, North Dakota 58102
Phone 701 | 293 | 8106
wildcrg.com

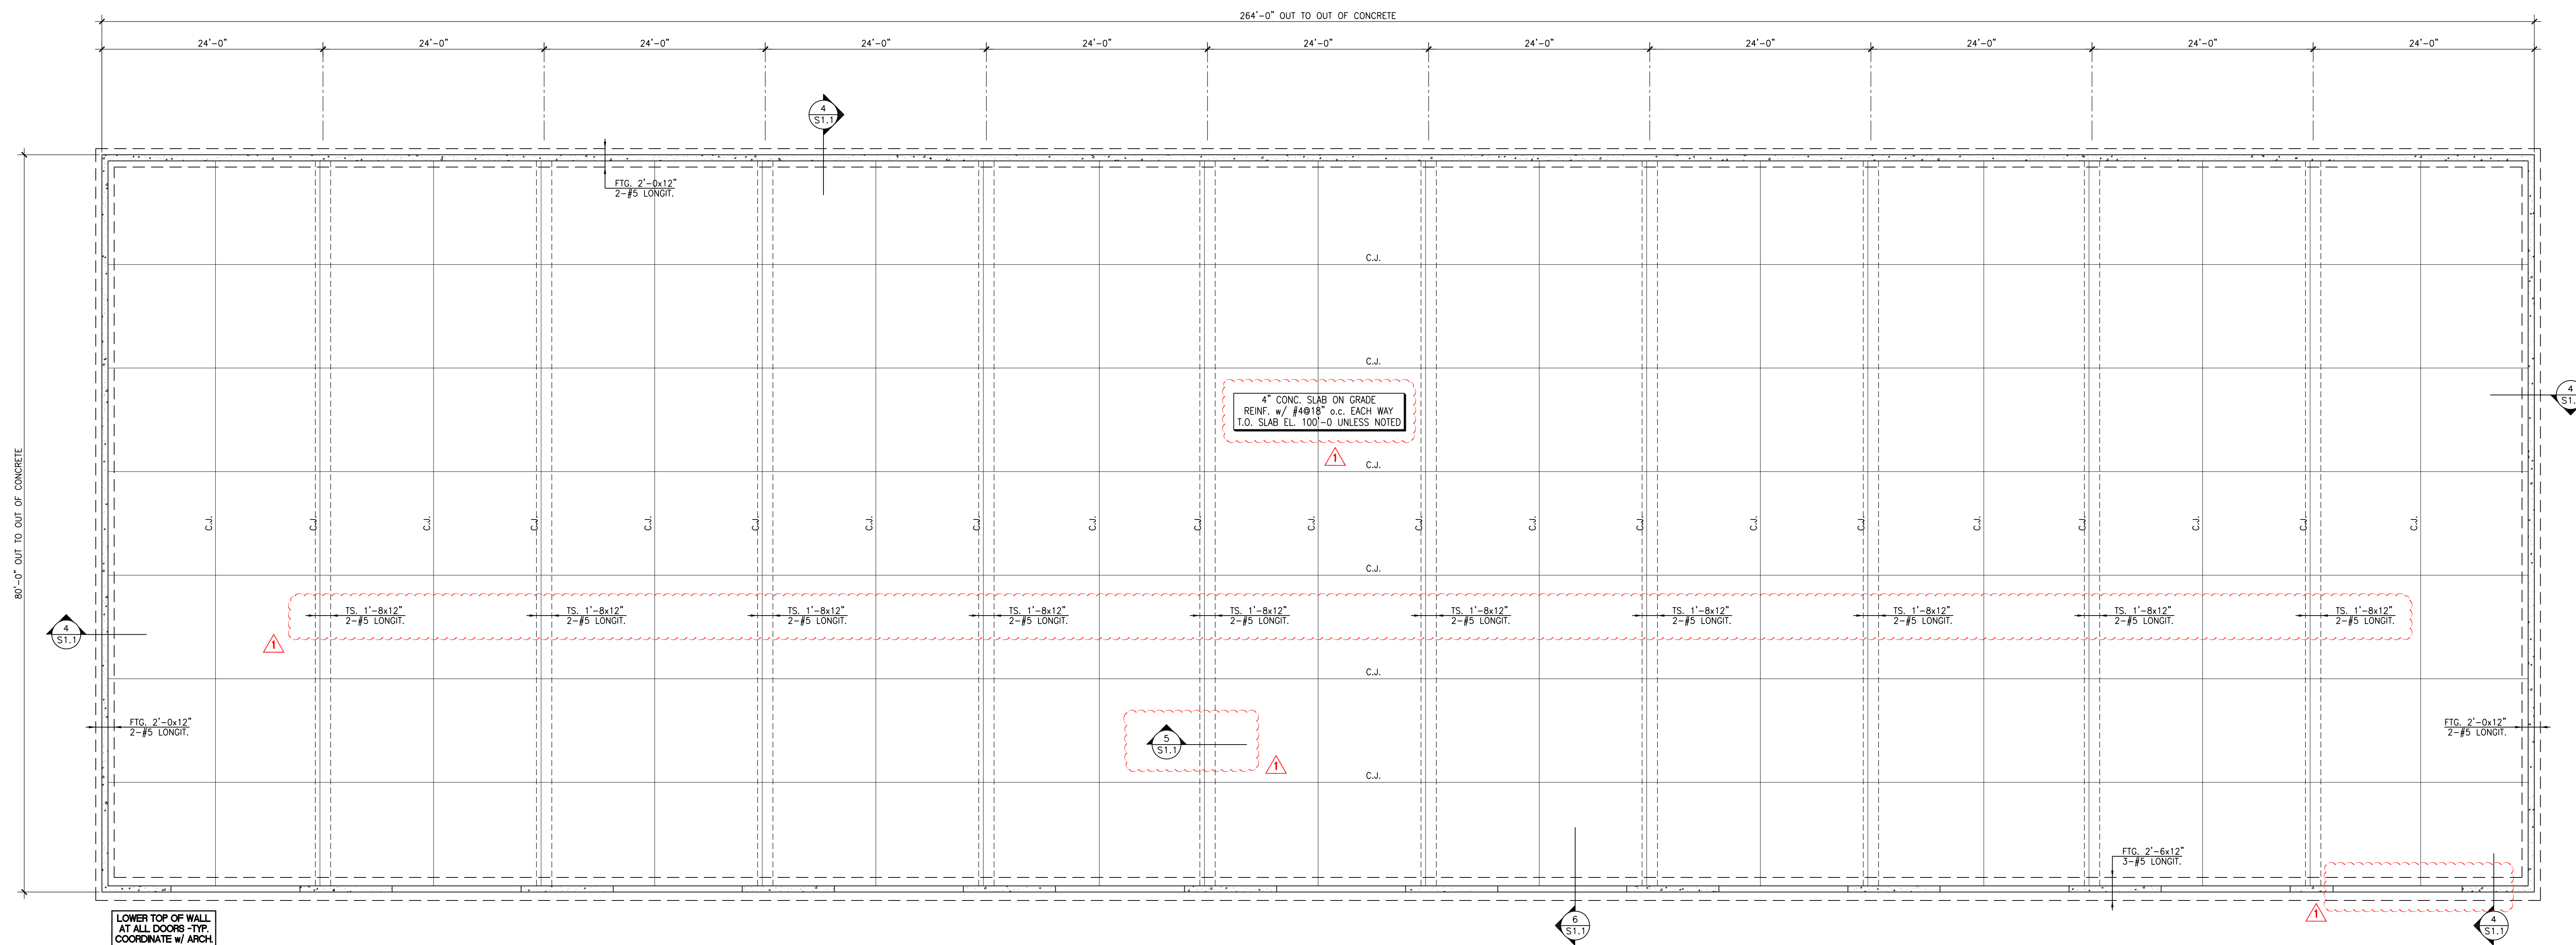







FOUNDATION PLAN

NOTE: 1). TOP OF FOOTING EL. = 96'-0" U.N.O.

SCALE: 1/8"=1'-0"

GENERAL STRUCTURAL NOTES

- Design Codes Used:
 - IBC 2021
 - ACI Concrete Code
 - AISC Code=ASD
- Design Loads:
 - Roof Snow Load: $P_s = 27 \text{ PSF} + \text{Drift (Balanced)}$
 Unbalanced snow load as per ASCE 7-16 Section 7
 - Wind Load: $V_{ult} = 115 \text{ MPH}$ Basic Wind Speed
 Risk Category = II
 Wind Exposure C
 Internal Pressure Coefficient ± 0.18
- Design Stresses Used:
 - Concrete:
 - Slabs on Grade: 4500 PSI @ 28 days
 - Footings and Foundation Walls: 3000 PSI @ 28 days
 - Exterior exposed: 4000 PSI @ 28 days (air entrained)
 - Structural Slabs: 4000 PSI @ 28 days
 - Masonry Strength: $f_m = 1500 \text{ PSI}$
 - Steel:
 - W Shapes: $F_y = 50 \text{ KSI}$ (ASTM A992)
 - Tubes: $F_y = 46 \text{ KSI}$ (ASTM A500 Grade B)
 - Angles, Channels, Bars: $F_y = 36 \text{ KSI}$ (ASTM A36)
 - Pipes: $F_y = 35 \text{ KSI}$ (ASTM A53)
 - Reinforcing Steel: 60 KSI (ASTM A615-60)
 - Soil Bearing Pressure: 1500 PSF (Assumed, Verify w/ Geotechnical Engineer's review of Excavation)
- CONCRETE COVERAGE for reinforcing shall be as follows:
 - Footings: 3 inches
 - Columns and Piers: 1 1/2 inches
 - Slabs on Grade: midheight for a single layer
 - Walls: 1 1/2 inches @ exterior, 3/4 inch @ interior
 - Structural Slabs: 3/4 inch unless noted
 PROVIDE BAR SUPPORTS AND SPACERS in accordance with the ACI Detailing Manual.
- REINFORCING STEEL to be bent and placed in accordance with ACI code. All splices to be 38 db for #6 bar or smaller, 48db for #7 bar and larger.
- FOOTINGS to rest on undisturbed soil or engineered backfill. It is recommended that the Soils Engineer inspect soil conditions prior to construction. All walls and piers to center on footing unless otherwise noted. All footing elevations are given to the top of footings.
- ALL FOUNDATION WALLS to be laterally supported before backfilling. Vertical construction joints to be keys.
- OPENINGS in concrete FOUNDATION WALLS shall be reinforced with 2-#5 bars each side, extending 2'-0" past the face of the opening unless otherwise noted.
- FOUNDATIONS SHALL BE BUILT from approved, fully dimensioned shop drawings coordinated with construction documents and field conditions. Foundation shop drawings shall consist of the anchor bolt setting plan, concrete mix design, and concrete reinforcing plan with wall & pier dimensions. All subsequent shop drawings shall be coordinated with approved foundation shop drawings.
- SHOP DRAWINGS
 - Submit electronic copies of the following shop drawings to the architect/engineer for review prior to fabrication.
 - CONCRETE REINFORCING and mix designs for each class of concrete.
 - The contractor shall review and accept full responsibility for dimensional correctness. All shop drawings must bear the approval stamp of the contractor (to include initials, date and disposition), prior to review by the Architect or Engineer. The Engineer will return all shop drawings, unreviewed, that do not bear the approval stamp of the contractor.
- PORTLAND CEMENT to be ASTM C150, Type 1 & 1A.
- CONCRETE to be in accordance with ACI 301. Maximum shale content shall not exceed 0.5% for exposed concrete.
- CONTROL AND CONSTRUCTION JOINTS to be located as shown on the plan or at contractors option - not to exceed 12'-0" o.c. verify with future slab.
- ROOF TRUSSES to be engineered by the fabricator under the supervision of a professional engineer. Shop drawings to be stamped by the professional engineer. All trusses to have roof sheathing, including areas with scabbed in wood framing above.
- ROOF TRUSSES shall be secured to wall plates with H25.7 Anchors by Simpson or equal at every truss.
- General Contractor shall provide all lateral roof bracing as required by truss plate institute manual "HB-91" or as required by the truss design.
- CARPENTRY
 - Wood Studs: MSR 1650J-1.5E
 - Beams: Hem Fir, SPF #2, or better
 - LVL's (Laminated Veneer Lumber): $F_b = 2600 \text{ psi}$
 - Glue-Laminated Beams & Columns: $F_b = 2400 \text{ psi}$ (24F-V8 or better)
- Refer to IBC table or MN Building Code for typical nailing not shown. Table 2304.10.2.
- Contractor Field Verify all new lintels in existing walls have the correct plate width.
- SEE MECHANICAL, ELECTRICAL & ARCHITECTURAL DRAWINGS for all openings and inserts not shown on the plan. All opening sizes and locations to be verified with mechanical and electrical contractors.
- CONTRACTOR VERIFY all dimensions with Architectural Plan.

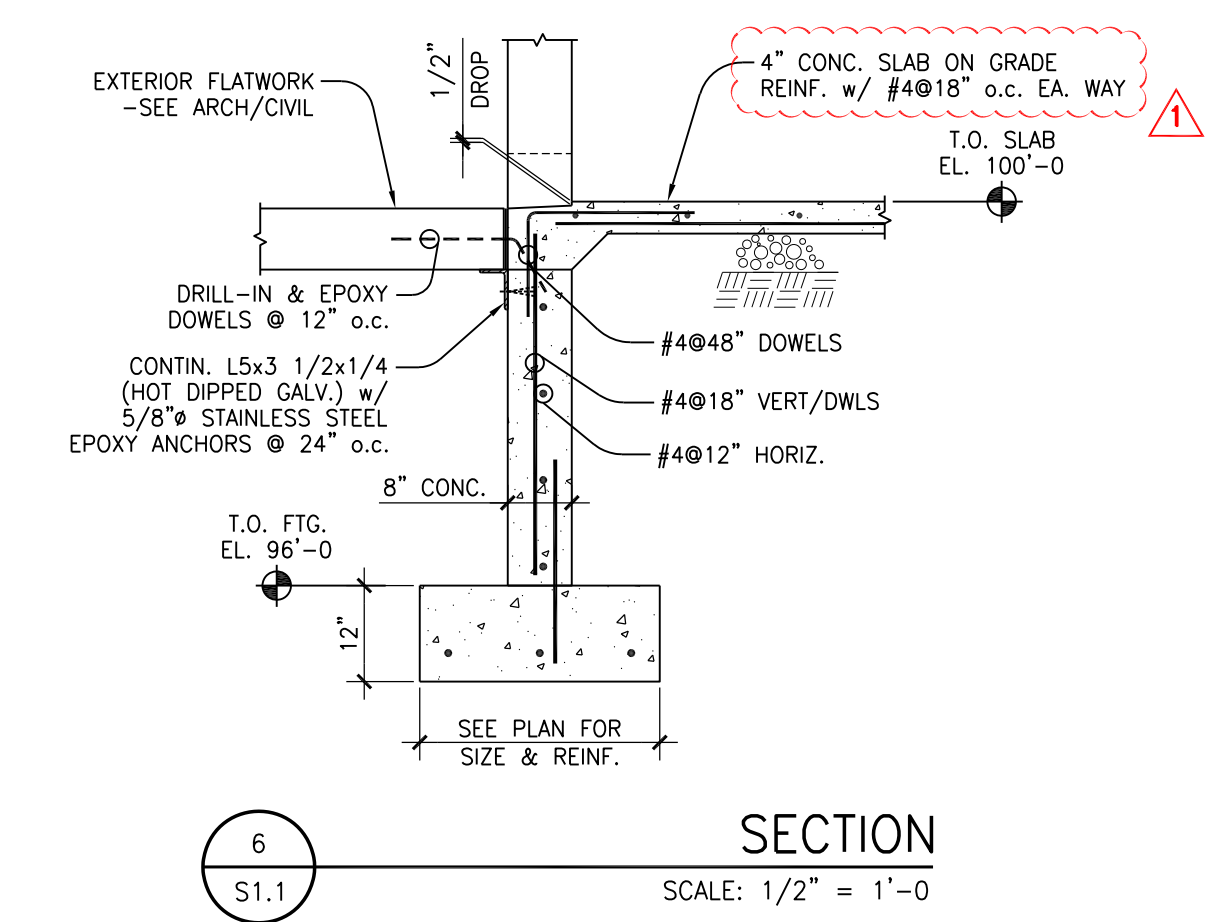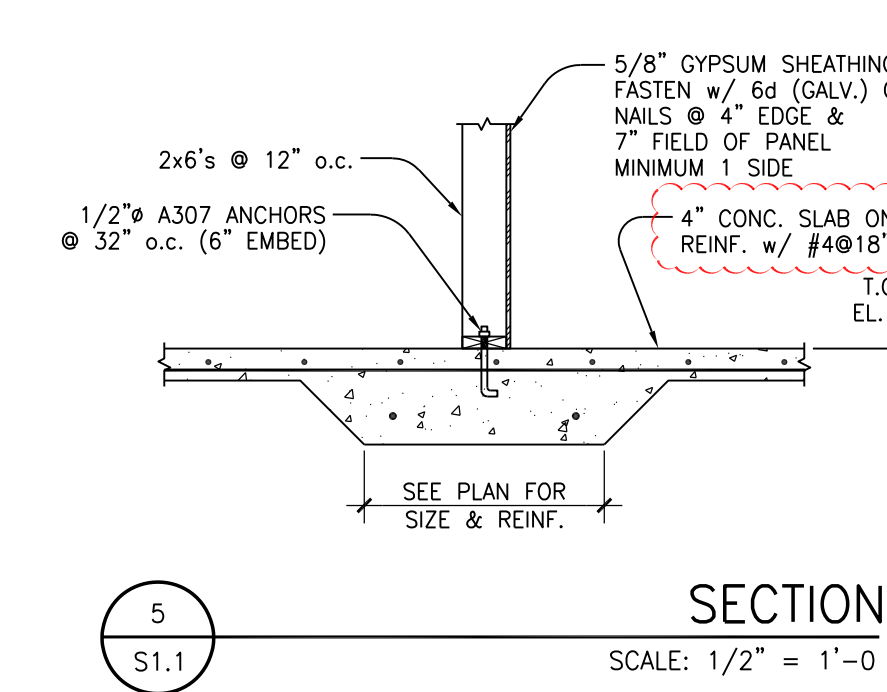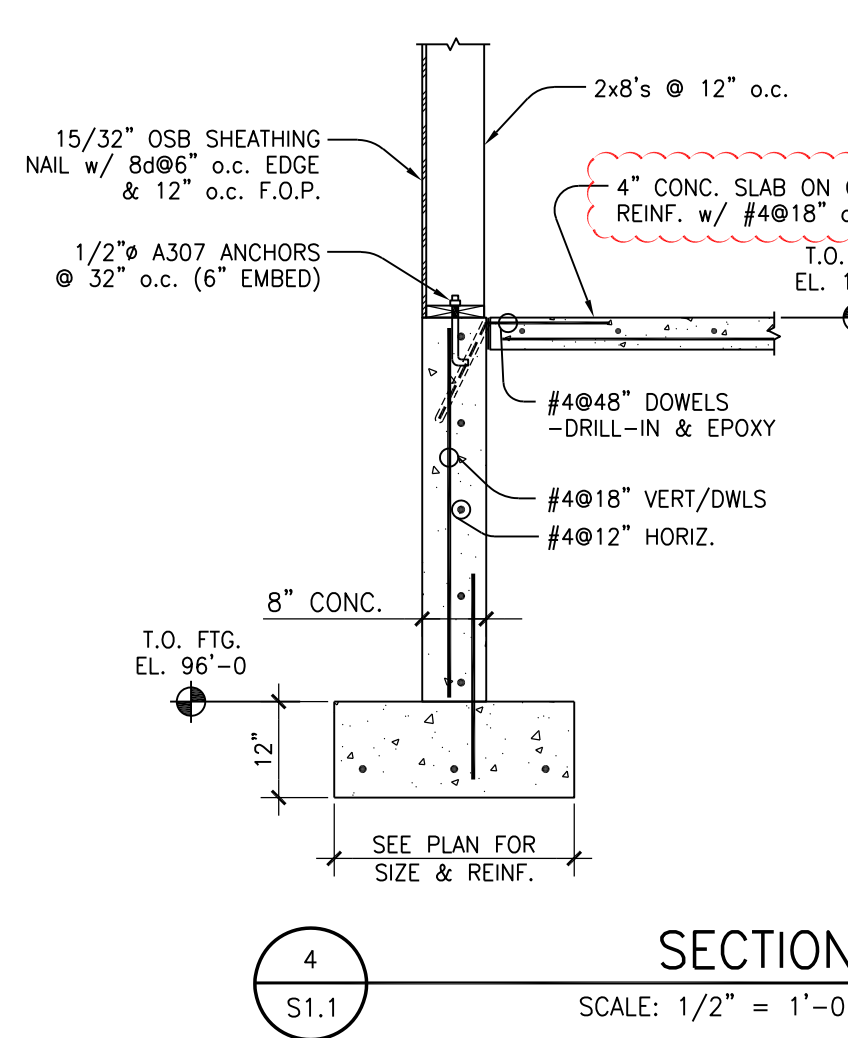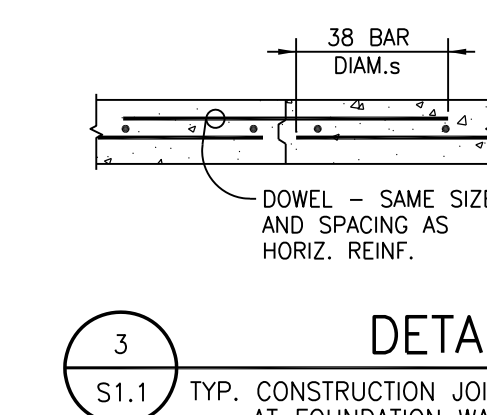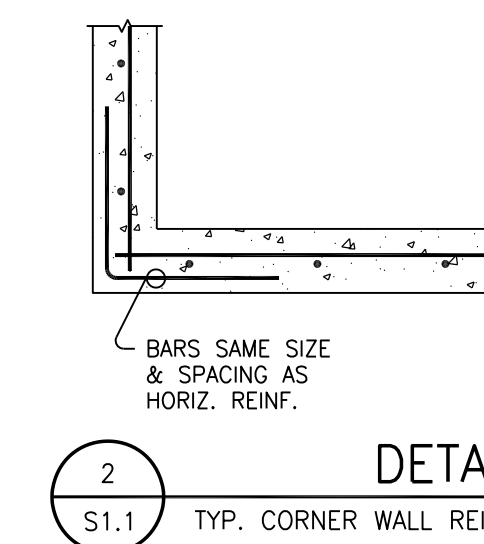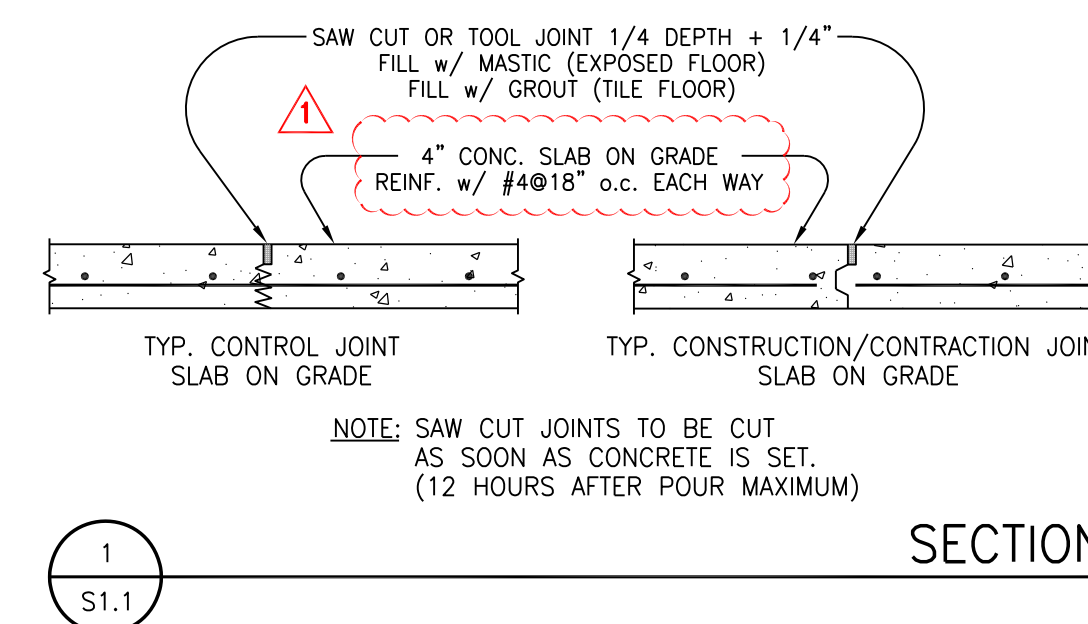

ADDENDUM #1
12/31/2024


REGISTERED PROFESSIONAL ENGINEER
STEVEN S. VONDAL
PE - 6694
DATE: 12/31/24

SOLIER & LARSON
ENGINEERING
CONSULTING STRUCTURAL ENGINEERS
3330 FIECHTNER DRIVE, SUITE 208
FARGO, NORTH DAKOTA 58103
TELEPHONE (701) 235-5293 FAX (701) 235-5894

wild | crg
architecture | construction

500 2nd Avenue North | Suite 514
Fargo, North Dakota 58102
Phone 701 | 293 | 8106
wildcrg.com

Foundation Plan
General Structural Notes
Sections & Details

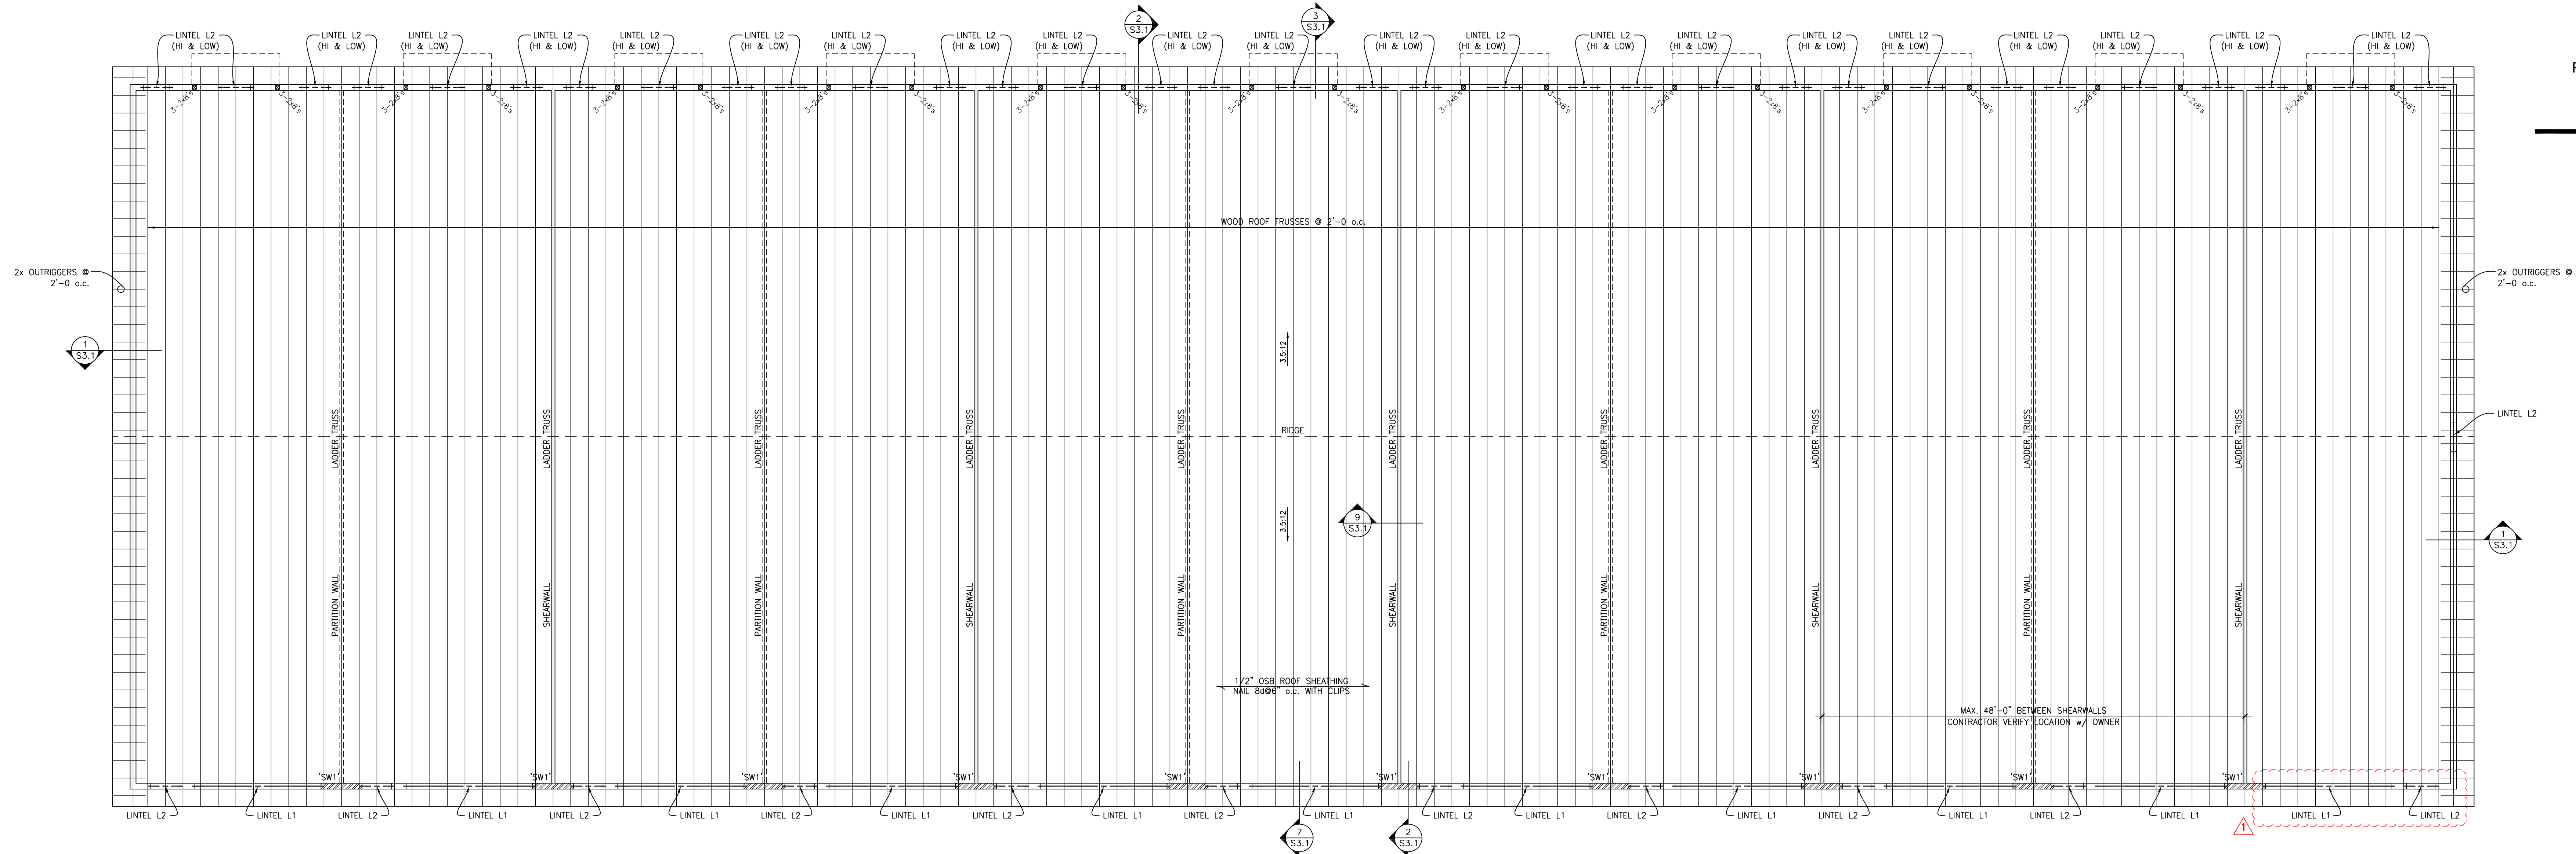


ROOF FRAMING PLAN


SCALE: 1/8"=1'-0"

LINTEL SCHEDULE			
MARK	LINTEL	R.O.	REMARKS
L1	4 - 1 3/4" x 14" LVL's @ TOP OF WALL 4 - 2x6's @ TOP OF OPENING	14'-0"	LVL's : 3 TRIMMERS/2 KING POSTS OR SAWN: 3 TRIMMERS/3 KING POSTS
L2	4 - 2x8's	3'-0" TO 3'-4"	1 TRIMMER/3 KING POSTS


NOTE: 1). VERIFY ALL LINTEL OPENING WIDTHS, ELEVATIONS, AND LOCATIONS WITH THE ARCHITECTURAL PLANS.
2). HIGH/LOW LINTEL - COORDINATE WITH ARCHITECTURAL PLANS.

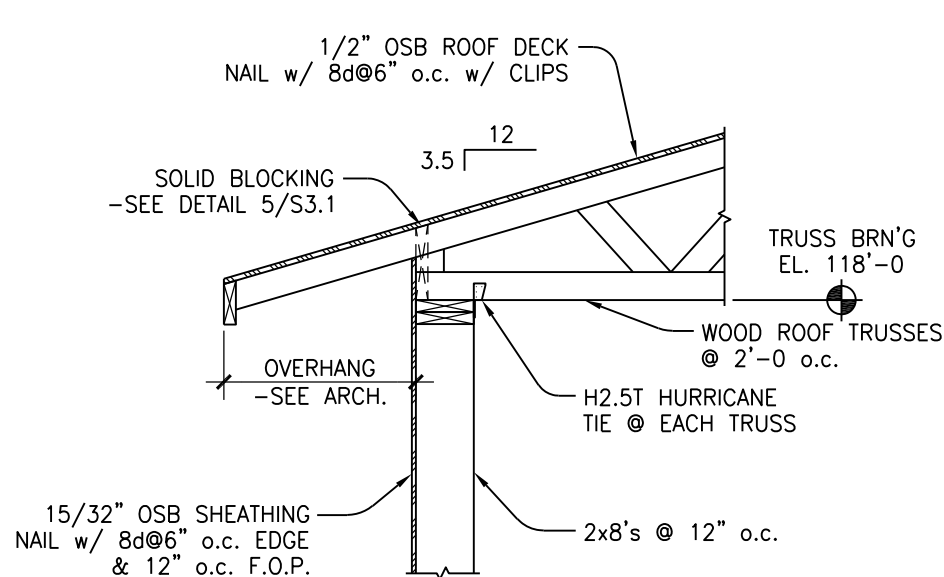

SECTION 1
SCALE: 1/2" = 1'-0"

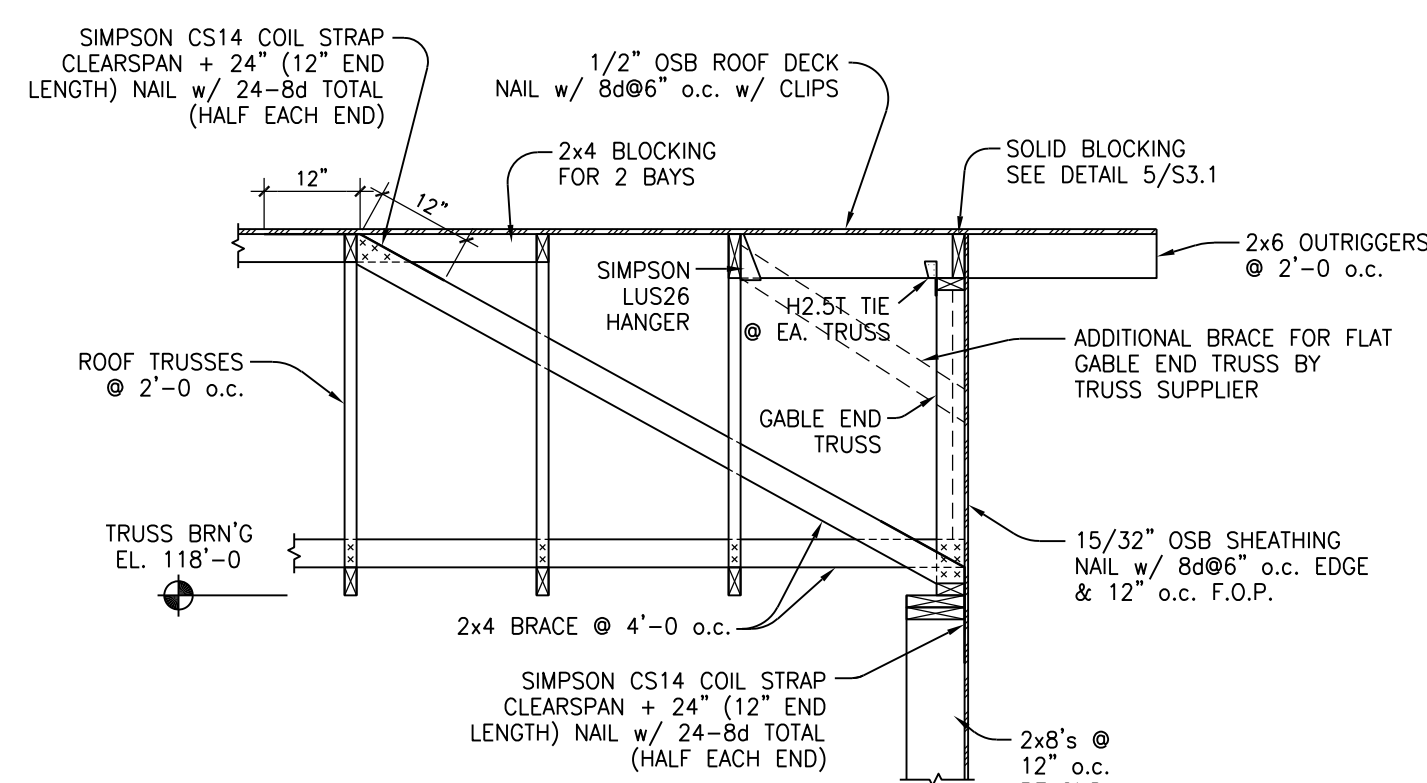


SECTION 2
SCALE: 1/2" = 1'-0"

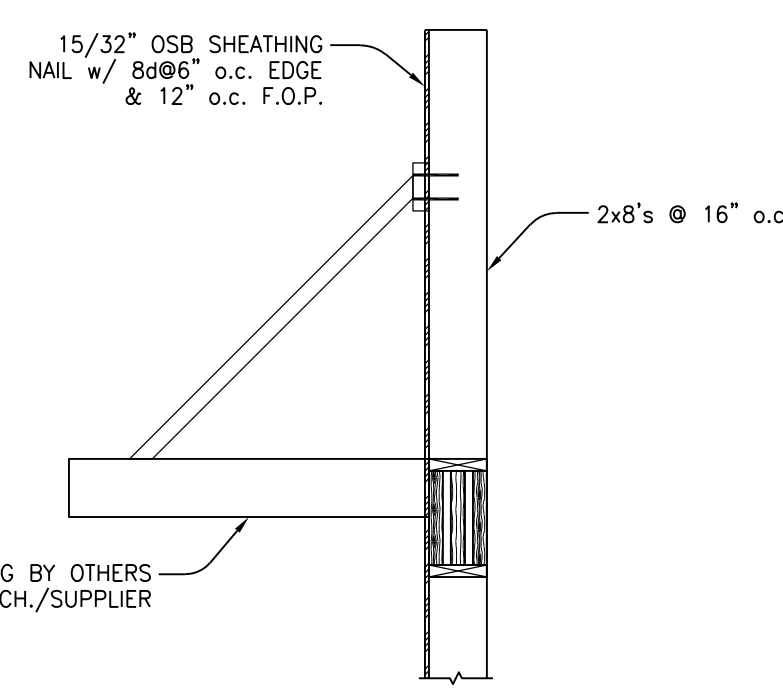


SECTION 3
SCALE: 1/2" = 1'-0"


** NOT USED **

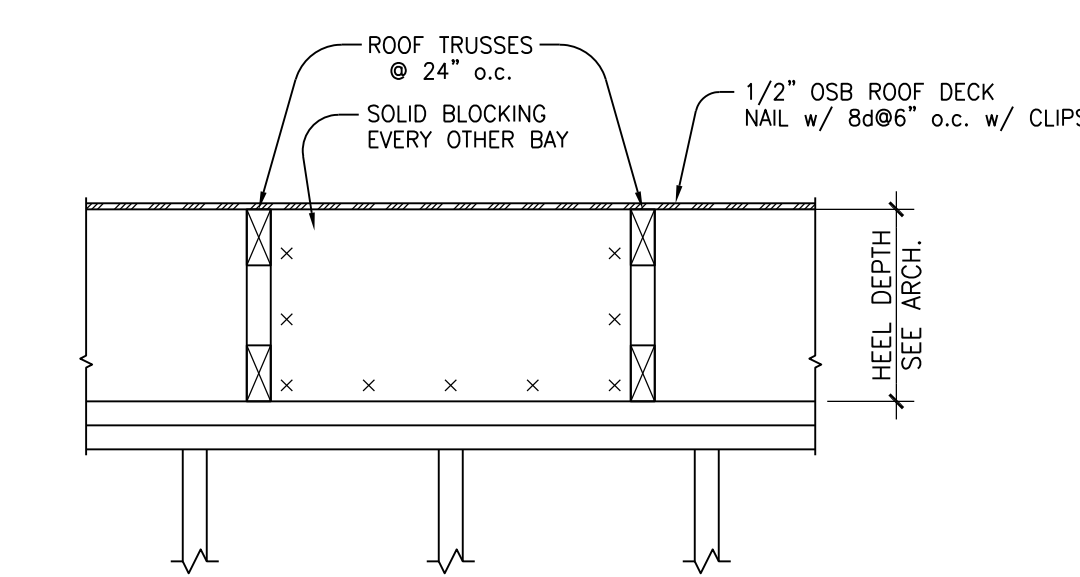


SECTION 5
SCALE: 1" = 1'-0"

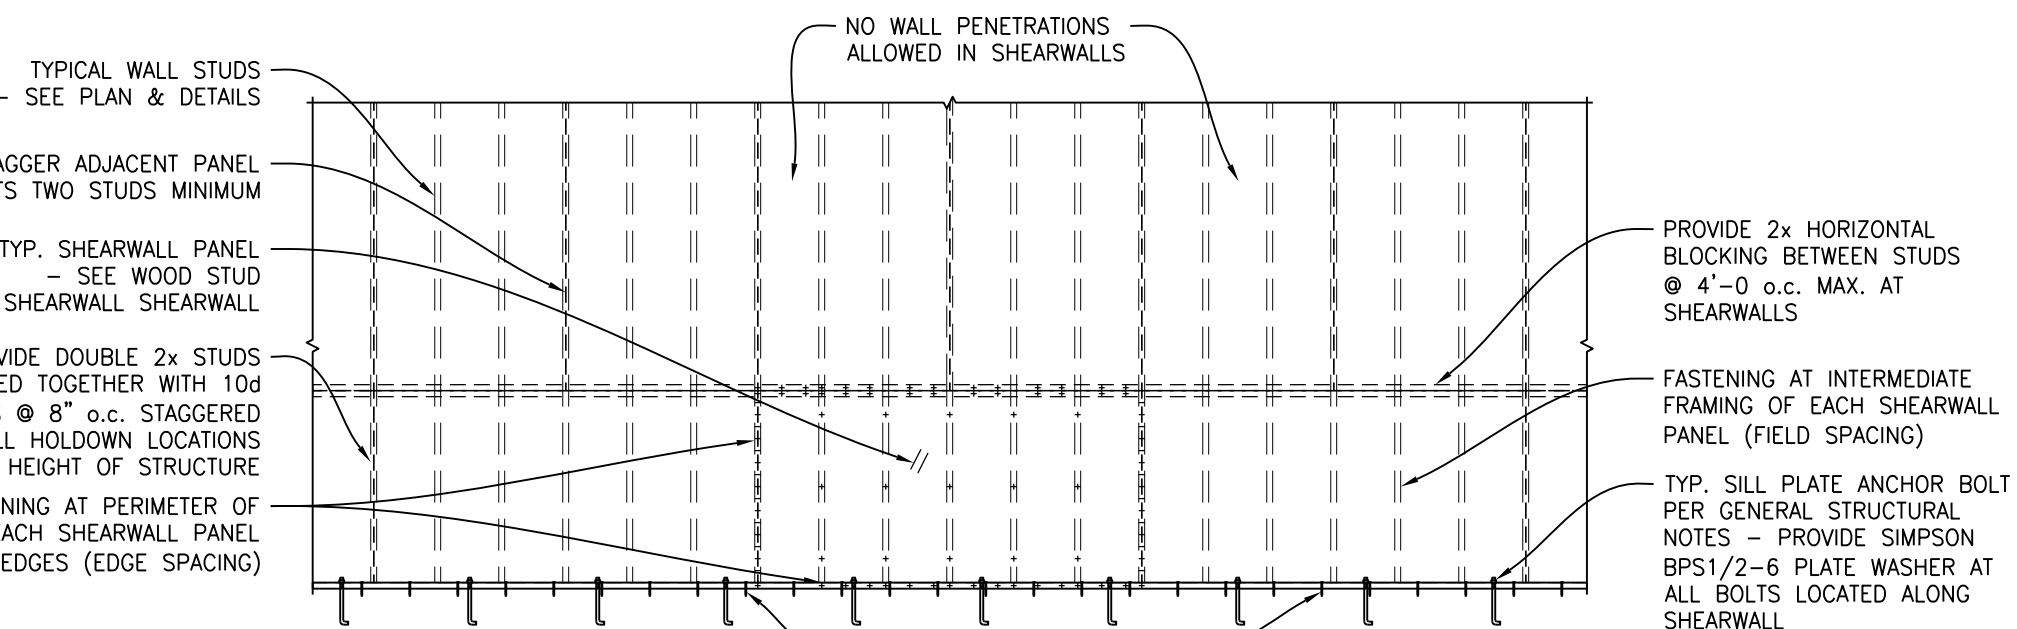


SECTION 6
SCALE: 1/4" = 1'-0"

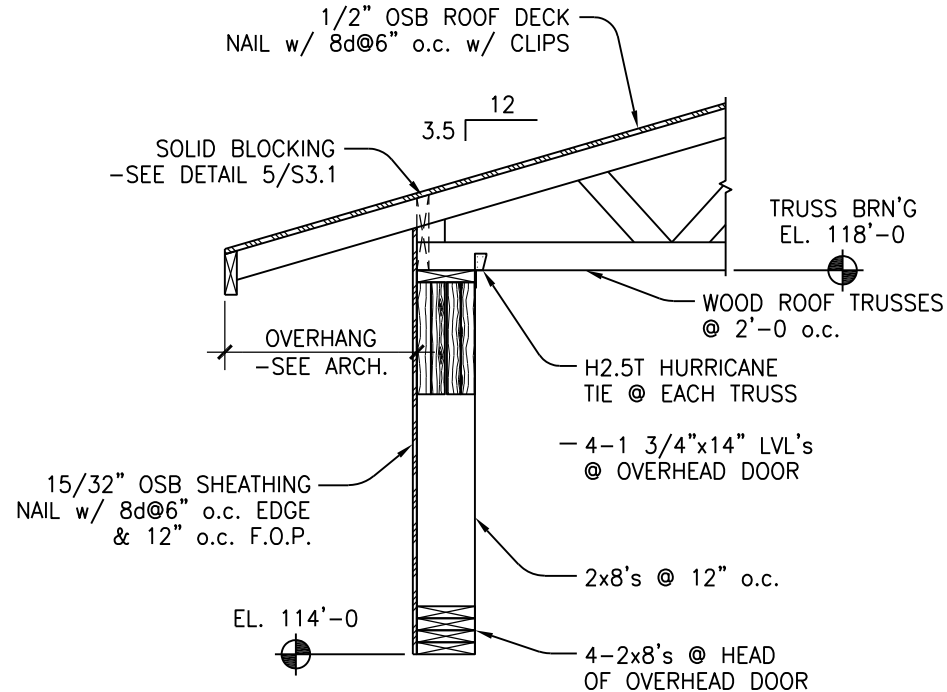



SECTION 7
SCALE: 1/2" = 1'-0"

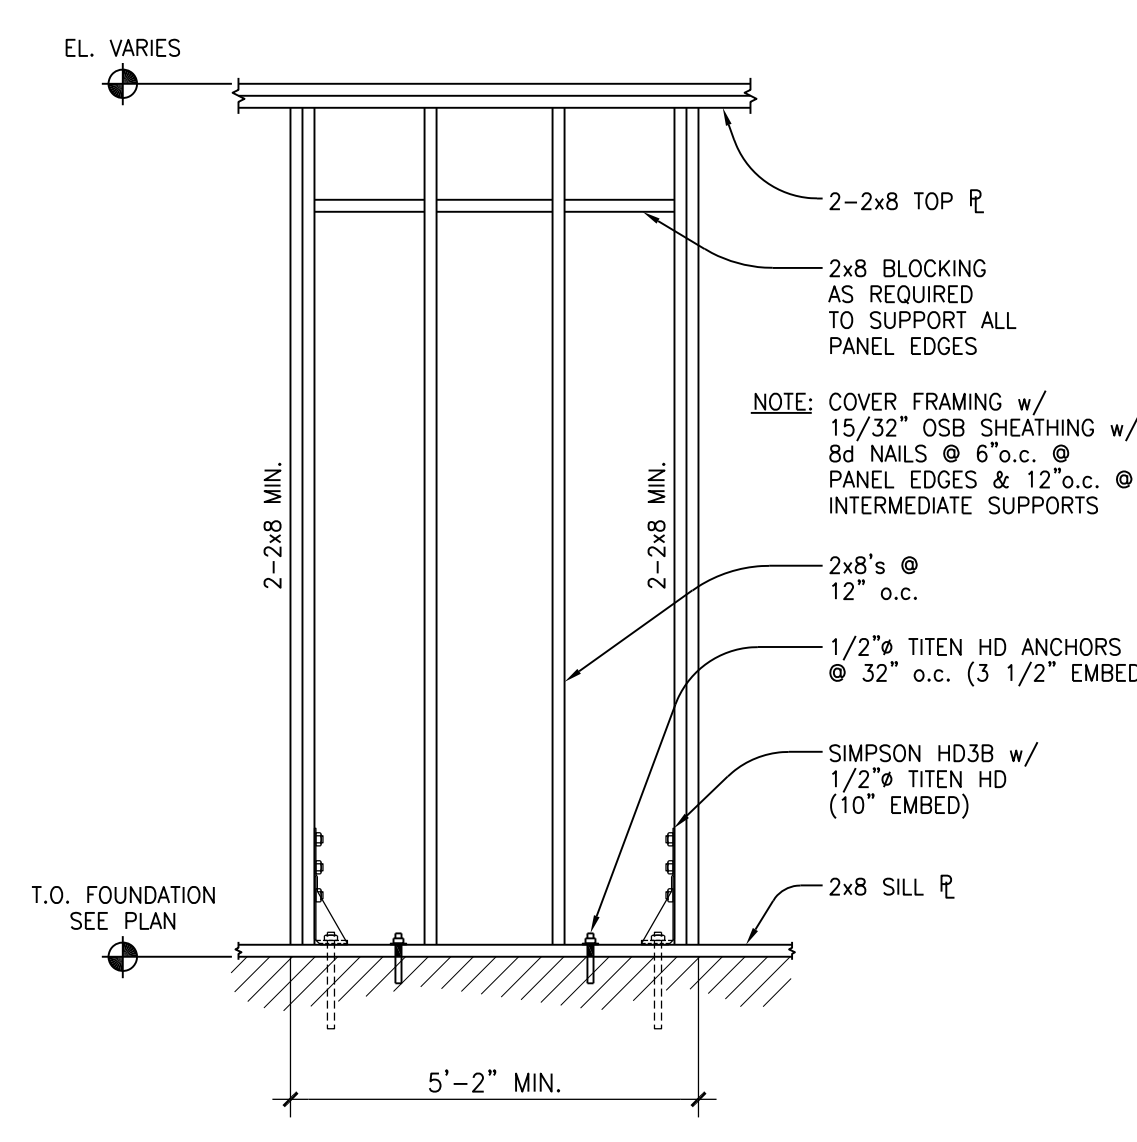

SECTION 8
SCALE: 1/2" = 1'-0"

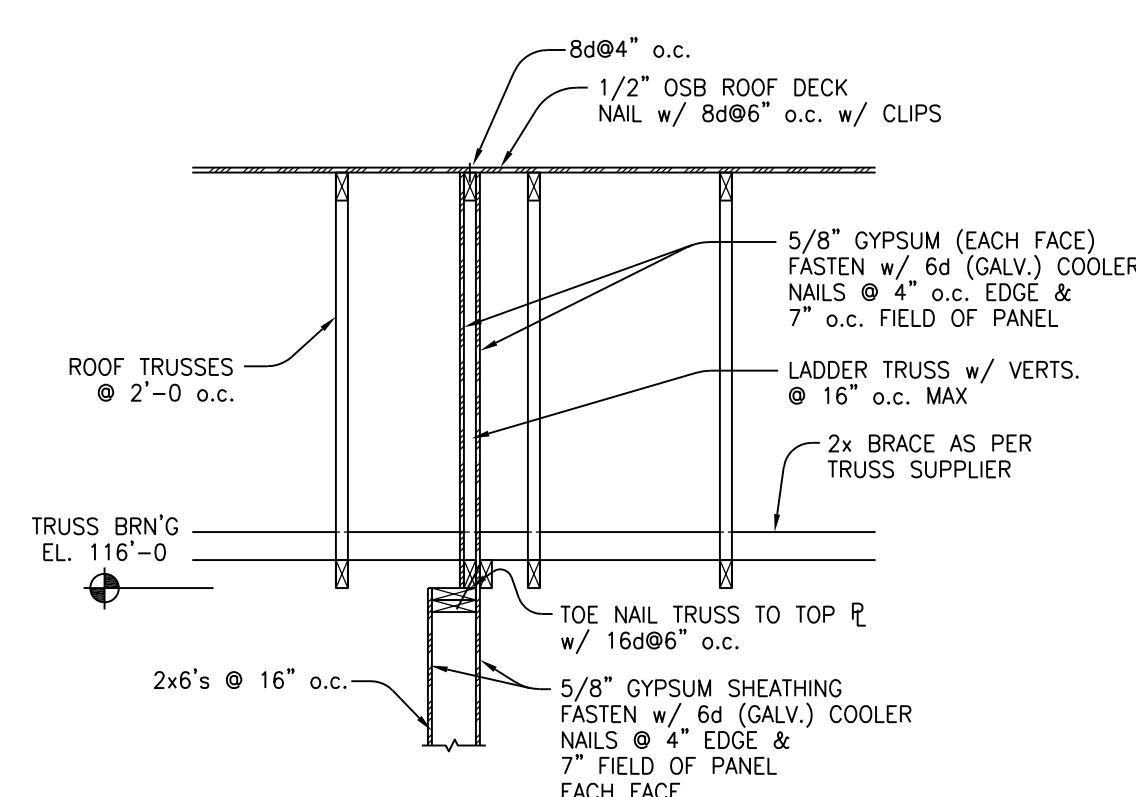

SECTION 9
SCALE: 1/2" = 1'-0"

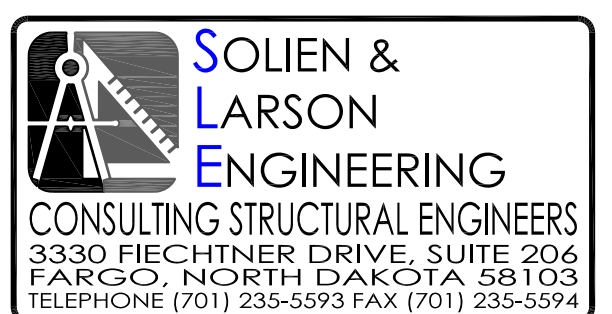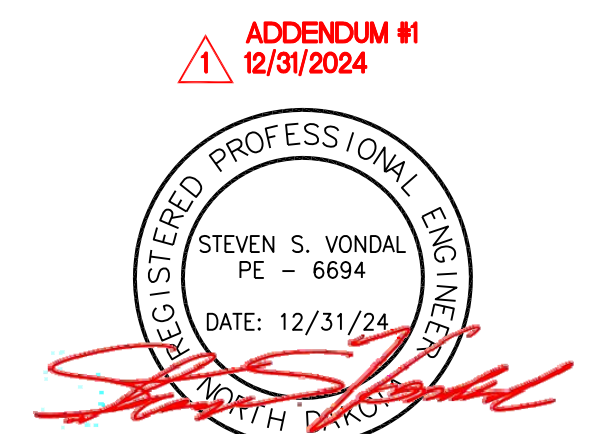


Roof Framing Plan
Sections & Details

Floor Plan General Notes

1. Rough carpentry contractor to provide & install all wood backing/blocking throughout.
2. Contractor to field verify all dimensions shown herein and alert Construction Manager of discrepancies.
3. All contractors to visit site to verify scope of work.
4. All walls to be framed, insulated, & sheathed to structure/structural deck above unless otherwise noted. See Wall Types & details for additional information.
5. Refer to Structural drawings for all shear wall locations.
6. All GWB to be painted SW 7667 (Zircon) with orange peel texture. Provide Level 3 finish at all GWB.
7. All products are basis of design UNO. Submit alternates to be approved by Owner/ Arch.

Floor Plan Keynotes


- 100 amp panel at Utility 100.
- 200 amp panel at each tenant space.
- Access hatch in shop ceiling to vented attic. To be framed in drywall with insulated drywall panel - See Detail 8/A4.1.
- Reinforced concrete slab to be poured at Utility 100. Reinforcement #4 bar 1'-6" on center each way - See Structural
- Designated area for building services/equipment. Wall and ground mounted - See Civil
- Reinforced concrete slab - See Structural. Allow for overhead door to close and seal properly to concrete slab.
- Steel bollard - See detail 2/A3.0 - Located 1'-0" off each side of the building (Qty. 4).
- Install exterior door to seal to foundation wall.
- Pre-finished metal canopy by Owner installed by framing contractor - Refer to Detail 5/A4.1.
- GWB at walls and ceilings to be Level 1 finish only - to get desired rating. No paint or mud.

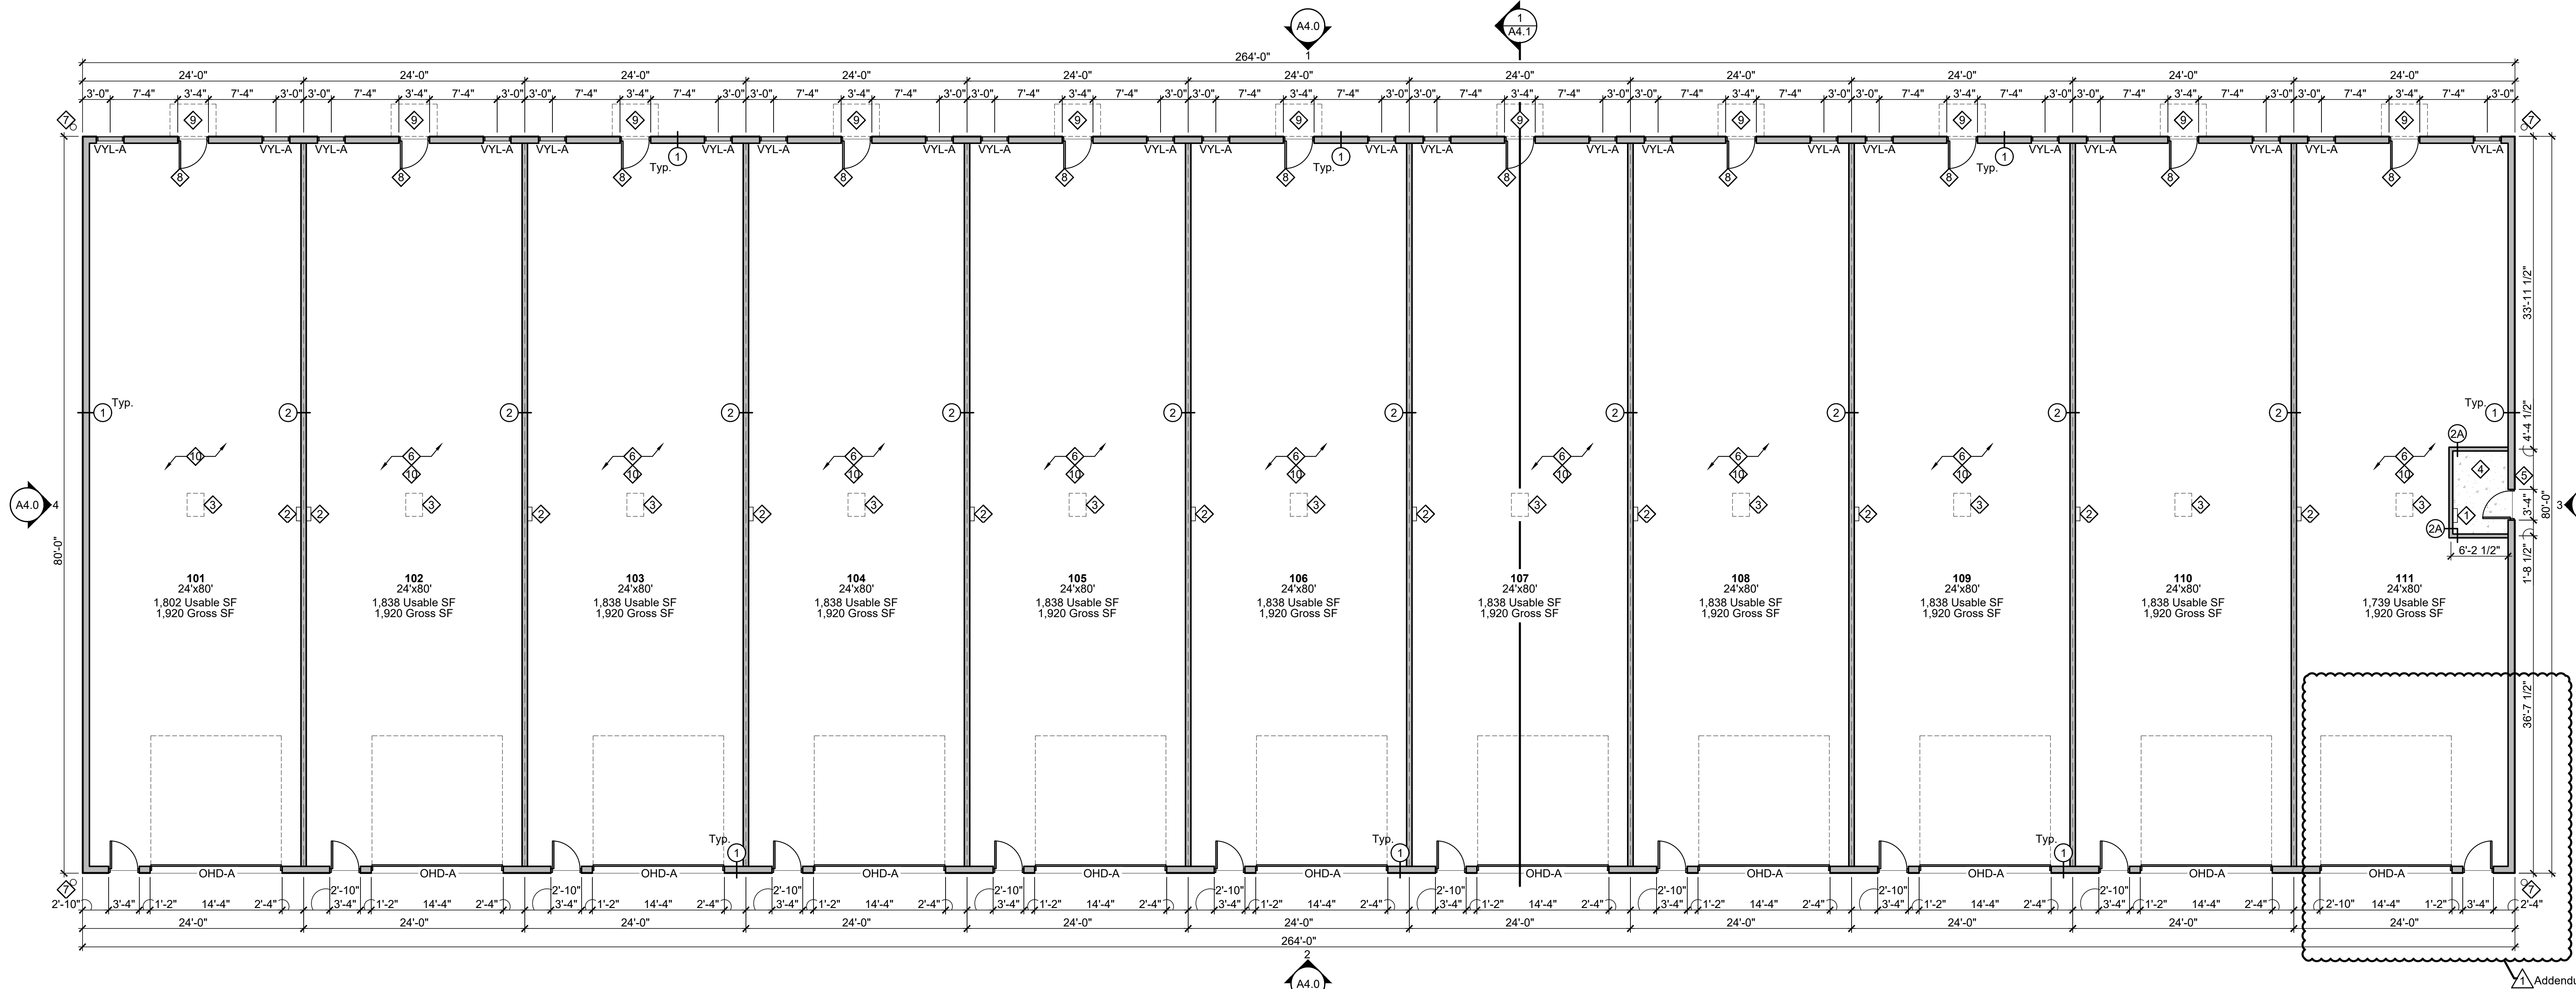

1 Floor Plan
1/8" = 1'-0"

11 Units
Total Gross: 21,120 SF


ADA Mounting Heights

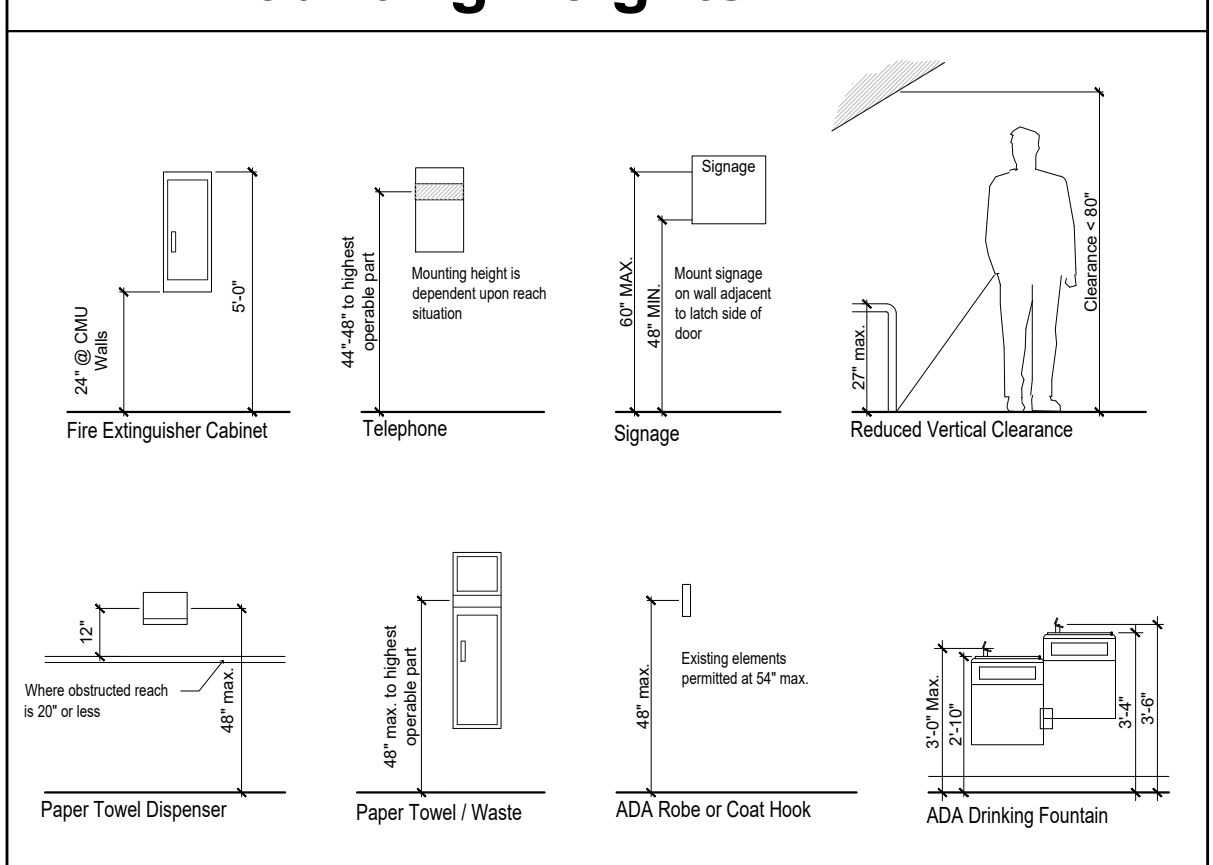

Planning and Zoning

Conditional CG - Conditional Heavy Commercial	
Information	See Civil Drawings
City Code Reference	Title 14 and Ordinance no. 6516
Lot Size	266,731
Building Size	21,120 sq ft (Building 1 of 4)
Zone	Conditional GC - Conditional Heavy Commercial
Maximum Building Coverage	80%
Maximum Lot Impervious Area	85%
Landscape Buffer	20' Along South and East property lines
Front Yard Setback	15'
Interior Yard Setback	0' as long as building is 2 stories or less
Street Side Setback	0' as long as building is 2 stories or less
Rear Yard Setback	10'
Building Height Limit	3 Stories or 50'
Parking Requirements for Development	
Total Development Size	91,012 sq ft
Parking Calc Factor (Business)	1 Stall per 360 sq ft - 220
On Street Parking	48 Stalls Allowed based on Ordinance and Layout
Number of Stalls Required	253
Total Parking Provided	268


Key Plan

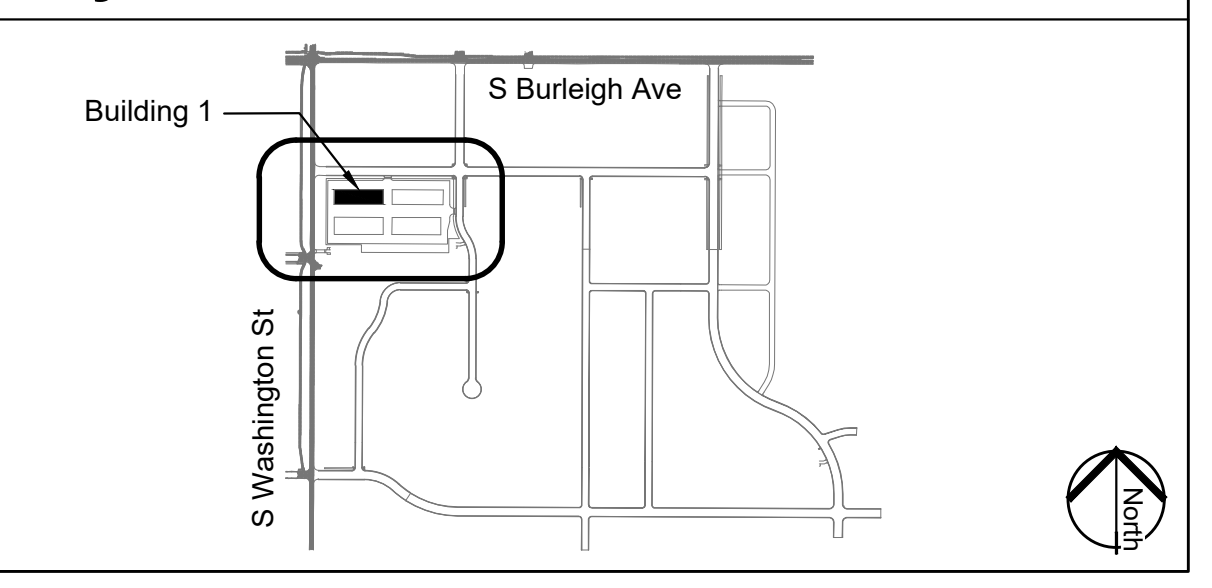


Code Research Summary

2021 International Building Code			
Information	Reference		
Occupancy	Mixed Use Group - "B" Business, "M" Mercantile, "S-1" Storage	Section 304, 309, 311	
Total Square Footage	21,120 sq ft (Building 1 of 4)	See Floor Plans	
Sprinkled	Yes	Section 903	
General Building Information			
Height - Maximum Feet	"B" Business: 60 ft, "M" Mercantile: 60 ft, "S-1" Storage: 60 ft	Table 504.3	
Height - Maximum Stories	"B" Business: 3 Stories, "M" Mercantile: 2 Stories, "S-1" Storage: 2 Stories	Table 504.4	
Area - Base Allowable (S1)	36,000 sq ft	36,000 sq ft	36,000 sq ft
Area - Base Allowable (SM)	27,000 sq ft	27,000 sq ft	27,000 sq ft
Area - Frontage Increase	N/A	Section 506.3.3	
Area - Factor Increase	N/A	Table 506.3.3	
Allowable Area	N/A	Table 506.3.3	
Total Allowable Area Per Floor	N/A		
Fire Separation Area	N/A		
Construction/ Fire Resistive Requirements			
Construction Type	Type V-B (sprinkled)	Table 601	
Structural Frame	0 hours	Table 601	
Exterior Bearing Wall	0 hours	Table 601	
Interior Bearing Wall	0 hours	Table 601	
Exterior Non-Bearing Wall	0 hours	Table 601	
Interior Non-Bearing Wall	0 hours	Table 601	
Floor/ Ceiling	0 hours	Table 601	
Roof/ Ceiling	0 hours	Table 601	
Fire Rated Resistive Construction			
Maximum Area of Exterior Wall Openings	Not Required since >30' Separation Distance	Section 705.8	
Fire Barriers	As Required by Table 508 for Occupancy Separation No Separation Required Between "B", "M", and "S-1"	Section 706 Section 706.4/ 707.3.10	
Fire Barriers (Incidental Use Areas)	See Section 707 and 711	Section 509.4	
Light, Ventilation, and Sanitation			
Minimum Facilities Required	Standard		
Water Closets	To Be Determined	Table 2902.1	
Lavatories	To Be Determined	Table 2902.1	
Urinals	To Be Determined	Table 2902.1	
Drinking Fountains	To Be Determined	Table 2902.1	
Service Sink	To Be Determined	Table 2902.1	
Means of Egress			
Use	To Be Determined		
Occupant Load Factor	To Be Determined	Table 1004.5	
Occupant Load - Net Area	To Be Determined		
Total Tenant Occupant Load	To Be Determined		
Number of Exits Required	2 Provided at Each Tenant Space	Section 1006	
Minimum Exit Width Required	To Be Determined		
Means of Egress Minimum Height	7 ft 6 in	Section 1003.2	
Exit Door Minimum Width	32 in Clear (3'-0" nominal); Maximum: 48"	Section 1010.1.1	
Exit Door Minimum Height	6 ft 8 in	Section 1010.1.1	
Maximum Exit Access Travel Distance	B - 300 ft, M and S-1 - 250 ft	Table 1017.2	
Common Path of Egress Travel	B and S-1 - 100 ft, M - 75 ft	Table 1006.2.1	
Dead Ends	50 ft	Section 1020.5	
Project Description			
The Paradise Business Centre is located in the Paradise Valley Development in South Bismarck off of Fisher Lane and Rutland Drive. There are 4 buildings within the project. This code review reflects Building 1 only. The building is type V-B construction and is fully sprinkled. It is a Mixed-Use occupancy consisting of Business "B", Mercantile "M", and Storage "S-1". There are 11 total units in total. All work is to comply with Title 14 and Ordinance no. 6516. Off-street and on-street parking are being utilized to meet parking requirements.			

2 Bollard Detail

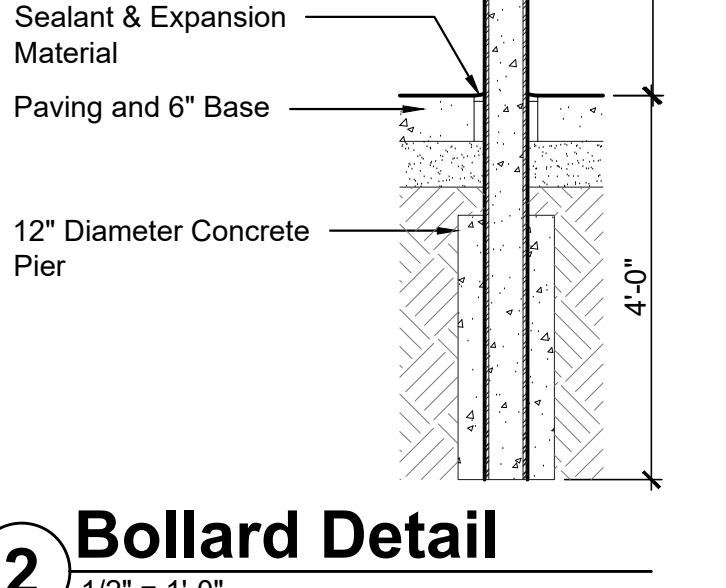


Wall Types

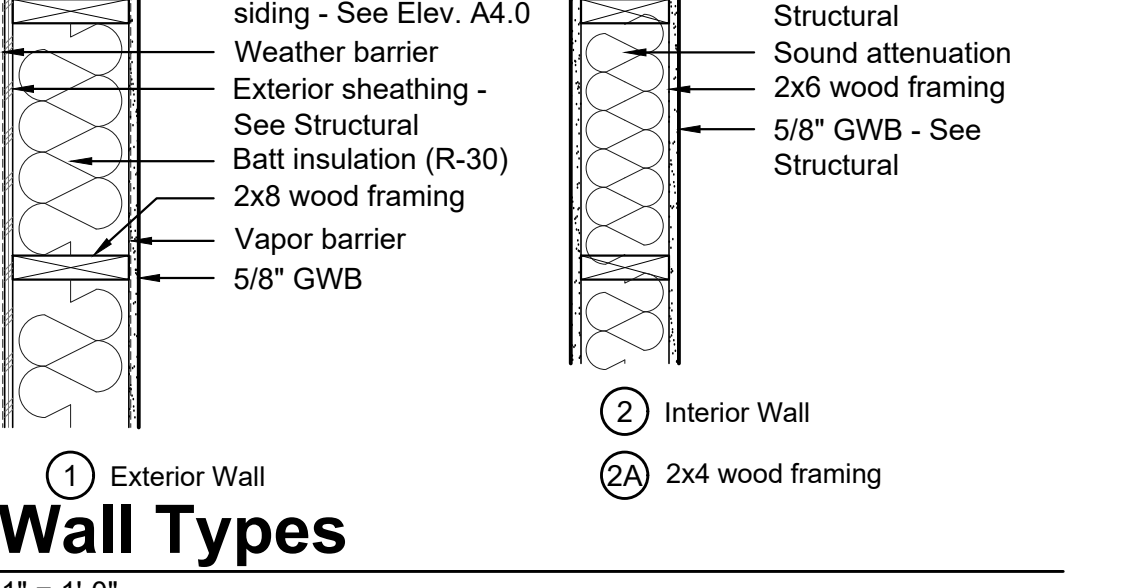


Door and Frame Schedule



Door Location	Size	Door Type	Rating	Frame Type	Hardware	Remarks
All Units	3'-0" x 6'-8" x 1 3/4"	Door-1	-	Door-1	Entrance Function Lockset and Deadbolt Basis of Design: Schlage AL Jupiter	-
Utility Room	3'-0" x 6'-8" x 1 3/4"	Door-2	-	Door-2	Entrance Function Lockset and Deadbolt Basis of Design: Schlage AL Jupiter	-

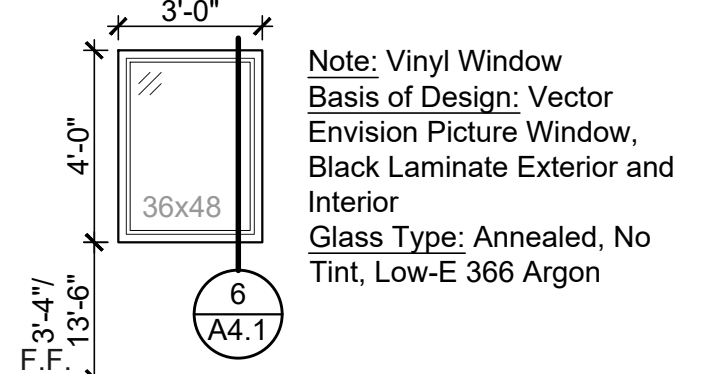

Window Types
1/4" = 1'-0"

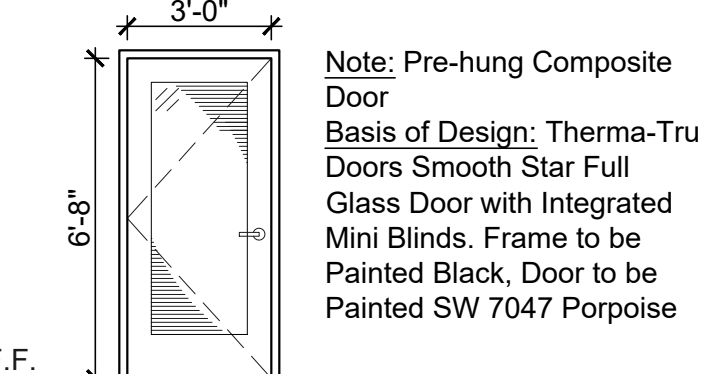

Door and Frame Types
1/4" = 1'-0"

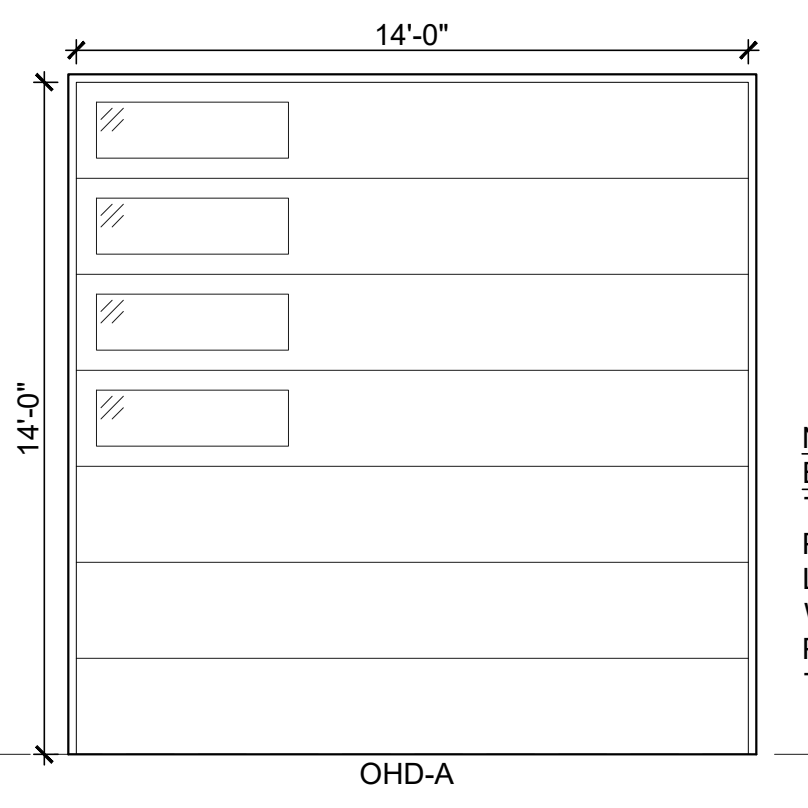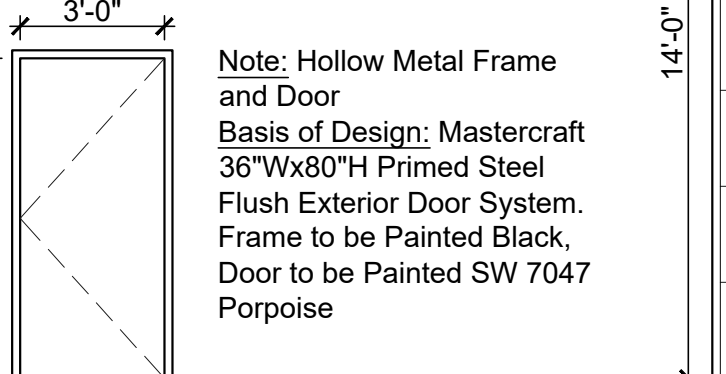

Revision Schedule		
Δ	Addendum	01/03/2025


I HEREBY CERTIFY THAT THIS PLAN SPECIFICATION OR REPORT WAS PREPARED BY ME OR UNDER MY DIRECT SUPERVISION AND THAT I AM A DULY REGISTERED ARCHITECT UNDER THE LAWS OF THE STATE OF NORTH DAKOTA.
DATE: 02/27/2024 REGISTRATION NO.: 2809
SIGNED: [Signature]




Floor Plan, Code Research Summary, Planning and Zoning, Key Plan, Door and Frame Schedule/ Types, Wall Types, Window Types, Notes, ADA Mounting Heights, Details
© Copyright 2024 WILDCRG.LL.C.

Date:	02/27/2024 <th>Sheet</th>	Sheet
Project Number:	2344	
Drawn By:	APJ	
Checked By:	AEK	
Approved By:	AEK	


A3.0

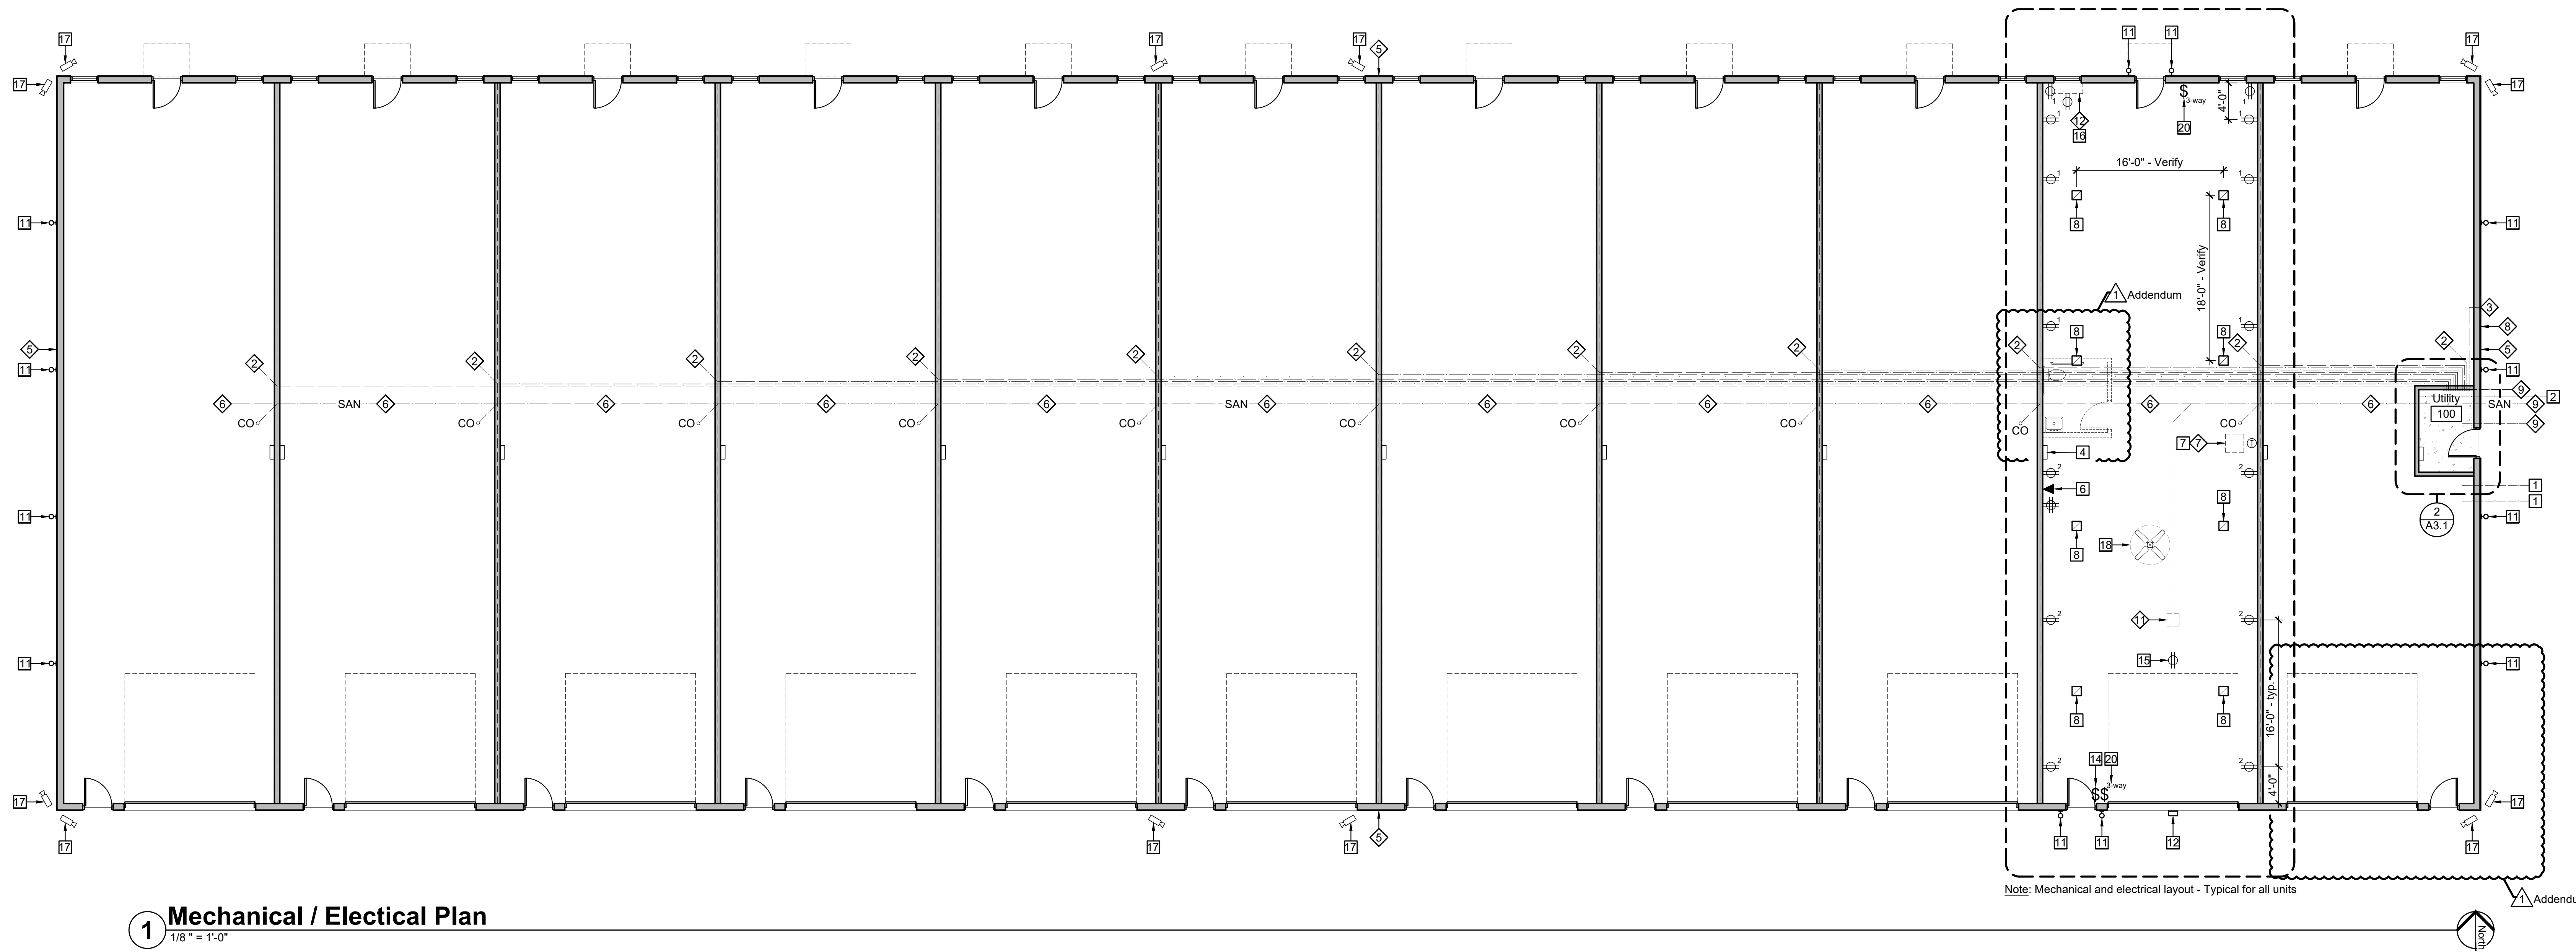

1 Mechanical / Electrical Plan
1/8" = 1'-0"

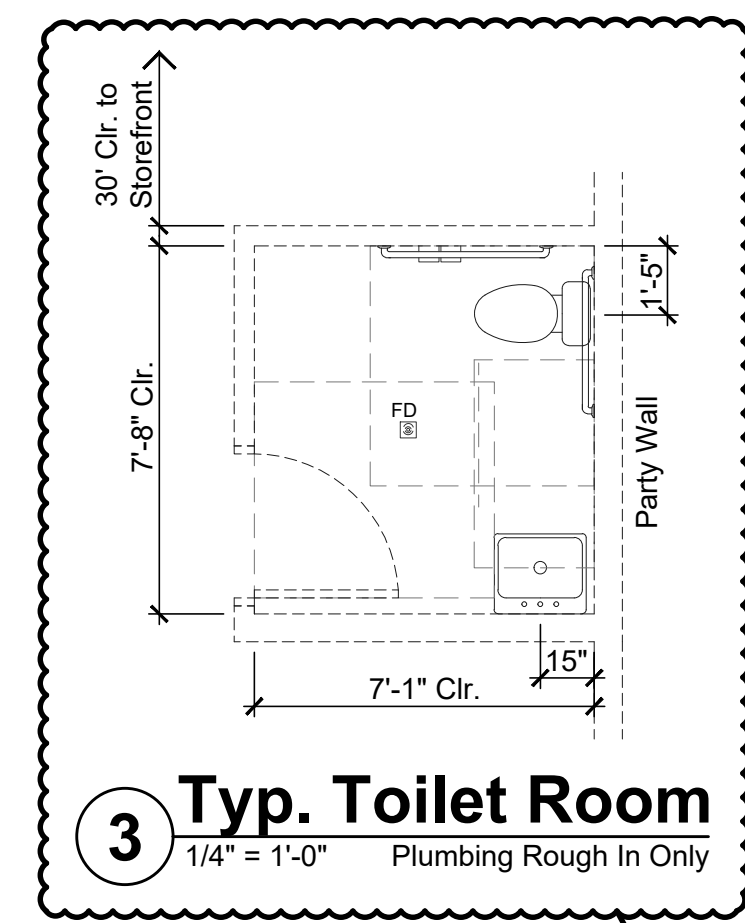

3 Typ. Toilet Room
1/4" = 1'-0" Plumbing Rough In Only

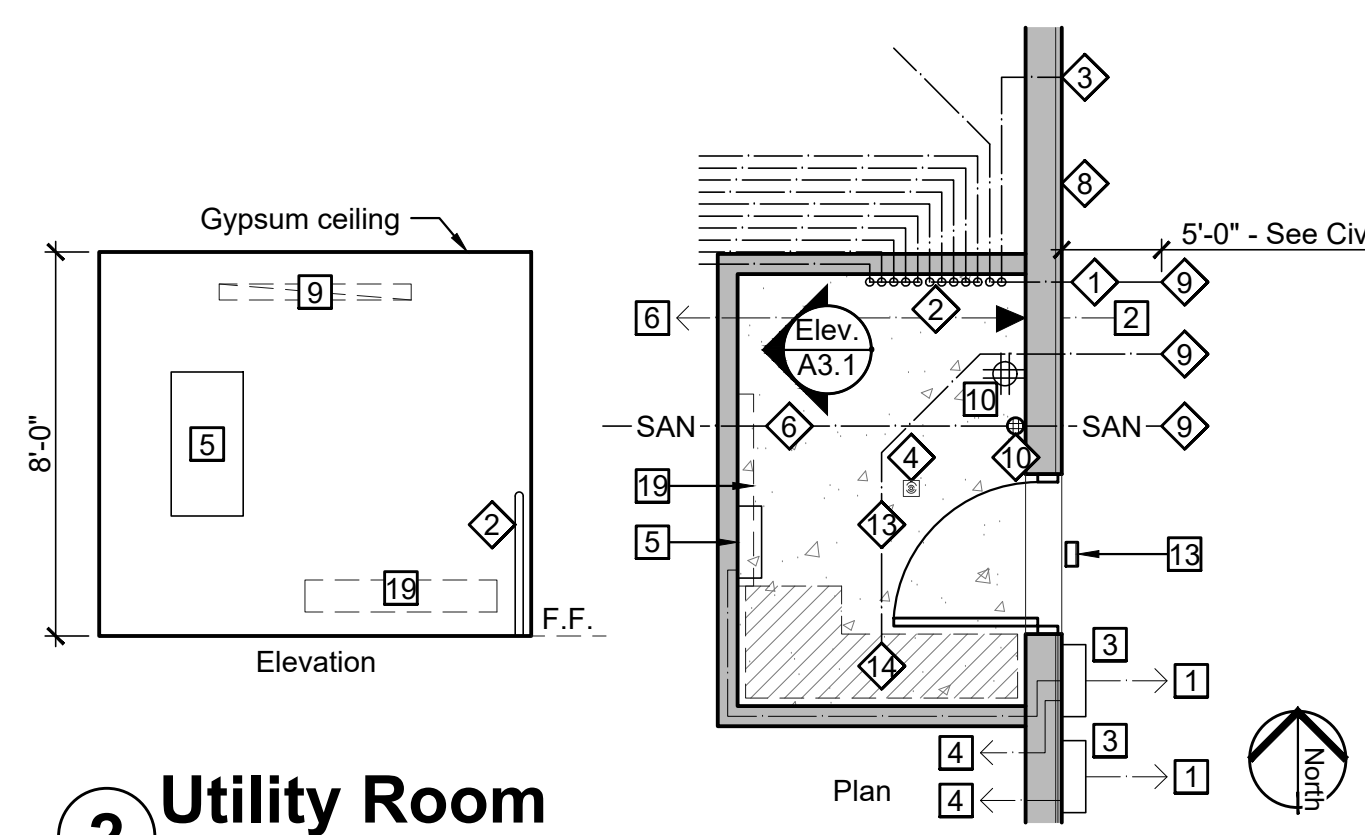

2 Utility Room
1/4" = 1'-0"

Mech/Plumbing Notes:

- Note: Mechanical/Plumbing Contractor to review drawings and visit site prior to bidding. Mechanical/Plumbing Contractor to design-build; provide all materials, labor, taxes, and permitting to achieve scope of work indicated on drawings. Provide required information and drawings necessary for state and local code review/approval and construction coordination.
- 1 Provide (1) 2" C900 (Domestic) CW Line into Utility 100. Provide water meter as required by code - verify location with CM.
 - 2 Provide (1) 1" (Domestic) CW Line as shown on plan underground per unit. Provide (1) shut off valve at each branch of 1" CW line in Utility 100. Stub 4" (Vertical) into each tenant space for future use. Verify location. Verify with City of Bismarck.
 - 3 Provide (1) RPZ Back flow preventer at 1" CW line for irrigation system. Provide quick connection for system blowout. Building 1 to control irrigation for entire site.
 - 4 Provide 2" Floor Drain at Utility 100.
 - 5 Provide (4) exterior Hose Bibs as shown on plan.
 - 6 Provide 4" PVC Sanitary Sewer line and cleanouts as shown on drawings. Stub 4" (Vertical) into each tenant space for future toilet room. Verify location with Arch/CM. Verify proper line slope - See Civil Drawings.
 - 7 Provide ceiling-hung heater and thermostat for each unit. Basis of Design: Reznor UDX Natural Gas Unit Heater. Include all components to vent thru roof. Direct wired or plug in. Verify heater and thermostat location and height with Arch/CM. Verify total BTUs required per unit with mechanical contractor.
 - 8 Gas Meters provided by utility company - verify location with Owner/CM. Provide gas lines as shown on Plan to each ceiling-hung heater.
 - 9 Final connection to utilities by Mechanical Contractor. Verify locations with Civil Drawings.
 - 10 Plumbing contractor to provide floor drain vent pipe through roof as required.
 - 11 Provide 4" vertical stub for future floor drain and pipe to storm sewer at each tenant space.
 - 12 Thru-wall HVAC/CR cooling unit mounted below window. See Elevations for location. Basis of Design: Gree PTAC II GAE15AED3NRNB5GCP. Verify power requirements with Electrical Contractor. Verify condensate requirements with Mechanical Contractor. Provide custom color grill to be selected by Architect/Owner.
 - 13 Provide (1) 4" C900 (Domestic) CW Line into Utility 100. Provide water meter as required by code - verify location with CM.
 - 14 Designated area for fire riser and components for complete NFPA 13 fire suppression system. Each unit to have open shell design. Allow for future build out by Owner.

Electrical Notes:

- Note: Electrical Contractor to review drawings and visit site prior to bidding. Electrical Contractor to design-build; provide all materials, labor, taxes, and permitting to achieve scope of work indicated on drawings. Provide required information and drawings necessary for state and local code review/approval and construction coordination.
- All electrical outlets to be 60" A.F.F. U.N.O. Electrical contractor to provide plywood backing at panels.
- 1 Provide Transition Cabinet including (1) 4" Conduit from Transformer to Transition Cabinet. Provide (2) main conduit from Transition Cabinet to Utility 100 feeding (2) 800 Amp Main Breaker/MDPs - See Civil drawings.
 - 2 Transformer and Transition Cabinet to be located adjacent to Building 1 and shared with Building 2. Provide (2) concrete filled steel bollards as required by utility company. Verify route and footage of conduit with utility company.
 - 3 Provide (1) 2" PVC conduit from communication/data site pedestal to Utility 100. Daylight conduit into Utility 100 and daisy chain conduit to Building 3. Verify location of site pedestal with utility communication/data company - See Civil Drawings.
 - 4 Provide (2) 800 Amp (208/240 Single Phase) main breakers, feeding (1) 200 Amp panels, individually metered. Meters to be located on either side of MDP outside Utility 100 - Verify with utility company and electrical contractor.
 - 5 Each tenant space to receive (1) surface mounted 200 Amp panel. Provide required underground conduit to each tenant space, verify location of panel at each tenant space with CM/Owner.
 - 6 Utility 100 to receive (1) surface mounted 100 Amp panel, verify location of panel with CM/Owner.
 - 7 Provide (1) 3/4" conduit under ground from Utility 100 to each tenant space for future communication/data.
 - 8 Provide power to ceiling hung heater. Verify with Mechanical contractor.
 - 9 High bay light fixture for general interior shop lighting. Basis of Design: Lithonia Lighting CPHB 12LM MVOLT 50K Contractor Select Compact Pro LED High Bay. Provide minimum lumens requirements to meet code. All shop lighting to be on single circuit. Verify final quantity of fixtures and lighting layout with CM/Owner.
 - 10 Provide (1) 4'-0" LED utility fixture surface mounted on wall in Utility 100. Basis of Design: Lithonia Lighting WL LED Wall Surface Mount Bracket, 3000 Lumens, 5000K.
 - 11 Provide (1) quad outlet in Utility 100. Verify location with CM/Owner. See interior elevation.
 - 12 Provide (2) wall sconce light fixtures at each walk-through door on the North and South elevations and the East and West elevation as shown. Basis of Design: LEONLITE Integrated LED Cylinder Up/Down Outdoor Wall Light, 100V-277V, 20W, 3000K. See A4.0 for locations. All exterior fixtures to be controlled in Utility 100 with single photoeye.
 - 13 Provide (1) wall pack light fixture above each garage door on the South elevation. Basis of Design: RAB Lighting LED WP2XFU60, Color Selectable, Bronze Finish. See A4.0 for location. All exterior fixtures to be controlled in Utility 100 with single photoeye.
 - 14 Provide (1) downlight light fixture above Utility 100 door on the East elevation. Basis of Design: Lithonia Lighting WPX0 LED Wall Mount, Model #WPX0 LED ALO SWW2 MVOLT PE DDXD M2. See A4.0 for location. All exterior fixtures to be controlled in Utility 100 with single photoeye.
 - 15 Overhead door control location. Provide functions for Open, Close, and Stop.
 - 16 Receptacle for overhead door operator - ceiling mount.
 - 17 Dedicated 208-220v receptacle for thru-wall HVAC/CR cooling unit. Verify power requirements with Mechanical Contractor.
 - 18 POE security camera layout as shown. Include Cat6 to location and 8TB hard drive in Utility 100. Product: Revo Surveillance Systems. Include wire shelf. Verify final camera selection and location with CM/Owner. See 2/A3.1.
 - 19 56" ceiling fan. Basis of Design: Westinghouse Jan Ceiling Fan, White Finish, Model #7812700, no light. Provide variable speed switch at shop door to control shop ceiling fan.
 - 20 4" electrical baseboard heater in Utility 100. Basis of Design: Cadet 48 in. 206-volt, 1,000/750-watt Electric Baseboard Heater, Finish: White, Model #4F1000W.
 - 21 Provide 3-way switch at each door to control all interior shop lighting.

Revision Schedule	
▲ Addendum	01/03/2025

I HEREBY CERTIFY THAT THIS PLAN, SPECIFICATION, OR REPORT WAS PREPARED BY ME OR UNDER MY DIRECT SUPERVISION AND THAT I AM A DULY REGISTERED ARCHITECT UNDER THE LAWS OF THE STATE OF NORTH DAKOTA.

DATE: 02/27/2024 REGISTRATION NO.: 2829

SIGNED:

wild | crg
architecture | construction

500 2nd Avenue North | Suite 514
Fargo, North Dakota 58102

Phone 701 | 293 | 8106
wildcrg.com

Mechanical and Electrical Design-Build Plan, Notes, Enlarged Plan

Material Legend

- 1 - Metal Lap Siding
- Quality Edge, TruCedar Steel Siding
- Profile: Single 6" (Horizontal)
- Color: Solid 425 Statuary Bronze
- 2 - Metal Lap Siding
- Quality Edge, TruCedar Steel Siding
- Profile: Single 6" (Horizontal)
- Color: Solid 469 Fresh Canvas
- 3 - Metal Lap Siding
- Quality Edge, TruCedar Steel Siding
- Profile: 6" Board & Batten (Vertical)
- Color: HD2 Woodgrain M16 Cider Mill
- 4 - Metal Lap Siding
- Quality Edge, TruCedar Steel Siding
- Profile: Single 6" (Horizontal)
- Color: Solid 410 Thatch
- 5 - Stone Veneer
- Versetta Stone, LedgeStone
- Panel Size: 36" x 8"
- Color: Sterling
- Include Stone Cap
- 6 - Asphalt Shingles
- CertainTeed Landmark
- Color: Moire Black

Elevation Keynotes

- 1 Thru-wall HVAC/cooling unit mounted below window. Verify power requirements with electrical contractor. Provide custom color grill to be selected by architect/owner - See A3.1.
- 2 Pre-finished metal canopy by owner installed by framing contractor - Refer to Detail 5/A4.1.
- 3 6" Prefinished Metal Gutters and Downspouts. Basis of Design: Klauer Classic Rainware Collection - Color: Terra Bronze - Profile: Square.
- 4 Gas and Electric Meters - Verify with owner for mounting locations. Minimize visual impact to extent possible.
- 5 Light Fixture - See A3.1.
- 6 Light Fixture - See A3.1.
- 7 Light Fixture - See A3.1.

Roof Plan General Notes

- 1. Coordinate with Mechanical Plan for Equipment Locations, Venting & Information.

Roof Plan Keynotes

- 1 Ice and water barrier where indicated by hatch 4'-0" Min.
- 2 Asphalt shingles over underlayment and installed per manufacturer's recommendations - Basis of Design: CertainTeed Landmark
- 3 Ridge Vent - Provide and install final quantity recommended by roofing contractor.
- 4 Pre-manufactured Canopy - See Detail 5/A4.1.

Revision Schedule		
△	Addendum	01/03/2025


HEREBY CERTIFY THAT THIS PLAN, SPECIFICATION, OR REPORT WAS PREPARED BY ME OR UNDER MY DIRECT SUPERVISION AND THAT I AM A DULY REGISTERED ARCHITECT UNDER THE LAWS OF THE STATE OF NORTH DAKOTA.
DATE: 02/27/2024 REGISTRATION NO.: 2829
SIGNED: [Signature]

wild | crg
architecture | construction
500 2nd Avenue North, Suite 514
Fargo, North Dakota 58102
Phone 701 | 293 | 8106
wildcrg.com


Elevations, Material Legend, Roof Plan, Notes

© Copyright 2024 WILDCRG, LTD.


Date:	02/27/2024	Sheet
Project Number:	2344	A4.0
Drawn By:	APJ	
Checked By:	AEK	
Approved By:	AEK	

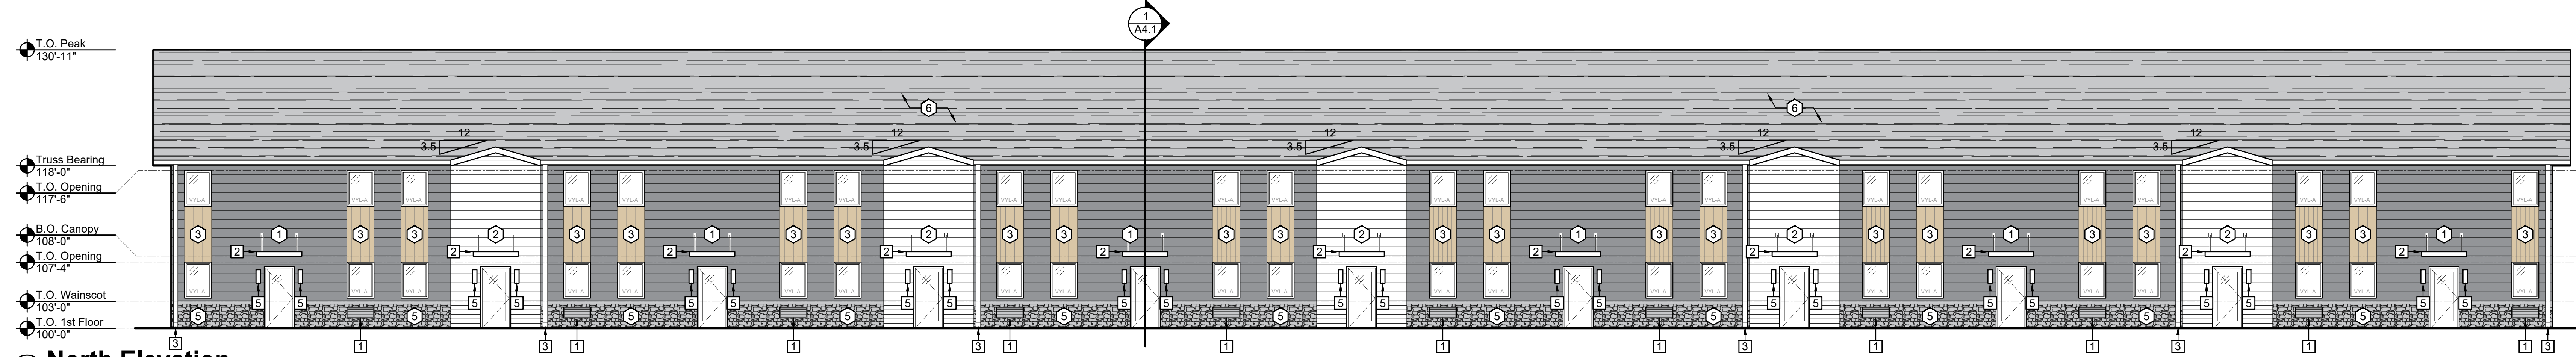

1 North Elevation
1/8" = 1'-0"

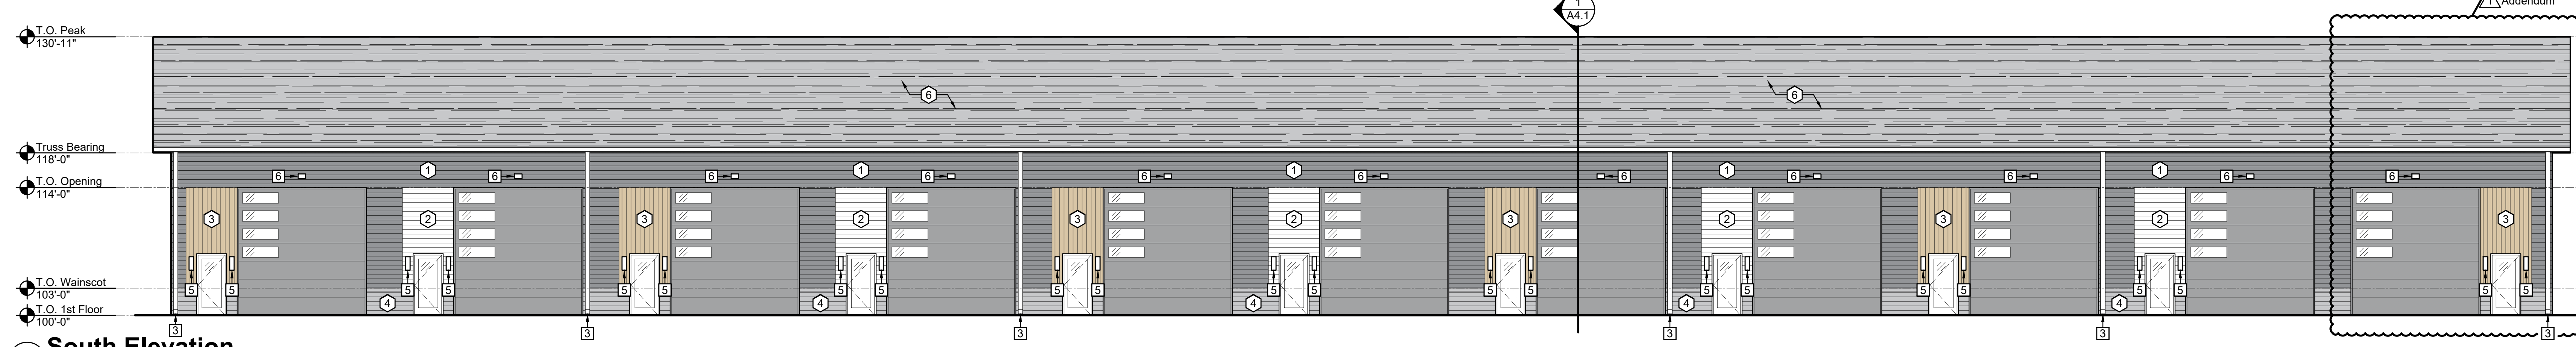


2 South Elevation
1/8" = 1'-0"

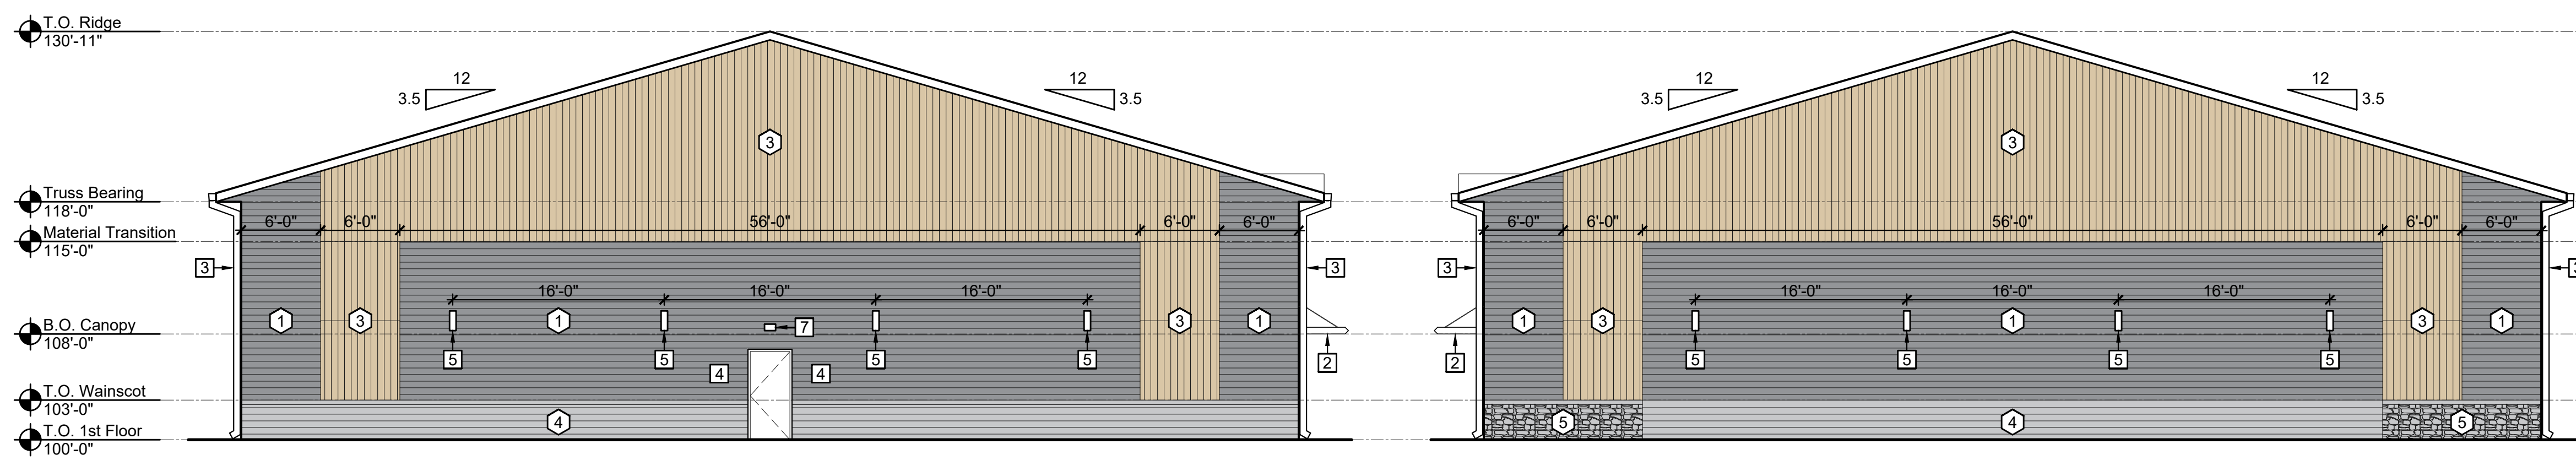


3 East Elevation
1/8" = 1'-0"


4 West Elevation
1/8" = 1'-0"

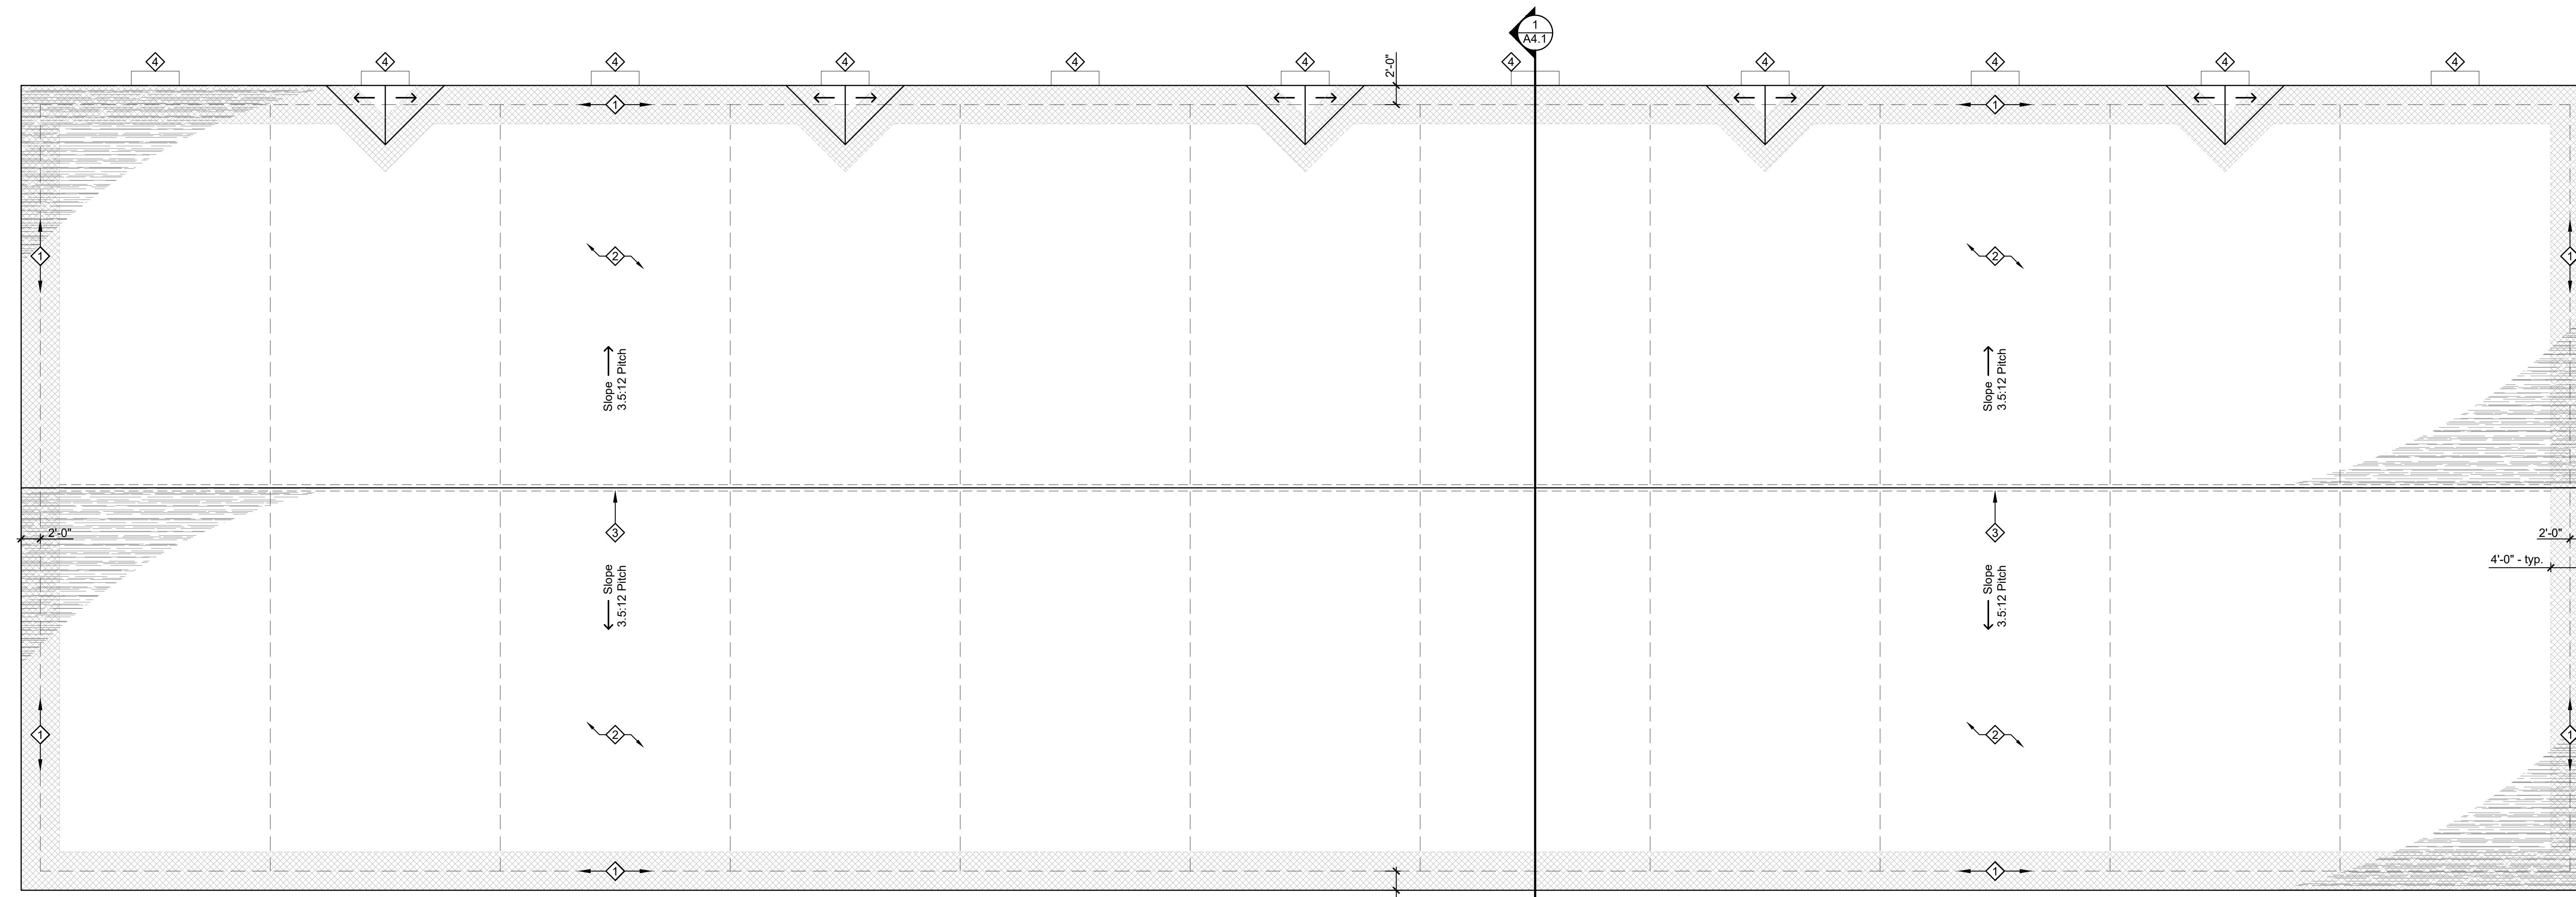


5 Roof Plan
1/8" = 1'-0"

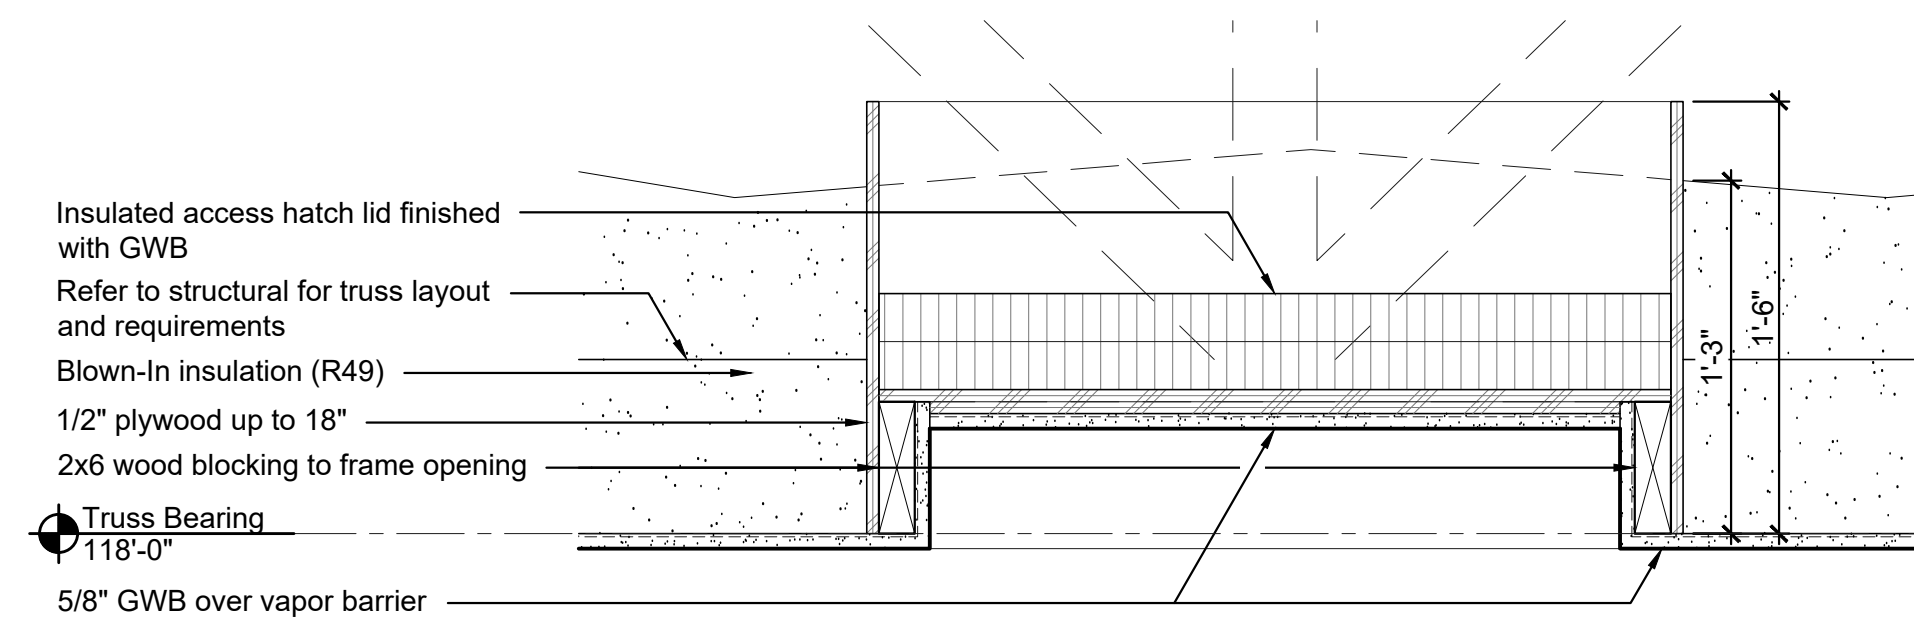


8 Typical Section Detail
1/12" = 1'-0"

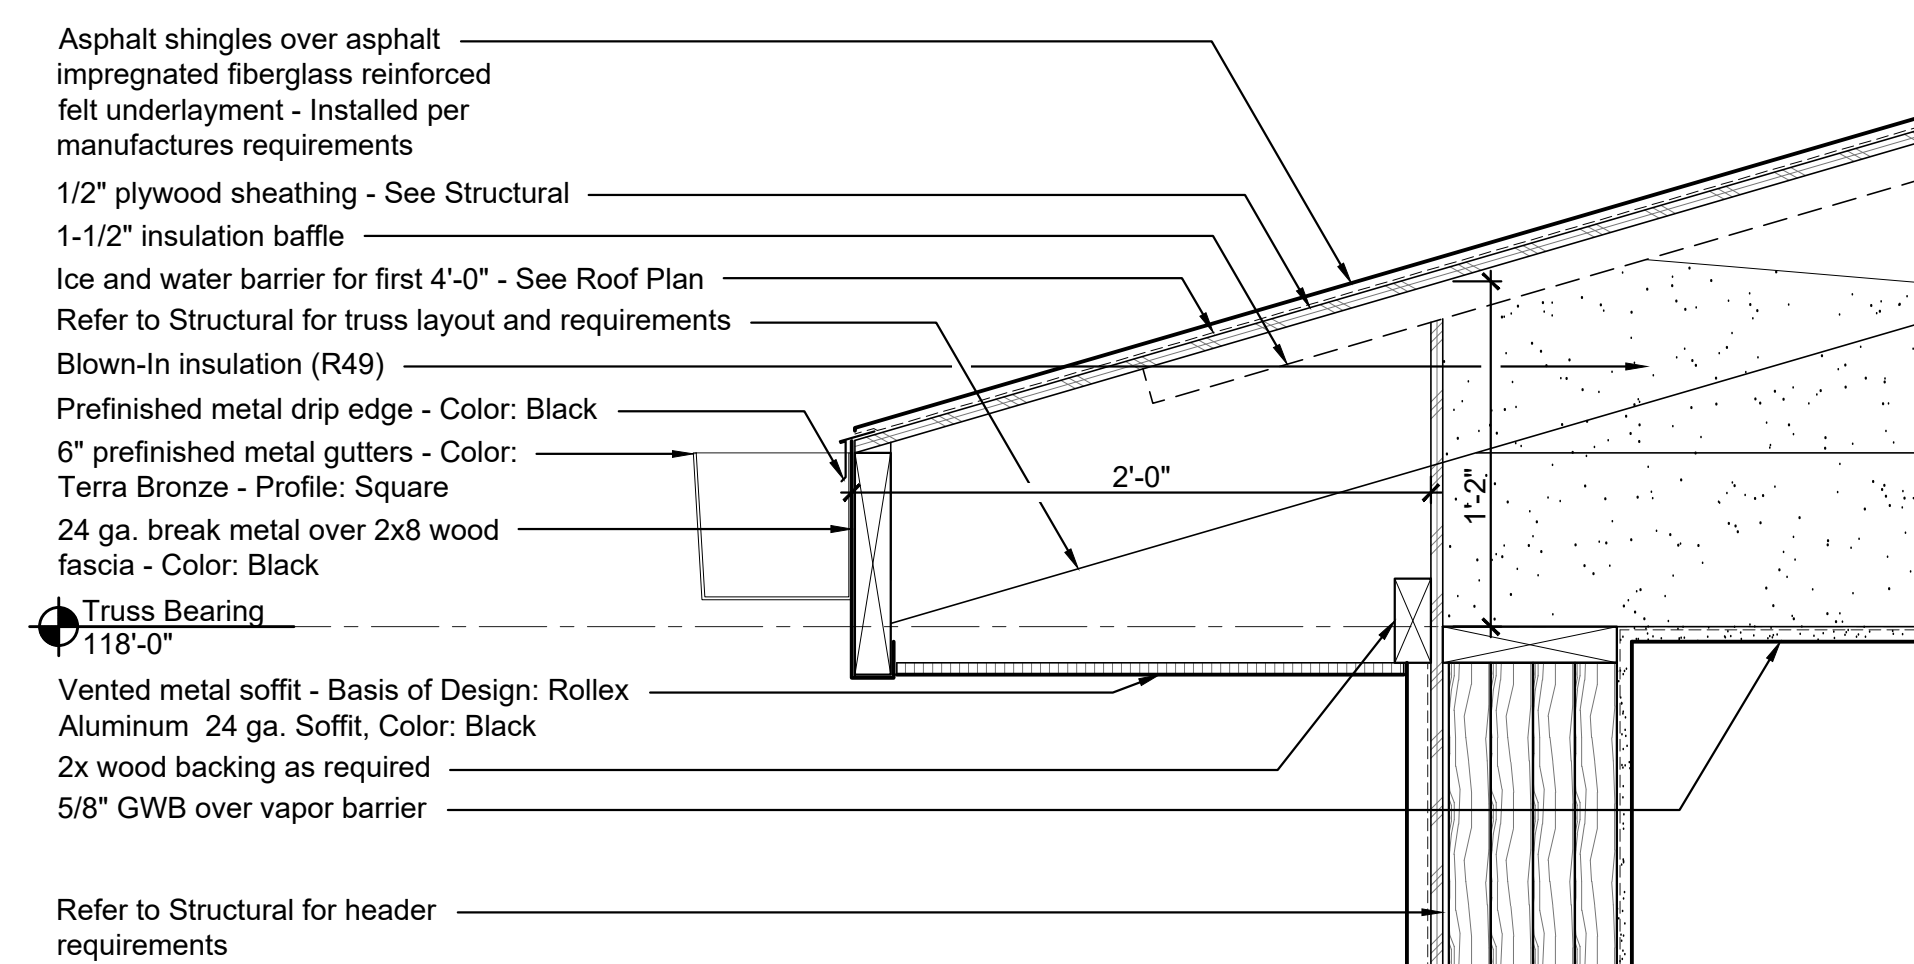


7 Section Detail
1/12" = 1'-0"

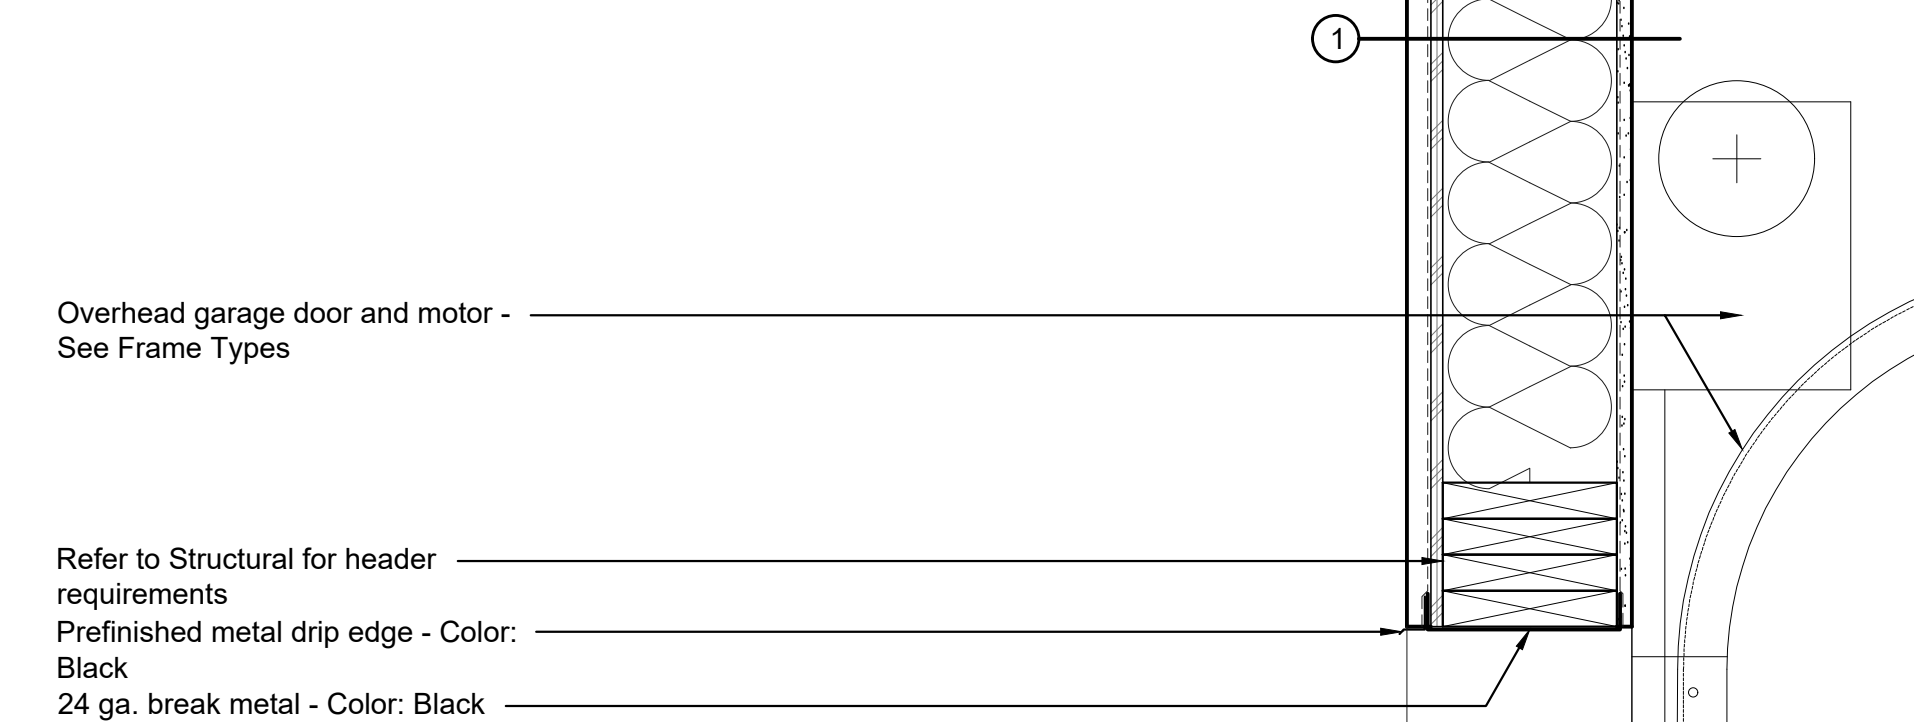


4 Typical Base Detail
1/12" = 1'-0"

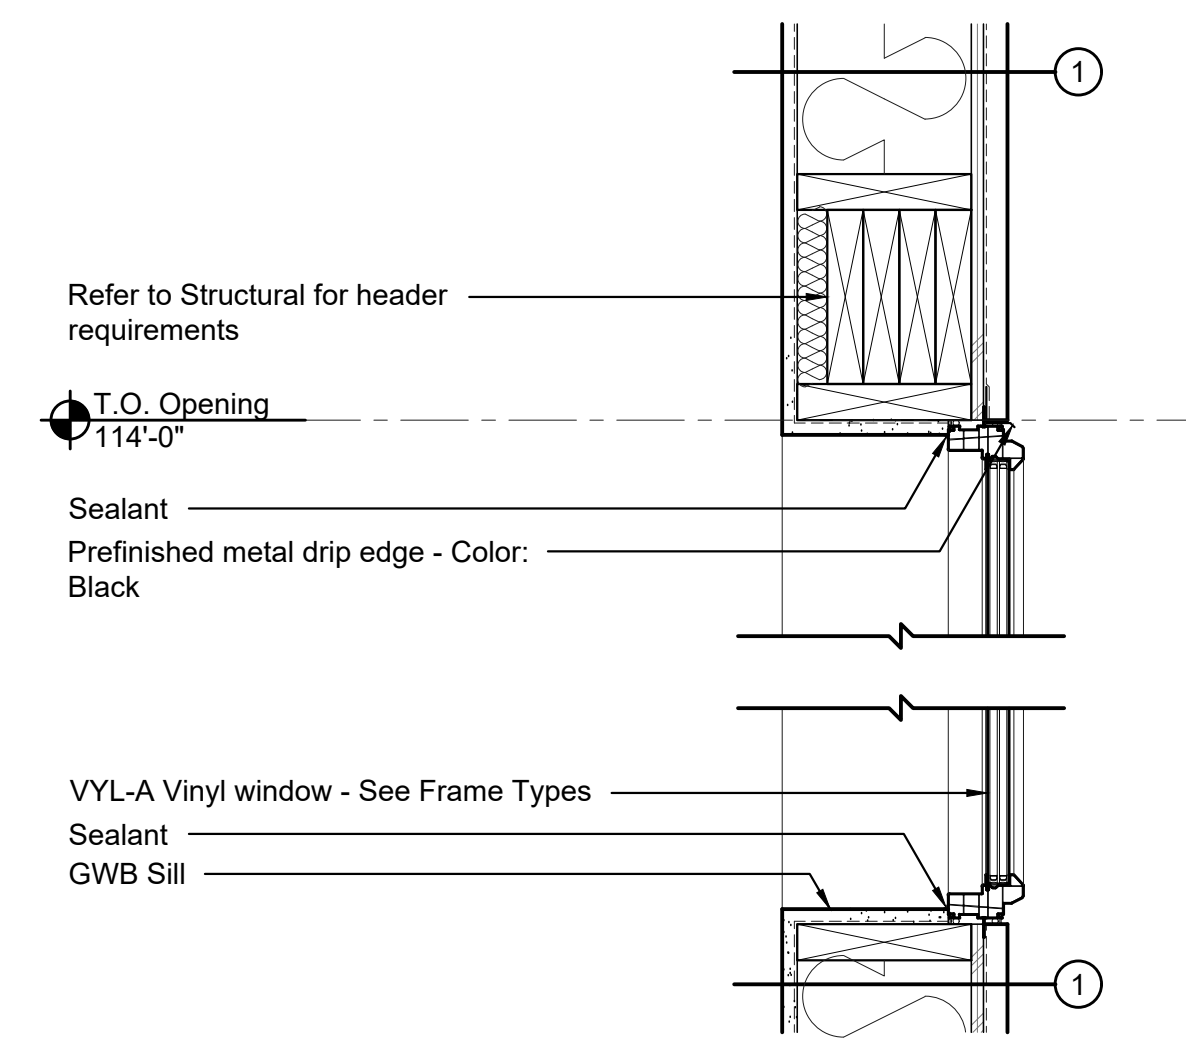


6 Head and Sill Detail
1/12" = 1'-0"

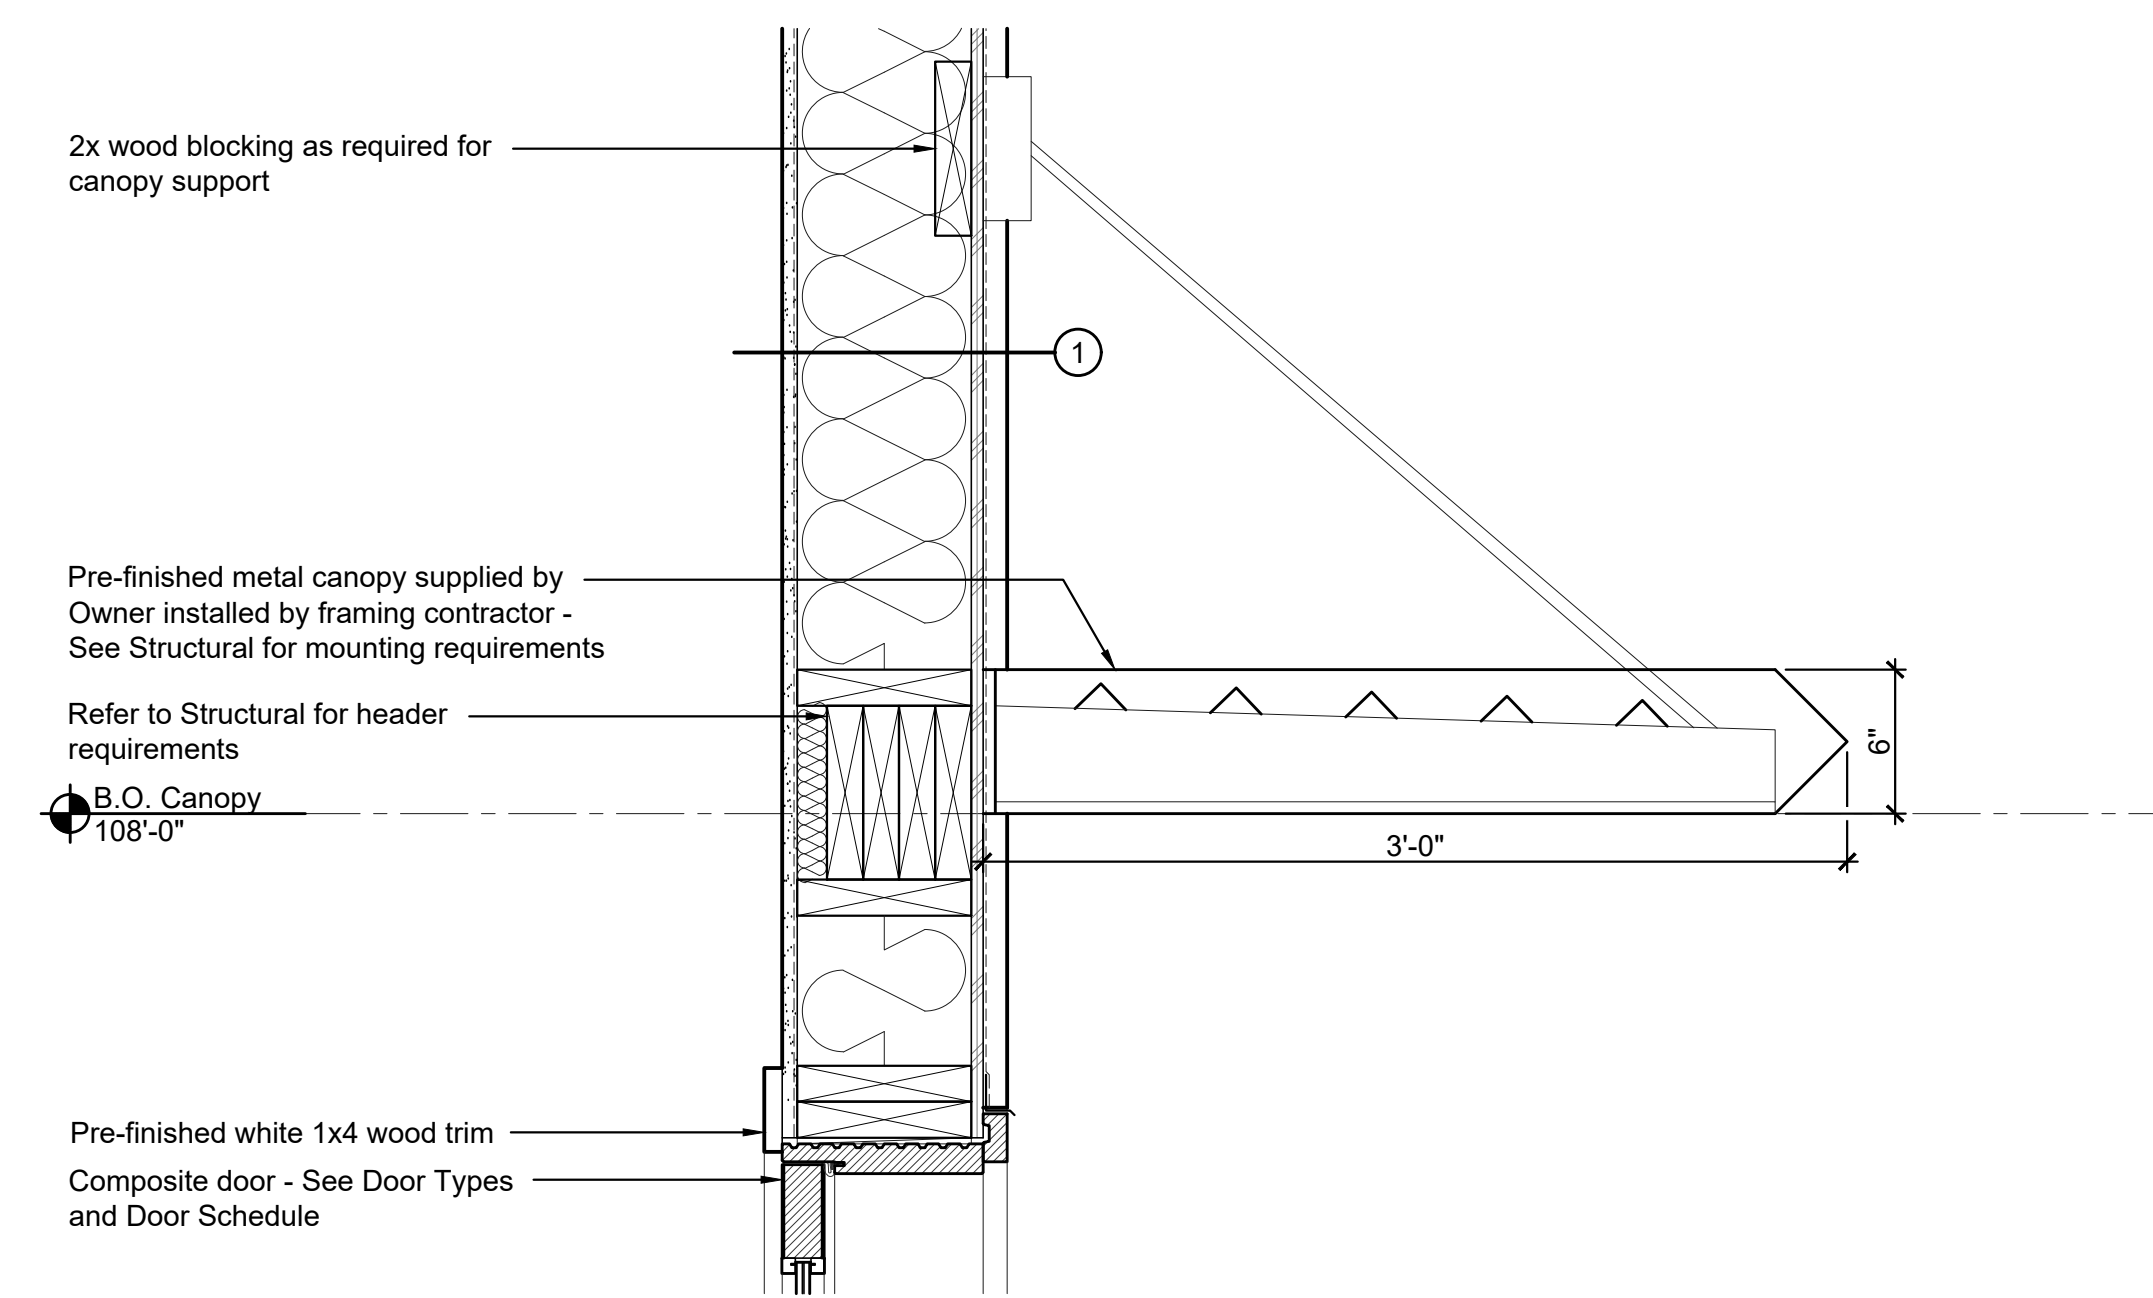


5 Section Detail
1/12" = 1'-0"

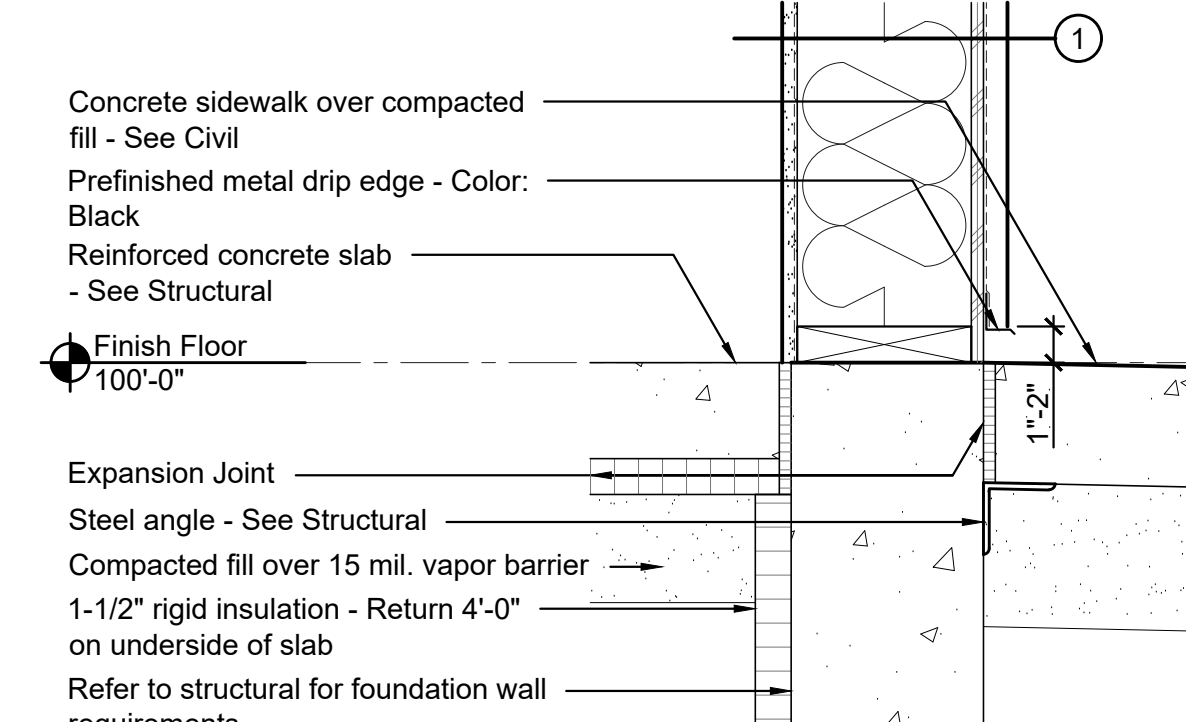

4 Typical Base Detail
1/12" = 1'-0"

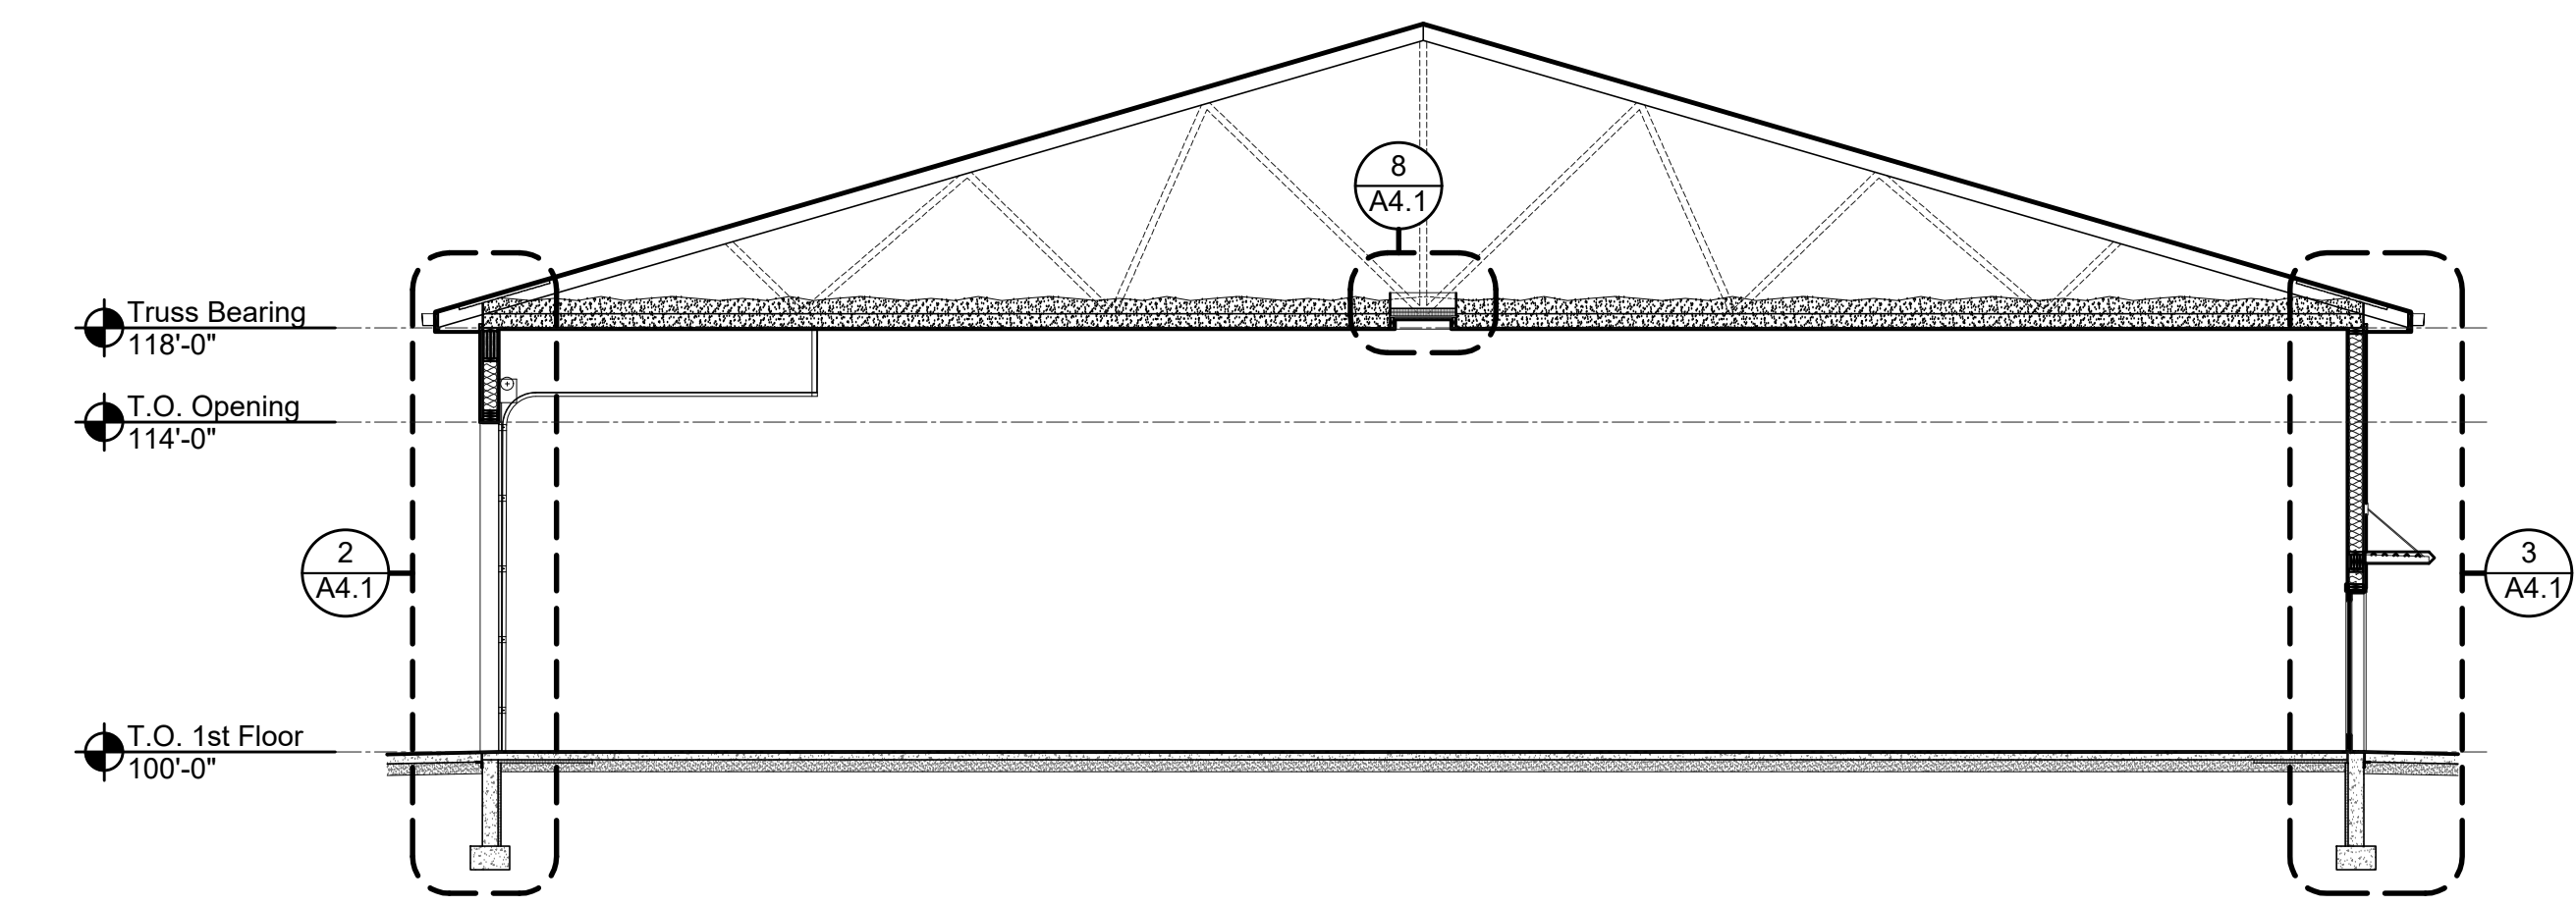

1 Building Section
1/8" = 1'-0"

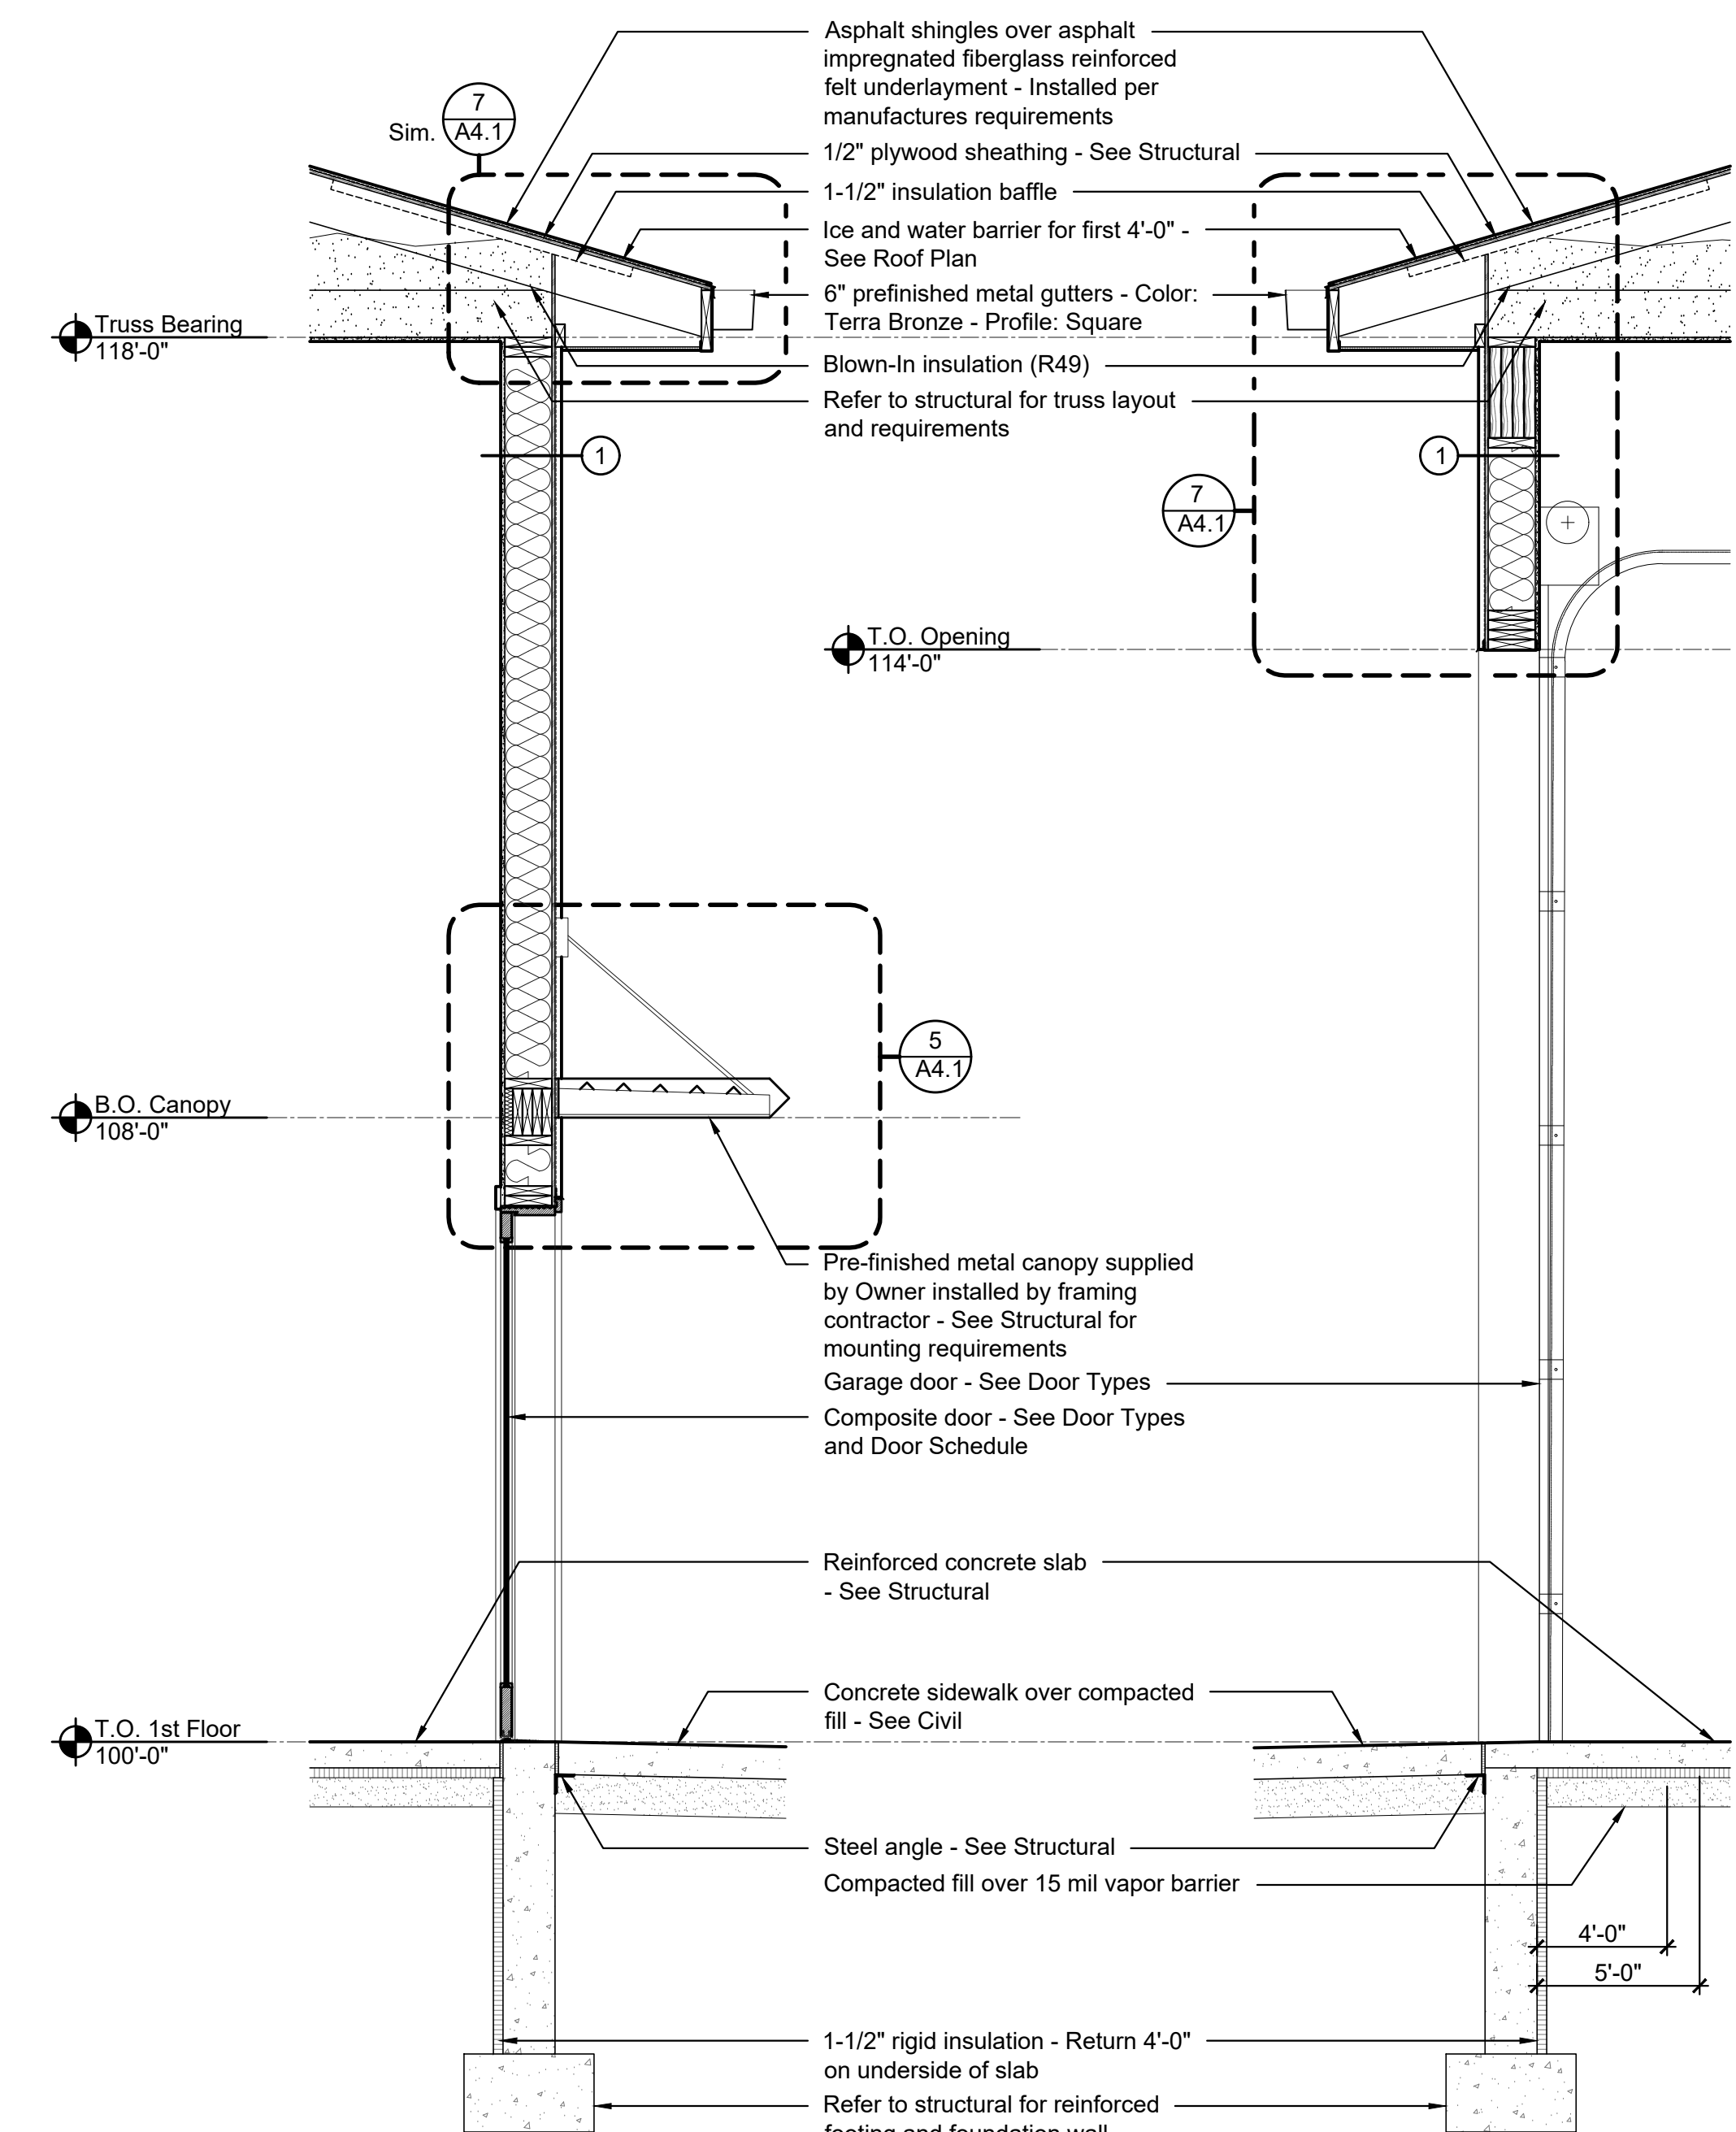

3 Wall Section
1/2" = 1'-0"


2 Wall Section
1/2" = 1'-0"

Revision Schedule		
Δ	Addendum	01/03/2025

ANDREW E. BERTHA
REGISTERED ARCHITECT
STATE OF NORTH DAKOTA
DATE: 02/27/2024 REGISTRATION NO.: 2699
SIGNED: [Signature]

wild | crg
architecture | construction
500 2nd Avenue North, Suite 514
Fargo, North Dakota 58102
Phone 701 | 293 | 8106
wildcrg.com

Building Section, Wall Sections, Section Details

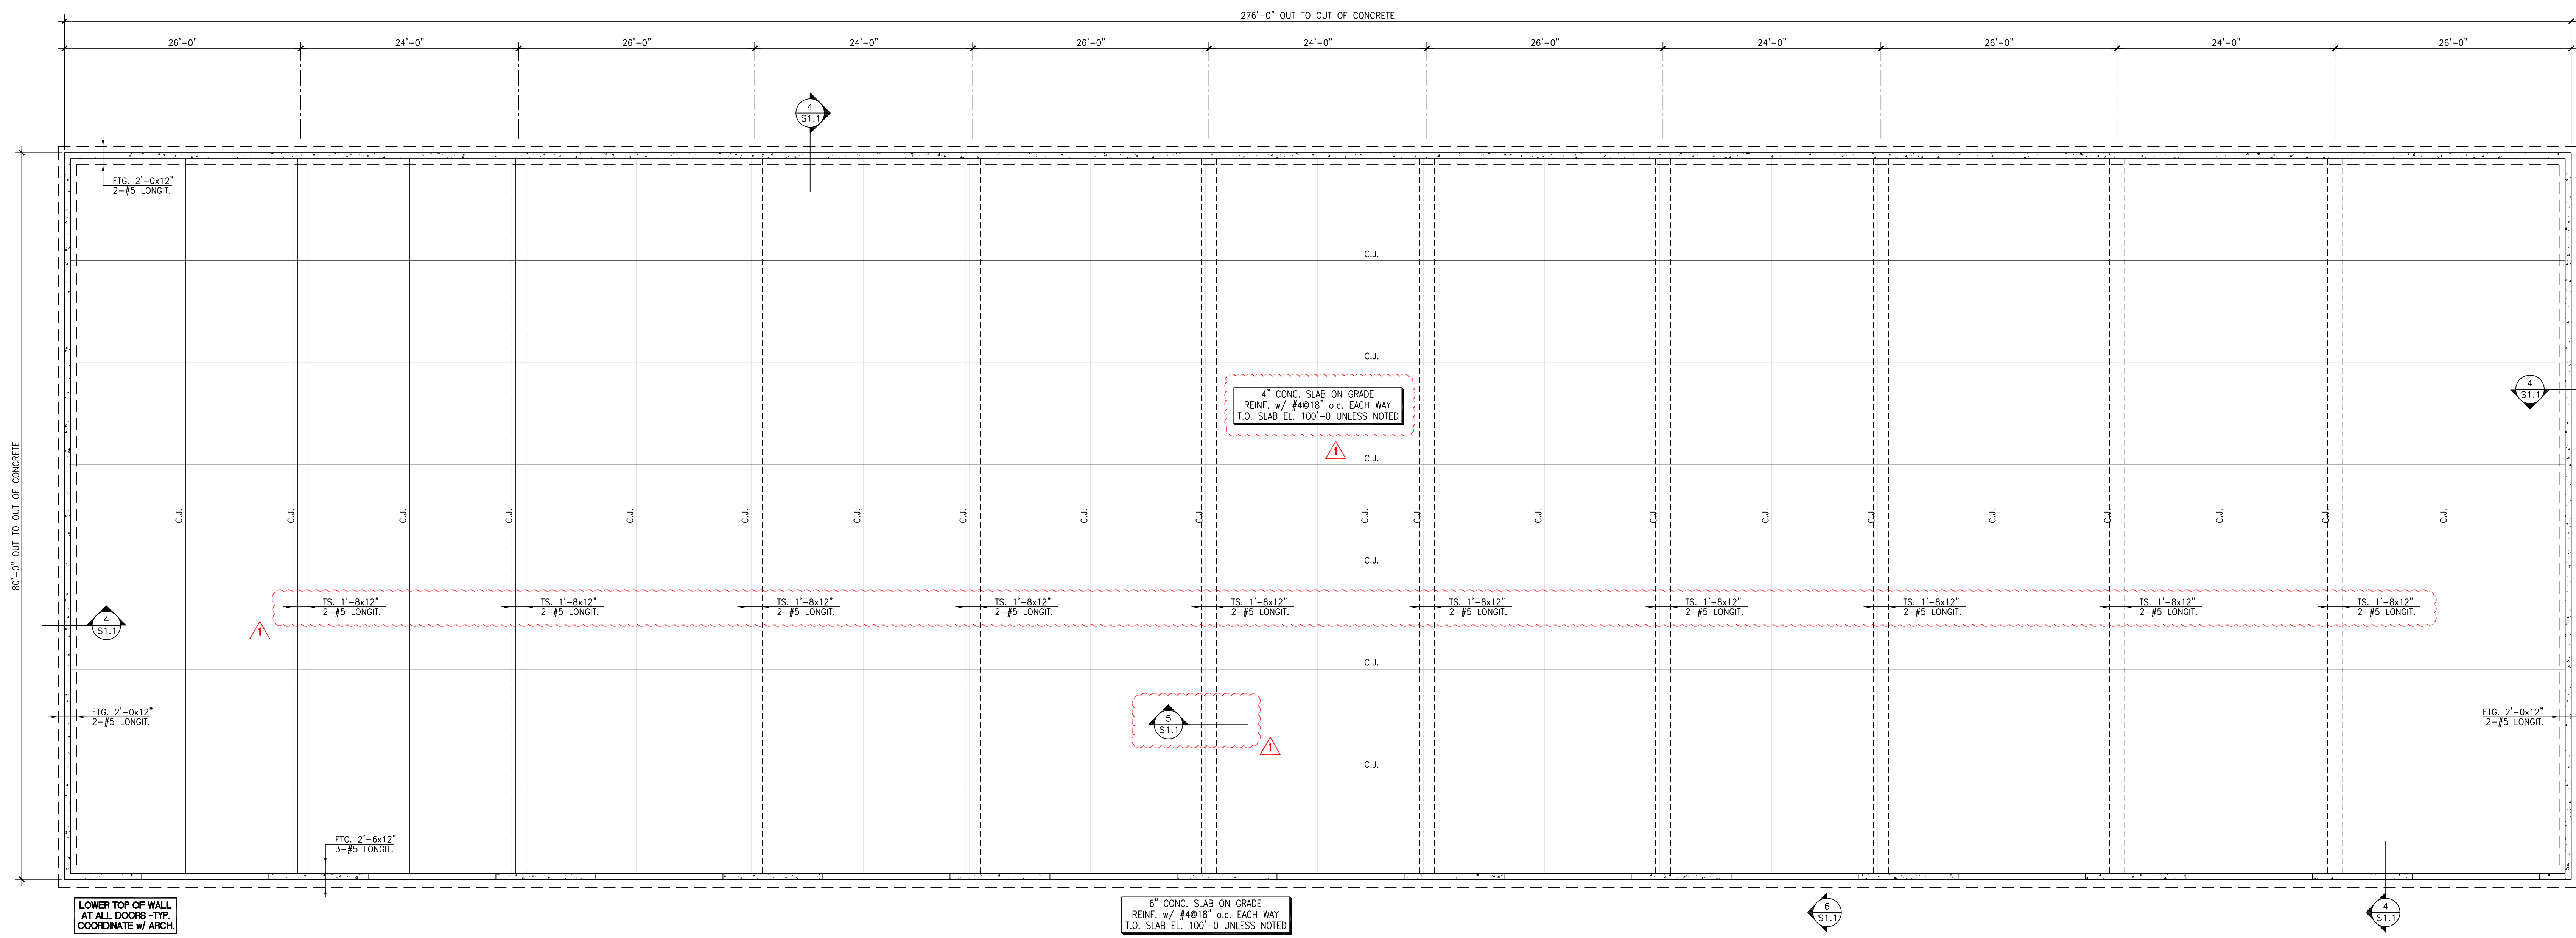







FOUNDATION PLAN

NOTE: 1). TOP OF FOOTING EL. = 96'-0 U.N.O.

SCALE: 1/8" = 1'-0

GENERAL STRUCTURAL NOTES

- Design Codes Used:
 - IBC 2021
 - ACI Concrete Code
 - AISC Code=ASD
- Design Loads:
 - Roof Snow Load:
 - $P_s = 27$ PSF + Drift (Balanced)
 - Unbalanced snow load as per ASCE 7-16 Section 7
 - $P_g = 35$ PSF
 - $C_e = 1.0$
 - $C_s = 1.0$
 - $C_t = 1.1$
 - Wind Load:
 - $V_{ult} = 115$ MPH Basic Wind Speed
 - Risk Category = II
 - Wind Exposure C
 - Internal Pressure Coefficient ± 0.18
- Design Stresses Used:
 - Concrete:
 - Slabs on Grade: 4500 PSI @ 28 days
 - Footings and Foundation Walls: 3000 PSI @ 28 days
 - Exterior exposed: 4000 PSI @ 28 days (air entrained)
 - Structural Slabs: 4000 PSI @ 28 days
 - Masonry Strength: $f_m = 1500$ PSI
 - Steel:
 - W Shapes: $F_y = 50$ KSI (ASTM A992)
 - Tubes: $F_y = 46$ KSI (ASTM A500 Grade B)
 - Angles, Channels, Bars: $F_y = 36$ KSI (ASTM A36)
 - Pipes: $F_y = 35$ KSI (ASTM A53)
 - Reinforcing Steel: 60 KSI (ASTM A615-60)
 - Soil Bearing Pressure: 1500 PSF (Assumed, Verify w/ Geotechnical Engineer's review of Excavation)
- CONCRETE COVERAGE for reinforcing shall be as follows:
 - Footings: 3 inches
 - Columns and Piers: 1 1/2 inches
 - Slabs on Grade: midheight for a single layer
 - Walls: 1 1/2 inches @ exterior, 3/4 inch @ interior, 3/4 inch unless noted
- Structural Slabs PROVIDE BAR SUPPORTS AND SPACERS in accordance with the ACI Detailing Manual.
- REINFORCING STEEL to be bent and placed in accordance with ACI code. All splices to be 38 db for #6 bar or smaller, 48db for #7 bar and larger.
- FOOTINGS to rest on undisturbed soil or engineered backfill. It is recommended that the Soils Engineer inspect soil conditions prior to construction. All walls and piers to center on footing unless otherwise noted. All footing elevations are given to the top of footings.
- ALL FOUNDATION WALLS to be laterally supported before backfilling. Vertical construction joints to be keyed.
- OPENINGS in concrete FOUNDATION WALLS shall be reinforced with 2-#5 bars each side, extending 2'-0" past the face of the opening unless otherwise noted.
- FOUNDATIONS SHALL BE BUILT from approved, fully dimensioned shop drawings coordinated with construction documents and field conditions. Foundation shop drawings shall consist of the anchor bolt setting plan, concrete mix design, and concrete reinforcement plan with wall & pier dimensions. All subsequent shop drawings shall be coordinated with approved foundation shop drawings.
- SHOP DRAWINGS
 - Submit electronic copies of the following shop drawings to the architect/engineer for review prior to fabrication.
 - CONCRETE REINFORCING and mix designs for each class of concrete.
 - The contractor shall review and accept full responsibility for dimensional correctness. All shop drawings must bear the approval stamp of the contractor (to include initials, date and disposition), prior to review by the Architect or Engineer. The Engineer will return all shop drawings, unreviewed, that do not bear the approval stamp of the contractor.
- PORTLAND CEMENT to be ASTM C150, Type 1 & 1A.
- CONCRETE to be in accordance with ACI 301. Maximum shale content shall not exceed 0.5% for exposed concrete.
- CONTROL AND CONSTRUCTION JOINTS to be located as shown on the plan or at contractors option - not to exceed 12'-0 o.c. verify with future slab.
- ROOF TRUSSES to be engineered by the fabricator under the supervision of a professional engineer. Shop drawings to be stamped by the professional engineer. All trusses to have roof sheathing, including areas with scabbed in wood framing above.
- ROOF TRUSSES shall be secured to wall plates with H25.7 Anchors by Simpson or equal at every truss.
- General Contractor shall provide all lateral roof bracing as required by truss plate institute manual "H8-91" or as required by the truss design.
- CARPENTRY
 - Wood Studs: MSR 1650J-1.5E
 - Beams: Hem Fir, SPF #2, or better
 - LVL's (Laminated Veneer Lumber): $F_b = 2600$ psi
 - Glue-Laminated Beams & Columns: $F_b = 2400$ psi (24F-V8 or better)
- Refer to IBC table or MN Building Code for typical nailing not shown. Table 2304.10.2.
- Contractor Field Verify all new lintels in existing walls have the correct plate width.
- SEE MECHANICAL, ELECTRICAL & ARCHITECTURAL DRAWINGS for all openings and inserts not shown on the plan. All opening sizes and locations to be verified with mechanical and electrical contractors.
- CONTRACTOR VERIFY all dimensions with Architectural Plan.

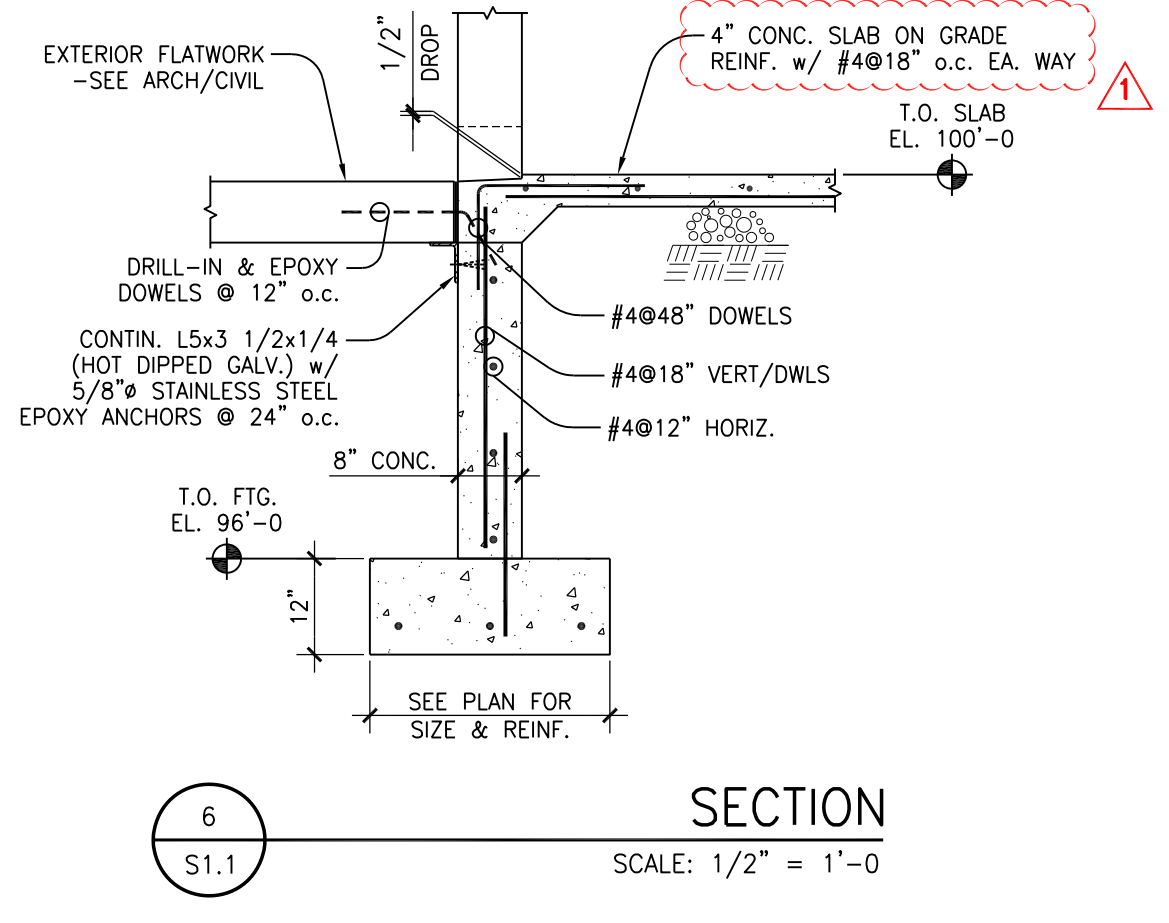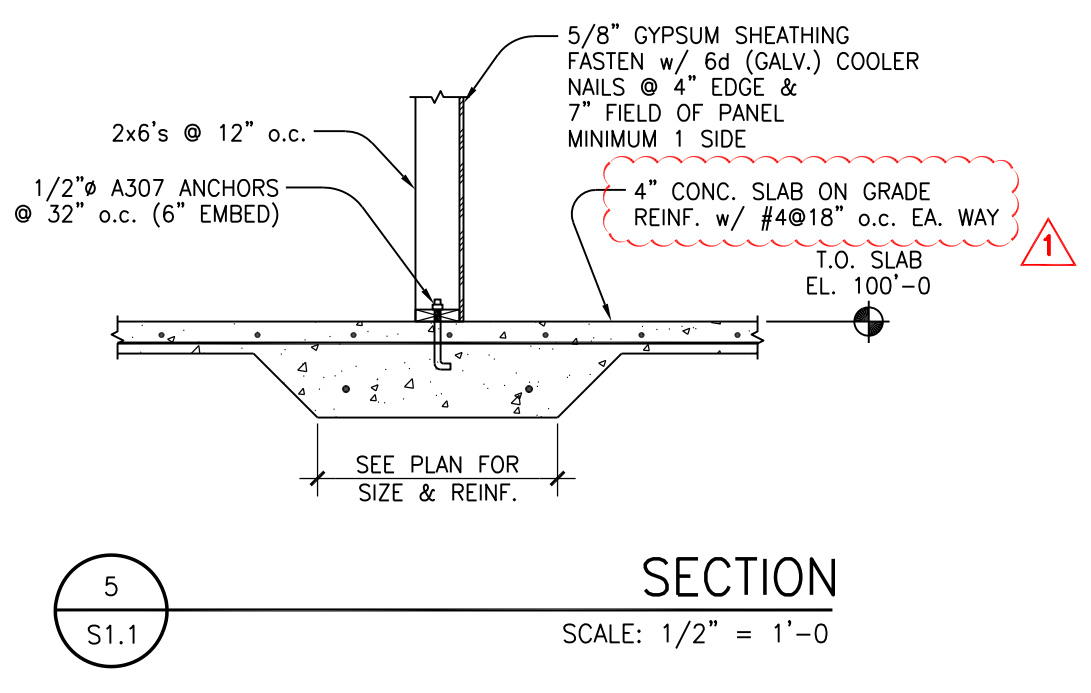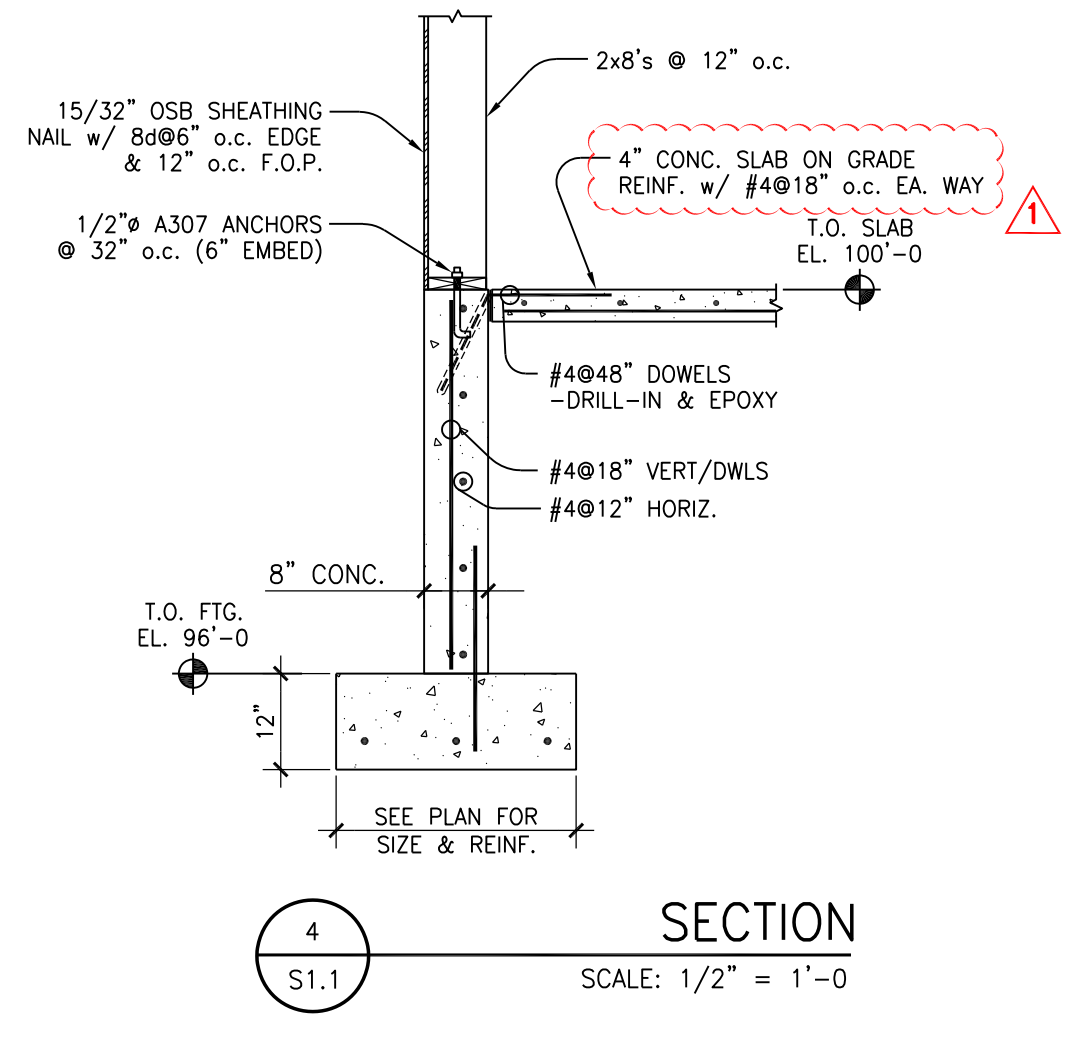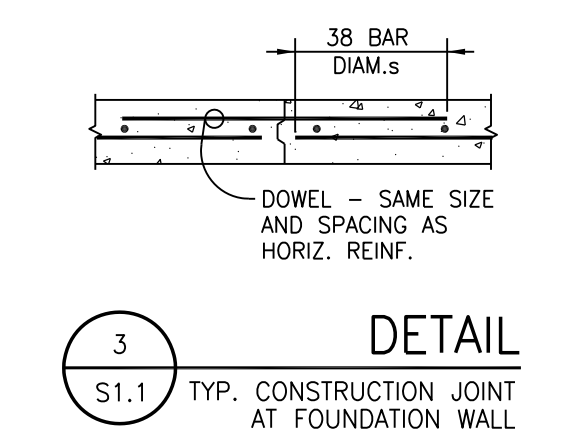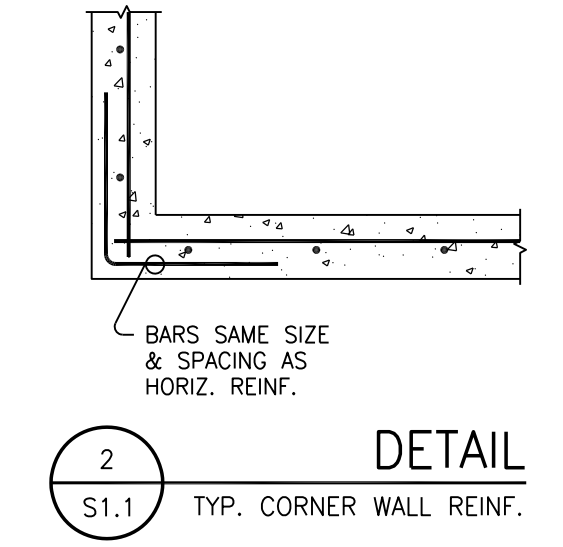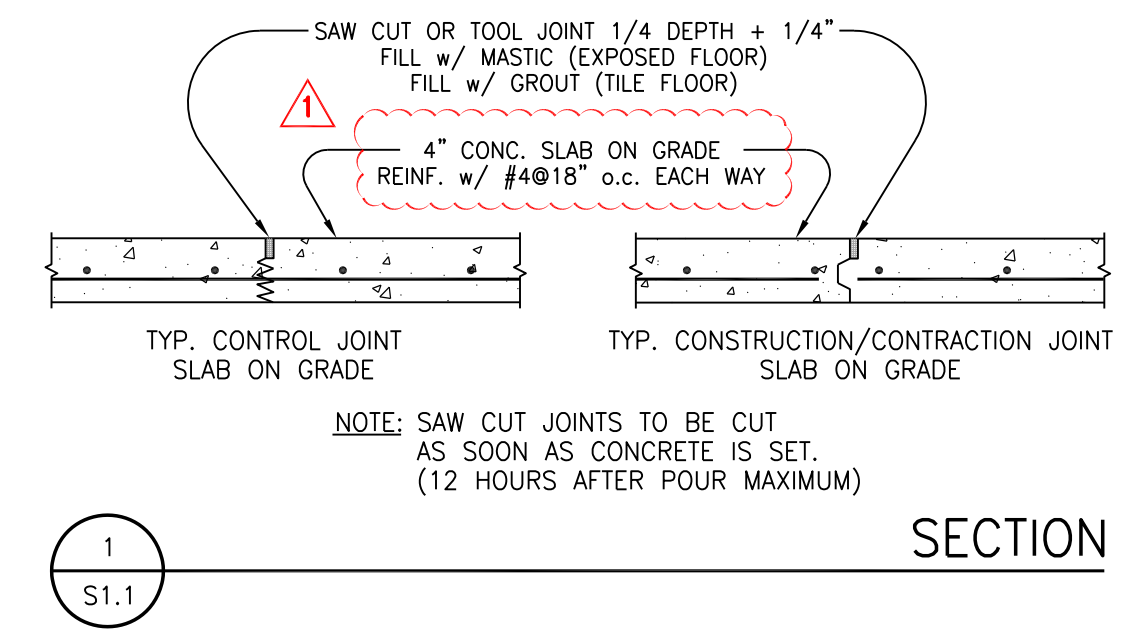

ADDENDUM #1
12/31/2024

REGISTERED PROFESSIONAL ENGINEER
STEVEN S. VONDAL
PE - 6694
DATE: 12/31/24


SOLIER & LARSON
ENGINEERING
CONSULTING STRUCTURAL ENGINEERS
3330 FIECHTNER DRIVE, SUITE 208
FARGO, NORTH DAKOTA 58103
TELEPHONE (701) 235-5293 FAX (701) 235-5294

wild | crg
architecture | construction

500 2nd Avenue North | Suite 514
Fargo, North Dakota 58102

Phone 701 | 293 | 8106
wildcrg.com

Foundation Plan
General Structural Notes
Sections & Details

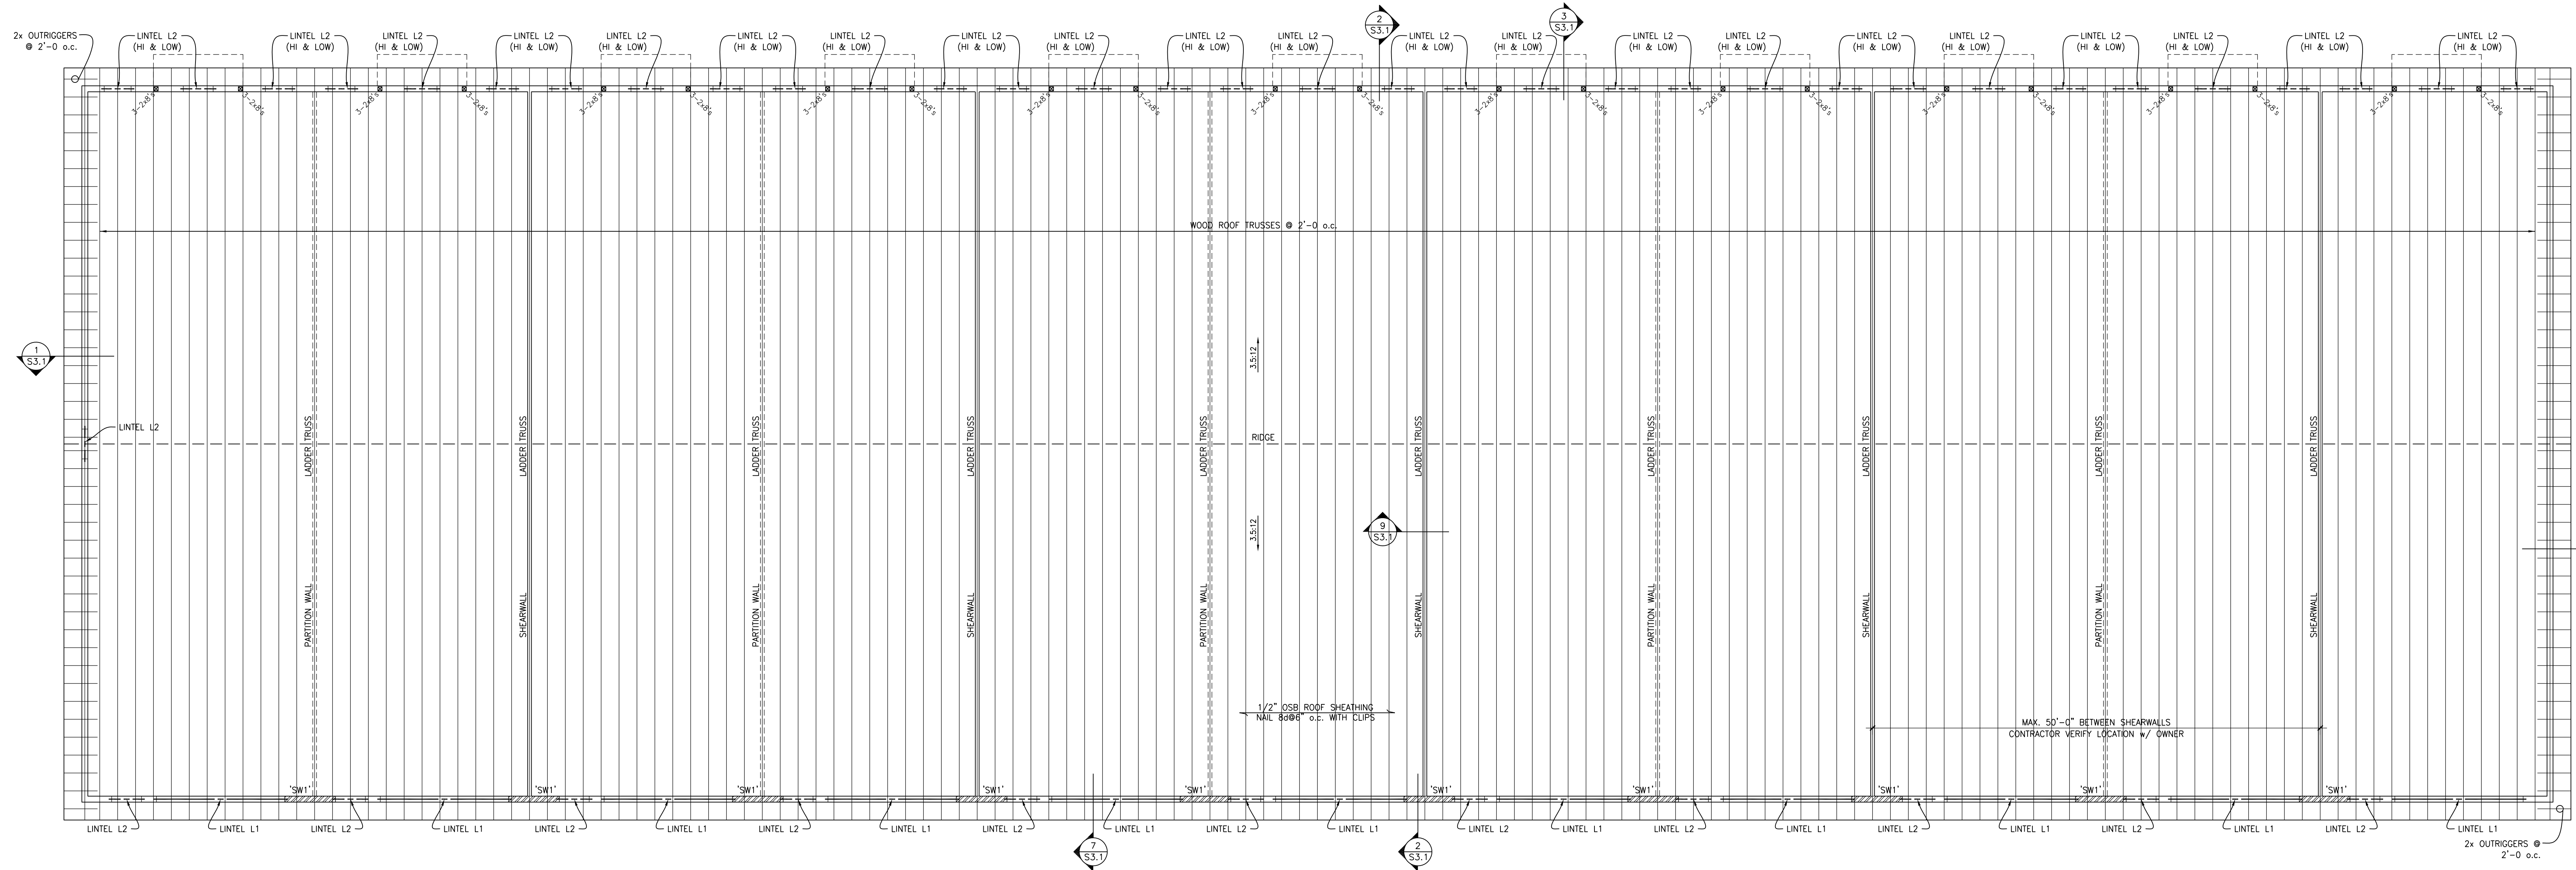


ROOF FRAMING PLAN


SCALE: 1/8"=1'-0"

LINTEL SCHEDULE			
MARK	LINTEL	R.O.	REMARKS
L1	4 - 1 3/4" x 14" LVL's @ TOP OF WALL 4 - 2x8's @ TOP OF OPENING	14'-0"	LVL's : 3 TRIMMERS/2 KING POSTS SAWNS : 3 TRIMMERS/3 KING POSTS
L2	4 - 2x8's	3'-0" TO 3'-4"	1 TRIMMER/3 KING POSTS


NOTE: 1). VERIFY ALL LINTEL OPENING WIDTHS, ELEVATIONS, AND LOCATIONS WITH THE ARCHITECTURAL PLANS.

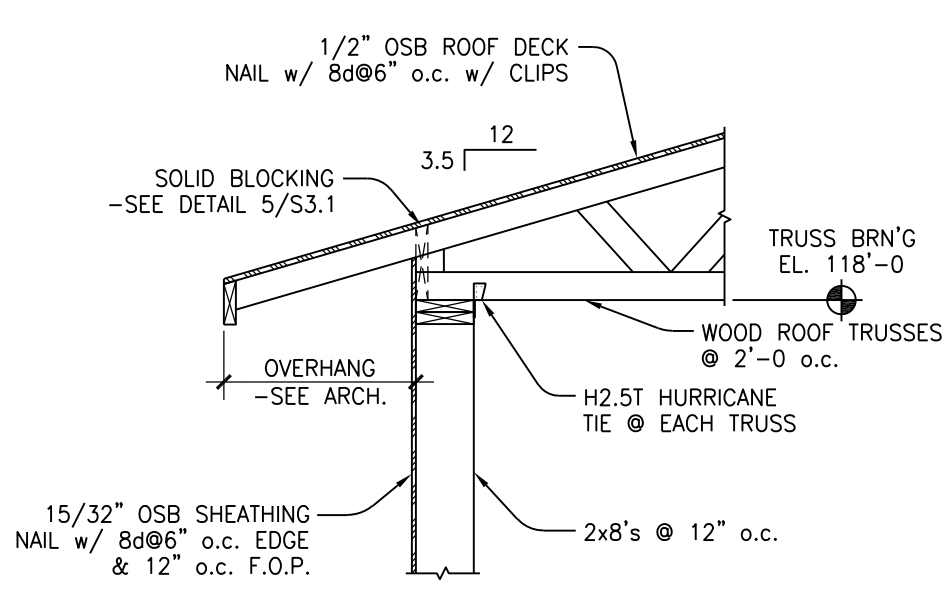

SECTION 1
SCALE: 1/2" = 1'-0"

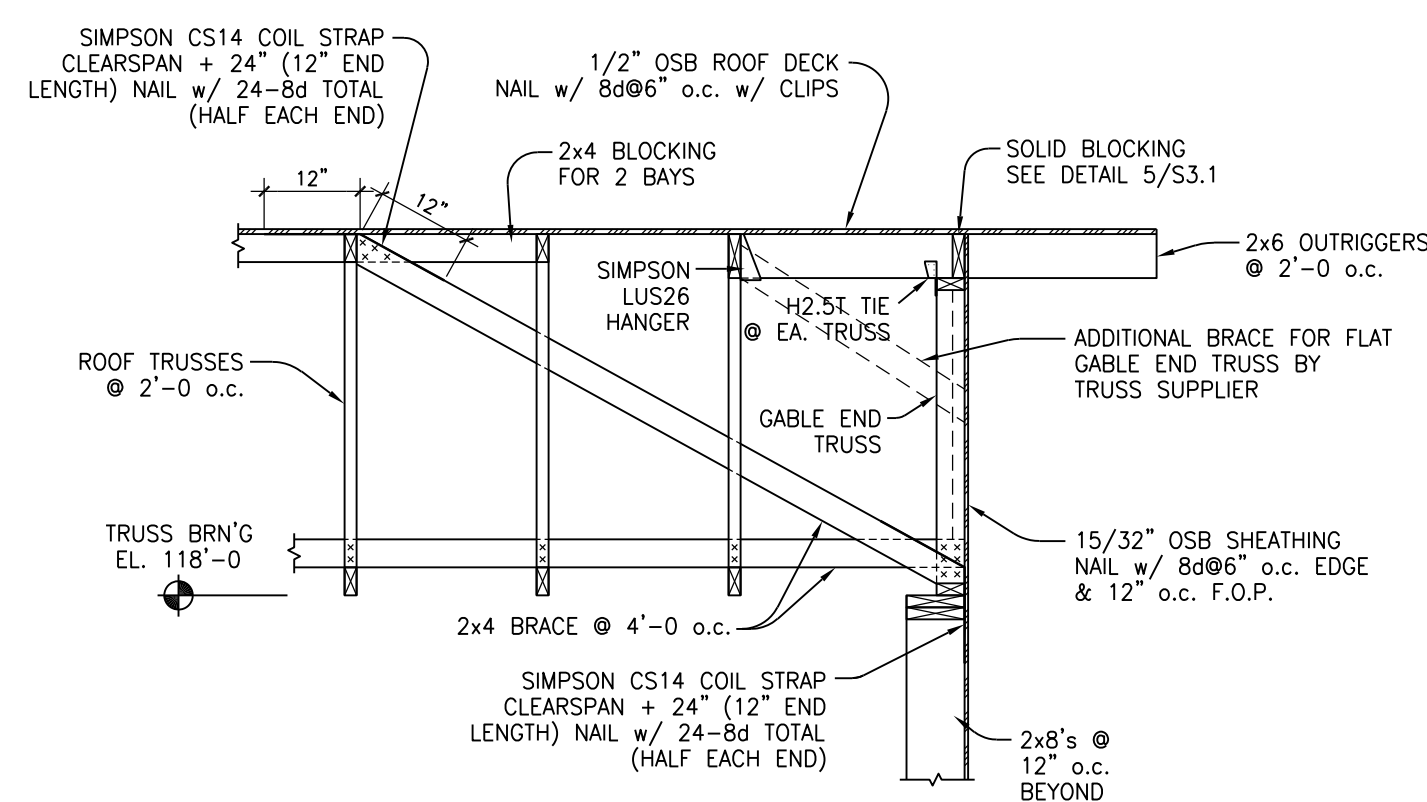


SECTION 2
SCALE: 1/2" = 1'-0"

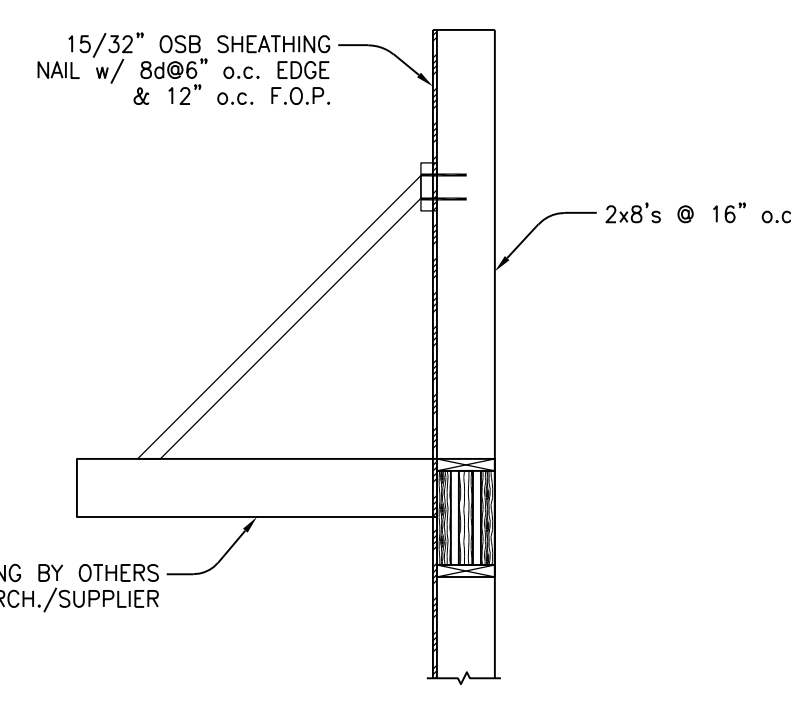


SECTION 3
SCALE: 1/2" = 1'-0"


** NOT USED **

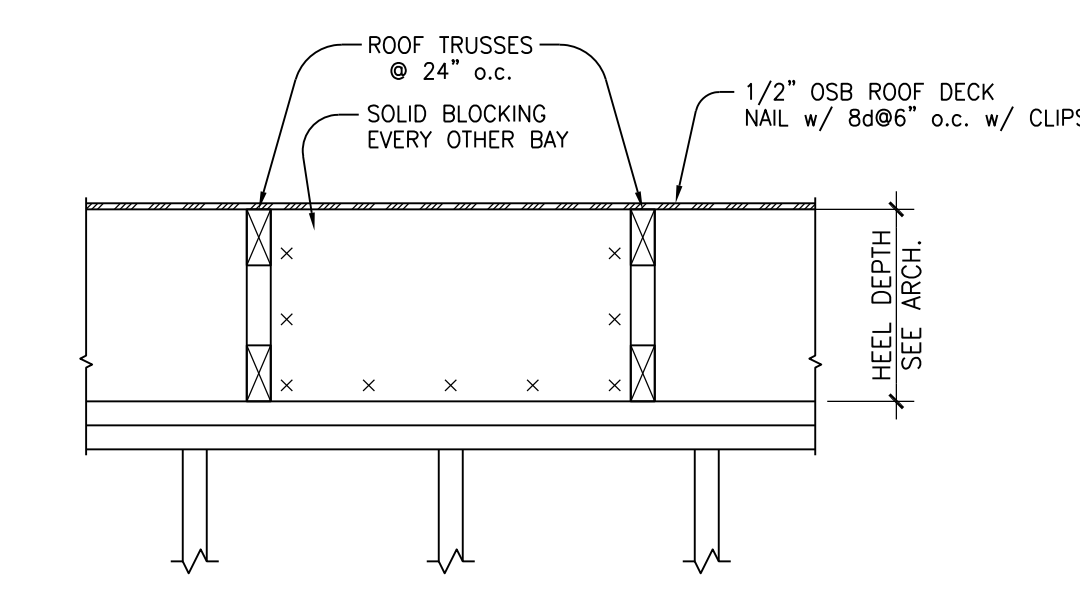


5 TYP. SOLID BLOCKING DETAIL
SCALE: 1" = 1'-0"

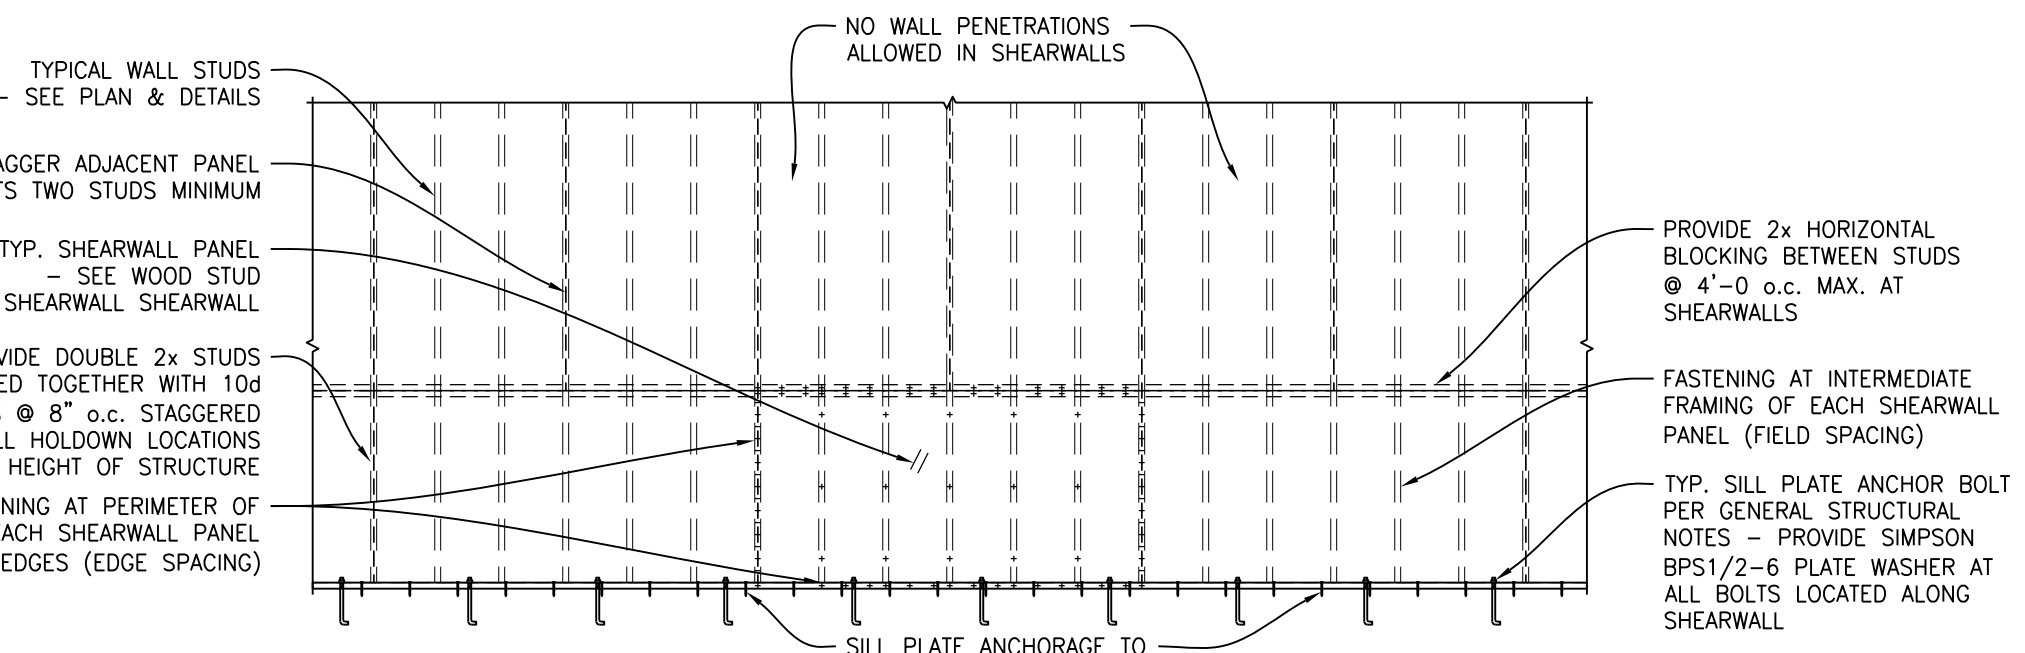


6 SHEARWALL ELEVATION
SCALE: 1/4" = 1'-0"

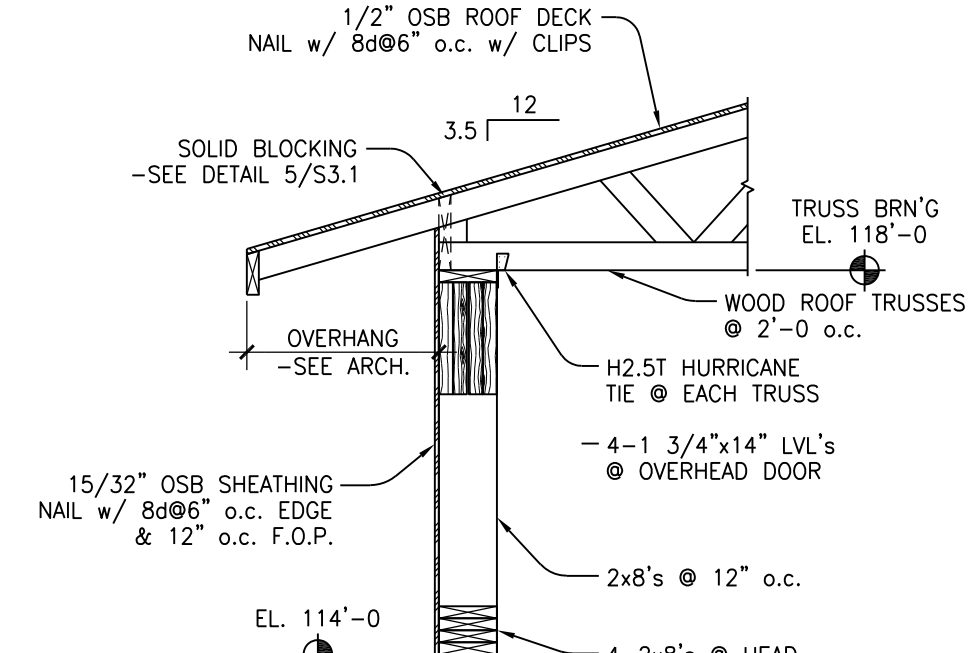



SECTION 7
SCALE: 1/2" = 1'-0"

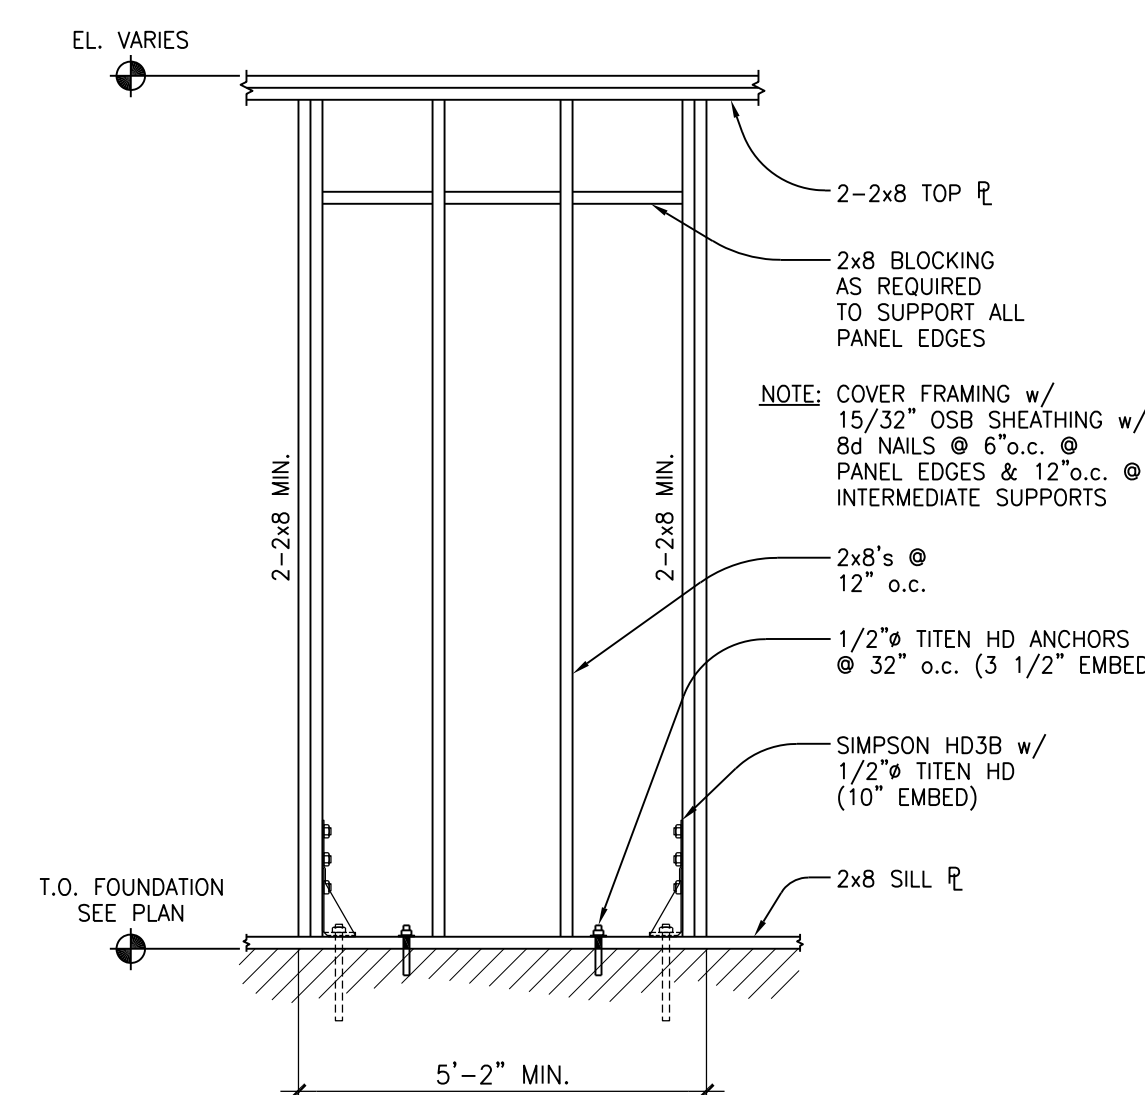

8 'SW1' SHEARWALL ELEVATION
SCALE: 1/2" = 1'-0"

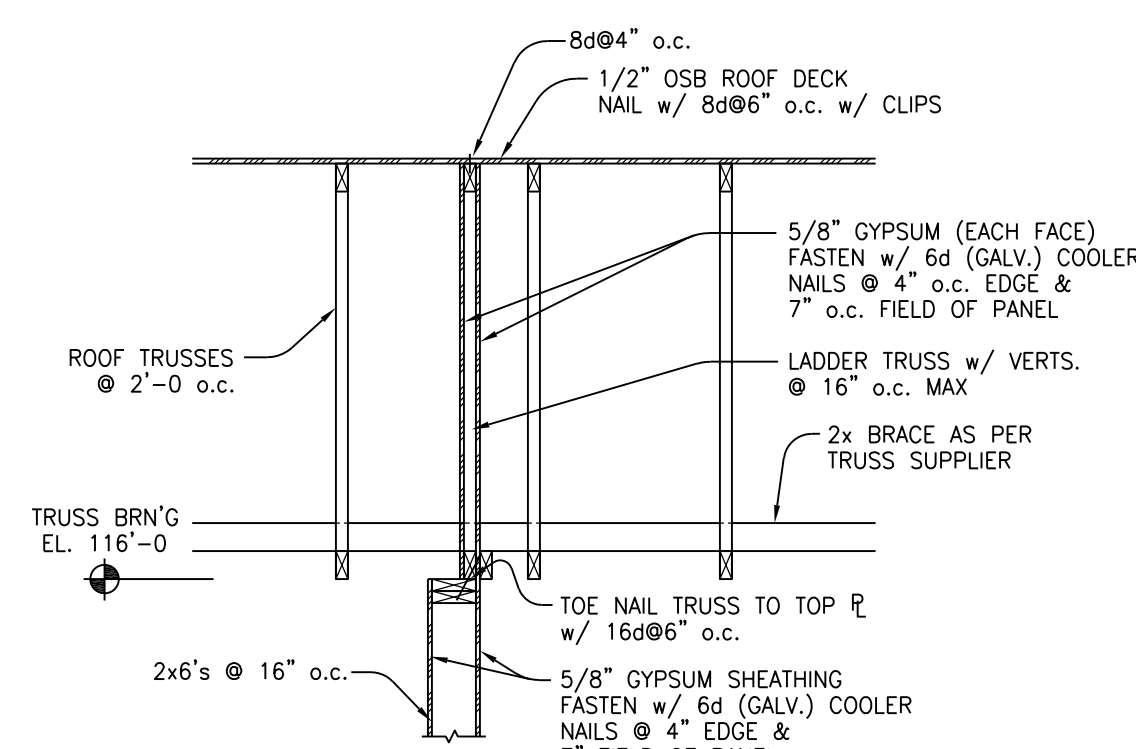

SECTION 9
SCALE: 1/2" = 1'-0"

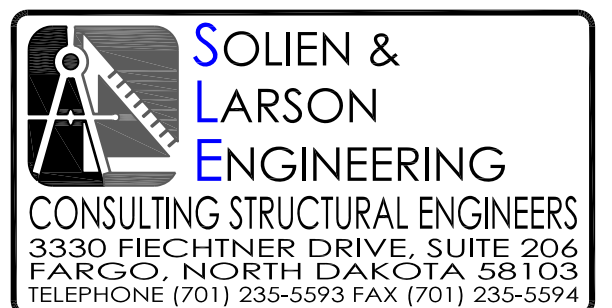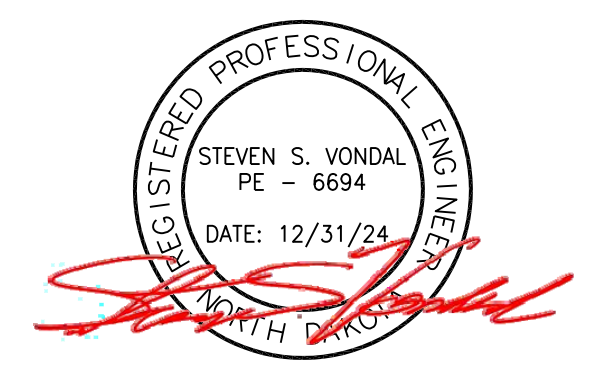


Roof Framing Plan
Sections & Details

Floor Plan General Notes

1. Rough carpentry contractor to provide & install all wood backing/blocking throughout.
2. Contractor to field verify all dimensions shown herein and alert Construction Manager of discrepancies.
3. All contractors to visit site to verify scope of work.
4. All walls to be framed, insulated, & sheathed to structure/structural deck above unless otherwise noted. See Wall Types & details for additional information.
5. Refer to Structural drawings for all shear wall locations.
6. All GWB to be painted SW 7667 (Zircon) with orange peel texture. Provide Level 3 finish at all GWB.
7. All products are basis of design UNO. Submit alternates to be approved by Owner/Arch.


Floor Plan Keynotes

- 100 amp panel at Utility 100.
- 200 amp panel at each tenant space.
- Access hatch in shop ceiling to vented attic. To be framed in drywall with insulated drywall panel - See Detail 8/A4.1.
- 4" reinforced concrete slab to be poured at Utility 100 only. Reinforcement #4 bar 1'-6" on center each way.
- Designated area for building services/equipment. Wall and ground mounted - See Civil
- 4" reinforced concrete slab to be poured for first 5'-0" at entire South area of plan. Reinforcement #4 bar 1'-6" on center each way. Allow for future concrete slab to tie-in at interior, allow for overhead door to close and seal properly to concrete slab.
- Steel bollard - See detail 2/A3.0 - Located 1'-0" off each side of the building (Qty. 4).
- Install exterior door to seal to foundation wall and allow for future interior concrete slab.
- Pre-finished metal canopy by Owner installed by framing contractor - Refer to Detail 5/A4.1.
- Floor to remain unfinished - dirt only. Allow for future concrete by Owner


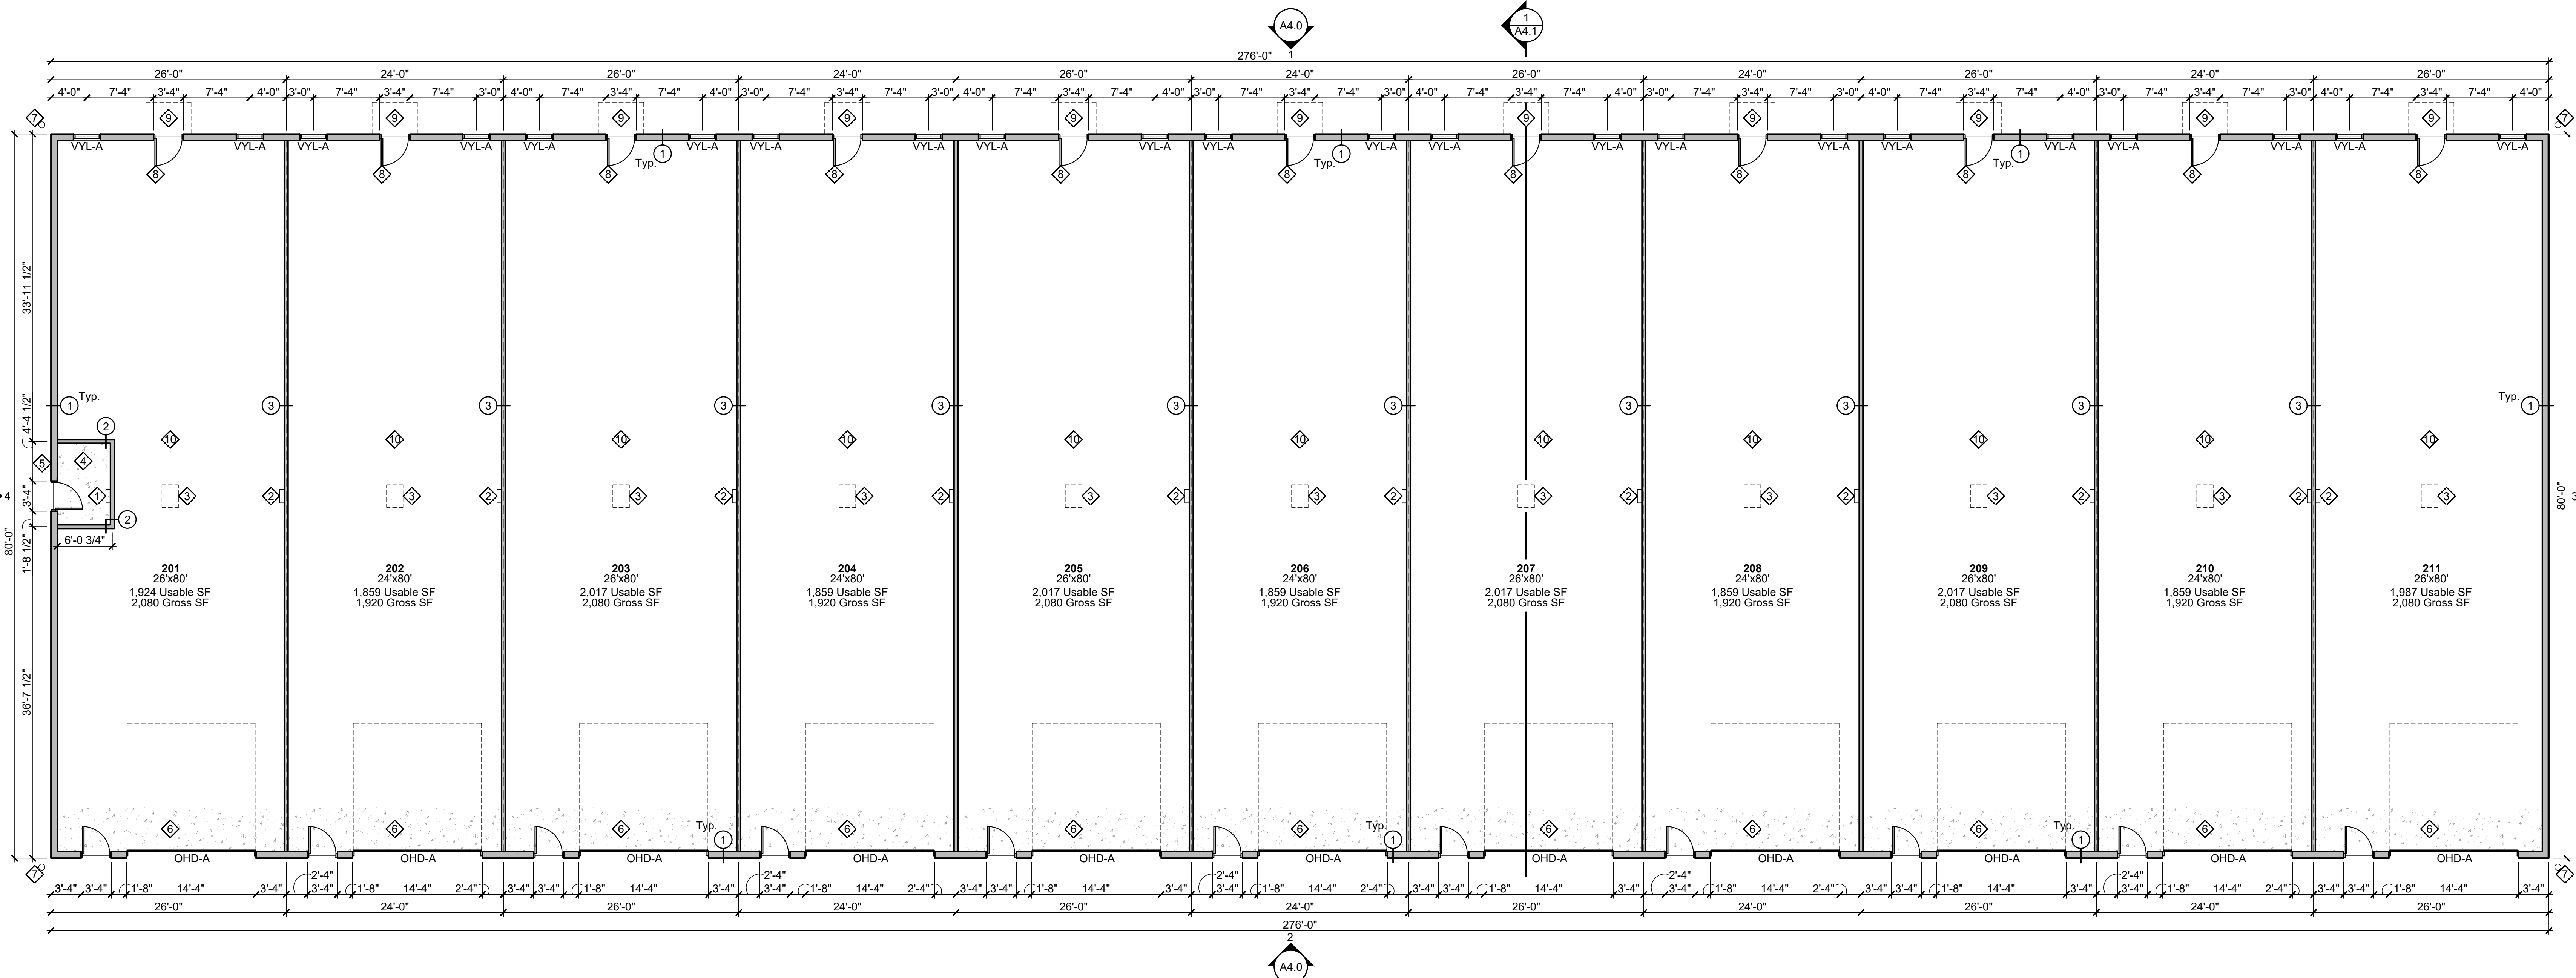


1 Floor Plan
1/8" = 1'-0"

11 Units
Total Gross: 22,080 SF

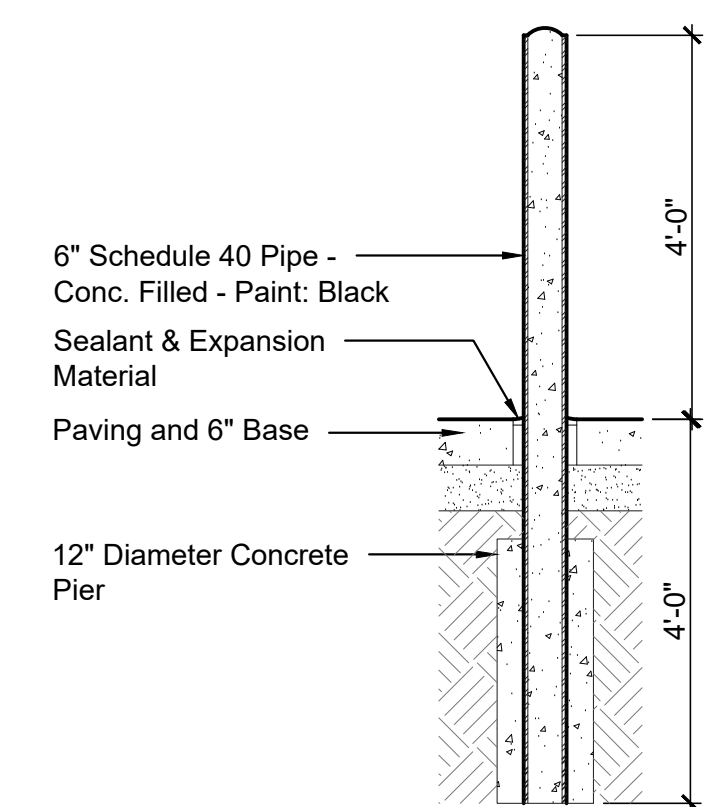


2 Bollard Detail
1/2" = 1'-0"

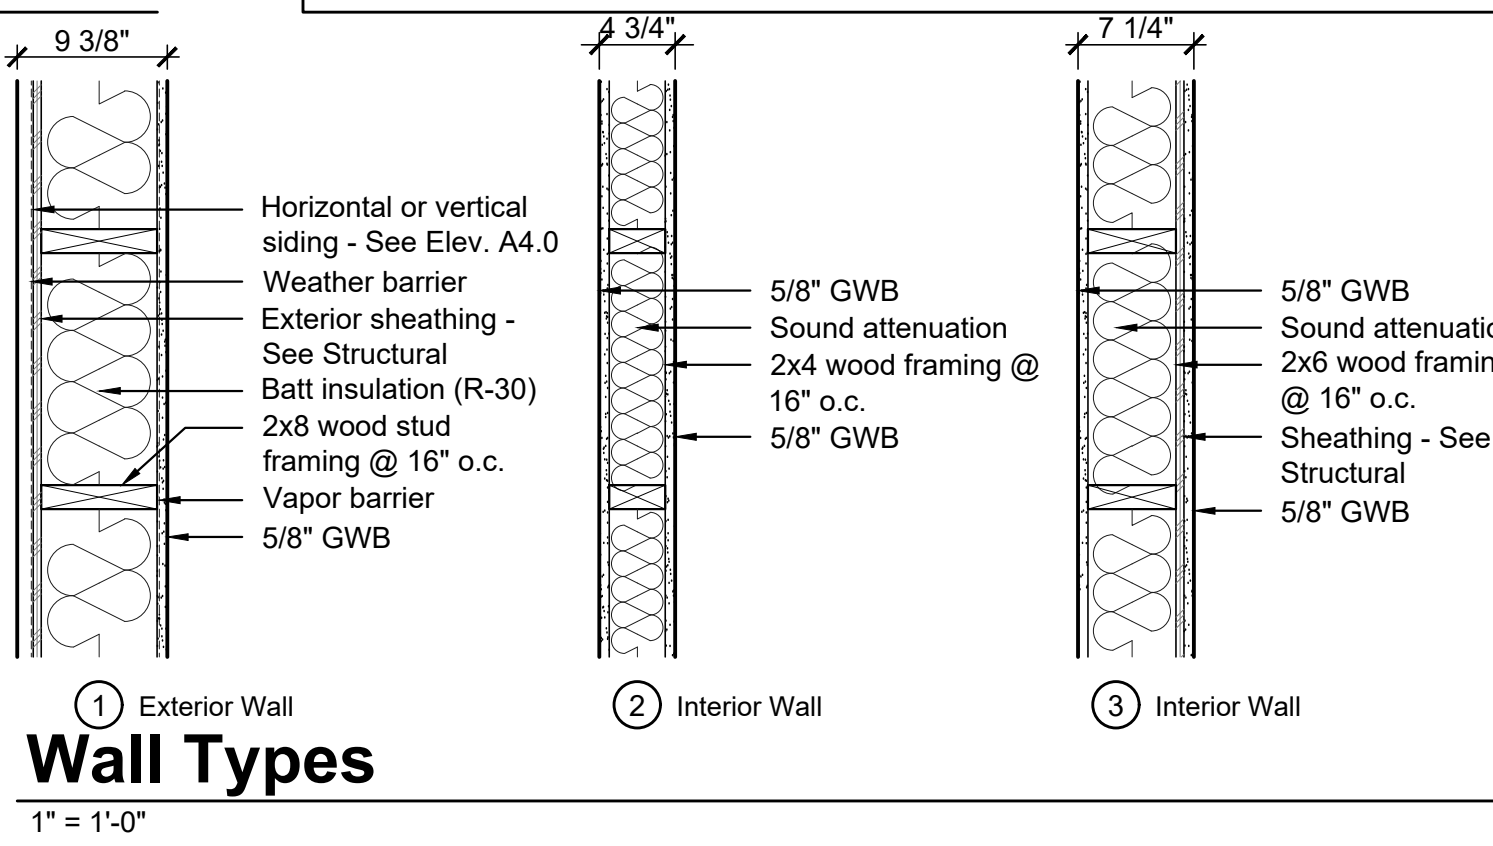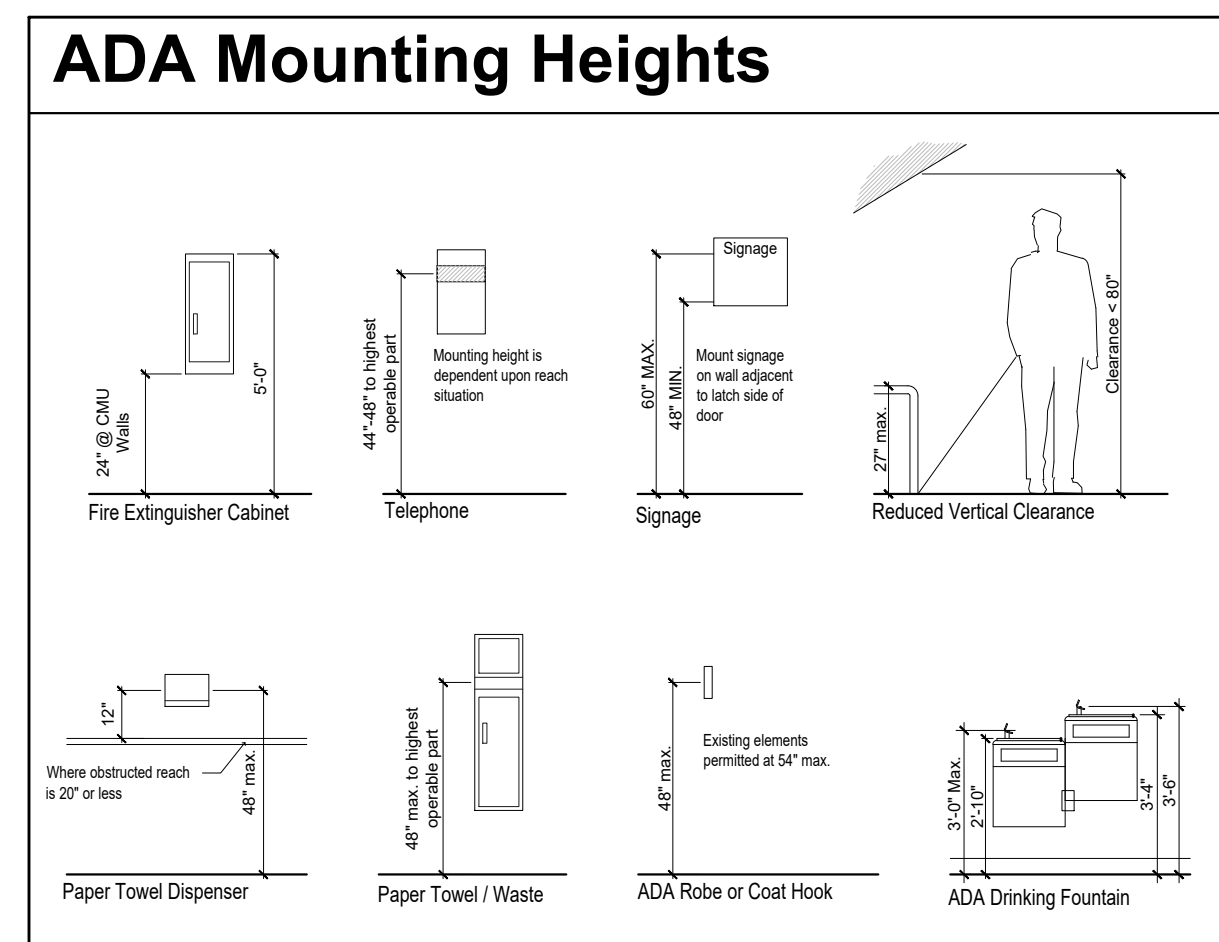

Door and Frame Schedule

Door Location	Size	Door Type	Rating	Frame Type	Hardware	Remarks
All Units	3'-0" x 6'-8" x 1 3/4"	Door-1	-	Door-1	Entrance Function Lockset and Deadbolt Basis of Design: Schlage AL Jupiter	-
Utility Room	3'-0" x 6'-8" x 1 3/4"	Door-2	-	Door-2	Entrance Function Lockset and Deadbolt Basis of Design: Schlage AL Jupiter	-

1. All Hardware to be Brushed Nickel finish unless otherwise noted.

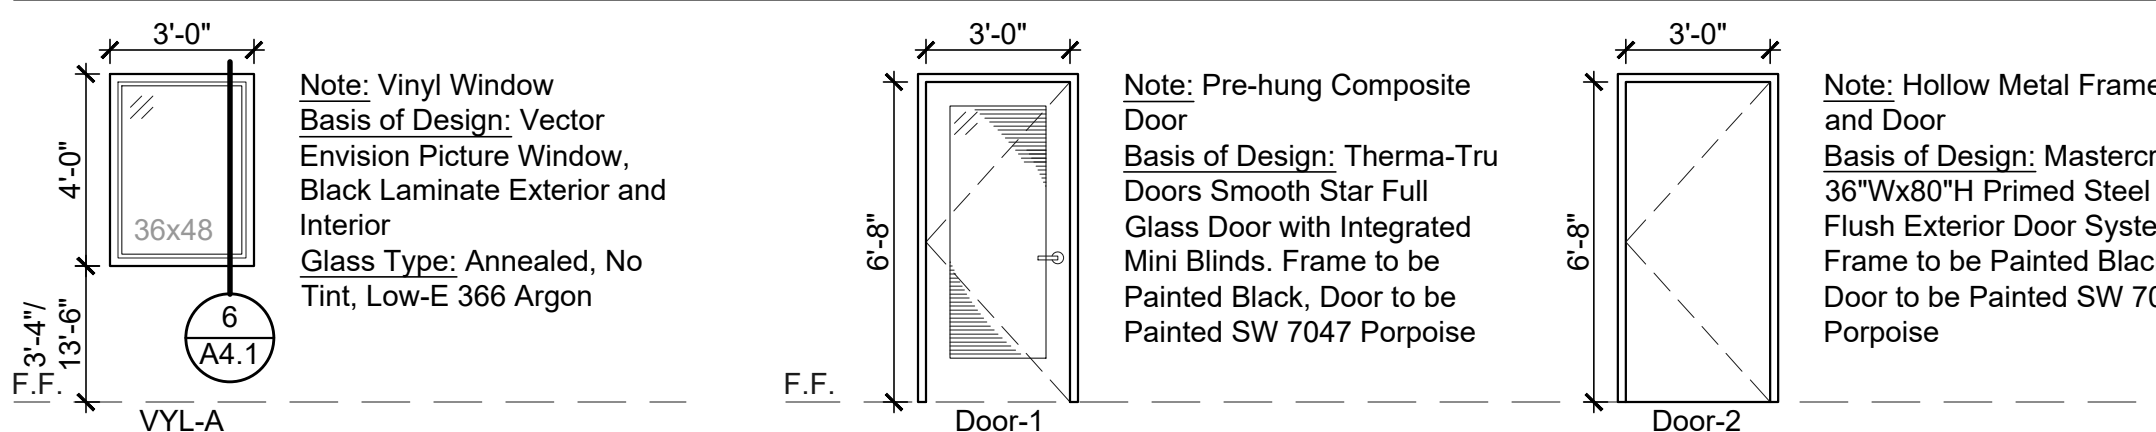



Window Types
1/4" = 1'-0"

Door and Frame Types
1/4" = 1'-0"

Planning and Zoning

Conditional CG - Conditional Heavy Commercial	
	Information
City Code Reference	See Civil Drawings
Lot Size	266,731
Building Size	22,080 sq ft (Building 2 of 4)
Zone	Conditional GC - Conditional Heavy Commercial
Maximum Building Coverage	80%
Maximum Lot Impervious Area	85%
Landscape Buffer	20' Along South and East property lines
Front Yard Setback	15'
Interior Yard Setback	0' as long as building is 2 stories or less
Street Side Setback	0' as long as building is 2 stories or less
Rear Yard Setback	10'
Building Height Limit	3 Stories or 50'
Parking Requirements for Development	
Total Development Size	91,012 sq ft
Parking Calc. Factor (Business)	1 Stall per 360 sq ft - 220
On Street Parking	48 Stalls Allowed based on Ordinance and Layout
Number of Stalls Required	253
Total Parking Provided	268

Key Plan

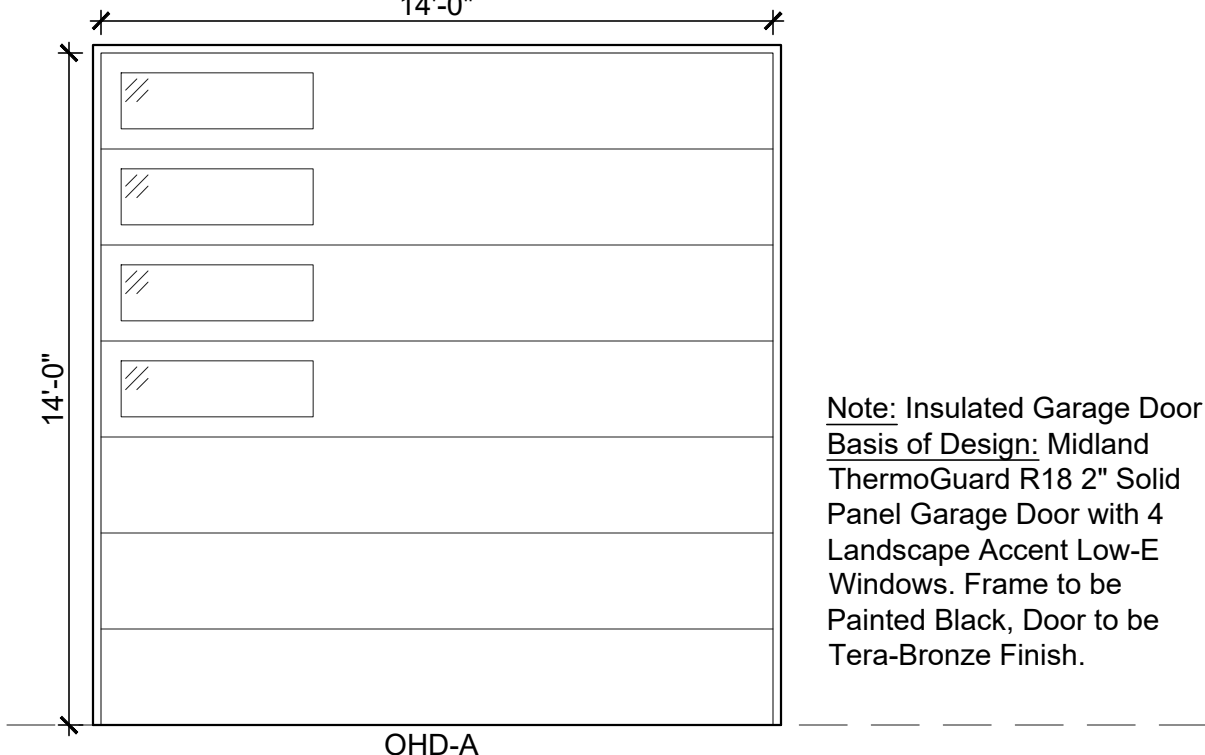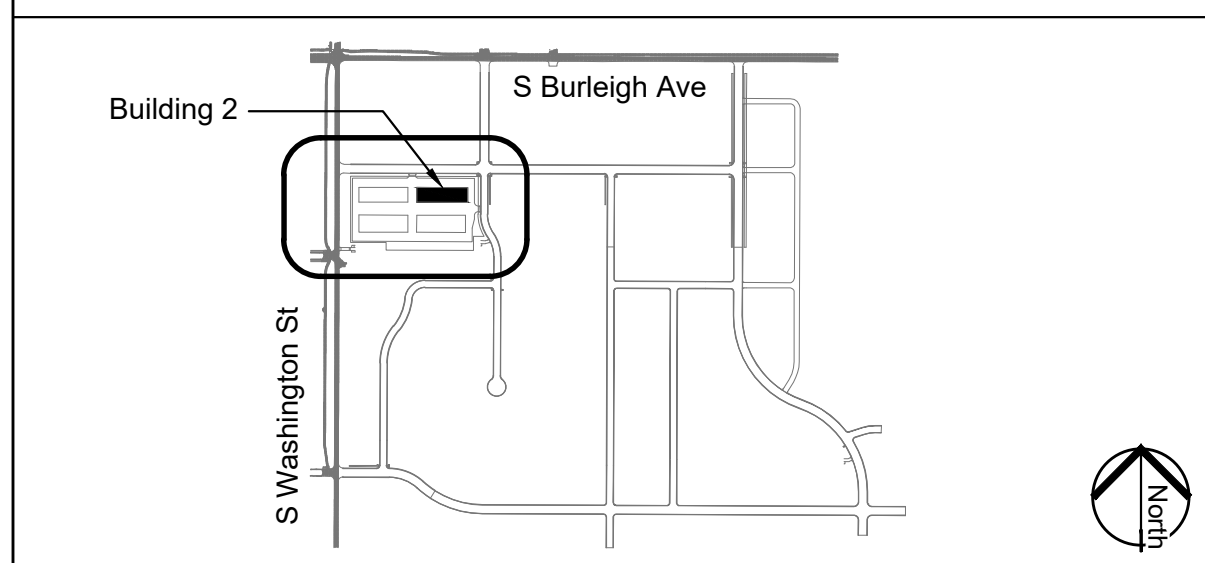

Code Research Summary

2021 International Building Code			
	Information	Reference	
Occupancy	Mixed Use Group - "B" Business, "M" Mercantile, "S-1" Storage	Section 304, 309, 311	
Total Square Footage	22,080 sq ft (Building 2 of 4)	See Floor Plans	
Sprinkled	Yes	Section 903	
General Building Information			
Height - Maximum Feet	"B" Business: 60 ft, "M" Mercantile: 60 ft, "S-1" Storage: 60 ft	Table 504.3	
Height - Maximum Stories	3 Stories, 2 Stories, 2 Stories	Table 504.4	
Area - Base Allowable (S1)	36,000 sq ft, 36,000 sq ft, 36,000 sq ft	Table 506.2	
Area - Base Allowable (SM)	27,000 sq ft, 27,000 sq ft, 27,000 sq ft	Table 506.3	
Area - Frontage Increase	N/A	Section 506.3.3	
Area - Factor Increase	N/A	Table 506.3.3	
Allowable Area	N/A	Table 506.3.3	
Total Allowable Area Per Floor	N/A		
Fire Separation Area	N/A		
Construction/ Fire Resistive Requirements			
Construction Type	Type V-B (sprinkled)	Table 601	
Structural Frame	0 hours	Table 601	
Exterior Bearing Wall	0 hours	Table 601	
Interior Bearing Wall	0 hours	Table 601	
Exterior Non-Bearing Wall	0 hours	Table 601	
Interior Non-Bearing Wall	0 hours	Table 601	
Floor/ Ceiling	0 hours	Table 601	
Roof/ Ceiling	0 hours	Table 601	
Fire Rated Resistive Construction			
Maximum Area of Exterior Wall Openings	Not Required since >30' Separation Distance	Section 705.8	
Fire Barriers	As Required by Table 508 for Occupancy Separation No Separation Required Between "B", "M", and, "S-1"	Section 706	
Fire Barriers (Incidental Use Areas)	See Section 707 and 711	Section 706.4 / 707.3.10	
Light, Ventilation, and Sanitation			
Minimum Facilities Required	Standard		
Water Closets	To Be Determined	Table 2902.1	
Lavatories	To Be Determined	Table 2902.1	
Urinals	To Be Determined	Table 2902.1	
Drinking Fountains	To Be Determined	Table 2902.1	
Service Sink	To Be Determined	Table 2902.1	
Means of Egress			
Use	To Be Determined		
Occupant Load Factor	To Be Determined	Table 1004.5	
Occupant Load - Net Area	To Be Determined		
Total Tenant Occupant Load	To Be Determined		
Number of Exits Required	2 Provided at Each Tenant Space	Section 1006	
Minimum Exit Width Required	To Be Determined		
Means of Egress Minimum Height	7 ft 6 in	Section 1003.2	
Exit Door Minimum Width	32 in Clear (3'-0" nominal); Maximum: 48"	Section 1010.1.1	
Exit Door Minimum Height	6 ft 8 in	Section 1010.1.1	
Maximum Exit Access Travel Distance	B - 200 ft, M and S-1 - 250 ft	Table 1017.2	
Common Path of Egress Travel	B and S-1 - 75 ft, M - 75 ft	Table 1006.2.1	
Dead Ends	50 ft	Section 1020.5	
Project Description			
The Paradise Business Centre is located in the Paradise Valley Development in South Bismarck off of Fisher Lane and Rutland Drive. There are 4 buildings within the project. This code review reflects Building 2 only. The building is type V-B construction and is fully sprinkled. It is a Mixed-Use occupancy consisting of Business "B", Mercantile "M", and Storage "S-1". There are 11 total units in total. All work is to comply with Title 14 and Ordinance no. 6516. Off-street and on-street parking are being utilized to meet parking requirements.			

I HEREBY CERTIFY THAT THIS PLAN SPECIFICATION OR REPORT WAS PREPARED BY ME OR UNDER MY DIRECT SUPERVISION AND THAT I AM A QUALY REGISTERED ARCHITECT UNDER THE LAWS OF THE STATE OF NORTH DAKOTA.
DATE: 01/31/2024 REGISTRATION NO. 2809
SIGNED: [Signature]




Floor Plan, Code Research Summary, Planning and Zoning, Key Plan, Door and Frame Schedule/ Types, Wall Types, Window Types, Notes, Details

© Copyright 2024 WJCRG, L.L.C.


Date: 01/31/2024 Sheet
Project Number: 2344
Drawn By: APJ
Checked By: AEK
Approved By: AEK

A3.0

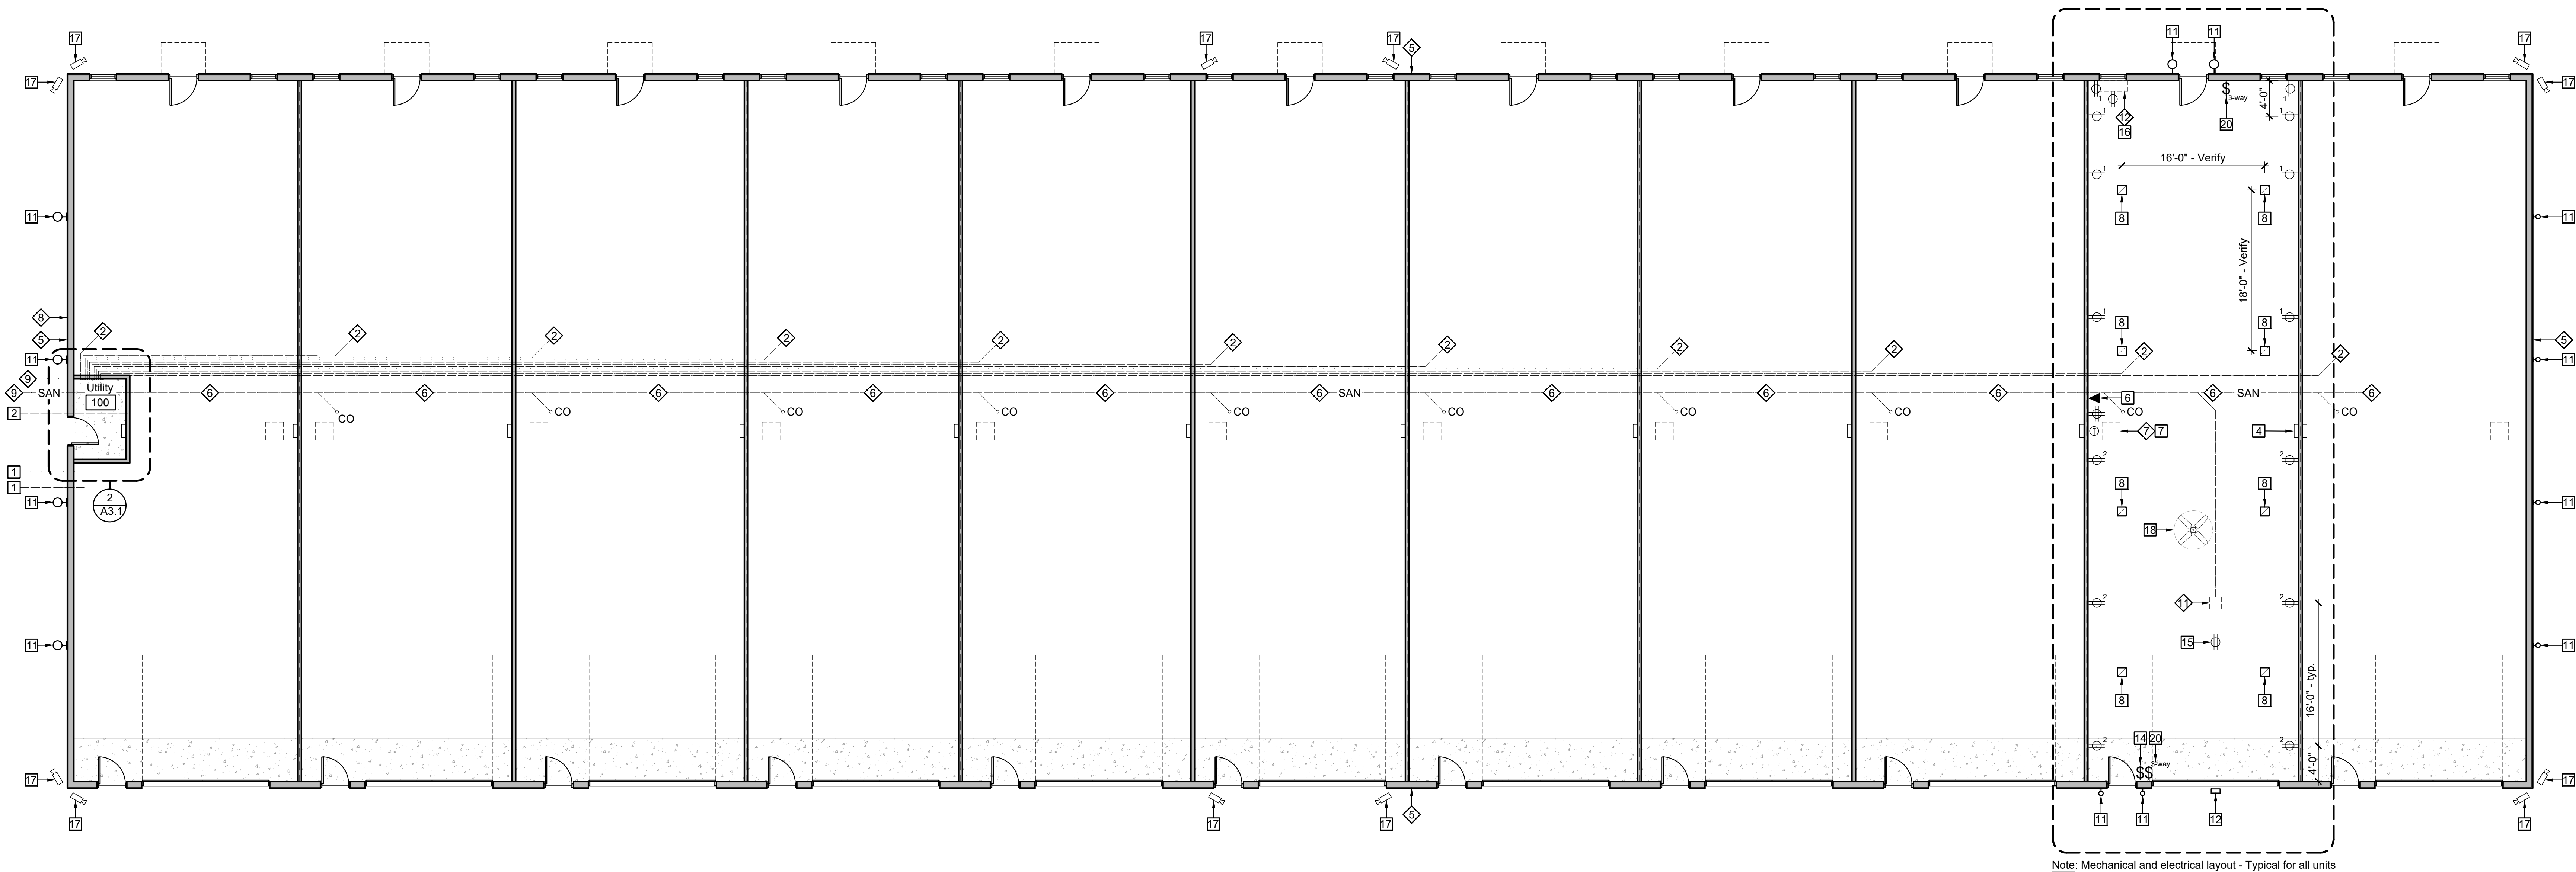

Note: Mechanical and electrical layout - Typical for all units

1 Mechanical / Electrical Plan
1/8" = 1'-0"

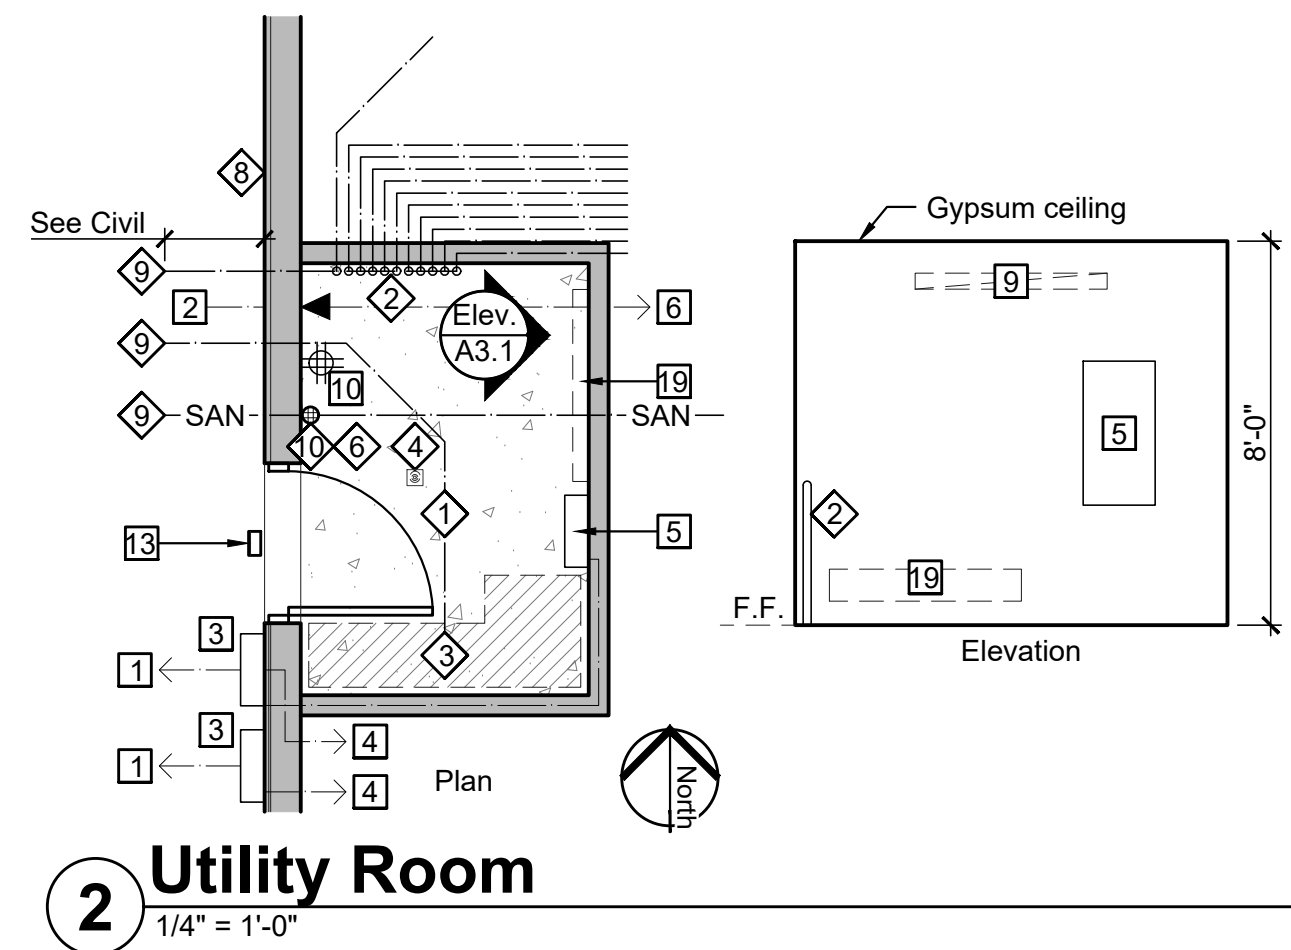

2 Utility Room
1/4" = 1'-0"

Mech/Plumbing Notes:

- Note: Mechanical/Plumbing Contractor to review drawings and visit site prior to bidding. Mechanical/Plumbing Contractor to design-build; provide all materials, labor, taxes, and permitting to achieve scope of work indicated on drawings. Provide required information and drawings necessary for state and local code review/approval and construction coordination.
- 1 Provide (1) 4" C900 (Domestic) CW Line into Utility 100. Provide water meter as required by code - verify location with CM.
 - 2 Provide (1) 1" (Domestic) CW Line as shown on plan underground per unit. Provide (1) shut off valve at each branch of 1" CW line in Utility 100. Stub 4" (Vertical) into each tenant space for future use. Verify location. Verify with City of Bismarck.
 - 3 Designated area for fire riser and components for complete NFPA 13 fire suppression system. Each unit to have open shell design. Allow for future build out by Owner.
 - 4 Provide 2" Floor Drain at Utility 100.
 - 5 Provide (4) exterior Hose Bibs as shown on plan.
 - 6 Provide 4" PVC Sanitary Sewer line and cleanouts as shown on drawings. Stub 4" (Vertical) into each tenant space for future toilet room. Verify location with Arch/CM. Verify proper line slope - See Civil Drawings.
 - 7 Provide ceiling-hung heater and thermostat for each unit. Basis of Design: Reznor UDX Natural Gas Unit Heater. Include all components to vent thru roof. Direct wired or plug in. Verify heater and thermostat location and height with Arch/CM. Verify total BTUs required per unit with mechanical contractor.
 - 8 Gas Meters provided by utility company - verify location with Owner/CM. Provide gas lines as shown on Plan to each ceiling-hung heater.
 - 9 Final connection to utilities by Mechanical Contractor. Verify locations with Civil Drawings.
 - 10 Plumbing contractor to provide floor drain vent pipe through roof as required.
 - 11 Provide 4" vertical stub for future floor drain and pipe to storm sewer at each tenant space.
 - 12 Thru-wall HVAC/lor cooling unit mounted below window. See Elevations for location. Basis of Design: Gree PTAC II GAE15AED3NRNB5GCP. Verify power requirements with Electrical Contractor. Verify condensate requirements with Mechanical Contractor. Provide custom color grill to be select by Architect/Owner.

Electrical Notes:

- Note: Electrical Contractor to review drawings and visit site prior to bidding. Electrical Contractor to design-build; provide all materials, labor, taxes, and permitting to achieve scope of work indicated on drawings. Provide required information and drawings necessary for state and local code review/approval and construction coordination.
- All electrical outlets to be 60" A.F.F. U.N.O. Electrical contractor to provide plywood backing at panels.
- 1 Provide Transition Cabinet including (1) 4" Conduit from Transformer to Transition Cabinet. Provide (2) main conduit from Transition Cabinet to Utility 100 feeding (2) 800 Amp Main Breaker/MDPs - See Civil drawings.
 - 2 Transformer and Transition Cabinet to be located adjacent to Building 1 and shared with Building 2. Provide (2) concrete filled steel bollards as required by utility company. Verify route and footage of conduit with utility company.
 - 3 Provide (1) 2" PVC conduit from communication/data site pedestal to Utility 100. Daylight conduit into Utility 100 and daisy chain conduit to Building 4. Verify location of site pedestal with utility communication/data company - See Civil Drawings.
 - 4 Provide (2) 800 Amp (208/240 Single Phase) main breakers, feeding (1) 200 Amp panels, individually metered. Meters to be located on either side of MDP outside Utility 100 - Verify with utility company and electrical contractor.
 - 5 Each tenant space to receive (1) surface mounted 200 Amp panel. Provide required underground conduit to each tenant space, verify location of panel at each tenant space with CM/Owner.
 - 6 Utility 100 to receive (1) surface mounted 100 Amp panel, verify location of panel with CM/Owner.
 - 7 Provide (1) 3/4" conduit under ground from Utility 100 to each tenant space for future communication/data.
 - 8 Provide power to ceiling hung heater. Verify with Mechanical contractor.
 - 9 High bay light fixture for general interior shop lighting. Basis of Design: Lithonia Lighting CPHB 12LM MVOLT 50K Contractor Select Compact Pro LED High Bay. Provide minimum lumens requirements to meet code. All shop lighting to be on single circuit. Verify final quantity of fixtures and lighting layout with CM/Owner.
 - 10 Provide (1) 4'-0" LED utility fixture surface mounted on wall in Utility 100. Basis of Design: Lithonia Lighting WL LED Wall Surface Mount Bracket, 3000 Lumens, 5000K.
 - 11 Provide (1) quad outlet in Utility 100. Verify location with CM/Owner. See interior elevation.
 - 12 Provide (2) wall sconce light fixtures at each walk-through door on the North and South elevations and the East and West elevation as shown. Basis of Design: LEONLITE Integrated LED Cylinder Up/Down Outdoor Wall Light, 100V-277V, 20W, 3000K. See A4.0 for locations. All exterior fixtures to be controlled in Utility 100 with single photoeye.
 - 13 Provide (1) wall pack light fixture above each garage door on the South elevation. Basis of Design: RAB Lighting LED WP2XFU60, Color Selectable, Bronze Finish. See A4.0 for location. All exterior fixtures to be controlled in Utility 100 with single photoeye.
 - 14 Provide (1) downlight light fixture above Utility 100 door on the East elevation. Basis of Design: Lithonia Lighting WXP0 LED Wall Mount, Model #WXP0 LED ALO SWW2 MVOLT PE DDXD M2. See A4.0 for location. All exterior fixtures to be controlled in Utility 100 with single photoeye.
 - 15 Overhead door control location. Provide functions for Open, Close, and Stop.
 - 16 Receptacle for overhead door operator - ceiling mount.
 - 17 Dedicated 208-220v receptacle for thru-wall HVAC/lor cooling unit. Verify power requirements with Mechanical Contractor.
 - 18 POE security camera layout as shown. Include Cat6 to location and 8TB hard drive in Utility 100. Product: Revo Surveillance Systems. Include wire shelf. Verify final camera selection and location with CM/Owner. See 2/A3.1.
 - 19 56" ceiling fan. Basis of Design: Westinghouse Jan Ceiling Fan, White Finish, Model #7812700, no light. Provide variable speed switch at shop door to control shop ceiling fan.
 - 20 4" electrical baseboard heater in Utility 100. Basis of Design: Cadet 48 in. 206-volt 1,000/750-watt Electric Baseboard Heater, Finish: White, Model #4F1000W.
 - 21 Provide 3-way switch at each door to control all interior shop lighting.

I HEREBY CERTIFY THAT THIS PLAN, SPECIFICATION, OR REPORT WAS PREPARED BY ME OR UNDER MY DIRECT SUPERVISION AND THAT I AM A DULY REGISTERED ARCHITECT UNDER THE LAWS OF THE STATE OF NORTH DAKOTA.

DATE: 01/31/2024 REGISTRATION NO.: 2899

SIGNED: _____

wild | crg
architecture | construction

500 2nd Avenue North | Suite 514
Fargo, North Dakota 58102

Phone 701 | 293 | 8106
wildcrg.com

Mechanical and Electrical Design-Build Plan, Notes, Enlarged Plan

Material Legend

- 1 - Metal Lap Siding
- Quality Edge, TruCedar Steel Siding
- Profile: Single 6" (Horizontal)
- Color: Solid 425 Statuary Bronze
- 2 - Metal Lap Siding
- Quality Edge, TruCedar Steel Siding
- Profile: Single 6" (Horizontal)
- Color: Solid 469 Fresh Canvas
- 3 - Metal Lap Siding
- Quality Edge, TruCedar Steel Siding
- Profile: 6" Board & Batten (Vertical)
- Color: HD2 Woodgrain M16 Cider Mill
- 4 - Metal Lap Siding
- Quality Edge, TruCedar Steel Siding
- Profile: Single 6" (Horizontal)
- Color: Solid 410 Thatch
- 5 - Stone Veneer
- Versetta Stone, Ledgestone
- Panel Size: 36" x 8"
- Color: Sterling
- Include Stone Cap
- 6 - Asphalt Shingles
- CertainTeed Landmark
- Color: Moire Black

Elevation Keynotes

- 1 Thru-wall HVAC/ Cooling Unit Mounted Below Window. Verify Power Requirements with Electrical Contractor. Provide Custom Color Grill to be Selected by Architect/Owner - See A3.1.
- 2 Pre-finished metal canopy by Owner installed by framing contractor - Refer to Detail 5/A4.1.
- 3 Prefinished Metal Gutters and Downspouts. Basis of Design: Klauer Classic Rainware Collection - Color: Terra Bronze - Profile: Square.
- 4 Gas and Electric Meters - Verify with Owner for Mounting Locations. Minimize Visual Impact to Extent Possible.
- 5 Light Fixture - See A3.1.
- 6 Light Fixture - See A3.1.
- 7 Light Fixture - See A3.1.

Roof Plan General Notes

- 1. Coordinate with Mechanical Plan for Equipment Locations, Venting & Information.

Roof Plan Keynotes

- 1 Ice and water barrier where indicated by hatch 4'-0" Min.
- 2 Asphalt shingles over underlayment and installed per manufacturer's recommendations - Basis of Design: CertainTeed Landmark
- 3 Ridge Vent - Provide and install final quantity recommended by roofing contractor.
- 4 Shear wall/ draft stop to extend to underside of roof deck - See Structural
- 5 Pre-manufactured Canopy - See Detail 5/A4.1.

ANDREW E. BERTHA
REGISTERED ARCHITECT
NORTH DAKOTA
DATE: 01/31/2024 REGISTRATION NO.: 2829
SIGNED: _____

wild | crg
architecture | construction
500 2nd Avenue North, Suite 514
Fargo, North Dakota 58102
Phone 701 | 293 | 8106
wildcrg.com





Elevations, Material Legend, Roof Plan, Notes

© Copyright 2024 WILDCRG.LTD.


Date: 01/31/2024
Project Number: 2344
Drawn By: APJ
Checked By: AEK
Approved By: AEK

Sheet


A4.0

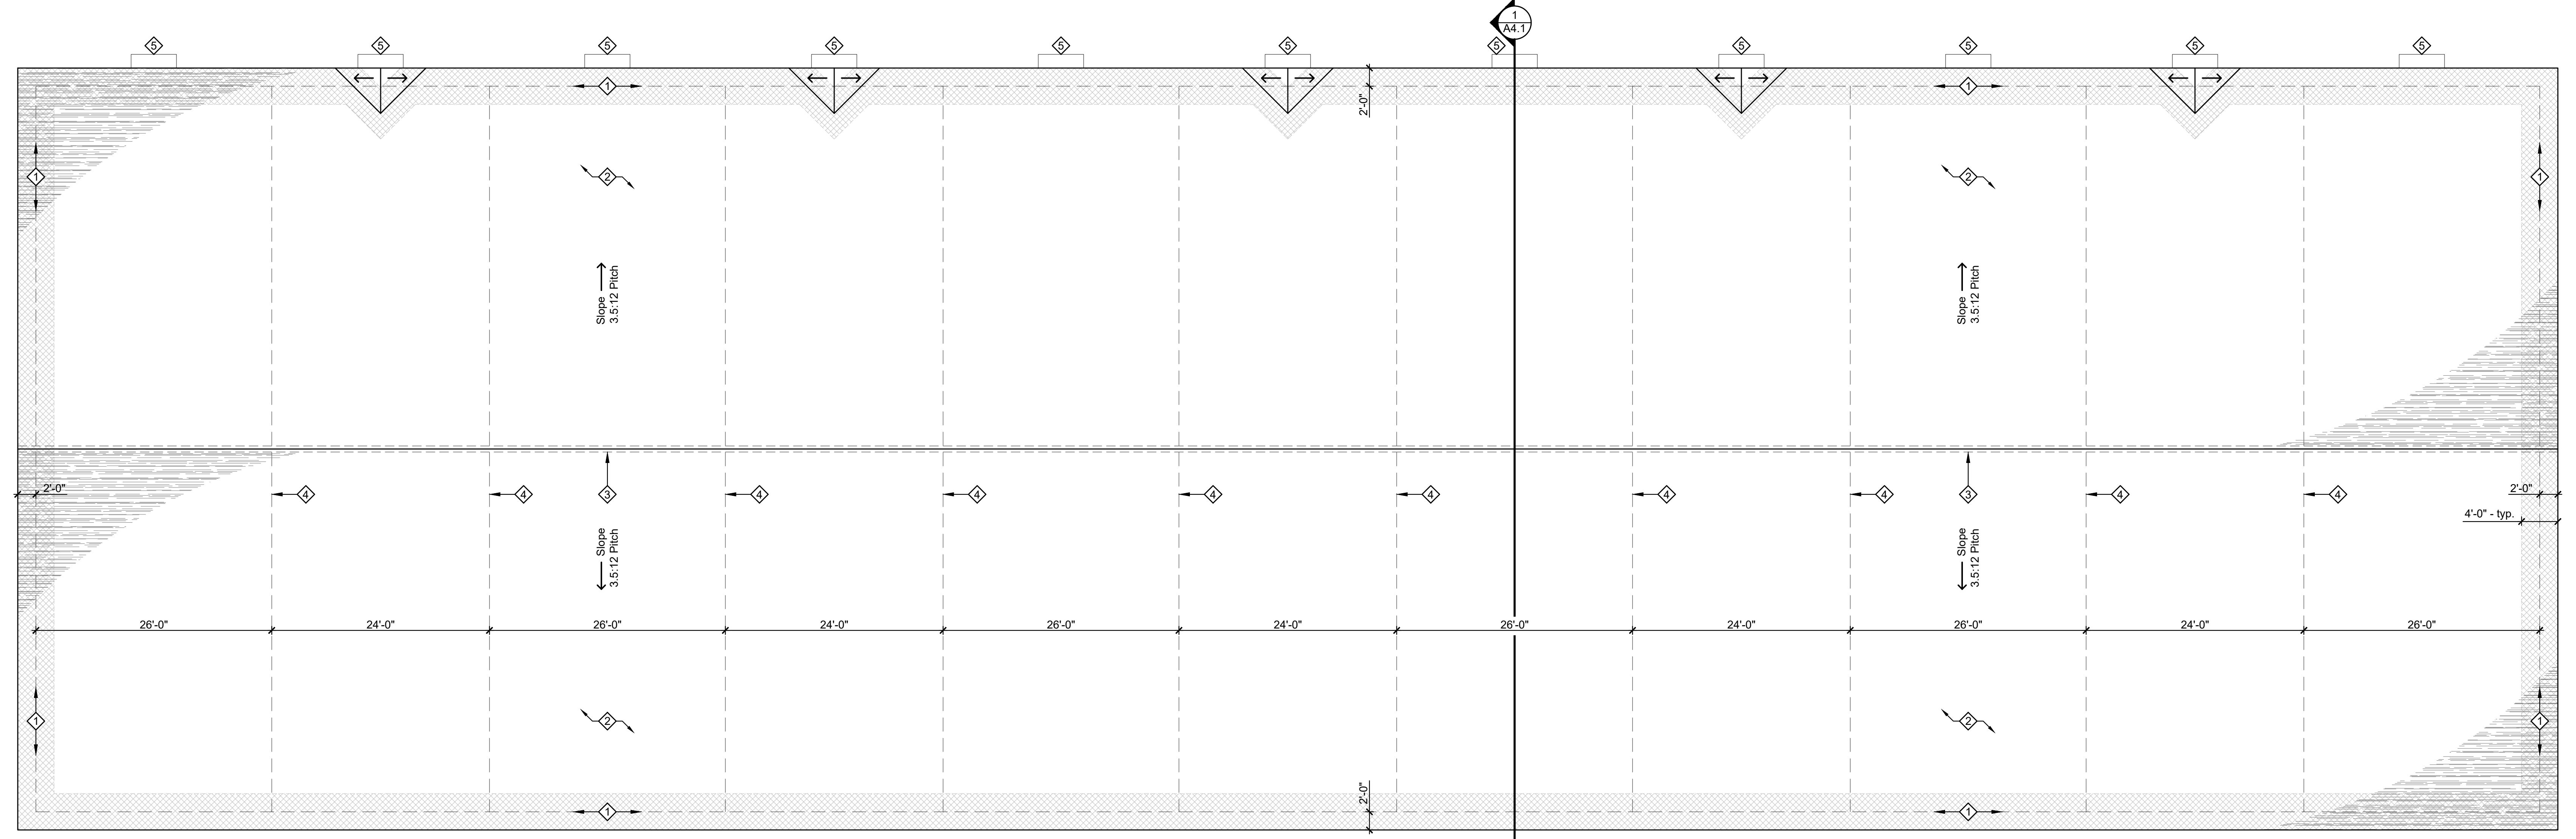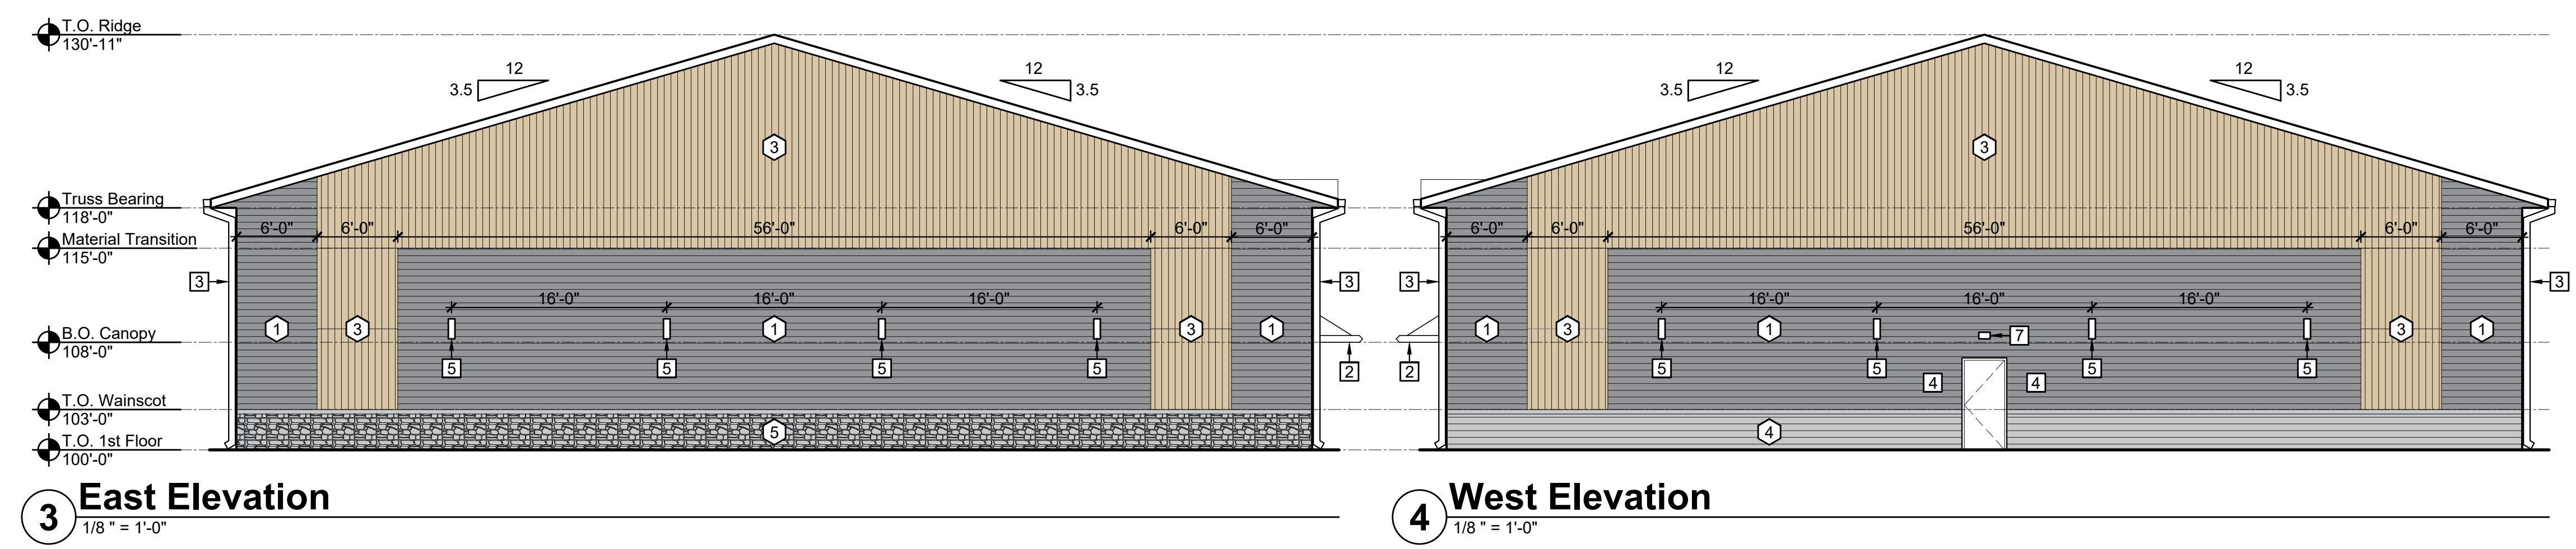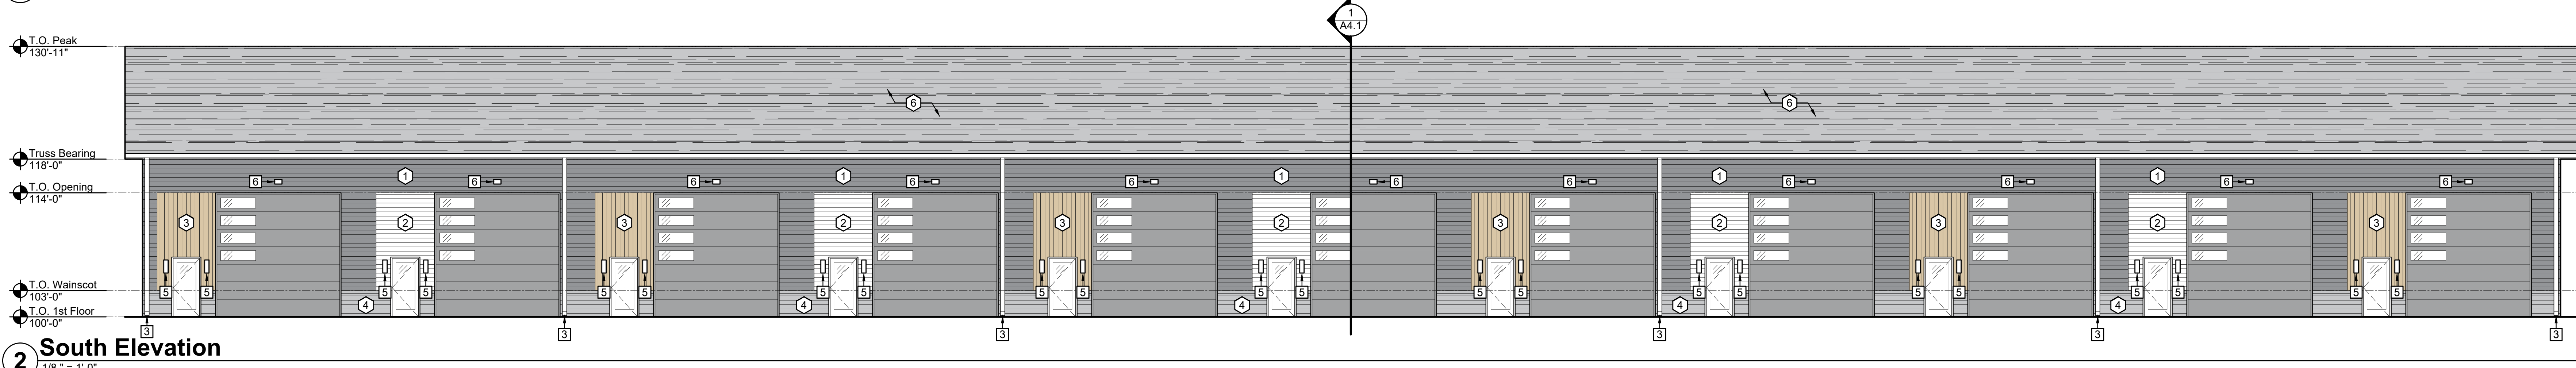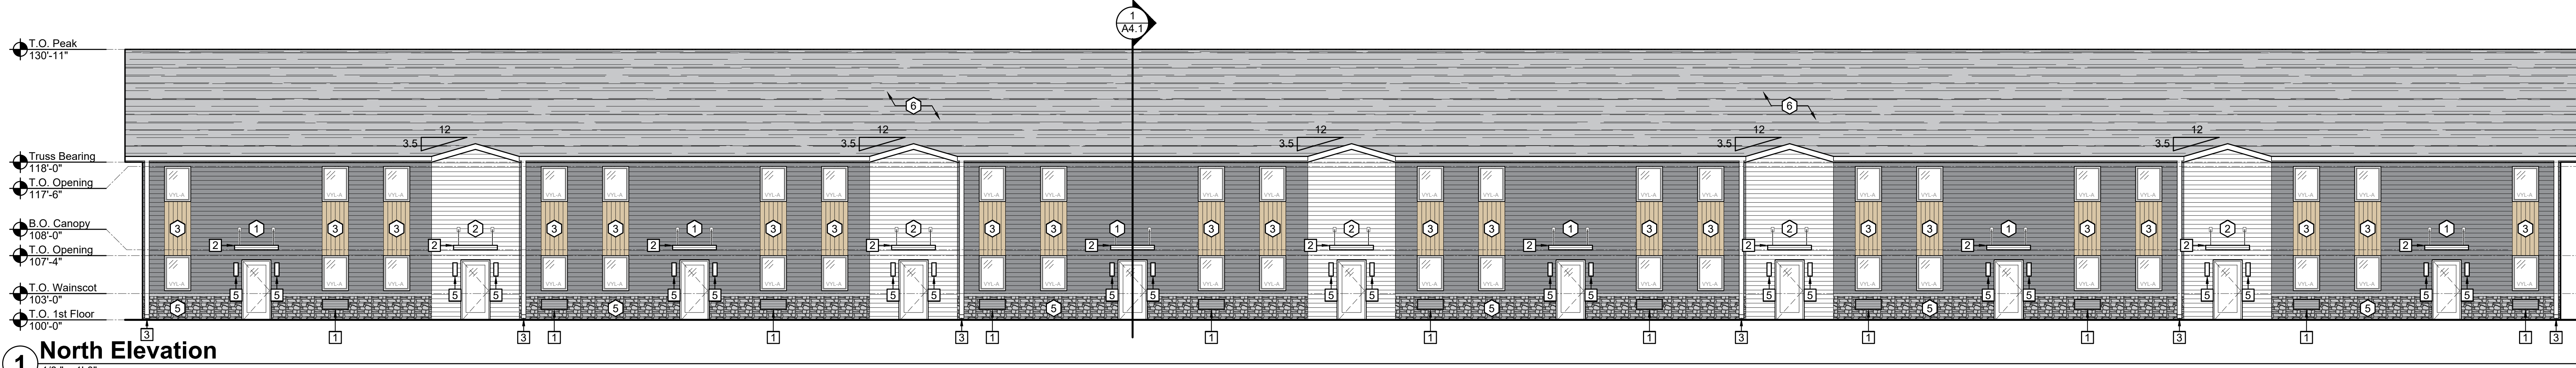


5 Roof Plan
1/8" = 1'-0"

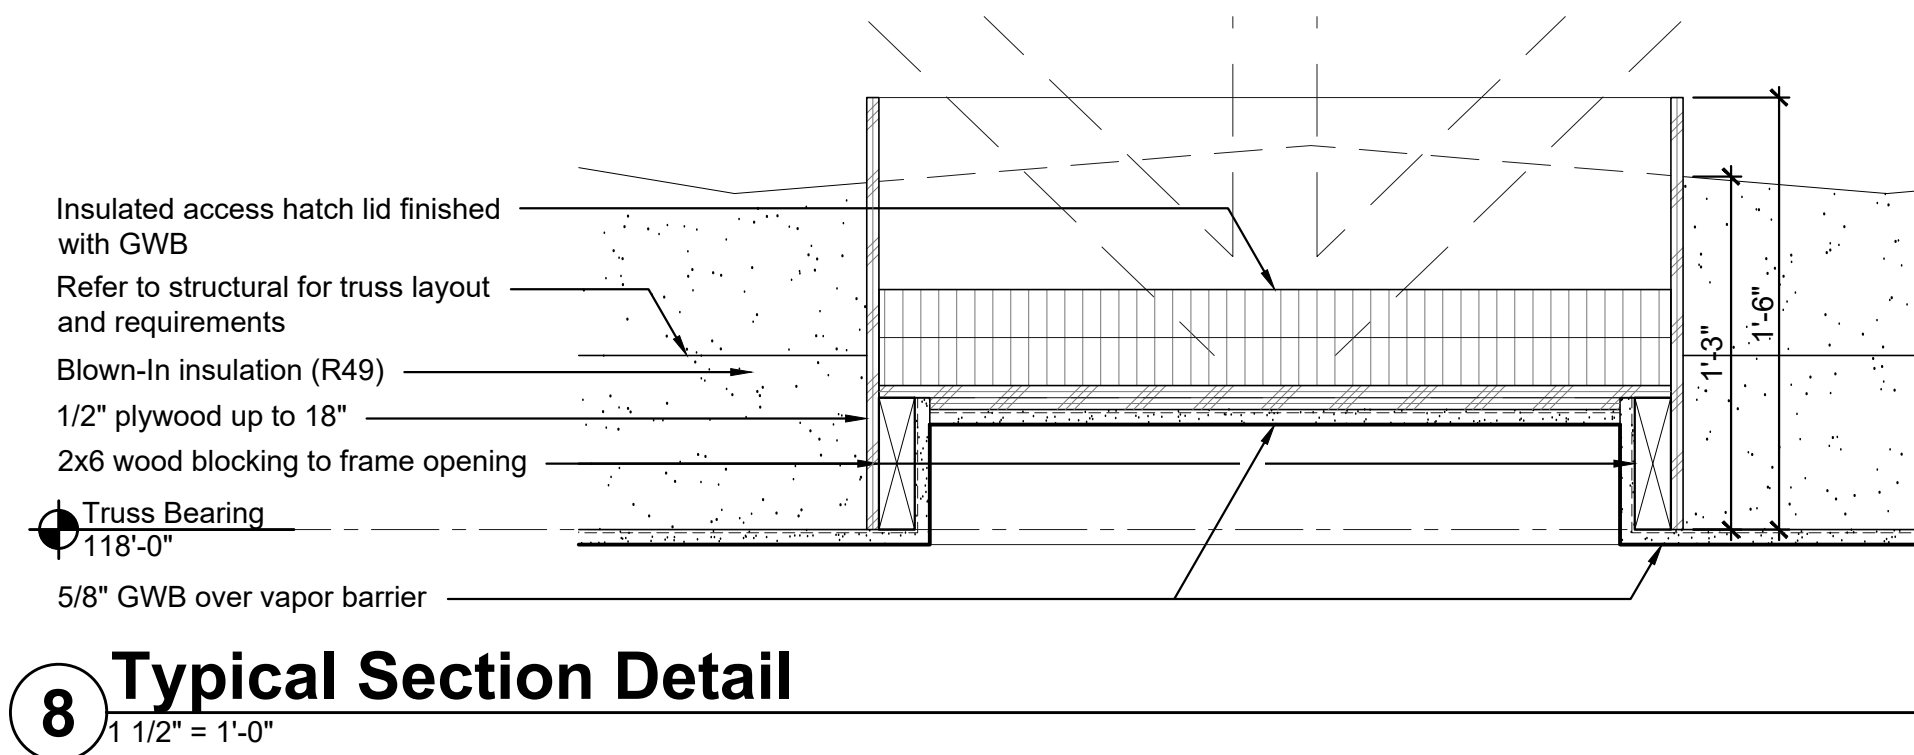


8 Typical Section Detail
1/12" = 1'-0"

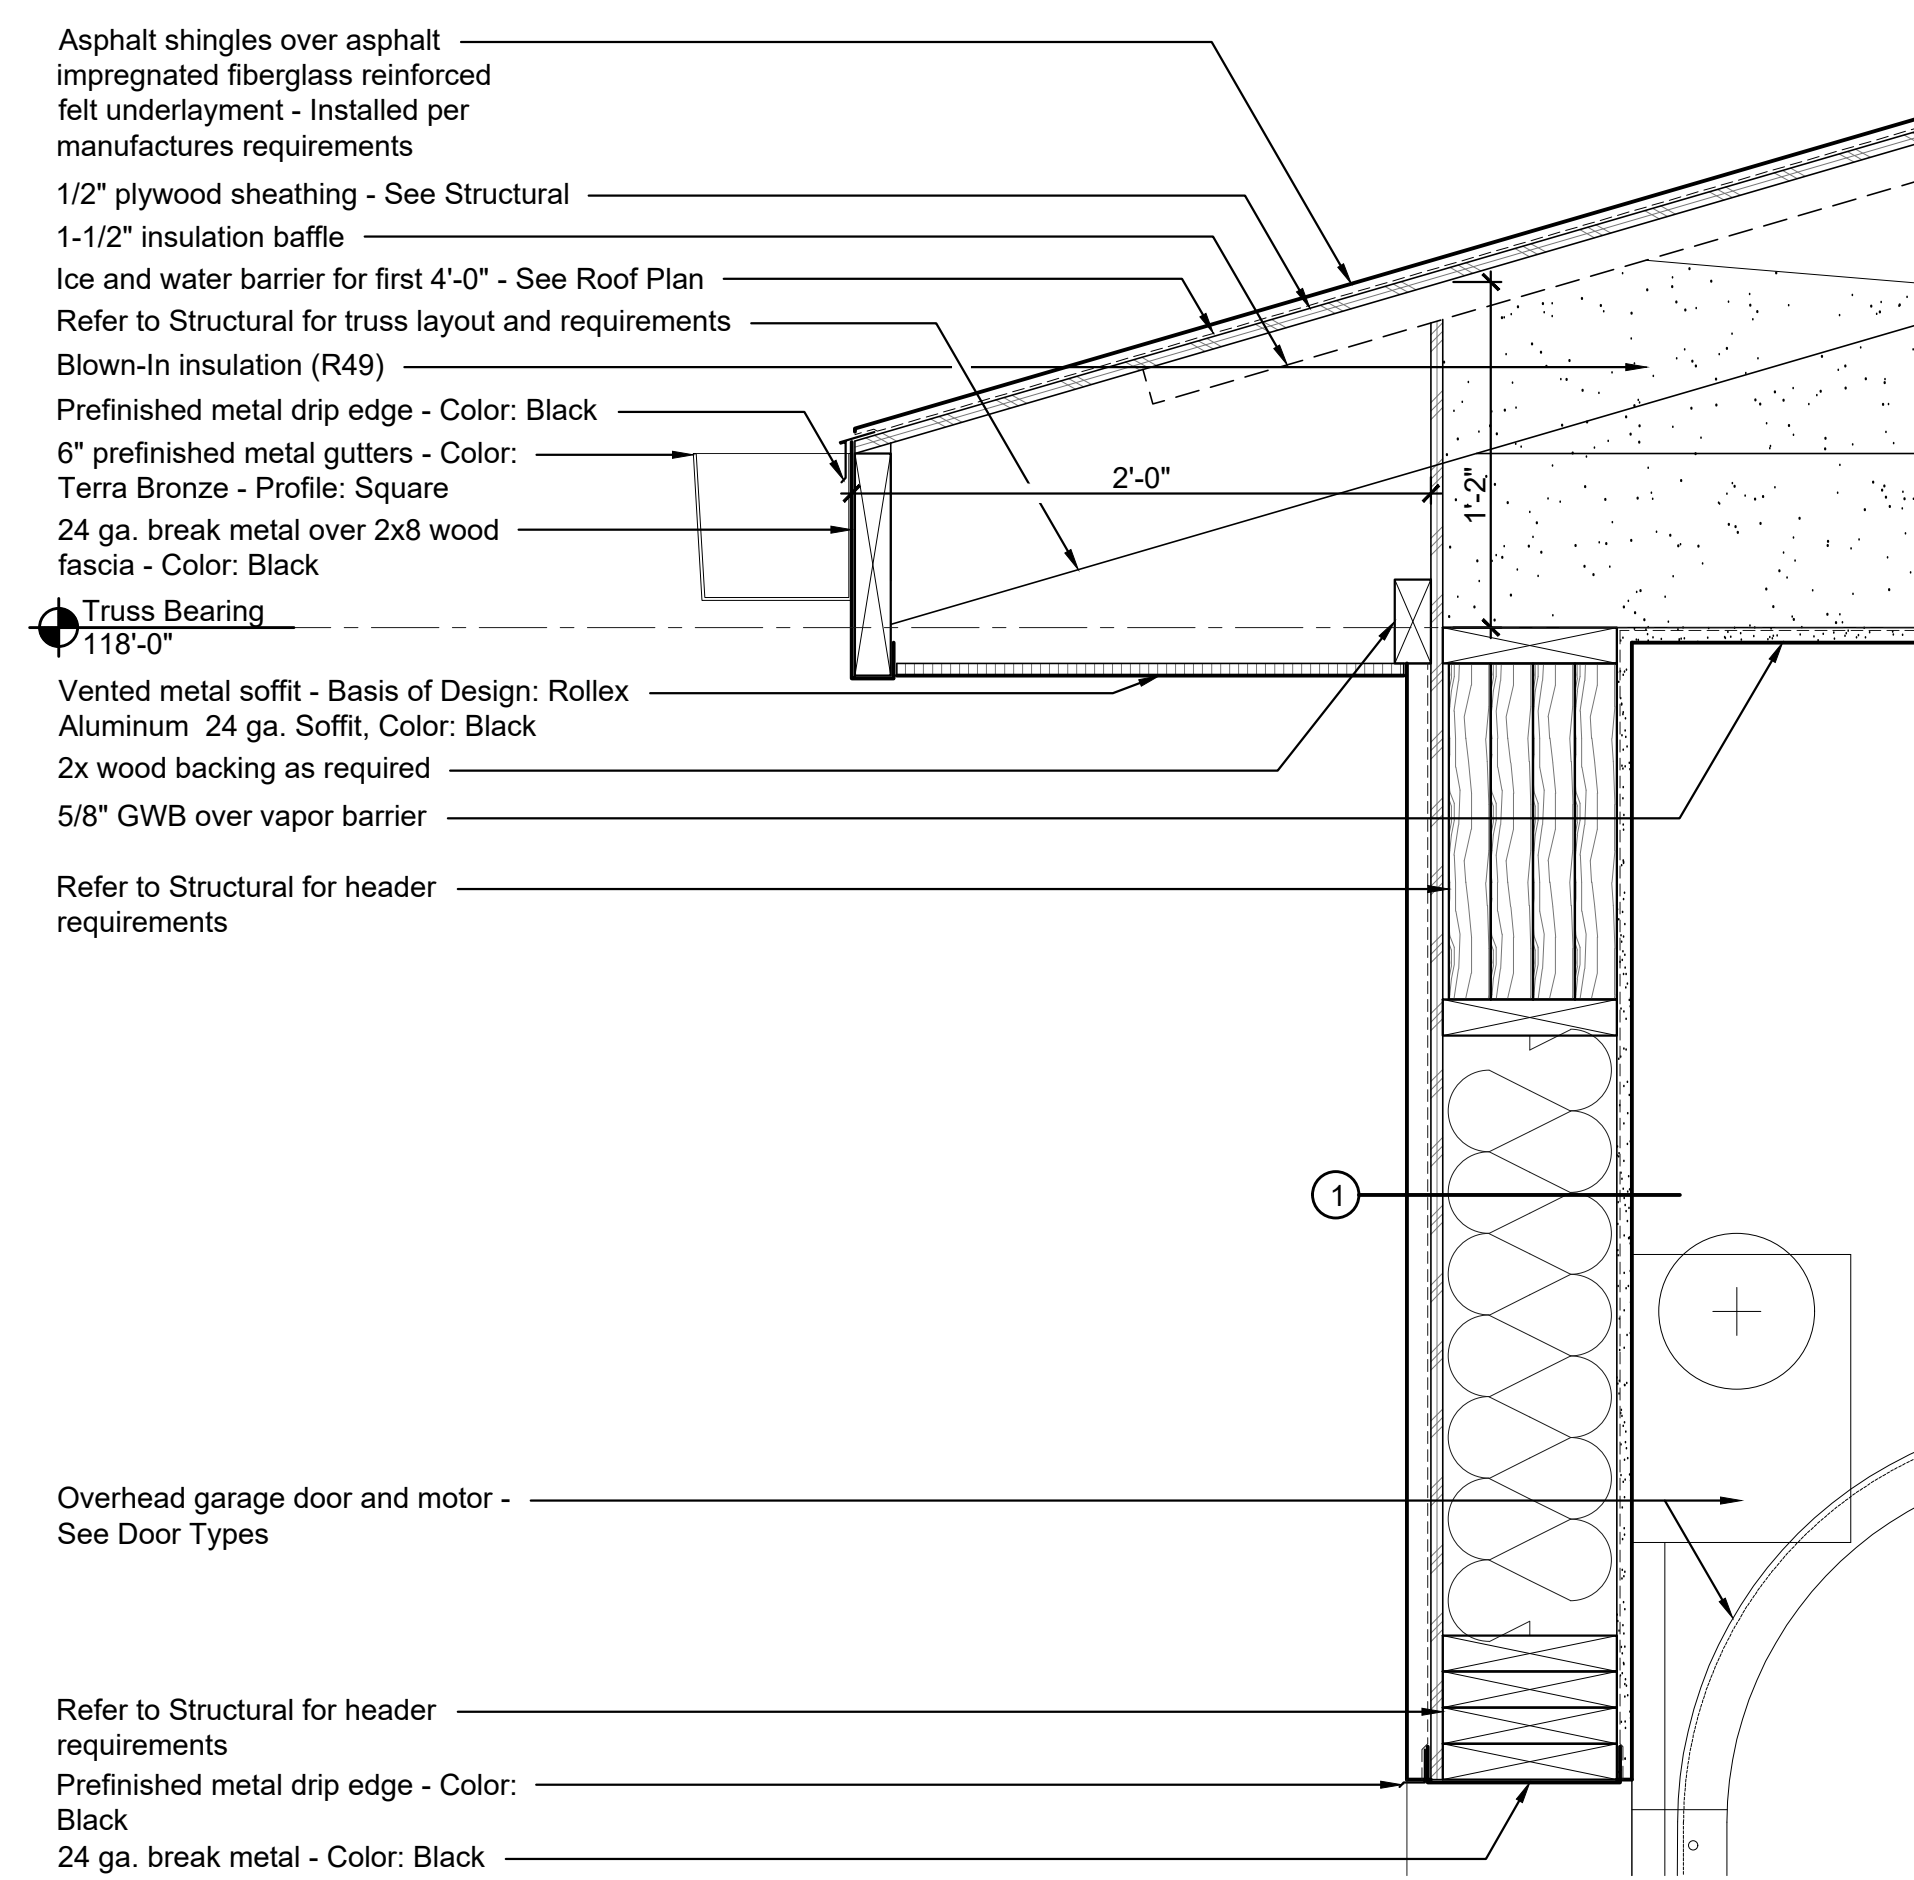


7 Section Detail
1/12" = 1'-0"

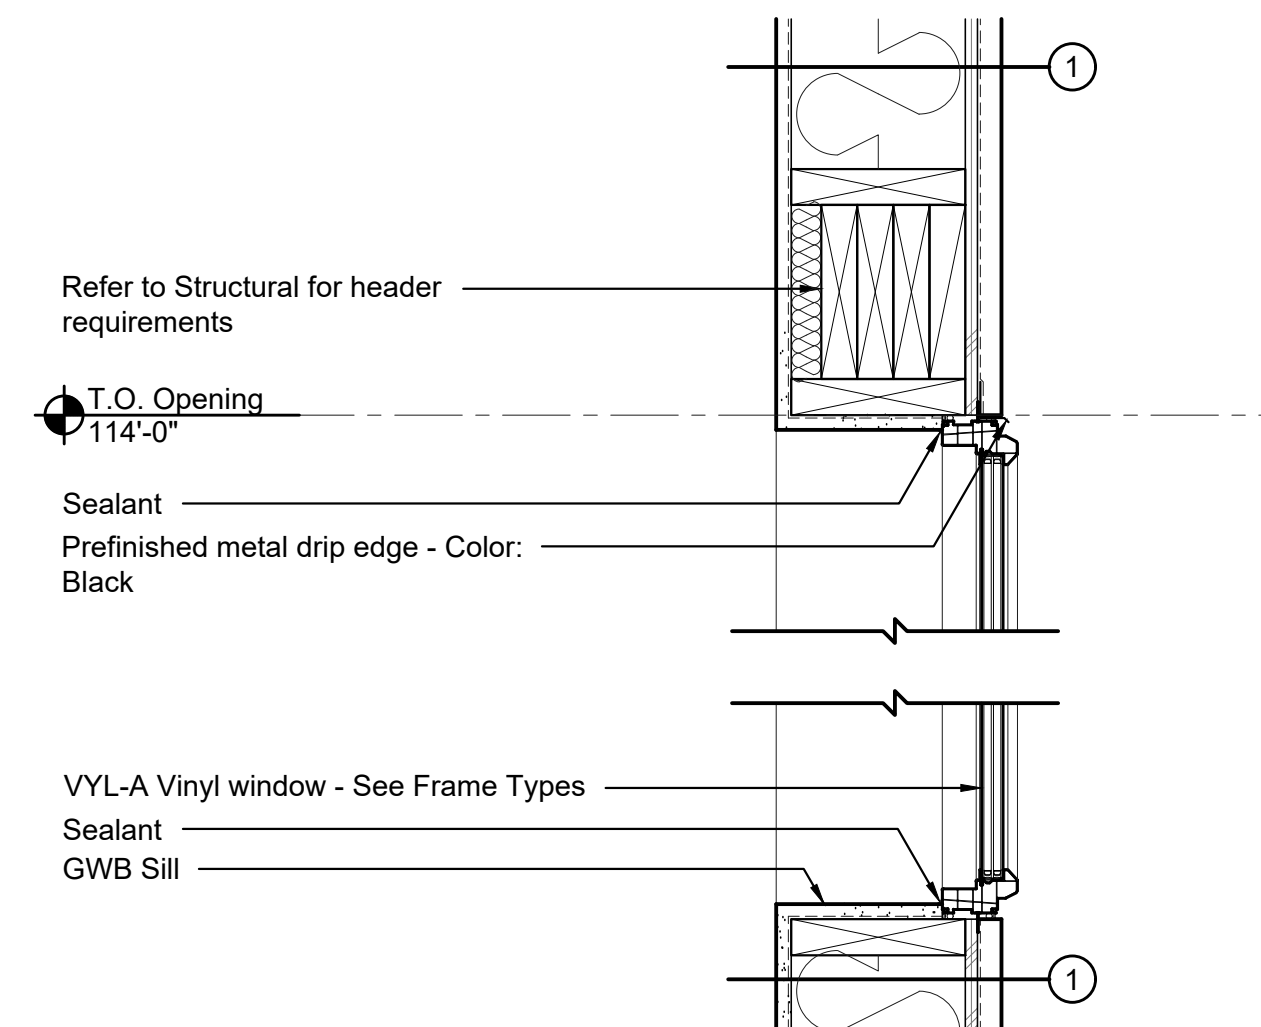


6 Head and Sill Detail
1/12" = 1'-0"

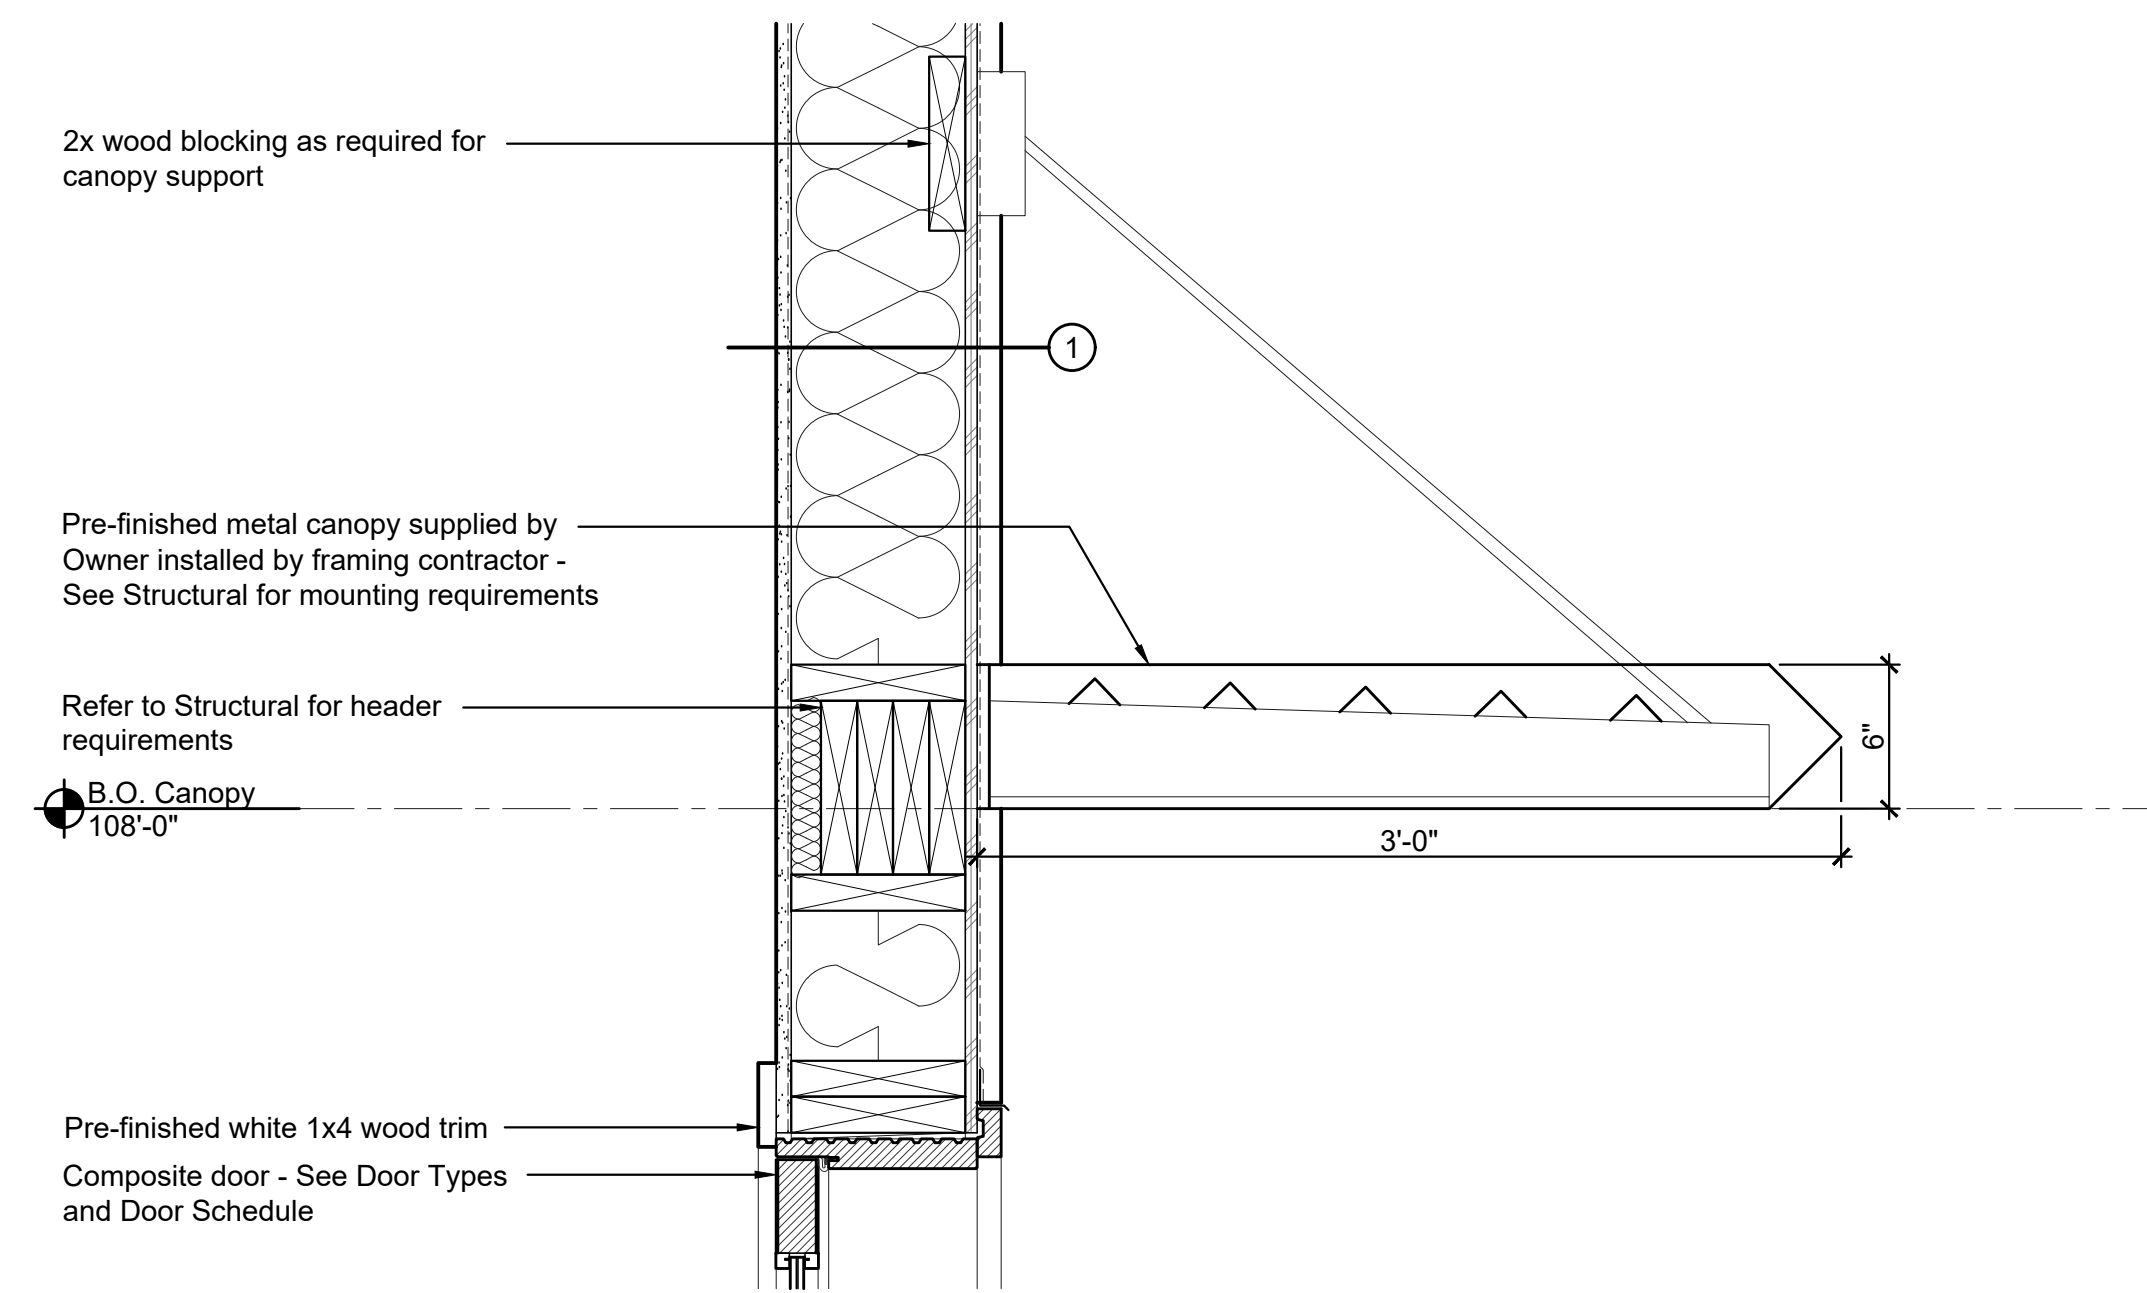


5 Section Detail
1/12" = 1'-0"

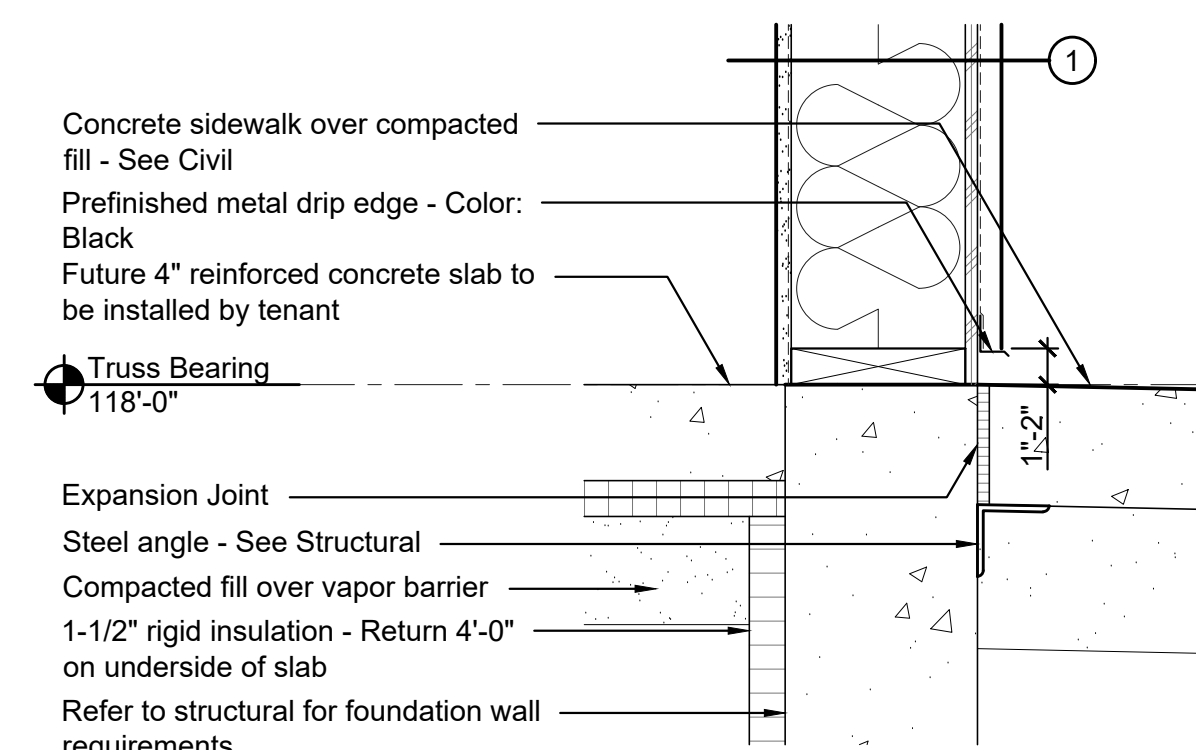

4 Typical Base Detail
1/12" = 1'-0"

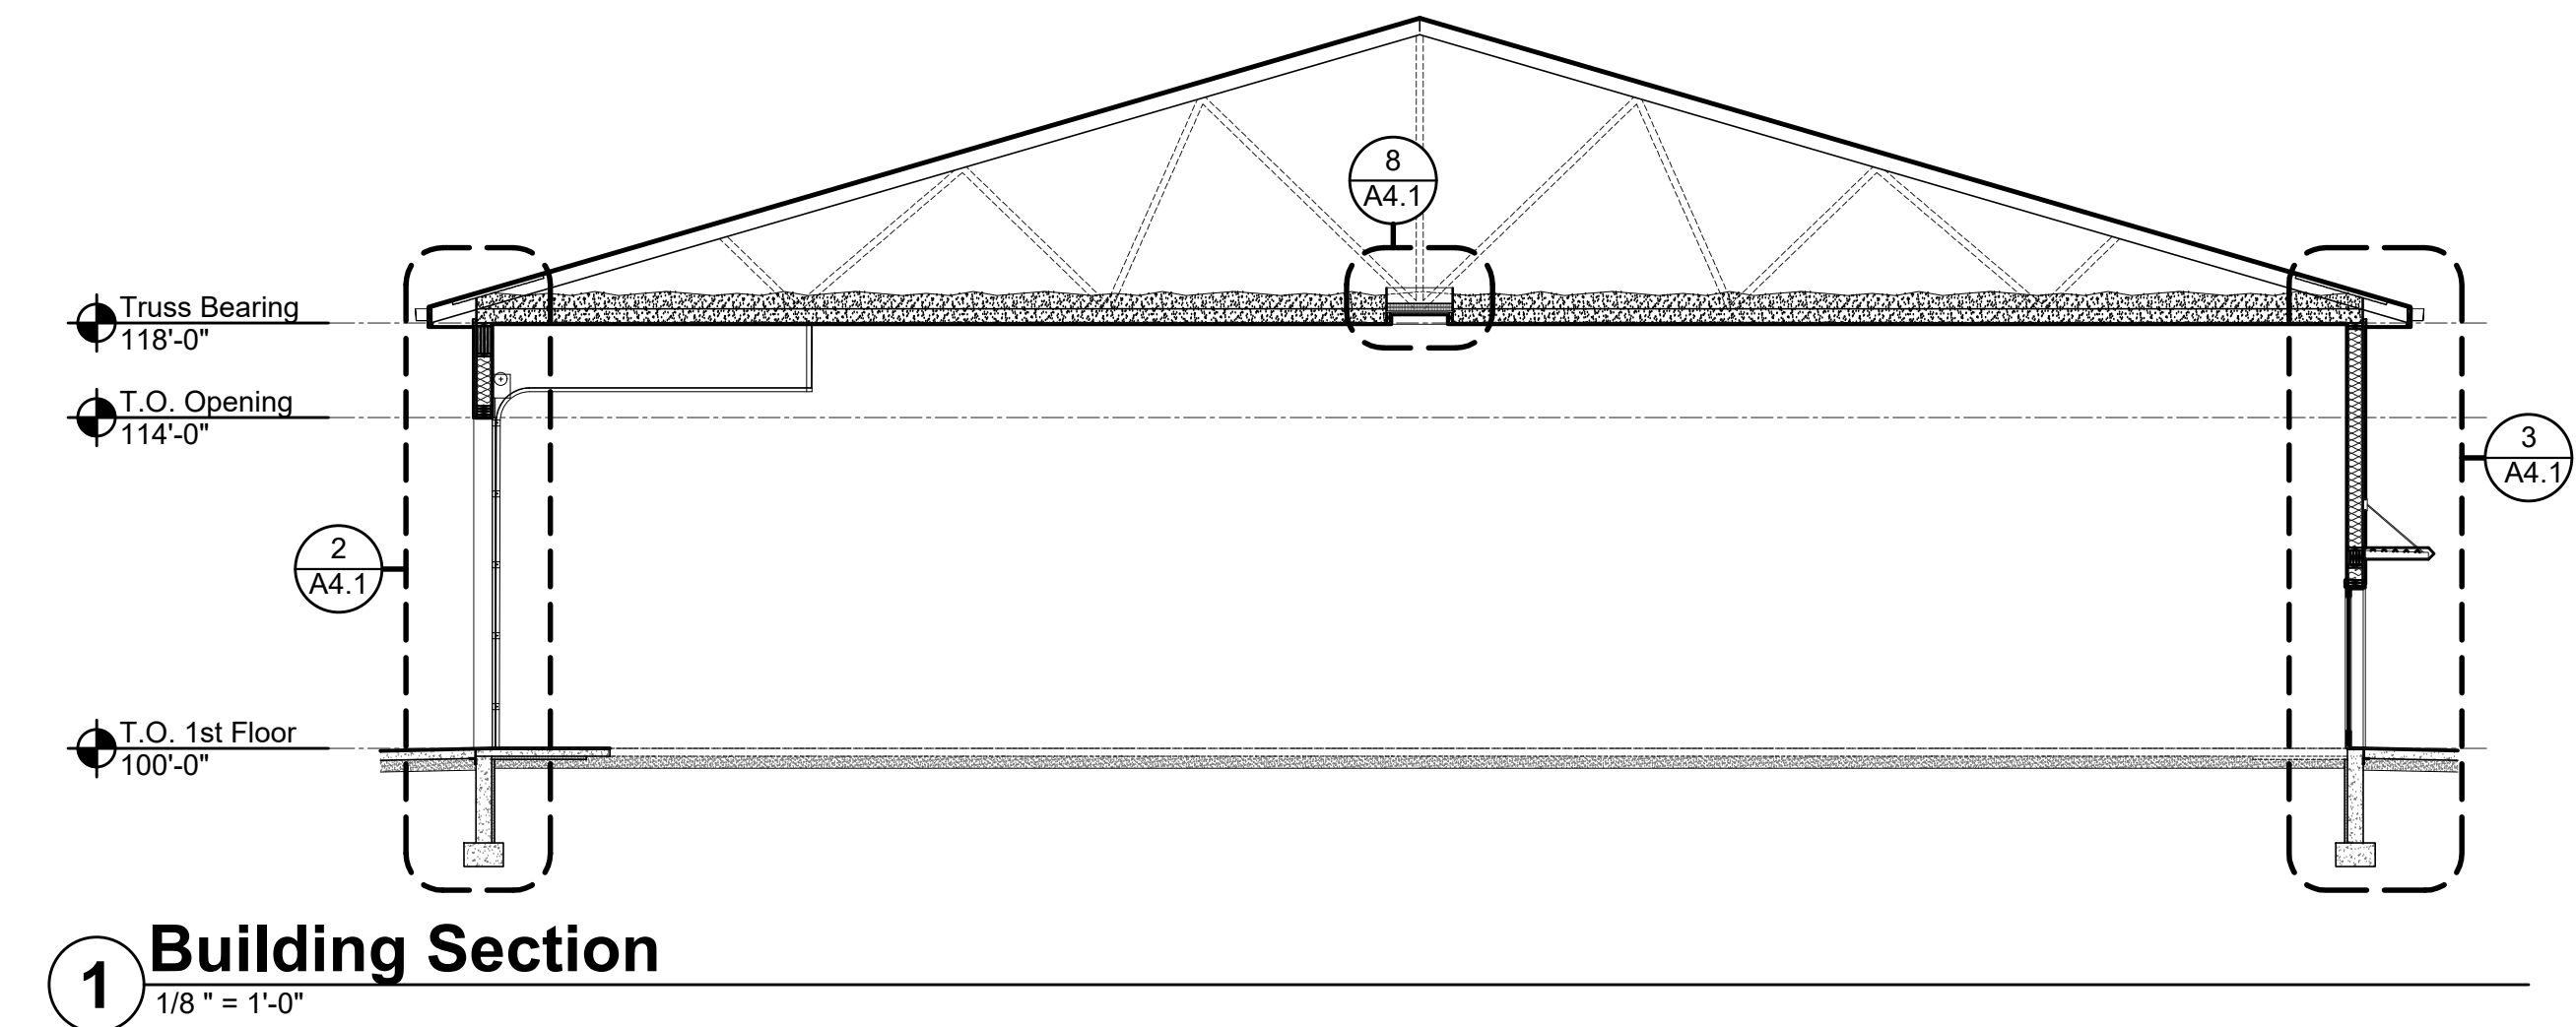

1 Building Section
1/8" = 1'-0"

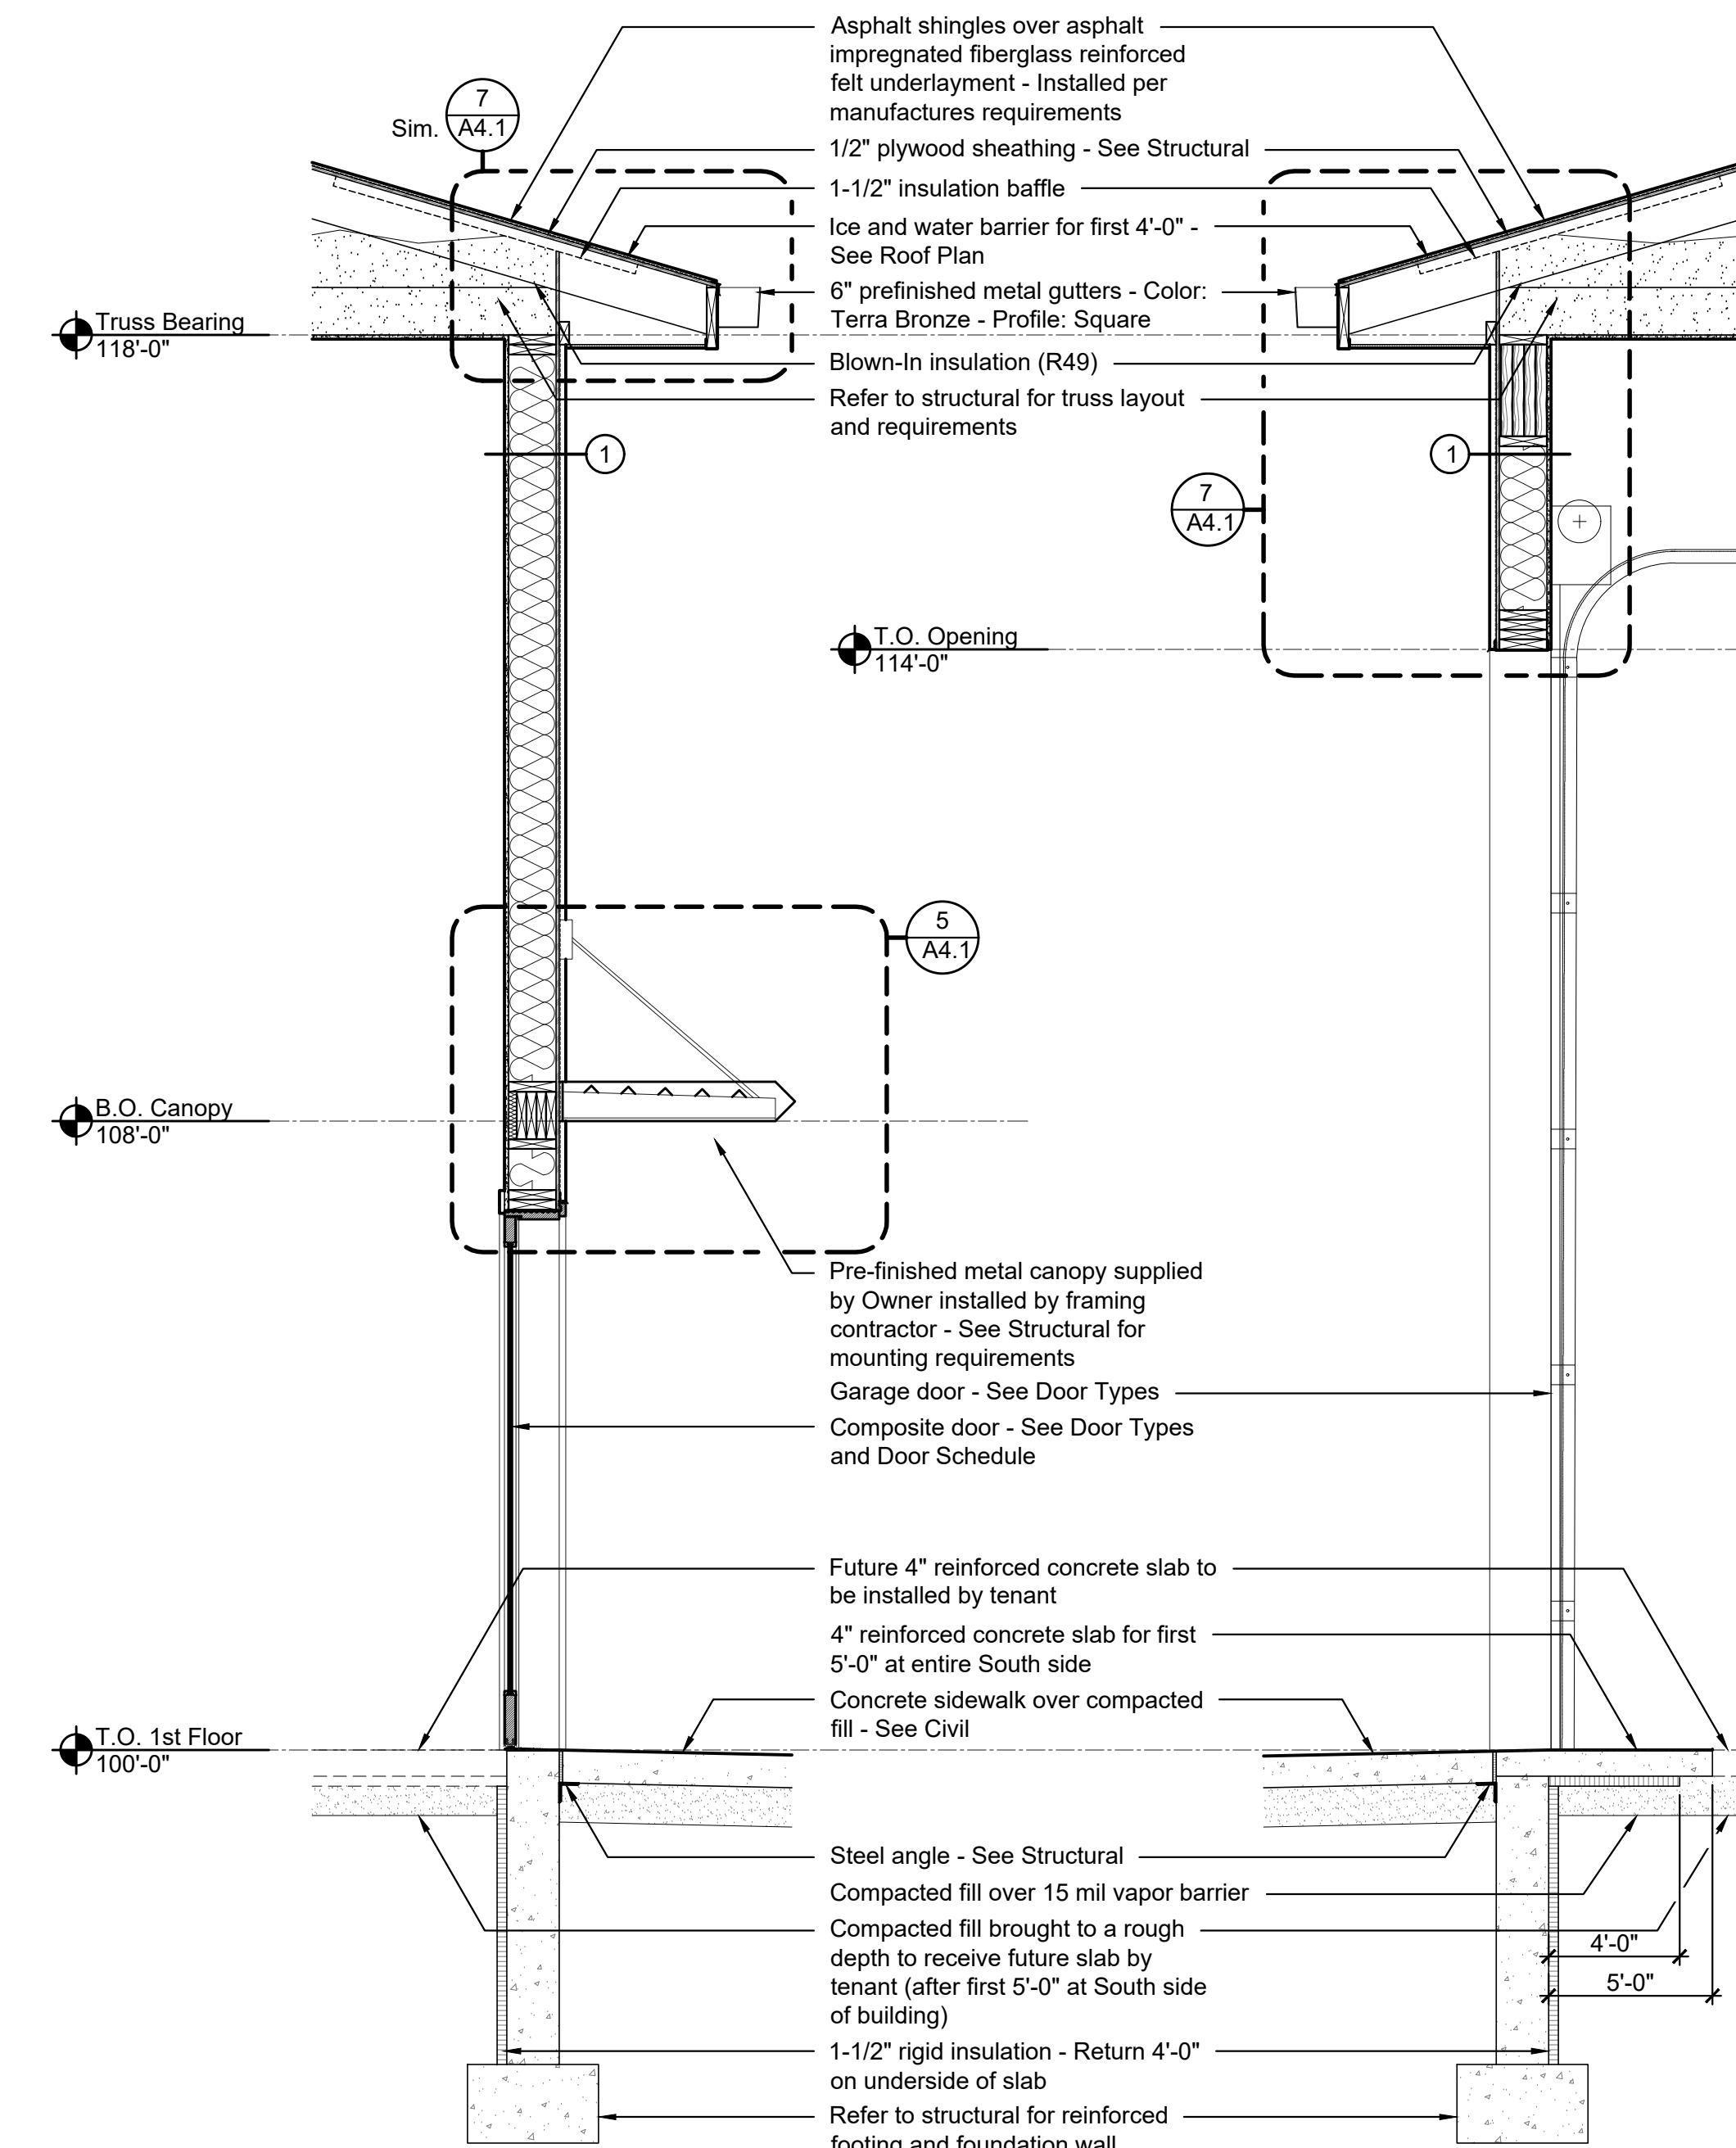

3 Wall Section
1/2" = 1'-0"

2 Wall Section
1/2" = 1'-0"

ANDREW E. AUSTIN
REGISTERED ARCHITECT
STATE OF NORTH DAKOTA
DATE: 01/31/2024 REGISTRATION NO.: 2899
SIGNED: [Signature]


wild | crg
architecture | construction
500 2nd Avenue North, Suite 514
Fargo, North Dakota 58102
Phone 701 | 293 | 8106
wildcrg.com

Building Section, Wall Sections, Section Details

© Copyright 2024 WILDCRG, LLC

Date: 01/31/2024
Project Number: 2344
Drawn By: APJ
Checked By: AEK
Approved By: AEK

A4.1

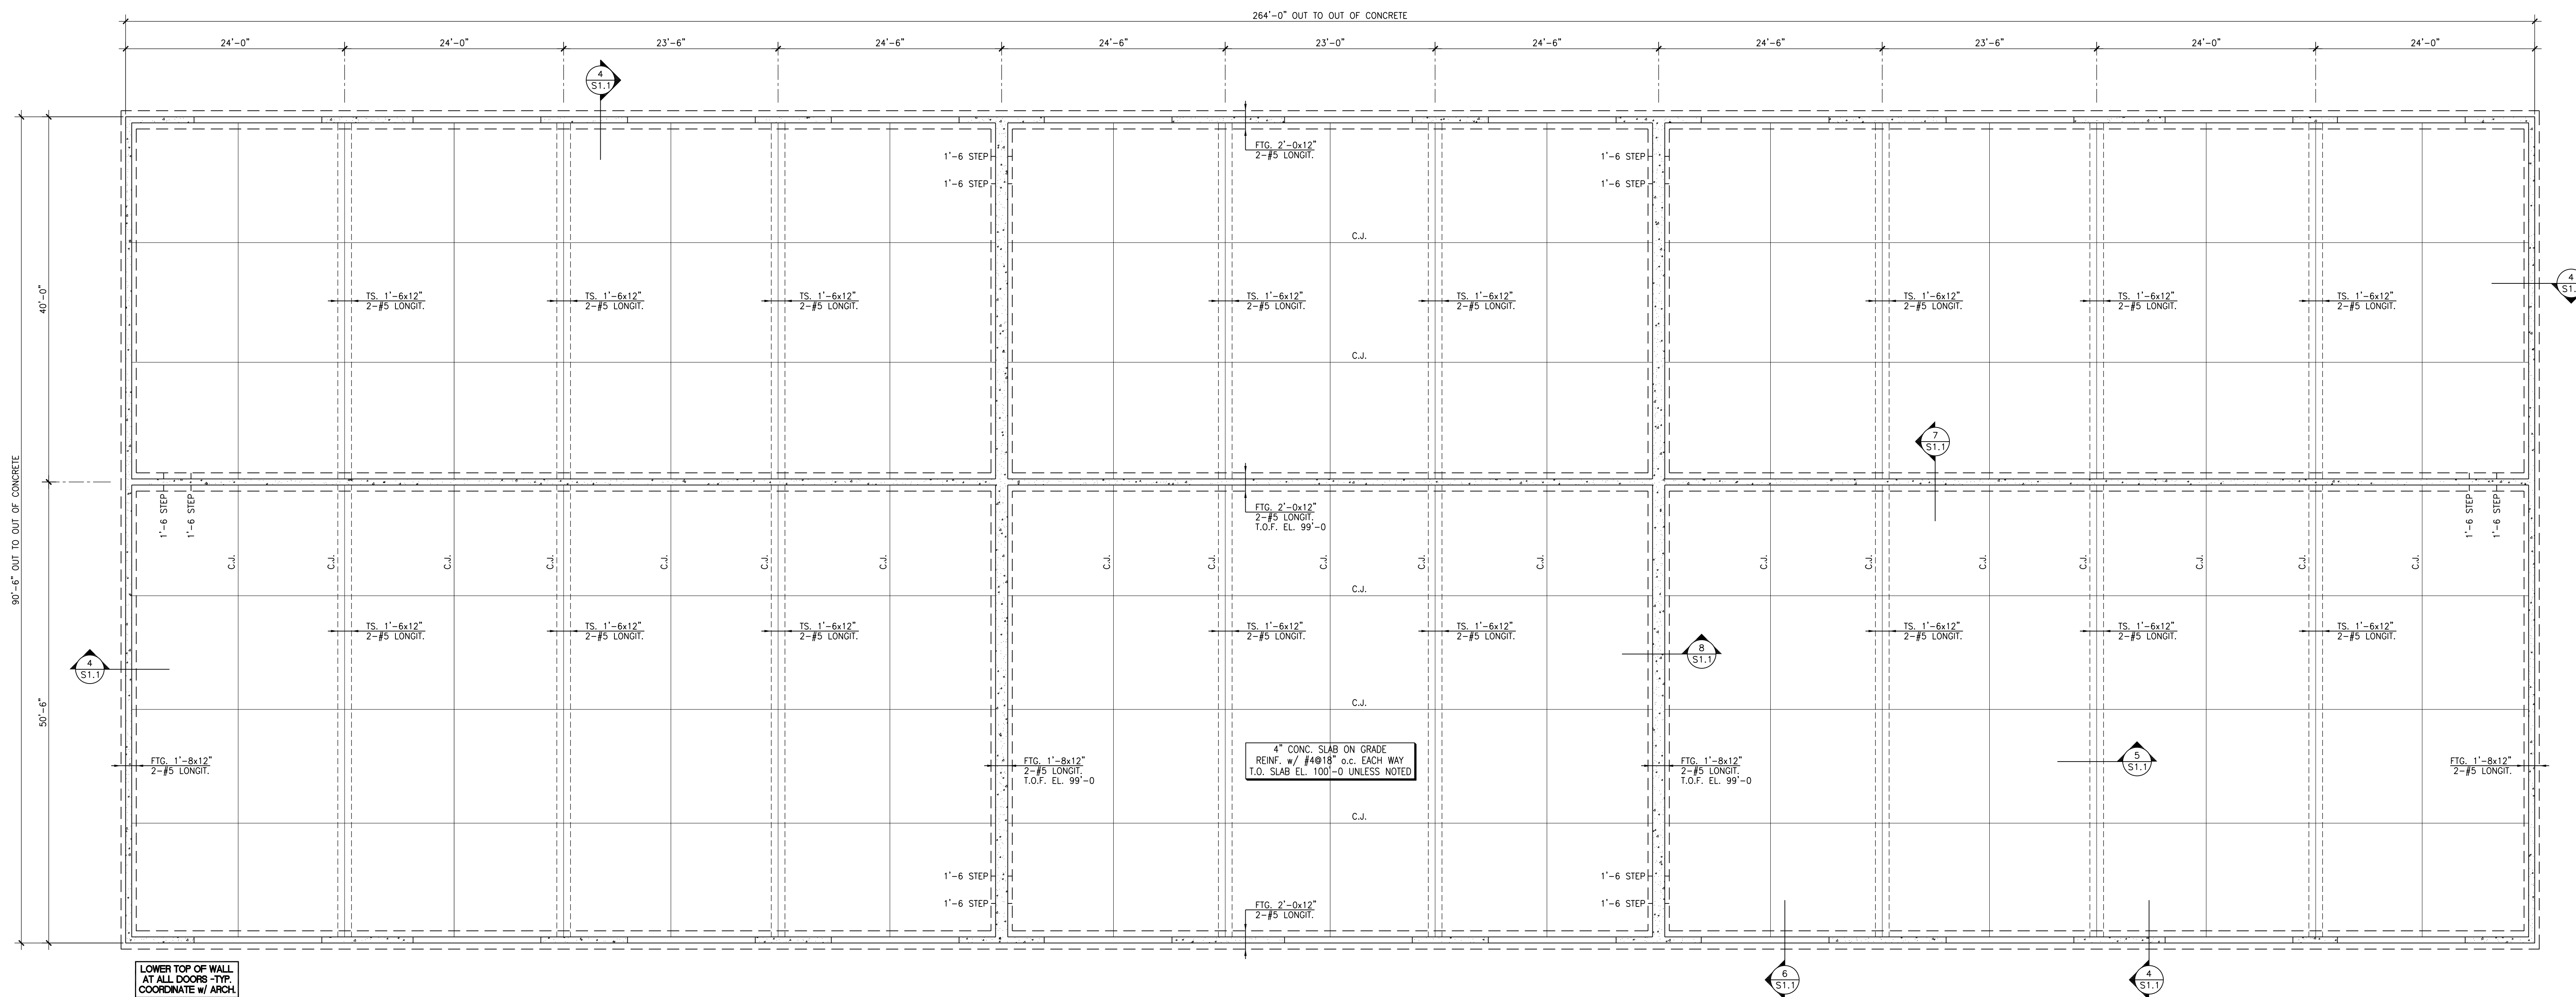


FOUNDATION PLAN

NOTE: 1). TOP OF FOOTING EL. = 96'-0" U.N.O.


SCALE: 1/8"=1'-0"

GENERAL STRUCTURAL NOTES


- Design Codes Used:
IBC 2021
ACI Concrete Code
AISC Code=ASD
- Design Loads:
Roof Snow Load: $P_s = 27 \text{ PSF} + \text{Drift (Balanced)}$
Unfinished snow load as per ASCE 7-16 Section 7
 $P_g = 35 \text{ PSF}$
 $C_e = 1.0$
 $Z_s = 1.0$
 $C_t = 1.1$
Wind Load:
Vel = 115 MPH Basic Wind Speed
Risk Category = II
Wind Exposure C
Internal Pressure Coefficient ±0.18
- Design Stresses Used:
Concrete:
- Slabs on Grade 4500 PSI @ 28 days
- Footings and Foundation Walls 3000 PSI @ 28 days
- Exterior exposed 4000 PSI @ 28 days (air entrained)
- Structural Slabs 4000 PSI @ 28 days
- Masonry Strength $f_m = 1500 \text{ PSI}$
Steel:
- W Shapes $F_y = 50 \text{ KSI (ASTM A992)}$
- Tubes $F_y = 46 \text{ KSI (ASTM A500 Grade B)}$
- Angles, Channels, Bars $F_y = 36 \text{ KSI (ASTM A36)}$
- Pipes $F_y = 35 \text{ KSI (ASTM A53)}$
Reinforcing Steel 60 KSI (ASTM A615-60)
Soil Bearing Pressure 1500 PSF (Assumed, Verify w/ Geotechnical Engineer's review of Excavation)
- CONCRETE COVERAGE for reinforcing shall be as follows:
Footings 3 inches
Columns and Piers 1 1/2 inches
Slabs on Grade midheight for a single layer
Walls 1 1/2 inches @ exterior
3/4 inch @ interior
3/4 inch unless noted
Structural Slabs PROVIDE BAR SUPPORTS AND SPACERS in accordance with the ACI Detailing Manual.
- REINFORCING STEEL to be bent and placed in accordance with ACI code. All splices to be 38 db for #6 bar or smaller, 48db for #7 bar and larger.
- FOOTINGS to rest on undisturbed soil or engineered backfill. It is recommended that the Soils Engineer inspect soil conditions prior to construction. All walls and piers to center on footing unless otherwise noted. All footing elevations are given to the top of footings.
- ALL FOUNDATION WALLS to be laterally supported before backfilling. Vertical construction joints to be keys.
- OPENINGS in concrete FOUNDATION WALLS shall be reinforced with 2-#5 bars each side, extending 2'-0" past the face of the opening unless otherwise noted.
- FOUNDATIONS SHALL BE BUILT from approved, fully dimensioned shop drawings coordinated with construction documents and field conditions. Foundation shop drawings shall consist of the anchor bolt setting plan, concrete mix design, and concrete reinforcement plan with wall & pier dimensions. All subsequent shop drawings shall be coordinated with approved foundation shop drawings.
- SHOP DRAWINGS
a. Submit electronic copies of the following shop drawings to the architect/engineer for review prior to fabrication.
1. CONCRETE REINFORCING and mix designs for each class of concrete.
b. The contractor shall review and accept full responsibility for dimensional correctness. All shop drawings must bear the approval stamp of the contractor (to include initials, date and disposition), prior to review by the Architect or Engineer. The Engineer will return all shop drawings, unreviewed, that do not bear the approval stamp of the contractor.
- PORTLAND CEMENT to be ASTM C150, Type 1 & 1A.
- CONCRETE to be in accordance with ACI 301. Maximum shale content shall not exceed 0.5% for exposed concrete.
- CONTROL AND CONSTRUCTION JOINTS to be located as shown on the plan or at contractor's option - not to exceed 12'-0" o.c. verify with future slab.
- ROOF TRUSSES to be engineered by the fabricator under the supervision of a professional engineer. Shop drawings to be stamped by the professional engineer. All trusses to have roof sheathing, including areas with scabbed in wood framing above.
- ROOF TRUSSES shall be secured to wall plates with H2.5T Anchors by Simpson or equal at every truss.
- General Contractor shall provide all lateral roof bracing as required by truss plate institute manual "H8-01" or as required by the truss design.
- CARPENTRY
Wood Studs MSR 1650J-1.5E
Beams Hem Fir, SPF #2, or better
LVL's (Laminated Veneer Lumber) $F_b = 2600 \text{ psi}$
Glu-Laminated Beams & Columns $F_b = 2400 \text{ psi (24F-V8 or better)}$
- Refer to IBC table or MN Building Code for typical nailing not shown. Table 2304.10.2.
- Contractor Field Verify all new lintels in existing walls have the correct plate width.
- SEE MECHANICAL, ELECTRICAL & ARCHITECTURAL DRAWINGS for all openings and inserts not shown on the plan. All opening sizes and locations to be verified with mechanical and electrical contractors.
- CONTRACTOR VERIFY all dimensions with Architectural Plan.

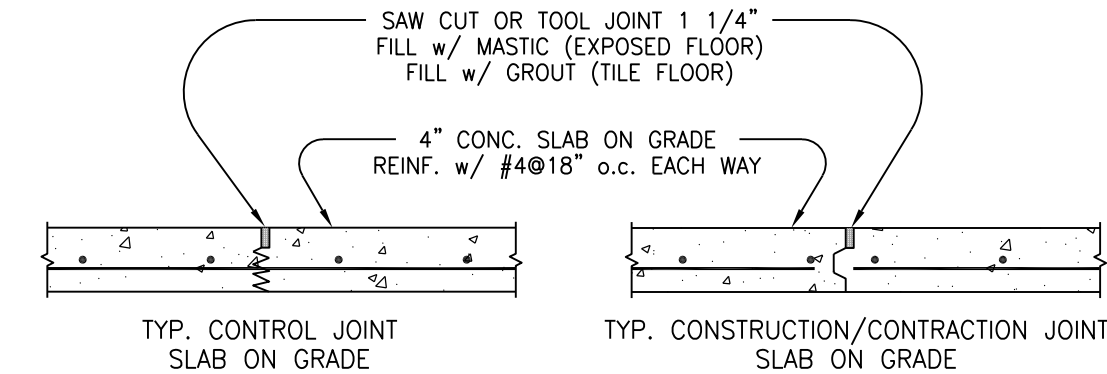


SECTION 1
SCALE: 1/2" = 1'-0"

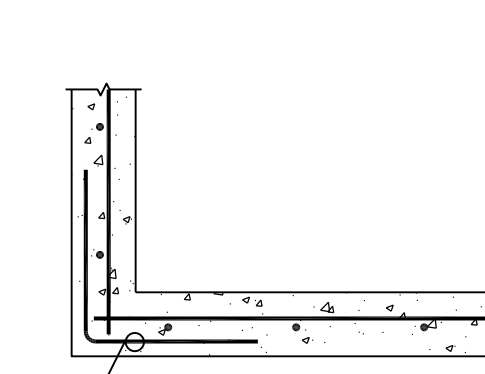


DETAIL 2
SCALE: 1/2" = 1'-0"

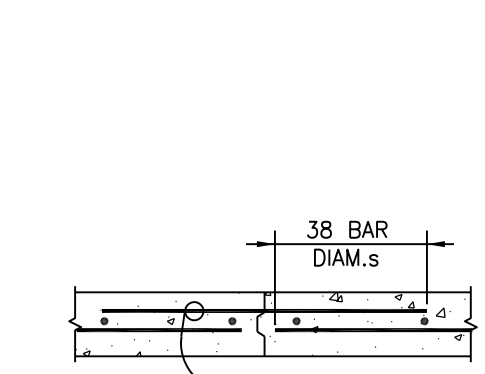


DETAIL 3
SCALE: 1/2" = 1'-0"

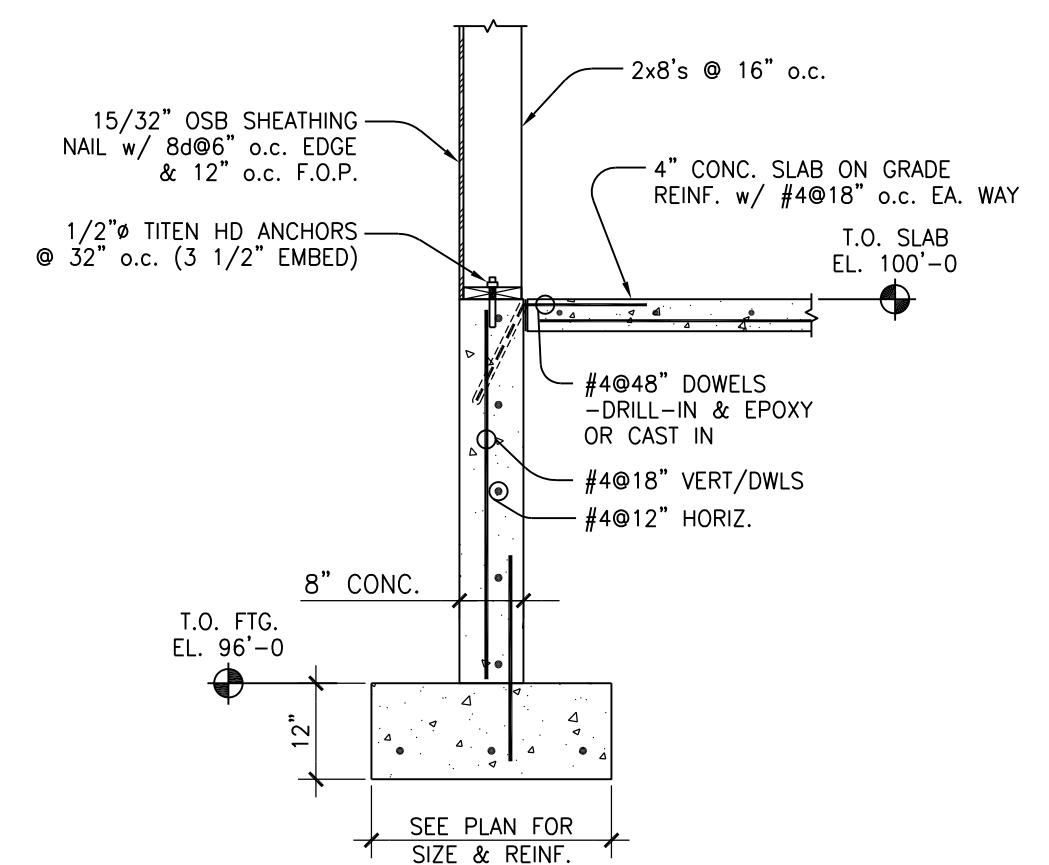


SECTION 4
SCALE: 1/2" = 1'-0"

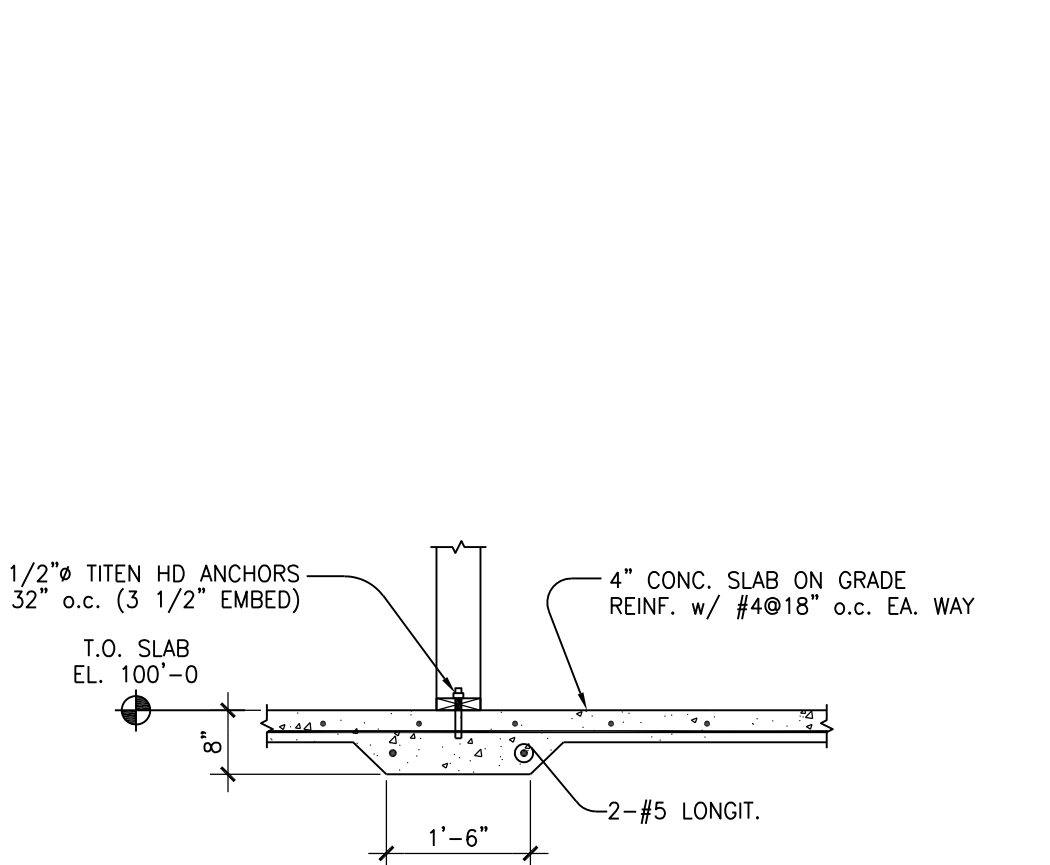


SECTION 5
SCALE: 1/2" = 1'-0"

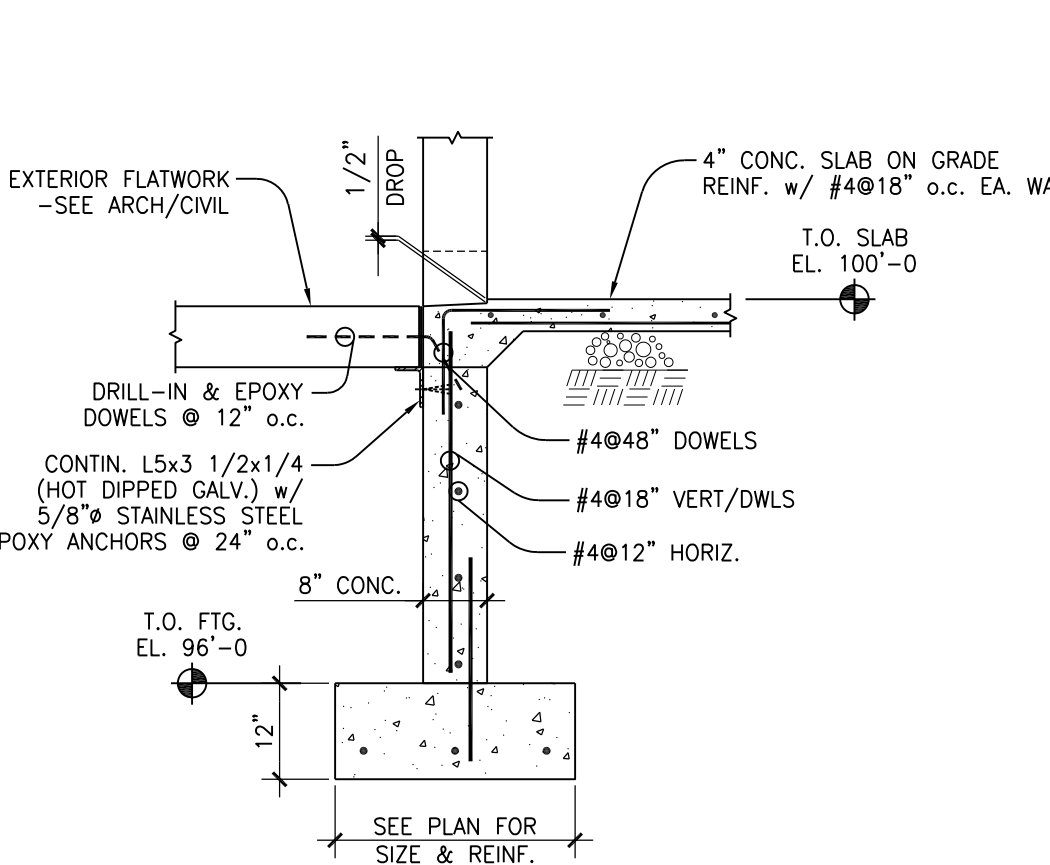


SECTION 6
SCALE: 1/2" = 1'-0"

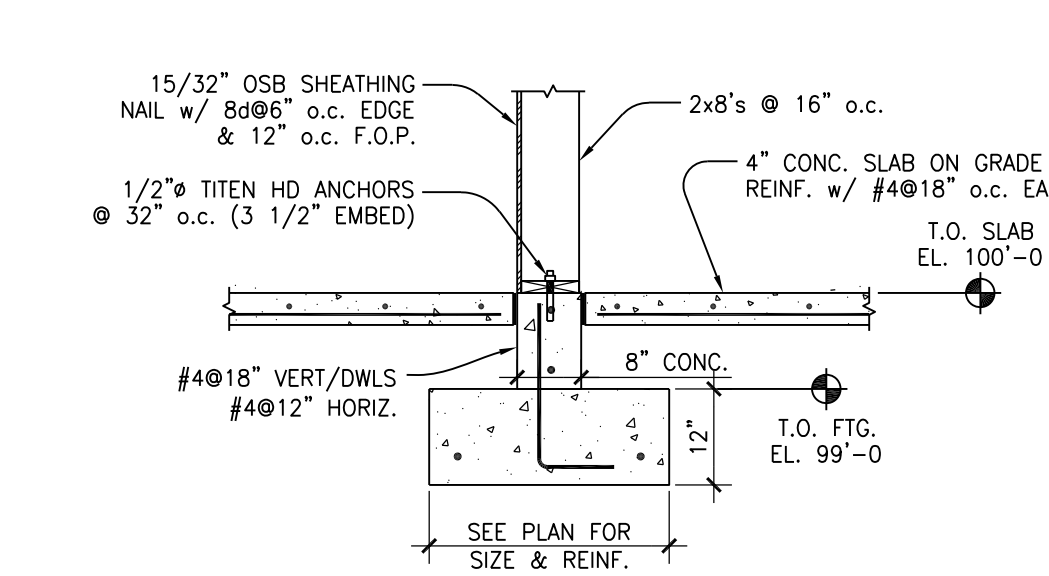


SECTION 7
SCALE: 1/2" = 1'-0"

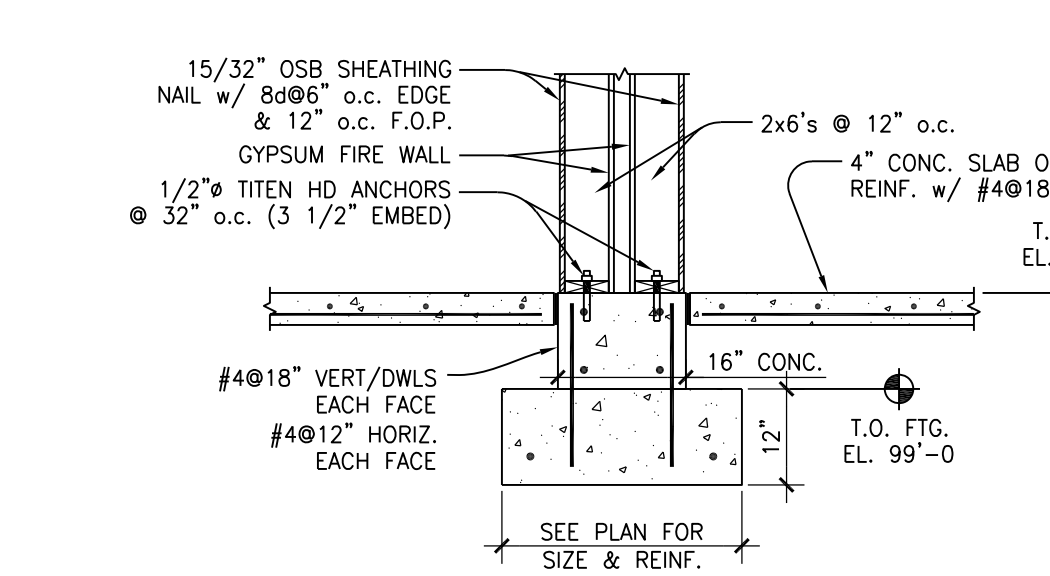

SECTION 8
SCALE: 1/2" = 1'-0"

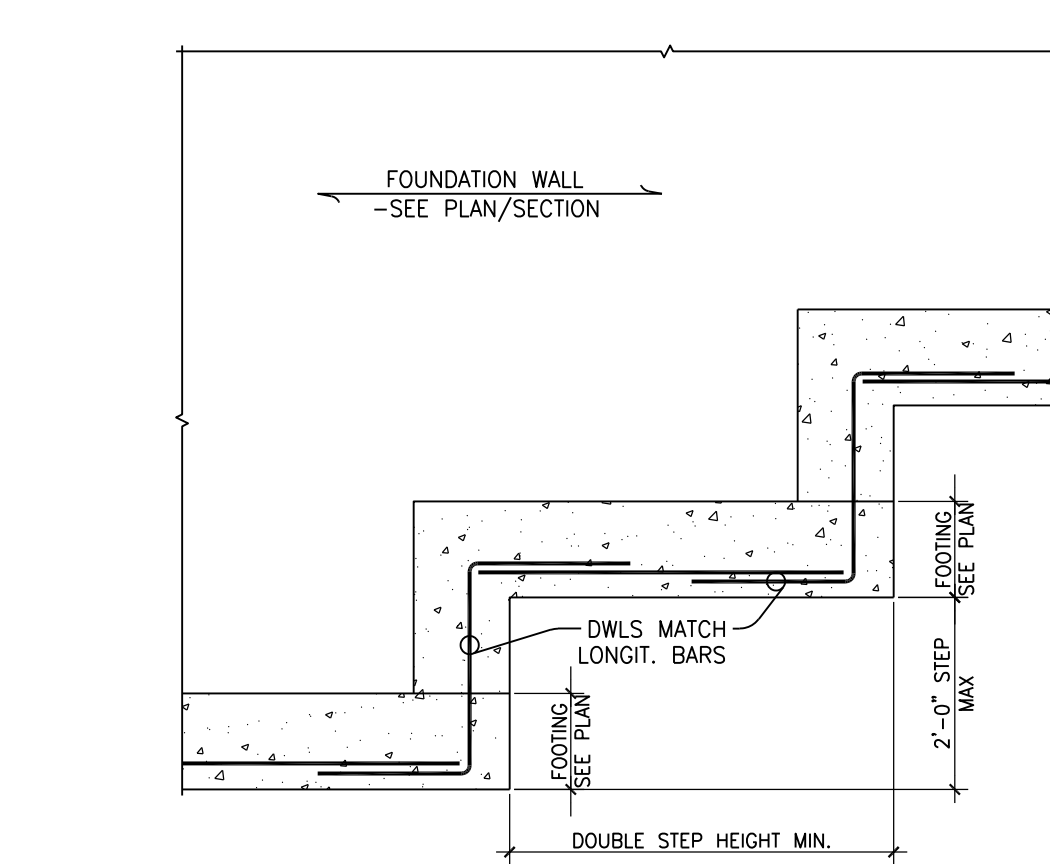


SECTION 10
SCALE: 1/2" = 1'-0"

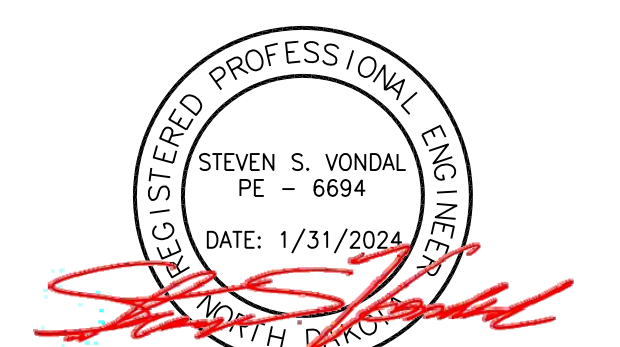

SOLIER & LARSON ENGINEERING
CONSULTING STRUCTURAL ENGINEERS
3330 FIECHTNER DRIVE, SUITE 208
FARGO, NORTH DAKOTA 58103
TELEPHONE (701) 235-5293 FAX (701) 235-5294


wild|crg
architecture | construction
500 2nd Avenue North | Suite 514
Fargo, North Dakota 58102
Phone 701 | 293 | 8106
wildcrg.com

Foundation Plan
General Structural Notes
Sections & Details

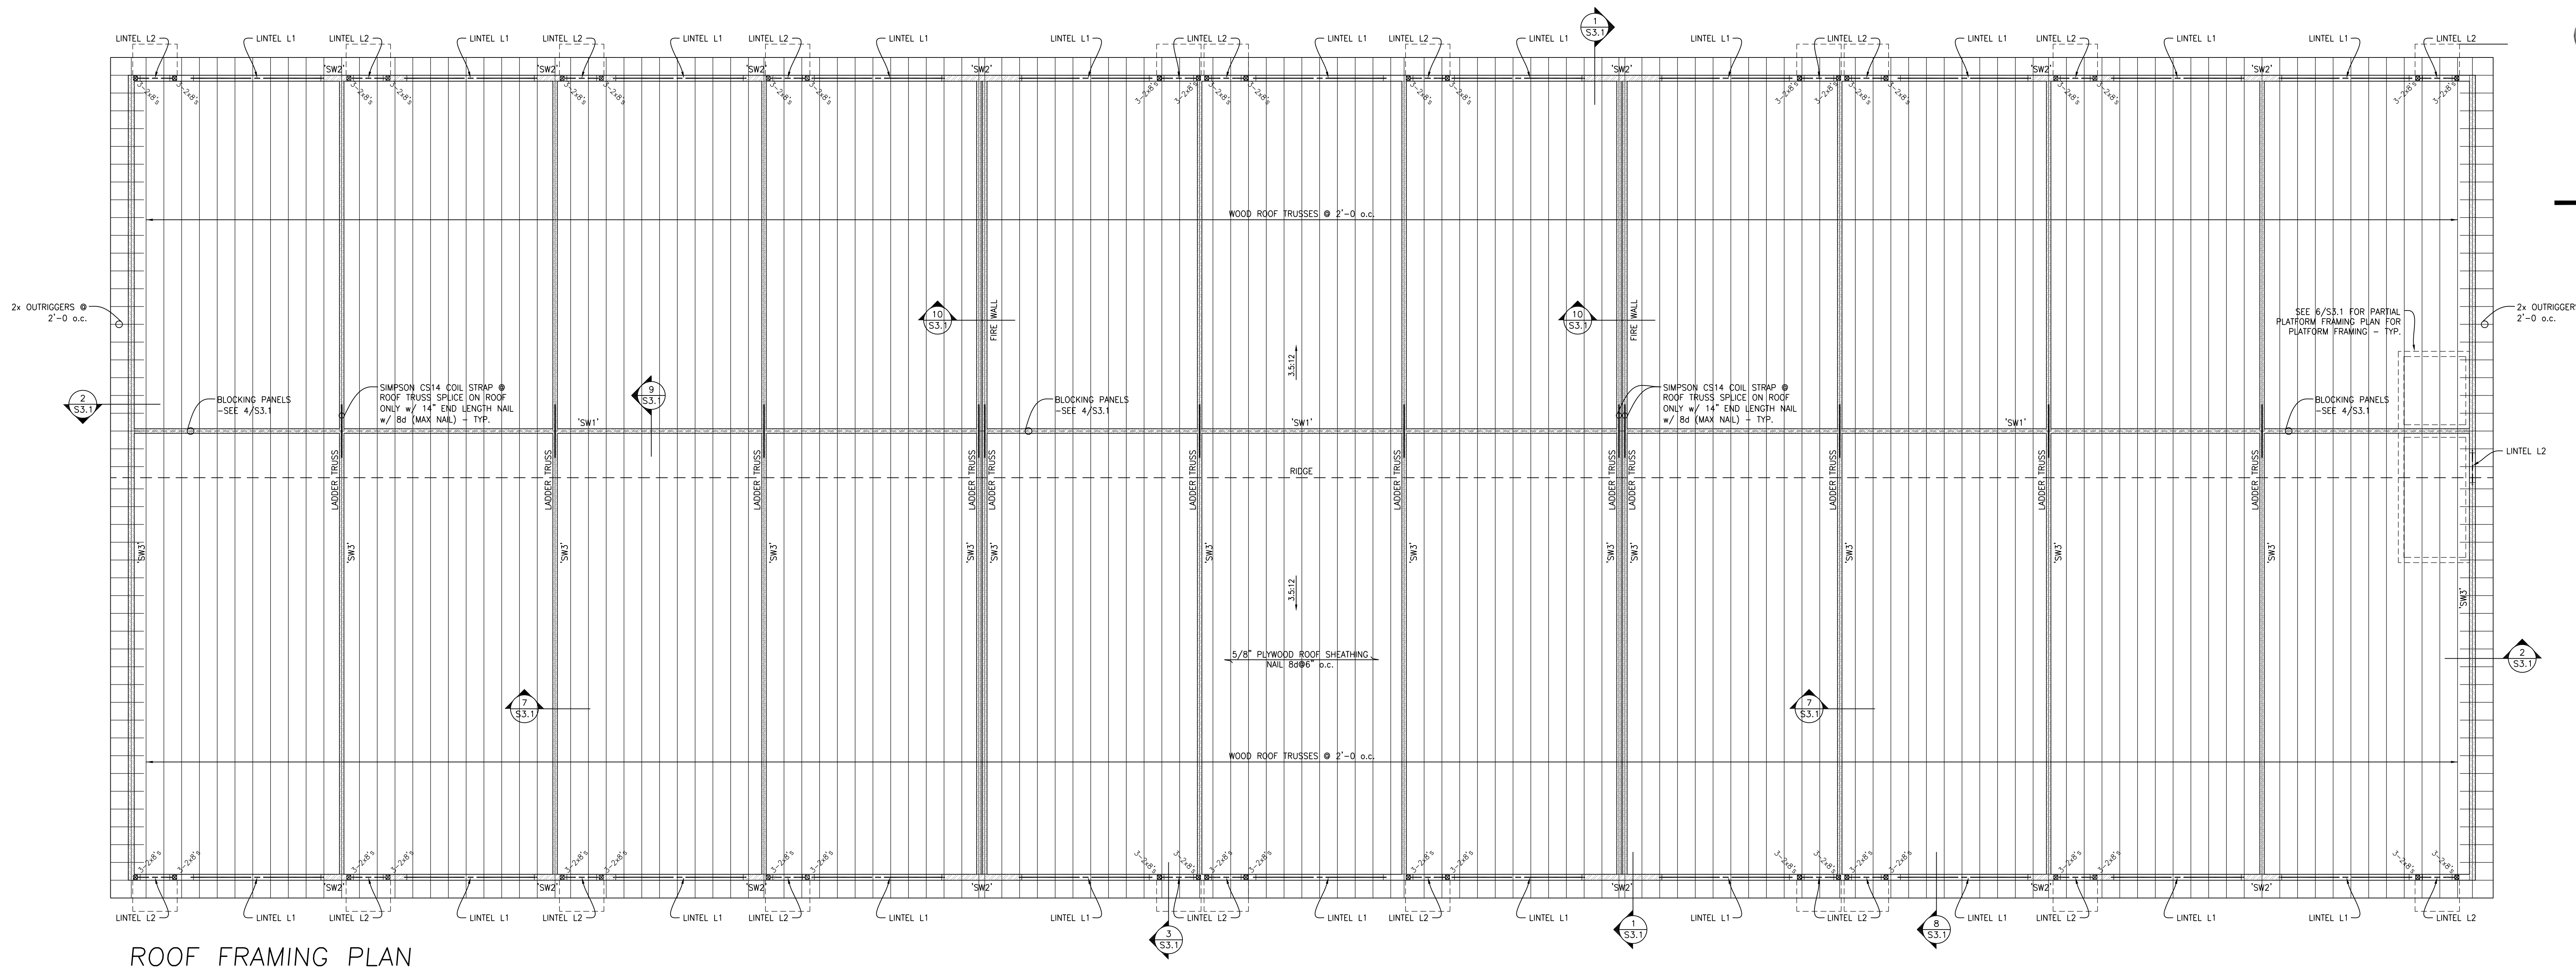


ROOF FRAMING PLAN


SCALE: 1/8" = 1'-0"

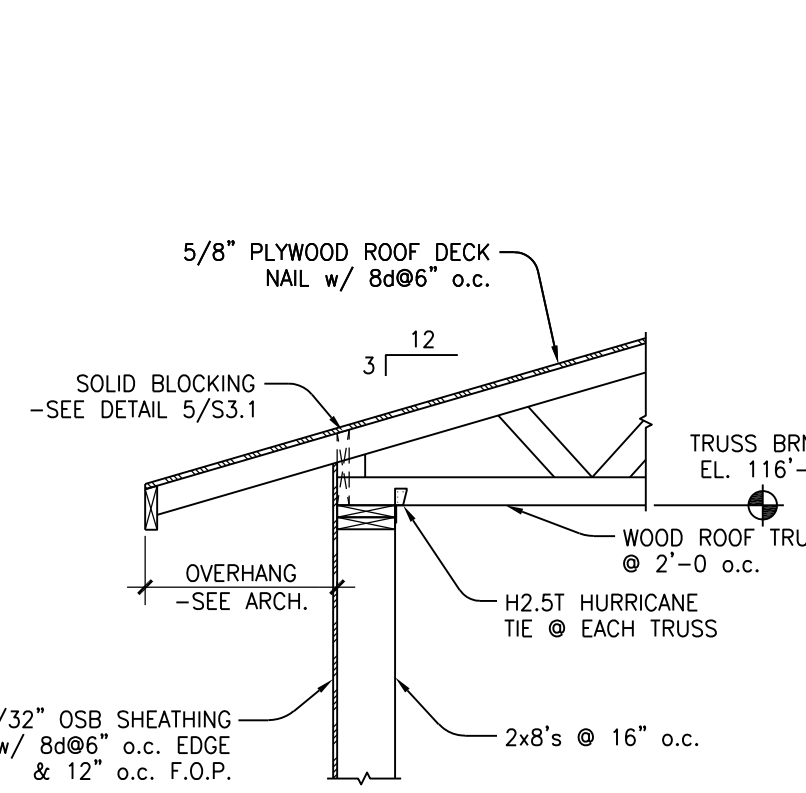


SECTION 1
SCALE: 1/2" = 1'-0"

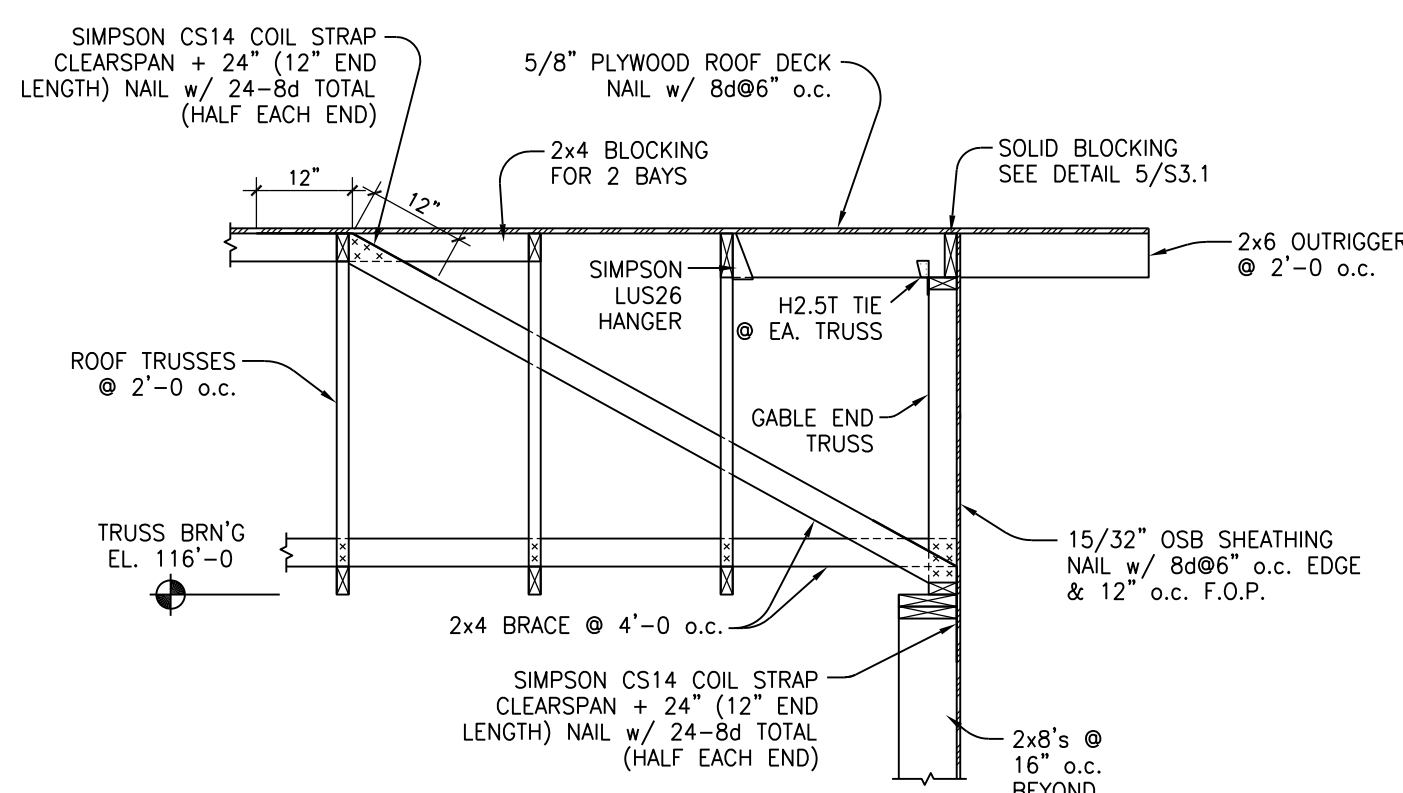


SECTION 2
SCALE: 1/2" = 1'-0"

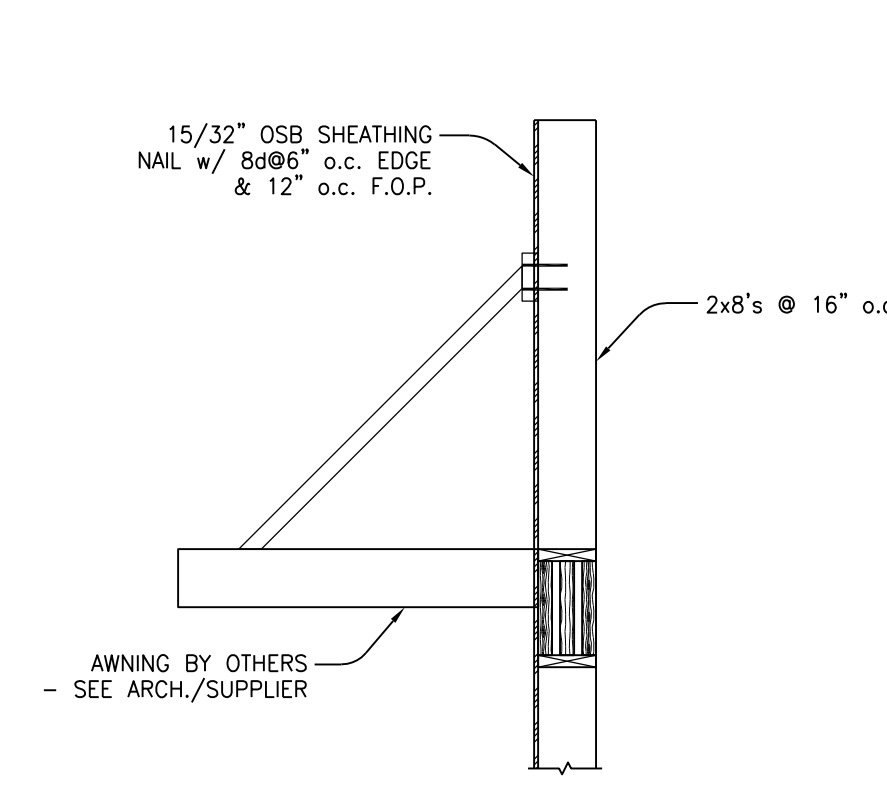


SECTION 3
SCALE: 1/2" = 1'-0"

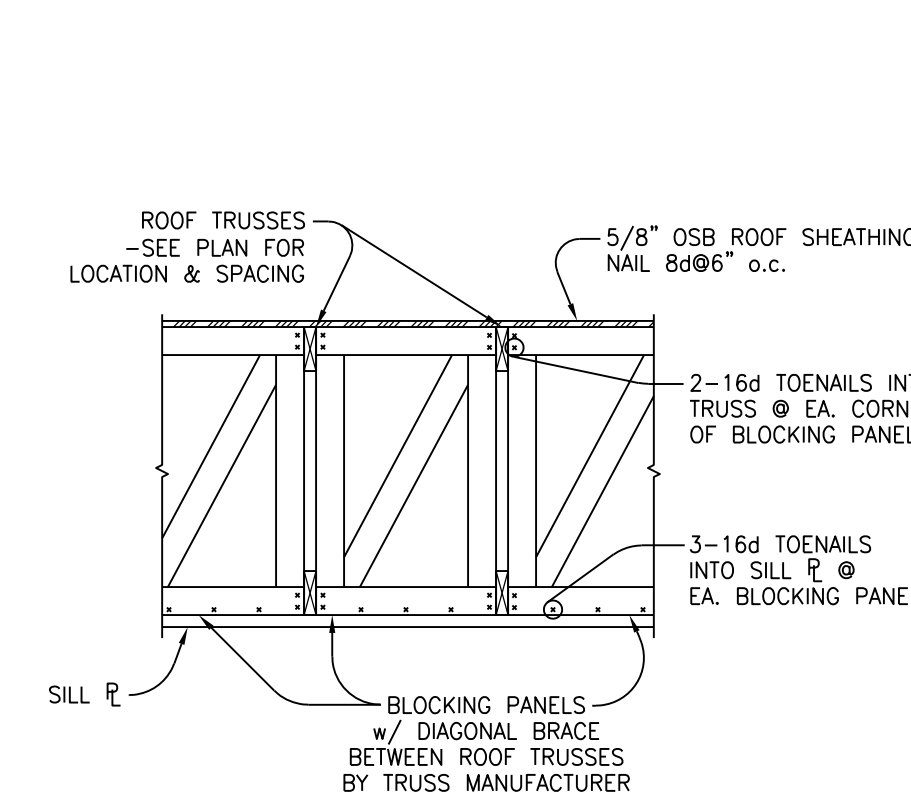

SECTION 4
SCALE: 1/2" = 1'-0"

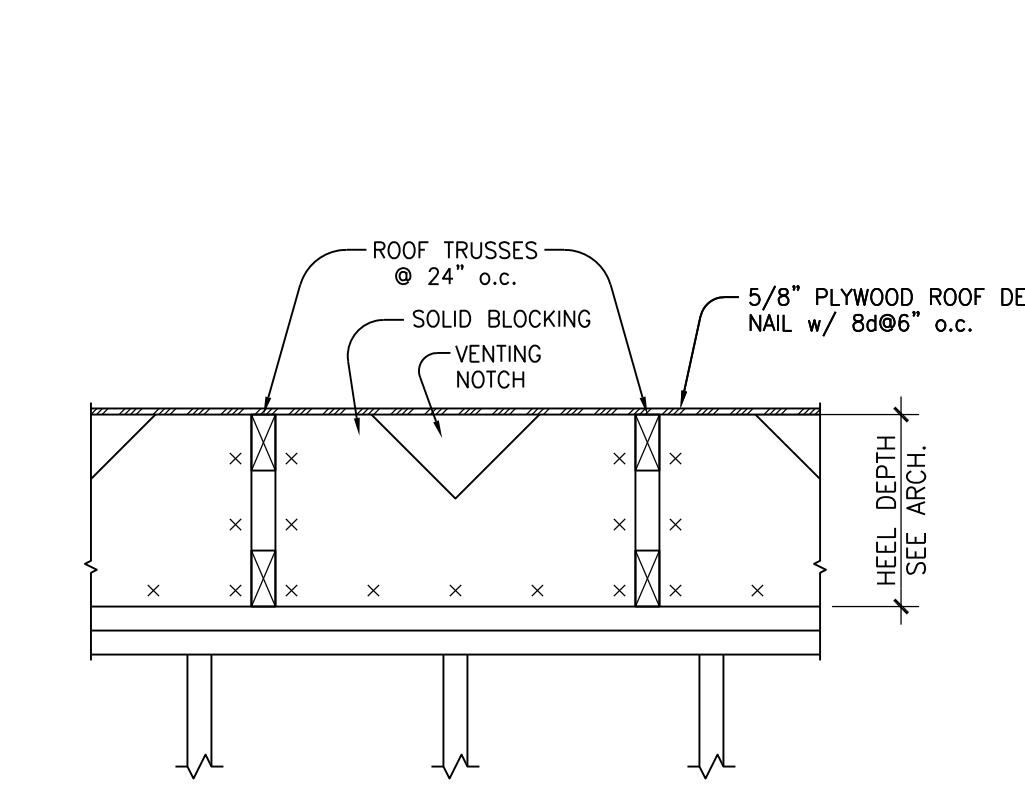


SECTION 5
SCALE: 1" = 1'-0"

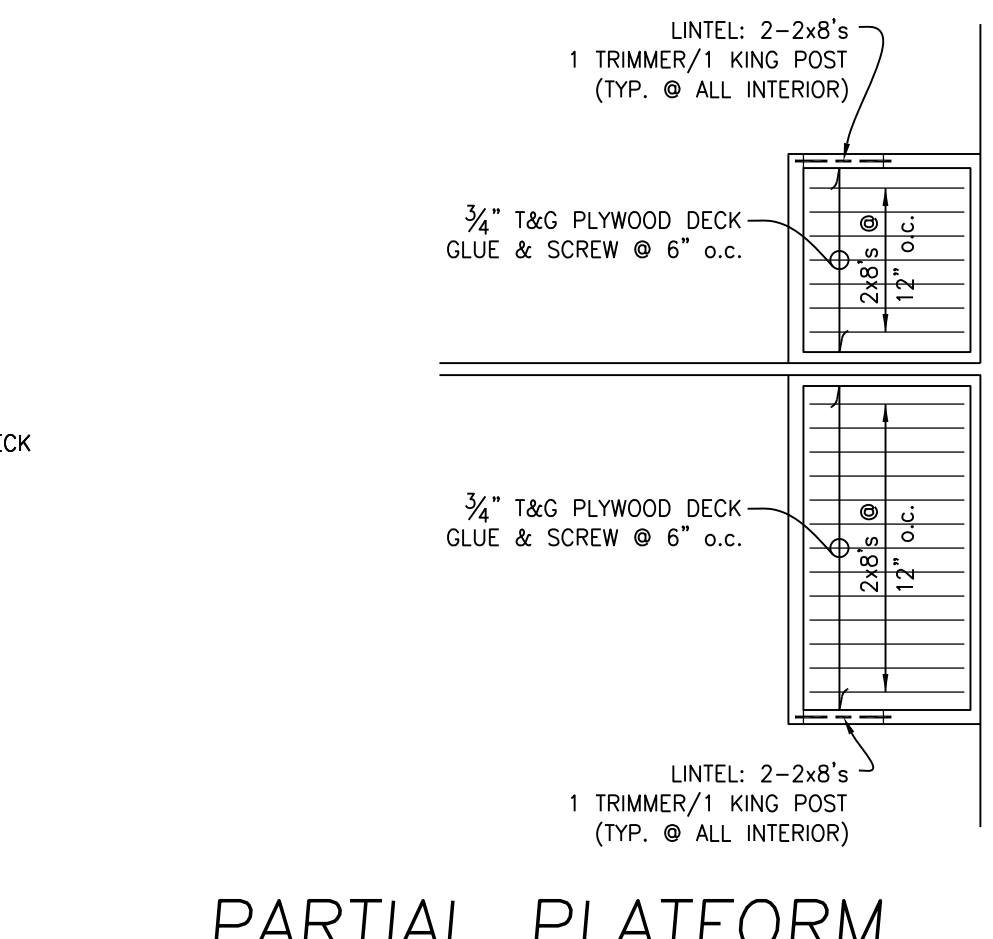


SECTION 6
SCALE: 1/8" = 1'-0"


NOTE: 1). JOIST BRN'G EL. = 108'-0" U.N.O.

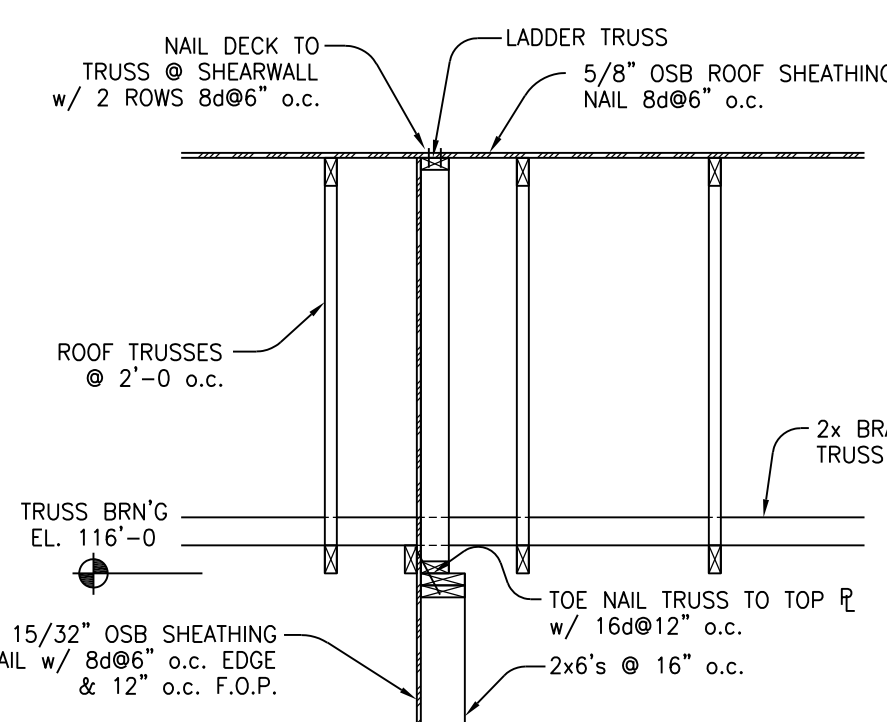


SECTION 7
SCALE: 1/2" = 1'-0"

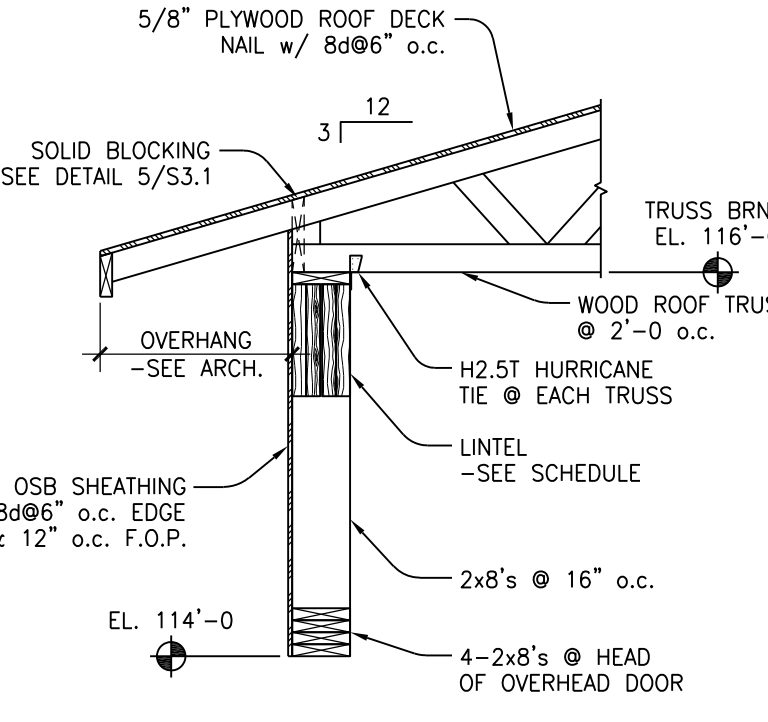


SECTION 8
SCALE: 1/2" = 1'-0"

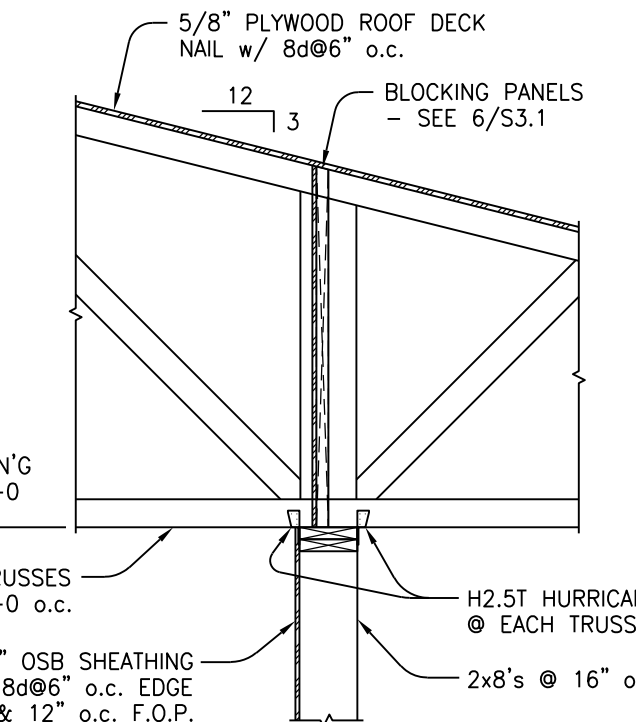


SECTION 9
SCALE: 1/2" = 1'-0"

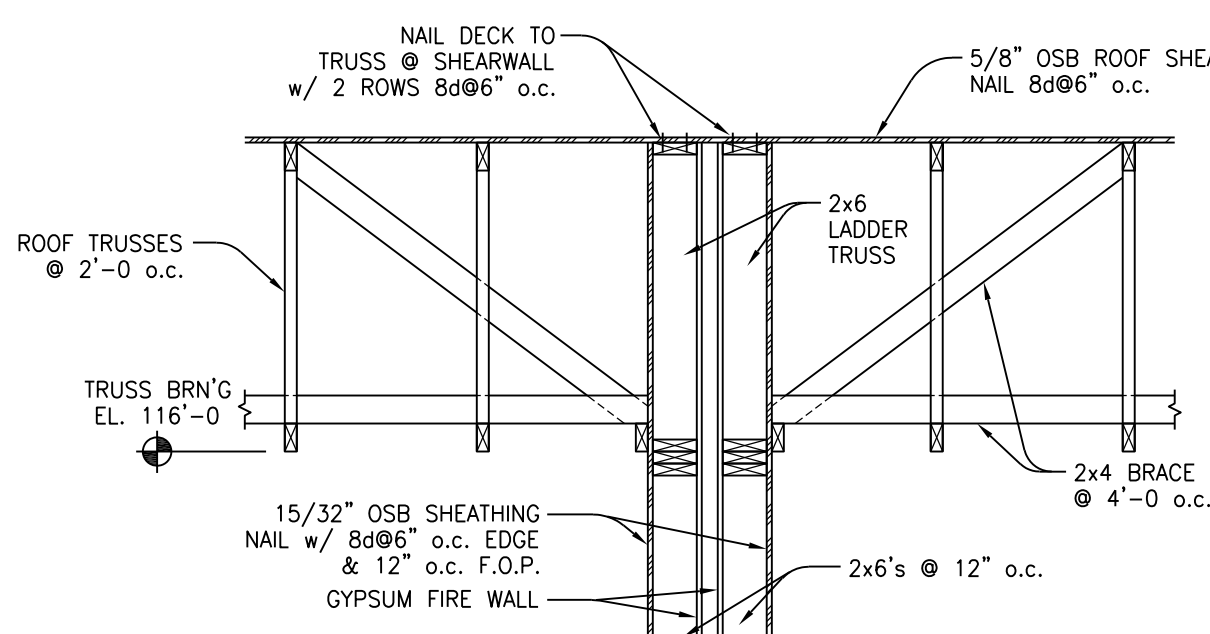

SECTION 10
SCALE: 1/2" = 1'-0"

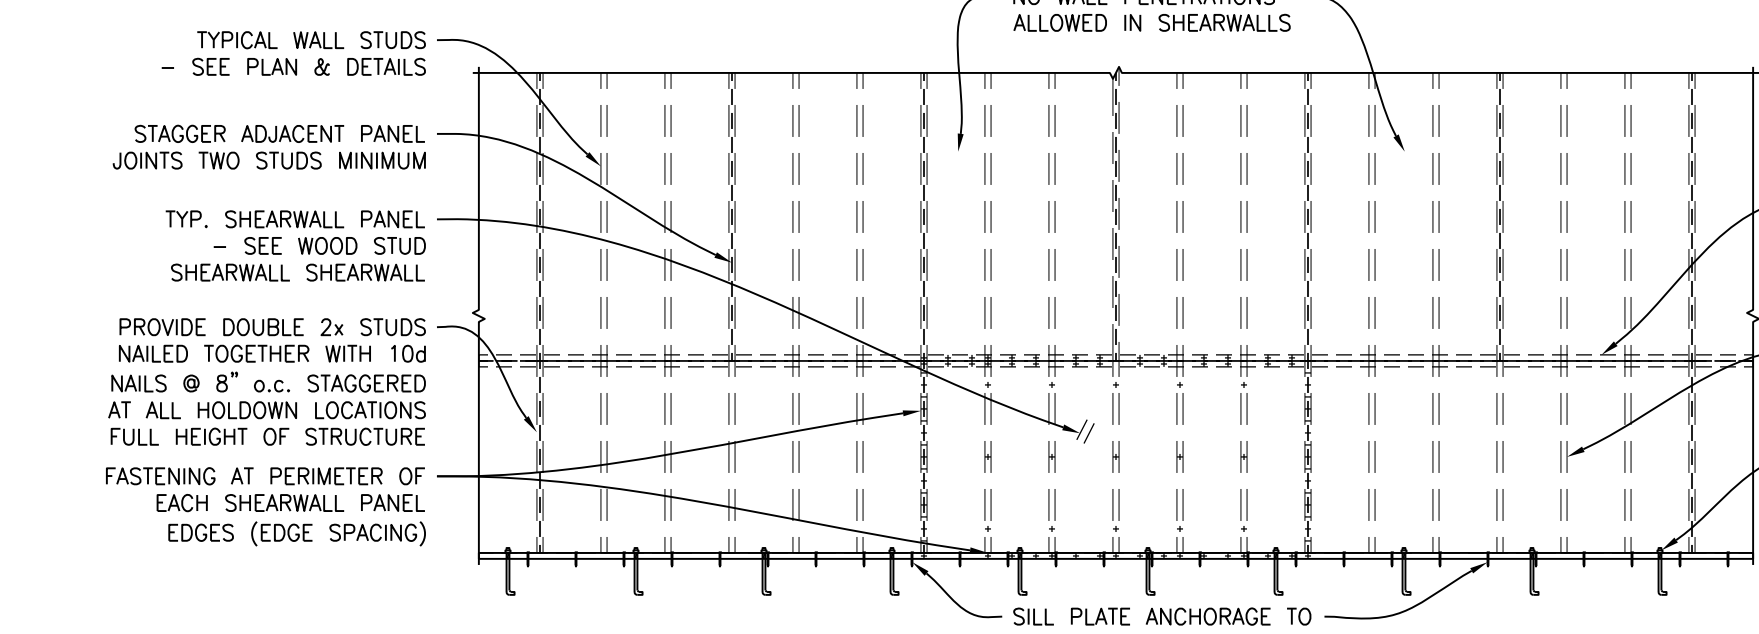

SECTION 11
SCALE: 1/4" = 1'-0"


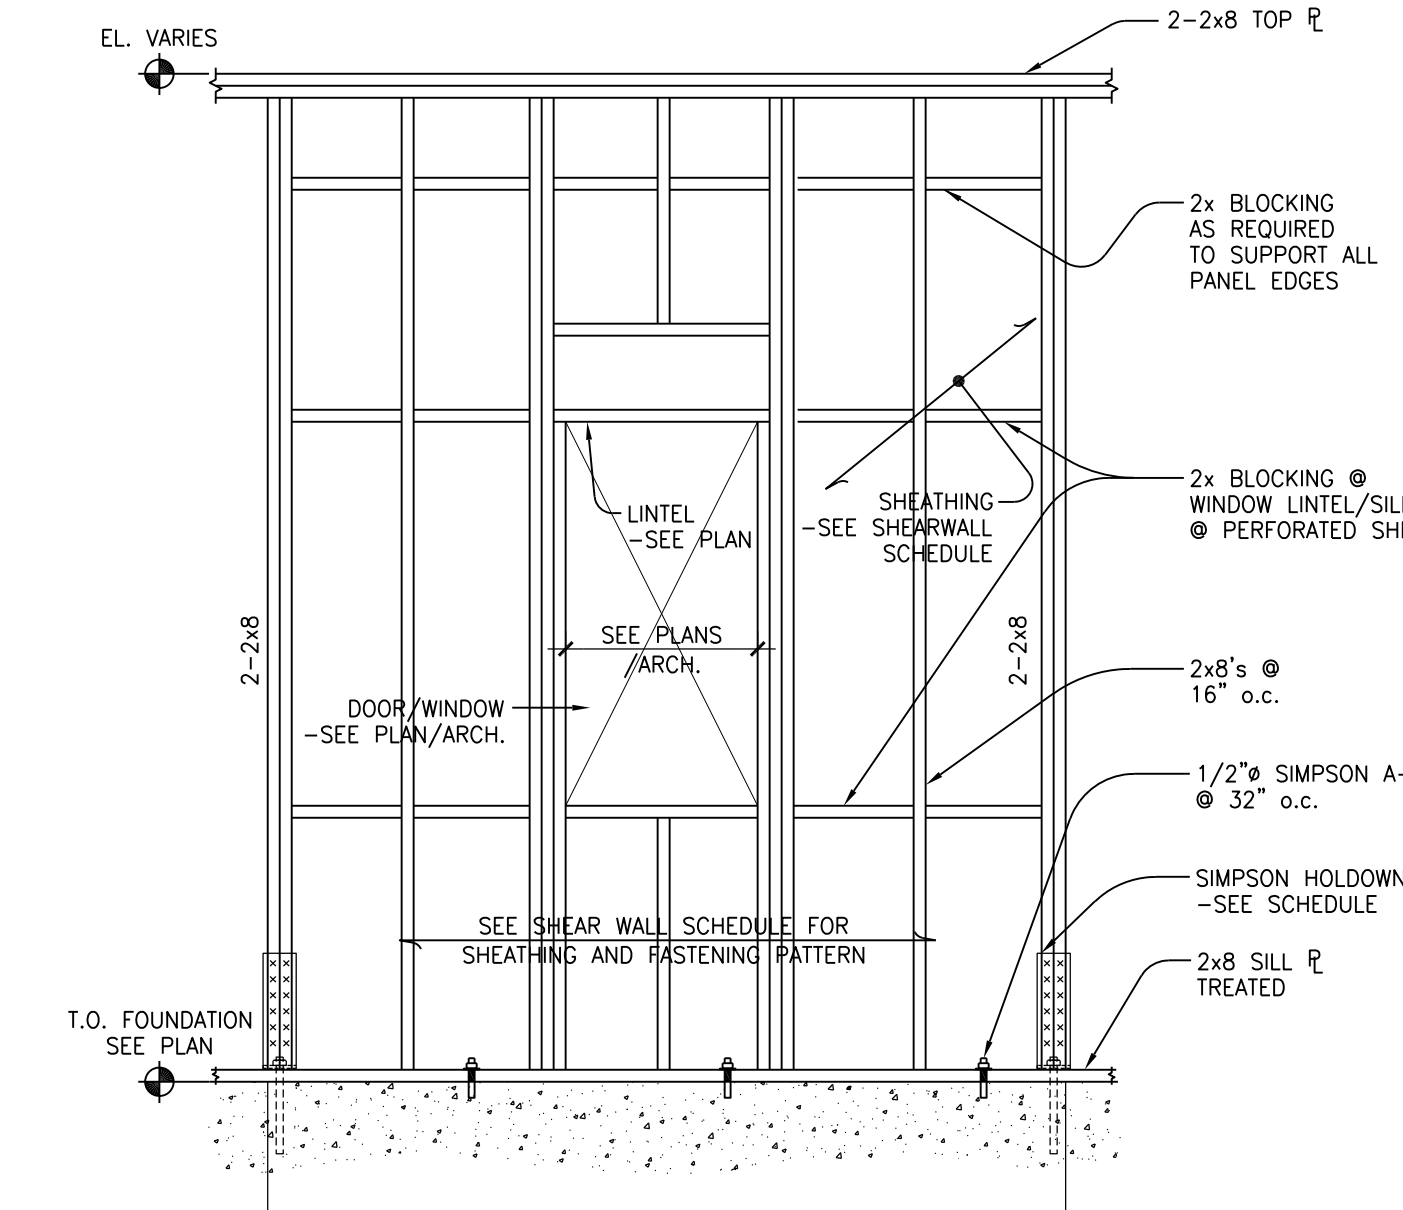


SECTION 12
SCALE: 1/2" = 1'-0"

LINTEL SCHEDULE			
MARK	LINTEL	R.O.	REMARKS
L1	4 - 1 3/4" x 14" LVL's @ TOP OF WALL 4 - 2x8's @ TOP OF OPENING	14'-0"	LVL's : 2 TRIMMERS/2 KING POSTS SAWN: 2 TRIMMERS/2 KING POSTS
L2	4 - 2x8's	3'0" TO 3'-4"	1 TRIMMER/2 KING POSTS

SHEAR WALL SCHEDULE			
NOTATION	'SW1'	'SW2'	'SW3'
APPROXIMATE WIDTH (VERIFY W/ ARCH.)	72'-0"	9'-3"	90'-6"
WALL PANEL AND FASTENING	15/32" O.S.B. - BLOCKED NAIL w/ 8d @ 6" o.c. EDGE & 12" o.c. FIELD OF PANEL	15/32" O.S.B. - BLOCKED NAIL 8d @ 6" o.c. EDGE & 12" o.c. FIELD OF PANEL	15/32" O.S.B. - BLOCKED NAIL 8d @ 6" o.c. EDGE & 12" o.c. FIELD OF PANEL
HOLDOWNS	NOT REQ'D	SIMPSON HD3B	NOT REQ'D
HOLDUP ANCHOR	NOT REQ'D	1/2" SIMPSON TITEN HD (10" EMBED)	NOT REQ'D
ADDITIONAL ANCHOR BOLTS	1/2" TITEN @ 32" o.c.	1/2" TITEN @ 32" o.c.	1/2" TITEN @ 32" o.c.
COMMENTS	ATTACH TO MIN. 2-2x8's		

NOTE: 1). MINIMUM OF 3 ANCHOR BOLTS FOR EACH SHEAR WALL INCLUDING HOLDOWNS.
2). SIMPSON 1/2" TITEN HD ANCHOR BOLTS @ 32" o.c. ALL OTHER LOCATIONS UNLESS NOTED.
3). TYPICAL EXTERIOR SHALL BE 15/32" O.S.B. SHEATHING NAILED w/ 8d @ 6" o.c. EDGE & 12" o.c. FIELD OF PANEL. BLOCKED PANEL EDGES UNLESS NOTED OTHERWISE.

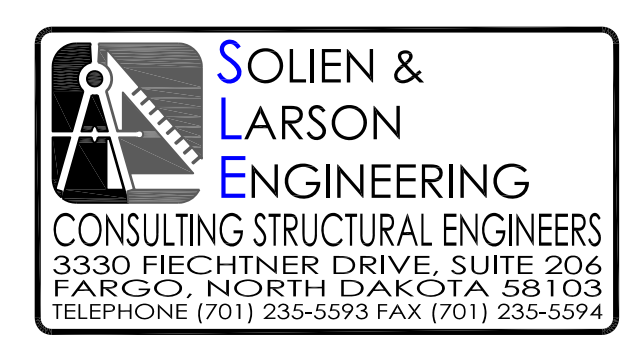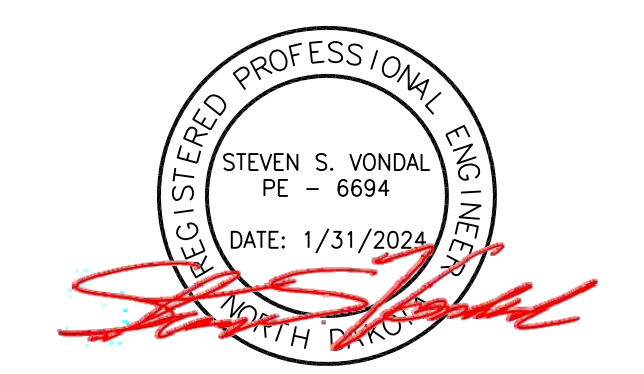


Floor Plan General Notes

1. Rough carpentry contractor to provide & install all wood backing/blocking throughout.
2. Contractor to field verify all dimensions shown herein and alert Construction Manager of discrepancies.
3. All contractors to visit site to verify scope of work.
4. All walls to be framed, insulated, & sheathed to structure/structural deck above unless otherwise noted. See Wall Types & Details for additional information.
5. Refer to Structural for all shear wall locations.
6. All GWB to be painted SW 7657 (Zircon) with orange peel texture. Provide Level 3 finish at all GWB.
7. Concrete floor throughout to be 4" reinforced concrete slab - See Structural Drawings

Floor Plan Keynotes


- ① 100 amp panel at Utility 100.
- ② 100 amp panel at each tenant space.
- ③ Access hatch in shop ceiling to vented attic. To be framed in drywall with insulated drywall panel - See Detail 8/A4.1.
- ④ Designated area for building services/equipment. Wall and ground mounted - See Civil/Mech/Elect.
- ⑤ 3 HR Fire Wall - (UL Design No. U454) - See wall types.
- ⑥ Steel bollard - See Detail 5/A3.0 - Located 1'-0" off each corner of the building (Qty. 4).
- ⑦ Pre-finished metal canopy by Owner installed by framing contractor - Refer to Detail 5/A4.1.
- ⑧ 4' tall knee wall (Wall Type 3A) to conceal all electrical outlets and conduit with drywall cap. Do not penetrate fire wall.

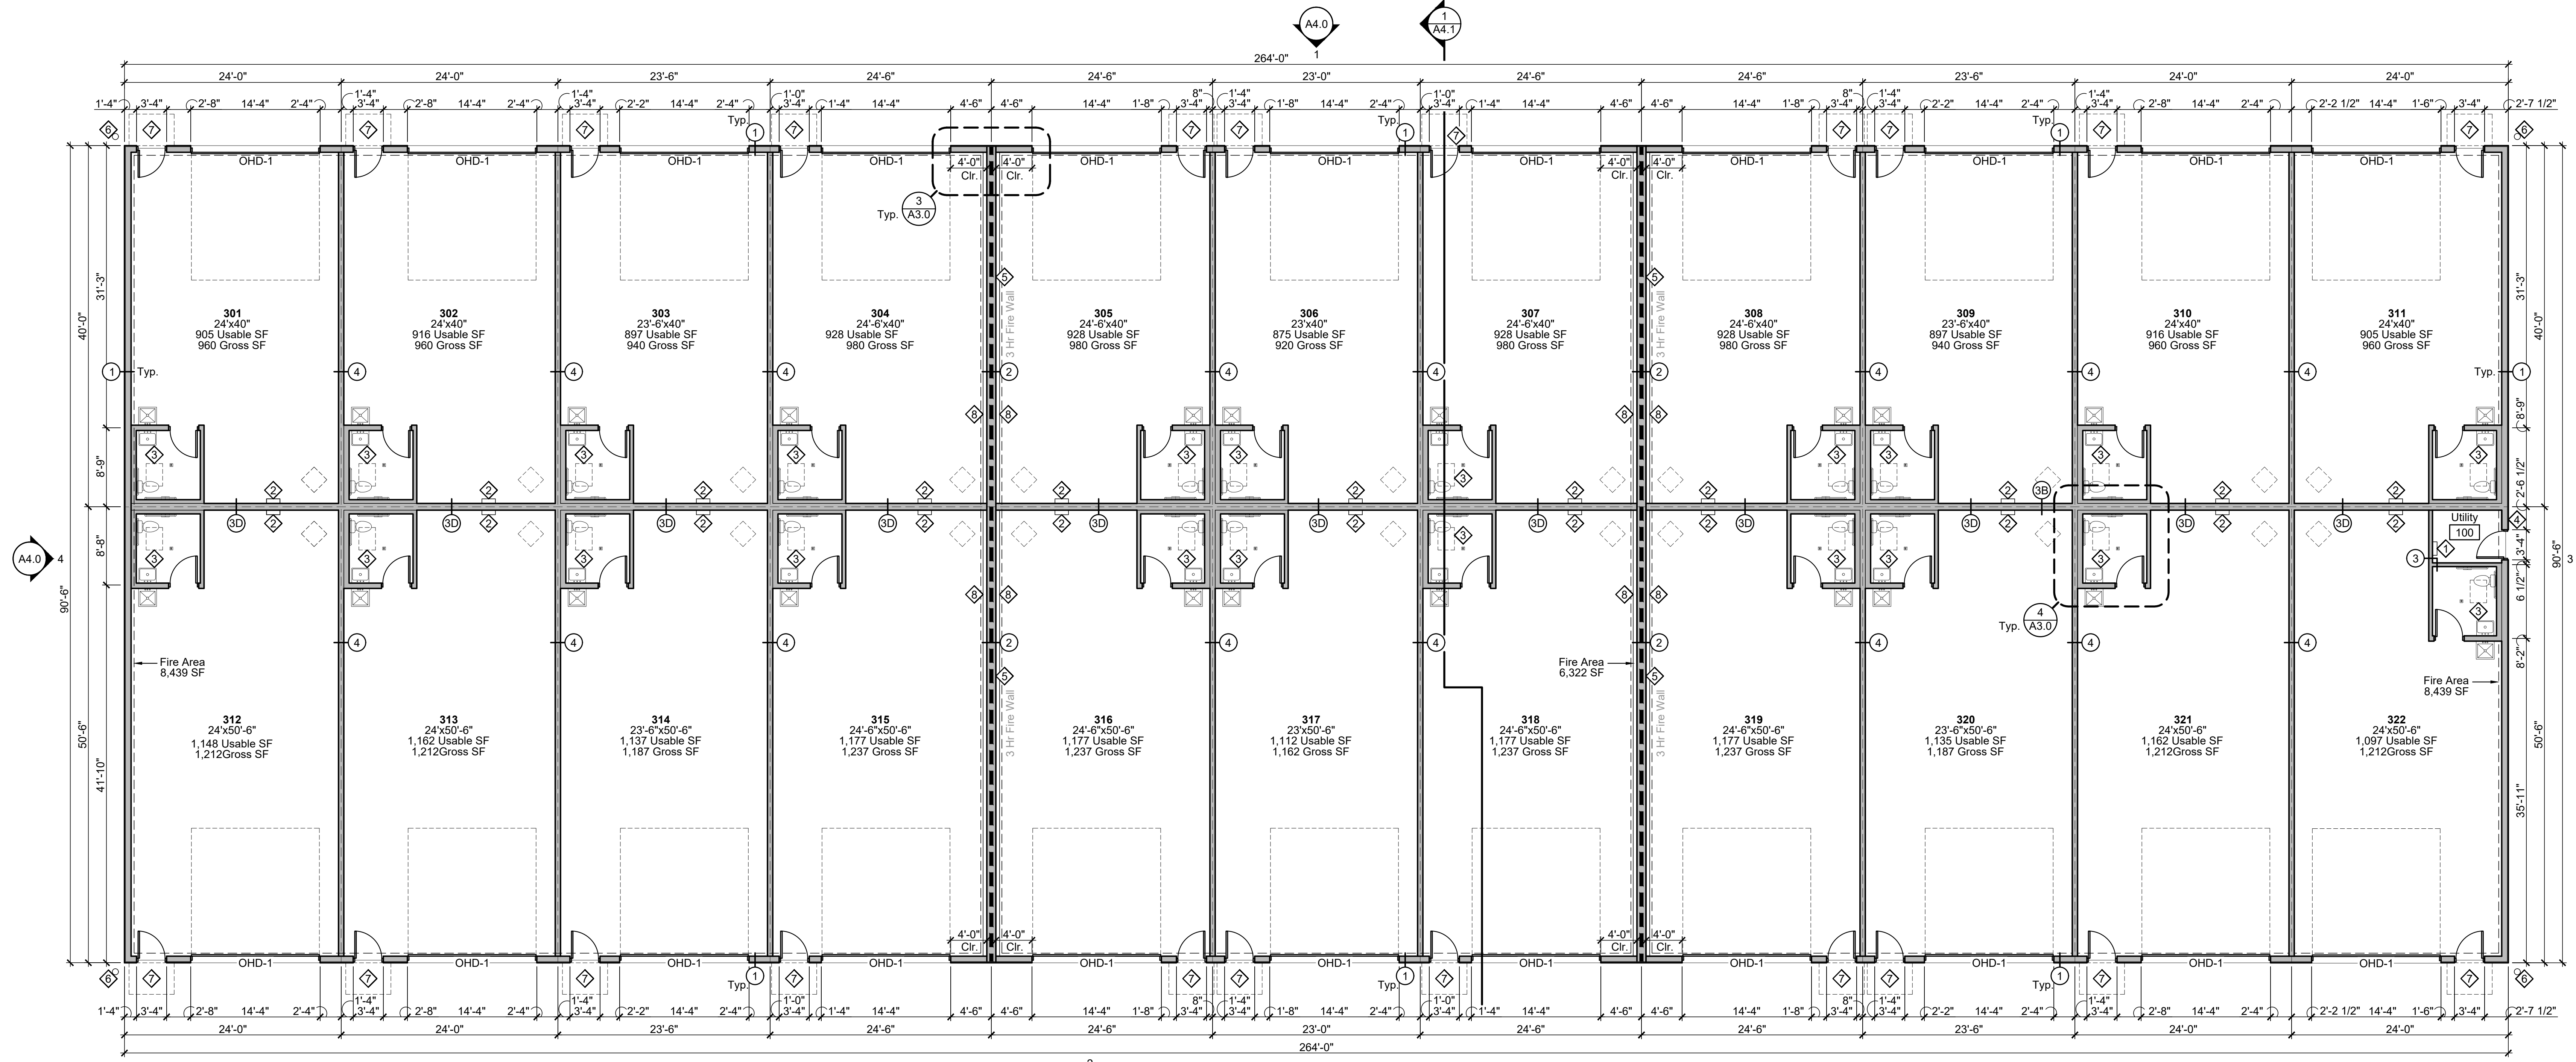


1 Floor Plan
1/8" = 1'-0"

Note: See A3.1 for ADA mounting requirements.


- Fixtures**
- Toilet:** Mansfield Summit3 Elongated Smart Height Magna Flush Flush Toilets (White) CLS-1955 Open Front Toilet Seats (White)
 - Sink:** Mansfield 20"x18" Wall Hung Lavatory (White)
 - Faucet:** Delta 520 Lavatory Faucet (Chrome)
 - Grab Bars:** Bobrick (1) 18", (1) 42", and (1) 36"
 - Utility Sink Faucet:** American Standard #8344212.004 With Bucket Hook and Garden Hose Hook Up
 - Mirror:** Bobrick 18"x36" B-290 Series Welded-Frame Mirror

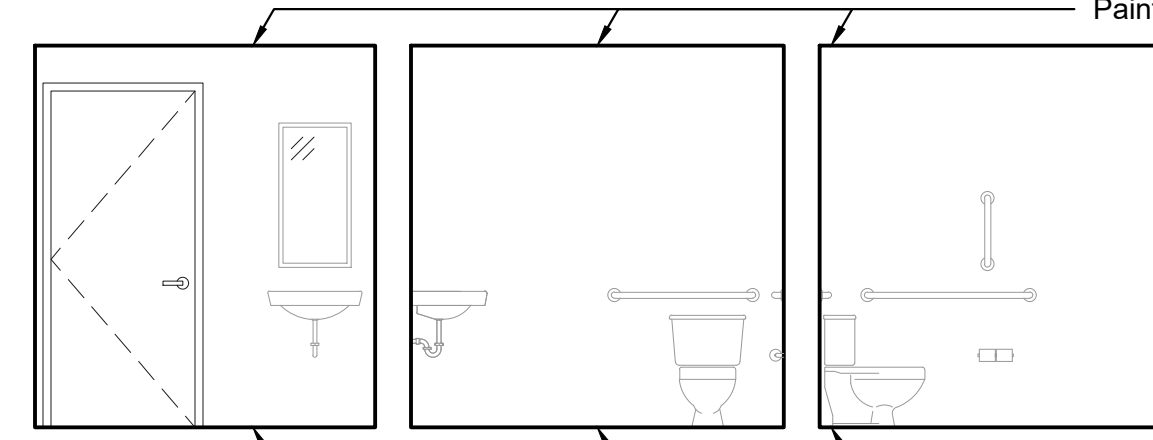

2 Typ. Toilet Room Int. Elev.
1/4" = 1'-0"

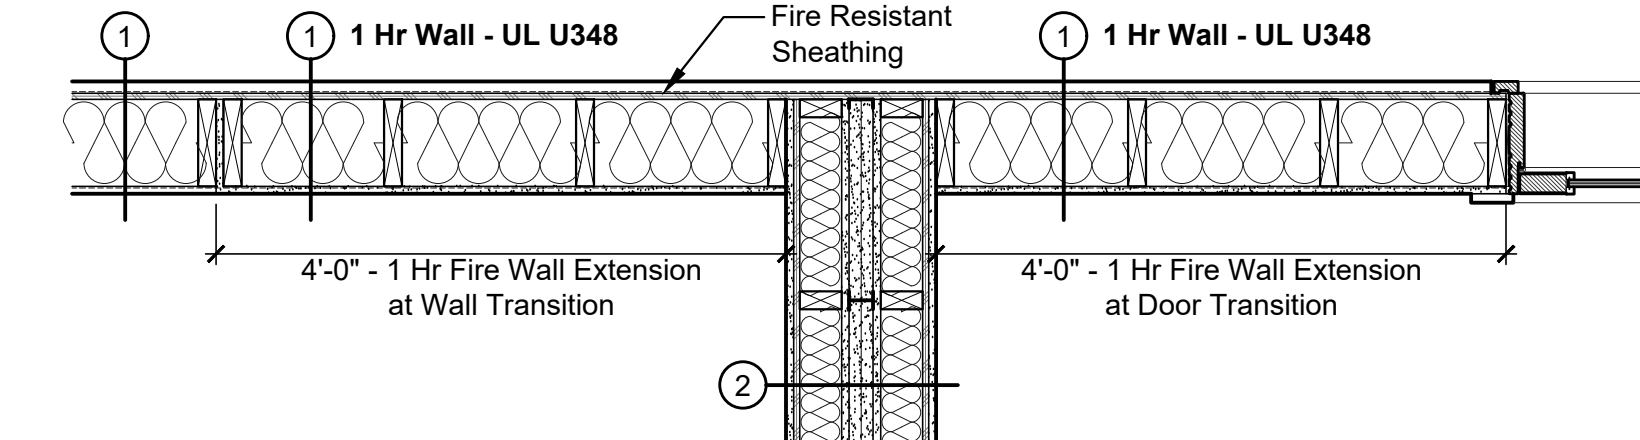

3 Plan Detail
3/4" = 1'-0"

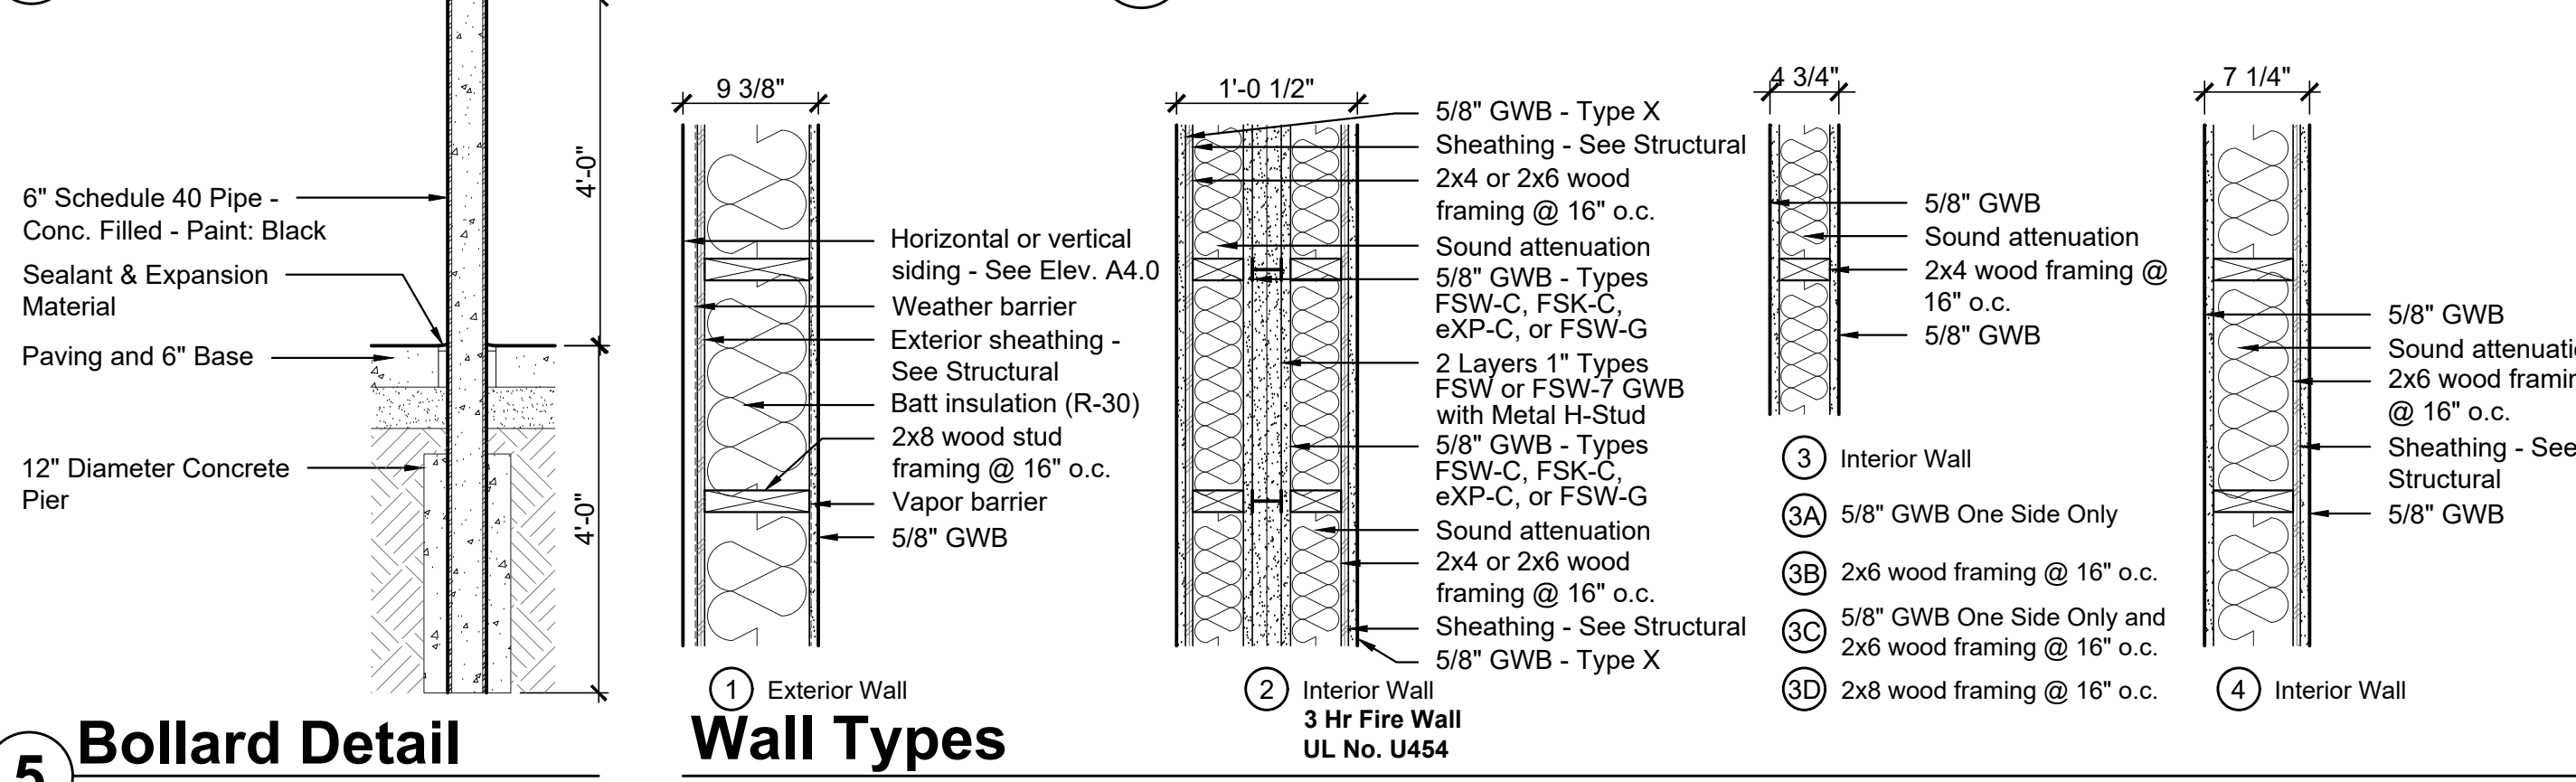


5 Bollard Detail
1/2" = 1'-0"

Door and Frame Schedule

Door Location	Size	Door Type	Rating	Frame Type	Hardware	Remarks
All Units	3'-0" x 6'-8" x 1 3/4"	Door-1	-	Door-1	Entrance Function Lockset and Deadbolt Basis of Design: Schlage AL Jupiter	-
Toilet Rooms	3'-0" x 6'-8" x 1 3/4"	Door-3	-	Door-3	Bathroom Function Lockset Basis of Design: Schlage AL Jupiter	-
Utility Room	3'-0" x 6'-8" x 1 3/4"	Door-2	-	Door-2	Entrance Function Lockset and Deadbolt Basis of Design: Schlage AL Jupiter	-

1. All Hardware to be Brushed Nickel finish unless otherwise noted.

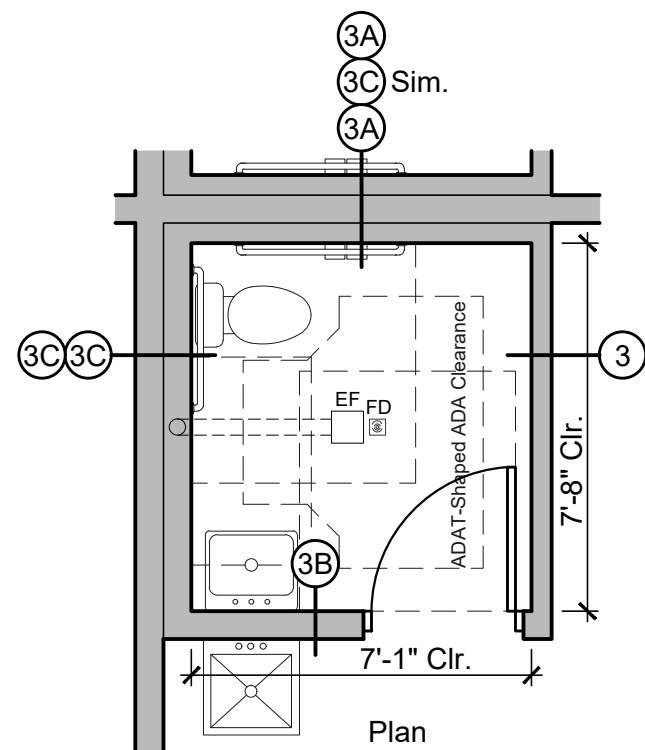

4 Typ. Toilet Room
1/4" = 1'-0"


Window Types
1/4" = 1'-0"

Door and Frame Types
1/4" = 1'-0"

Planning and Zoning

Information	See Civil Drawings
City Code Reference	Title 14 and Ordinance no. 6516
Lot Size	266,731
Building Size	23,892 sq ft (Building 3 of 4)
Zone	Conditional GC - Conditional Heavy Commercial
Maximum Building Coverage	80%
Maximum Lot Impervious Area	85%
Landscape Buffer	20' Along South and East property lines
Front Yard Setback	15'
Interior Yard Setback	0' as long as building is 2 stories or less
Street Side Setback	0' as long as building is 2 stories or less
Rear Yard Setback	10'
Building Height Limit	3 Stories or 50'
Parking Requirements for Development	
Total Development Size	91,012 sq ft
Parking Calc Factor (Business)	1 Stall per 360 sq ft - 220
On Street Parking	48 Stalls Allowed based on Ordinance and Layout
Number of Stalls Required	253
Total Parking Provided	268

Key Plan

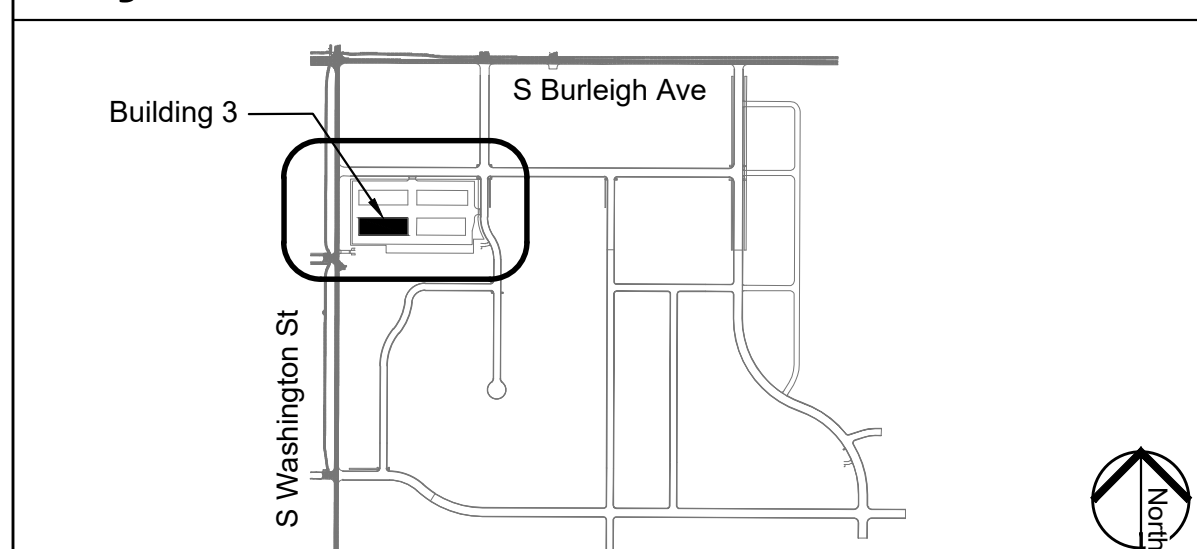

Code Research Summary

2021 International Building Code	Information	Reference
Occupancy	Mixed Use Group - "B" Business, "M" Mercantile, "S-1" Storage	Section 304, 309, 311
Total Square Footage	23,892 sq ft (Building 3 of 4)	See Floor Plans
Sprinkled	No	Section 903
General Building Information		
Height - Maximum Feet	"B" Business: 40 ft, "M" Mercantile: 40 ft, "S-1" Storage: 40 ft	Table 504.3
Height - Maximum Stories	"B" Business: 2 Stories, "M" Mercantile: 1 Story, "S-1" Storage: 1 Story	Table 504.4
Area - Base Allowable	9,000 sq ft	Table 506.2
Area - Frontage Increase	6,750 sq ft	Table 506.3.3
Area - Factor Increase	Per Table, 100% of building perimeter can be multiplied, with over 30 ft of open space = 0.75	Table 506.3.3
Allowable Area	$A_u = A_b + (NS \times I) / A_u = 9,000 + (9,000 \times 0.75) / A_u = 15,750$ sq ft	Table 506.3.3
Total Allowable Area Per Floor	15,750 sq ft (per Fire Area)	
Fire Separation Area	3 hours - See Below	
Construction/ Fire Resistive Requirements		
Construction Type	Type V-B (non-sprinkled)	Table 601
Structural Frame	0 hours	Table 601
Exterior Bearing Wall	0 hours	Table 601
Interior Bearing Wall	0 hours	Table 601
Exterior Non-Bearing Wall	0 hours	Table 601
Interior Non-Bearing Wall	0 hours	Table 601
Floor/Ceiling	0 hours	Table 601
Roof/Ceiling	0 hours	Table 601
Fire Rated Resistive Construction		
Maximum Area of Exterior Wall Openings	Not Required since >30' Separation Distance	Section 705.8
Fire Barriers	As Required by Table 508 for Occupancy Separation No Separation Required Between "B", "M", and, "S-1"	Section 706
Fire Walls	No Larger than 12,000 SF per Fire Area and Aggregate of 24,000 SF for Total Building, including future mezzanines. No Commercial Vehicles, Upholstered Furniture, or Mattresses Allowed	Section 903.2
Fire Wall Rating	3 hour Fire Wall Required (most restrictive)	Section 706.4/ 707.3.10
Fire Barriers (Incidental Use Areas)	See Section 707 and 711	Section 509.4
Light, Ventilation, and Sanitation		
Minimum Facilities Required	Standard	
Water Closets	1 Provided, to be determined based on use	Table 2902.1
Lavatories	1 Provided, to be determined based on use	Table 2902.1
Service Sink	1 Provided, to be determined based on use	Table 2902.1
Means of Egress		
Use	To Be Determined	
Occupant Load Factor	To Be Determined	Table 1004.5
Occupant Load - Net Area	To Be Determined	
Total Tenant Occupant Load	To Be Determined	
Number of Exits Required	1 Provided at Each Tenant Space	Section 1006
Minimum Exit Width Required	To Be Determined	
Means of Egress Minimum Height	7 ft 6 in	Section 1003.2
Exit Door Minimum Width	32 in Clear (3'-0" nominal); Maximum: 48"	Section 1010.1.1
Exit Door Minimum Height	6 ft 8 in	Section 1010.1.1
Maximum Exit Access Travel Distance	200 ft (non-sprinkled)	Table 1017.2
Common Path of Egress Travel	75 ft (non-sprinkled)	Table 1006.2.1
Dead Ends	20 ft (non-sprinkled)	Section 1020.4


Project Description

The Paradise Business Centre is located in the Paradise Valley Development in South Bismarck off of Fisher Lane and Rutland Drive. There are 4 buildings within the project. This code review reflects Building 3 only. The building is type V-B construction and is not sprinkled. Fire walls will be installed to meet fire area requirements. It is a Mixed-Use occupancy consisting of Business "B", Mercantile "M", and Storage "S-1". There are 22 total units in total. All work is to comply with Title 14 and Ordinance no. 6516. Off-street and on-street parking are being utilized to meet parking requirements.

I HEREBY CERTIFY THAT THIS PLAN, SPECIFICATION, OR REPORT WAS PREPARED BY ME OR UNDER MY DIRECT SUPERVISION AND THAT I AM A QUALIFIED ARCHITECT UNDER THE LAWS OF THE STATE OF NORTH DAKOTA.
DATE: 01/31/2024 REGISTRATION NO.: 2809





Floor Plan, Typ. Toilet Room, Plan Detail, Wall Types, Door and Frame Schedule, Window/ Door/ Frame Types, Planning and Zoning, Code Research Summary, Notes, Key Plan, Details

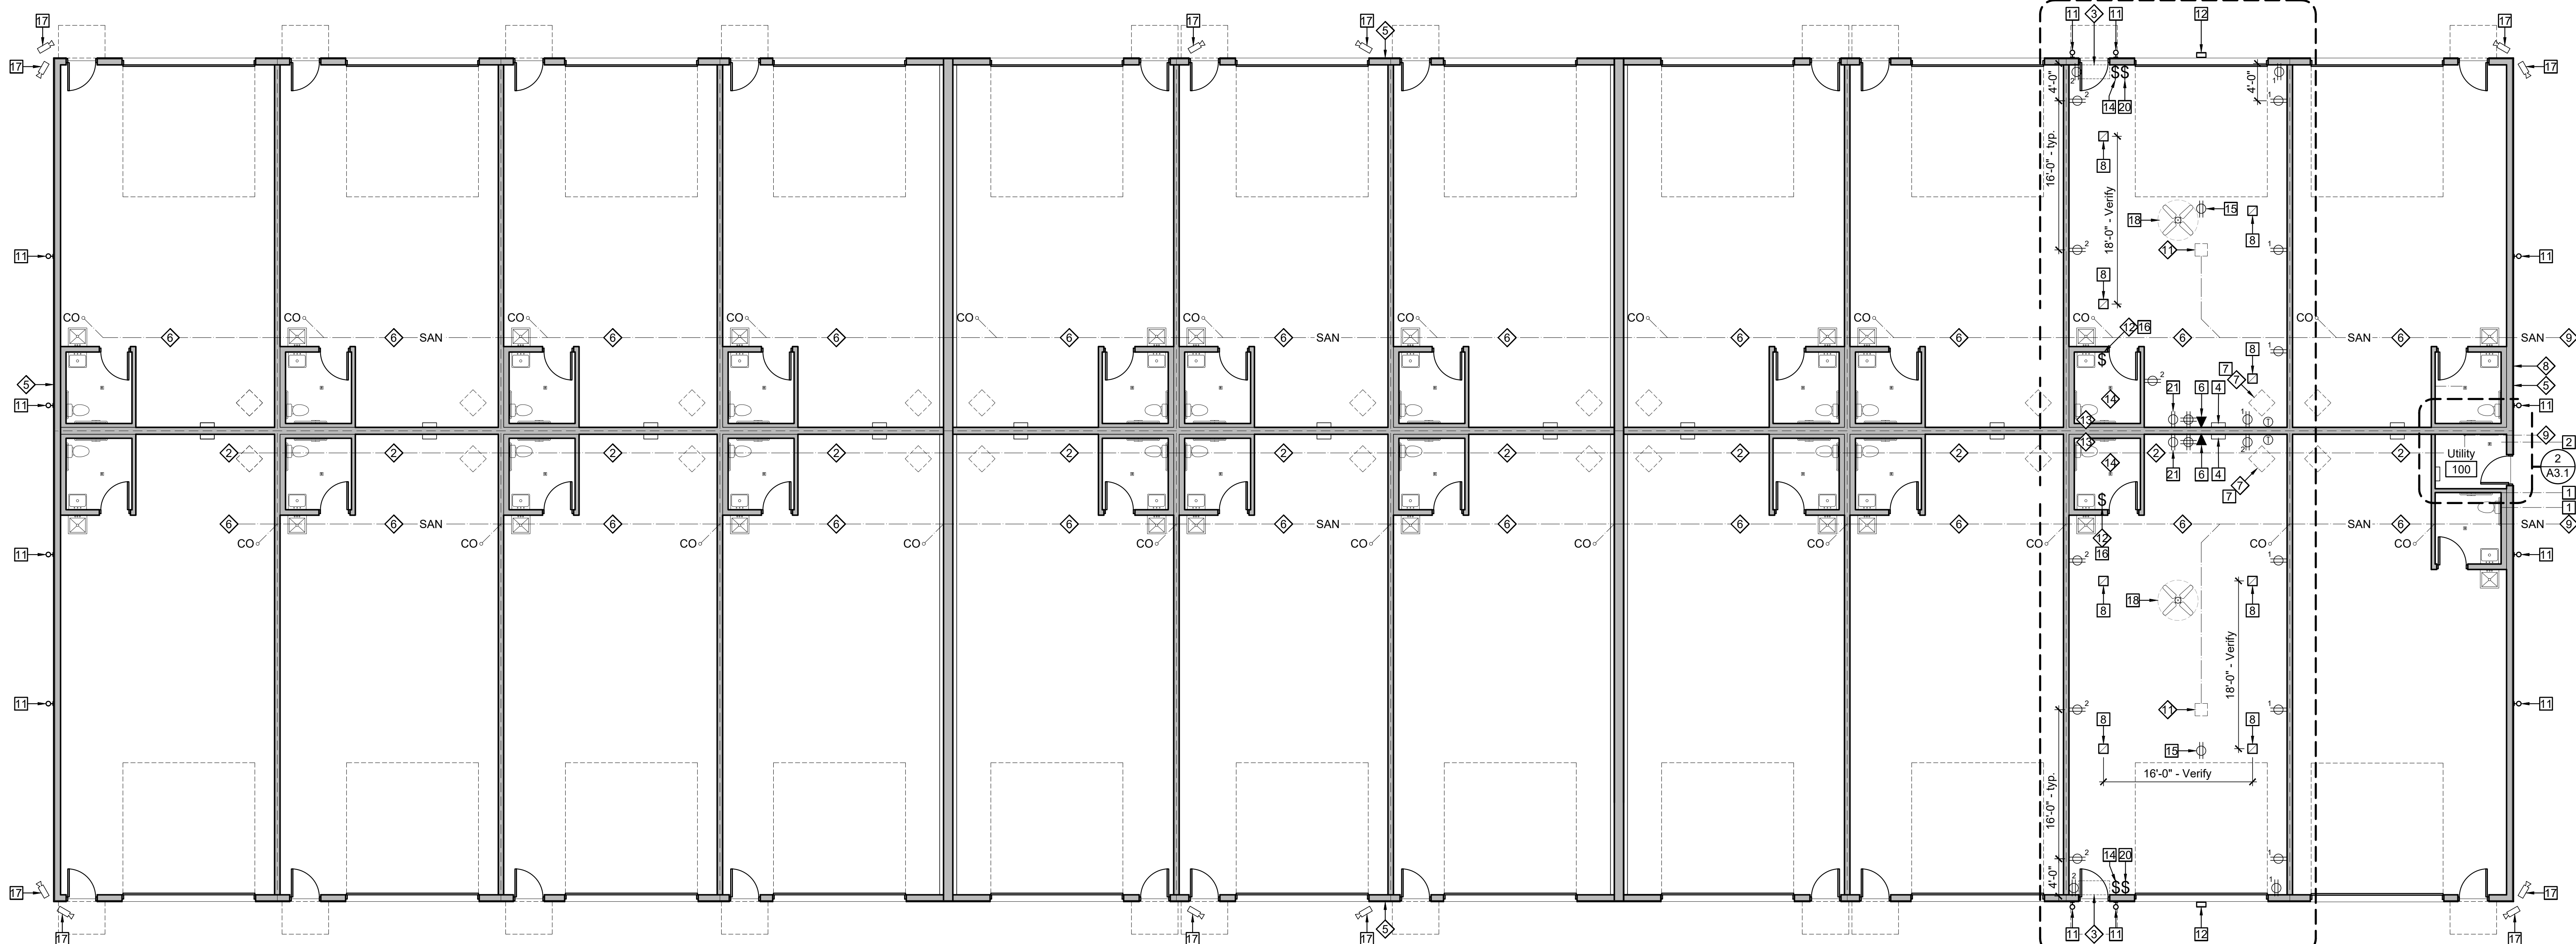

1 Mechanical / Electrical Plan
1/8" = 1'-0"

Note: Mechanical and electrical layout - Typical for all units

ADA Mounting Heights

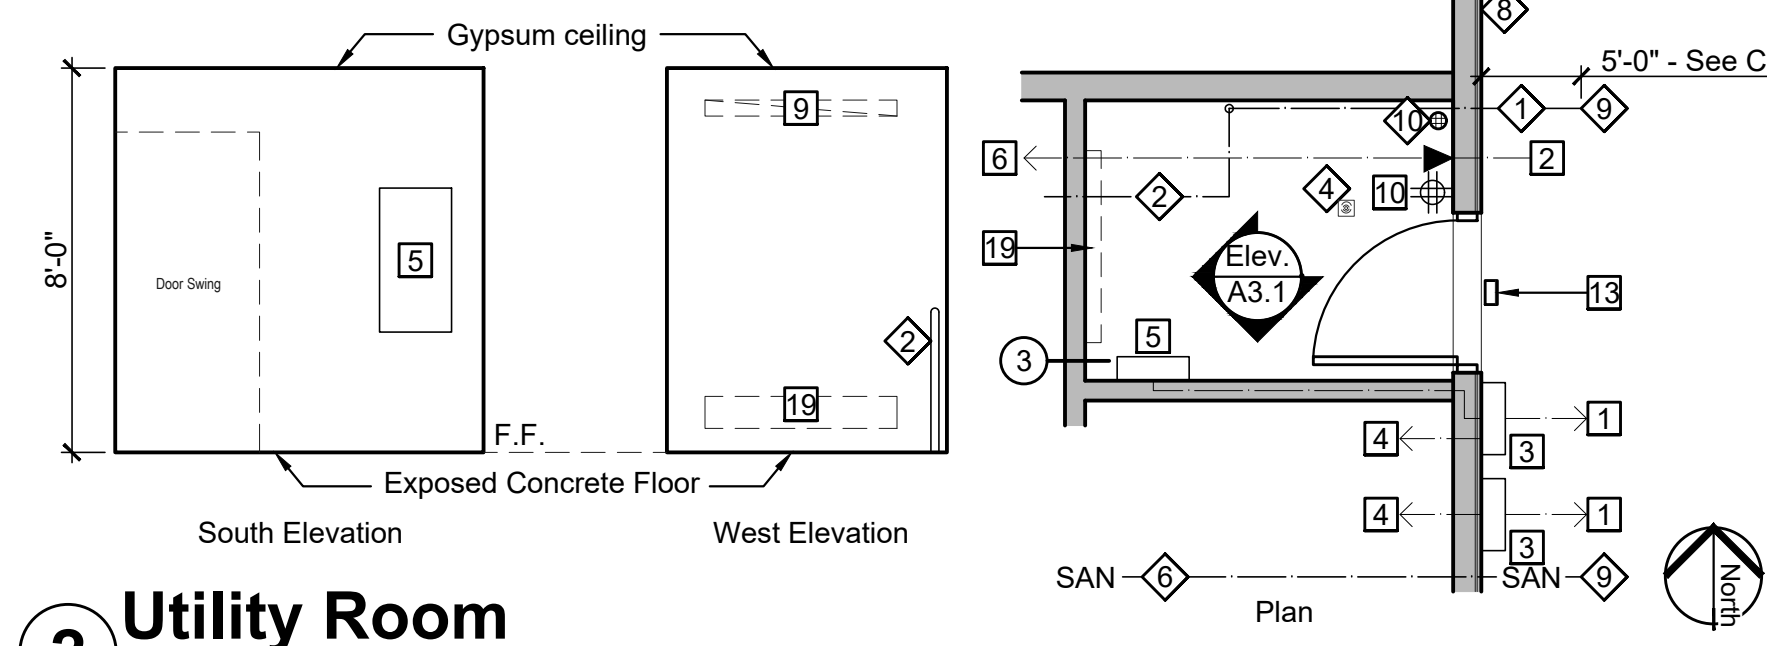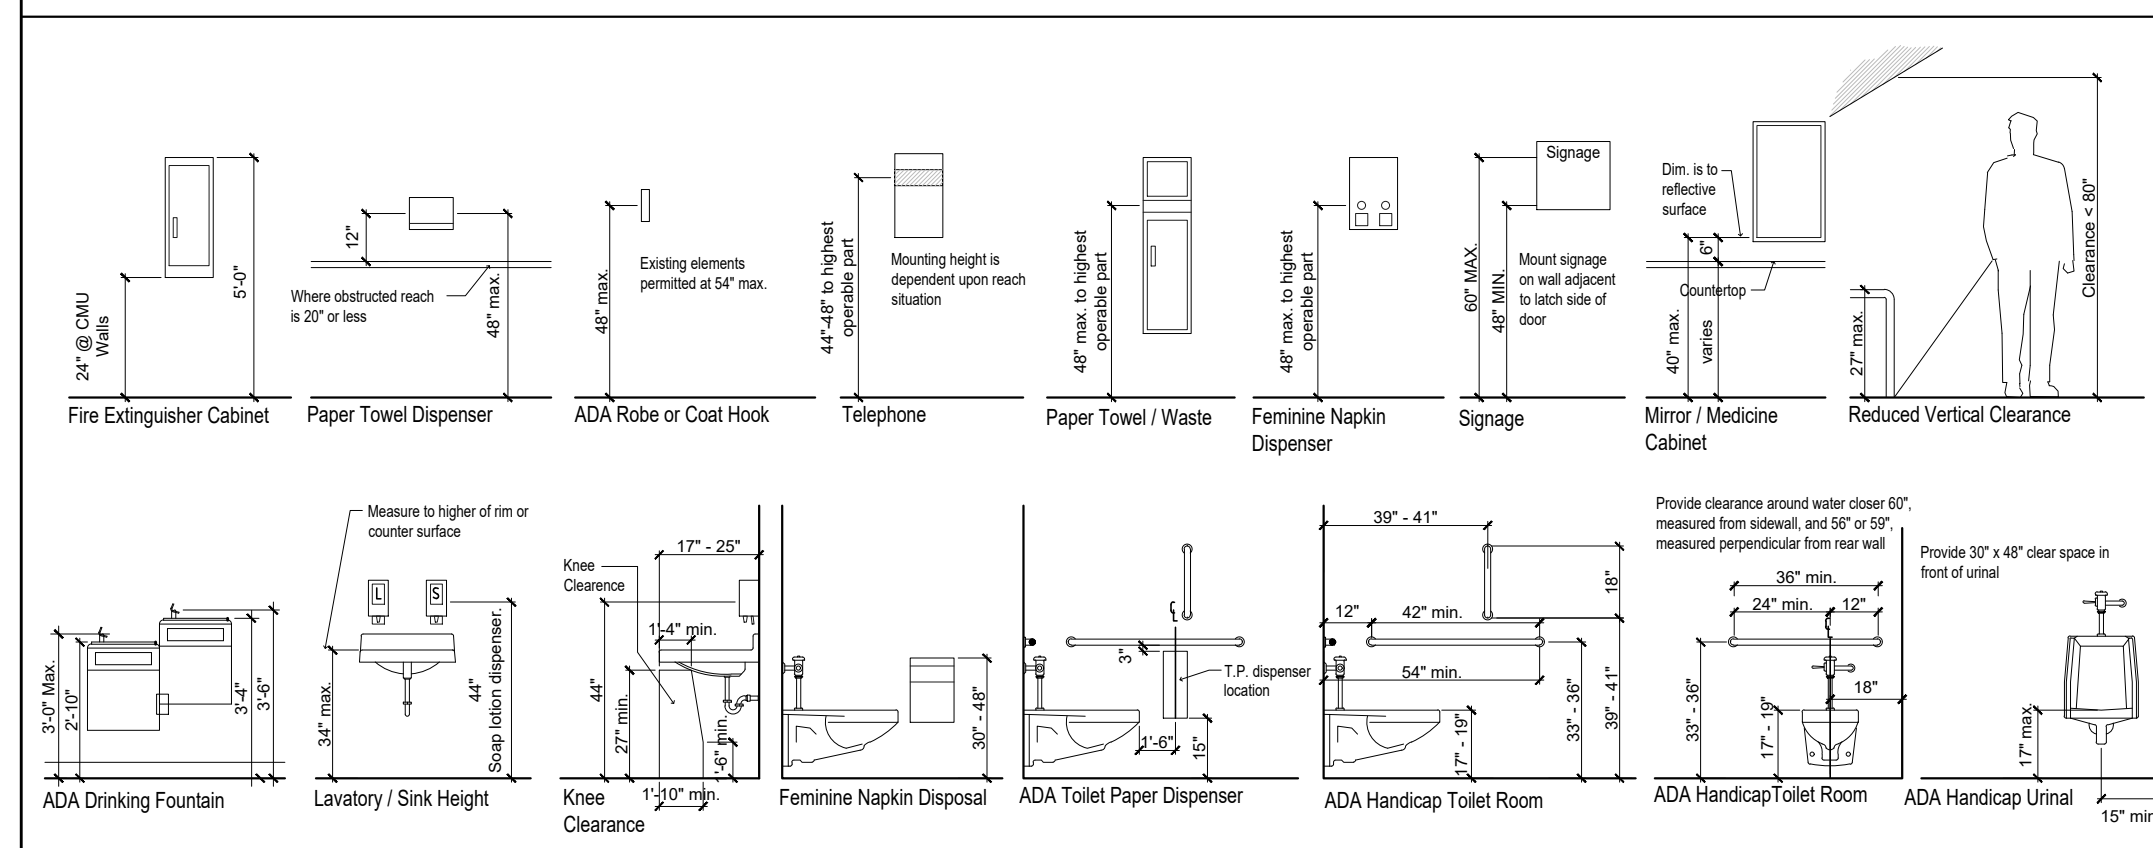

2 Utility Room
1/4" = 1'-0"

Mech/Plumbing Notes:

- Note: Mechanical/Plumbing Contractor to review drawings, and visit site prior to bidding. Mechanical/Plumbing Contractor to design-build; provide all materials, labor, taxes, and permitting to achieve scope of work indicated on drawings. Provide required information and drawings necessary for state and local code review/approval and construction coordination.
- 1 Provide (1) 2" C900 (Domestic) CW Line into Utility 100. Provide water meter as required by code - verify location with CM.
- 2 Provide (1) 2" (Domestic) CW Line as shown on plan underground. Provide (1) shut off valve at Utility 100. 2 back to back units to share branch off 2" CW main. Each unit to have separate shut off valves. Verify location. Verify with City of Bismarck.
- 3 Thru-wall HVAC/cooling insert installed above canopy. See Elevations for location. Basis of Design for Future Unit: Gree PTAC II GAE15AED3NRNB5GCP. Electrical Contractor to provide dedicated circuit to location for future use and temporary infill enclosure for complete wall assembly. Custom color grill to match adjacent siding. Verify final color selection with Architect/Owner.

- Alternate #1: Provide alternate price to provide and install all 22 units for entire building.
- 4 Provide 2" Floor Drain at Utility 100.
- 5 Provide (4) exterior Hose Bibs as shown on plan.
- 6 Provide 4" PVC Sanitary Sewer line and cleanouts as shown on drawings. Cleanouts to be flush with concrete floor. Verify location with Arch/CM. Verify proper line slope - See Civil Drawings.
- 7 Provide ceiling-hung heater and thermostat for each unit. Basis of Design: Reznor UDX Natural Gas Unit Heater. Include all components to vent thru roof. Direct wired or plug in. Verify heater and thermostat location and height with Arch/CM. Verify total BTUs required per unit with mechanical contractor.
- 8 Gas Meters provided by utility company - verify location with Owner/CM. Provide gas lines as shown on Plan to each ceiling-hung heater.
- 9 Final connection to utilities by Mechanical Contractor. Verify locations with Civil Drawings.
- 10 Plumbing contractor to provide floor drain vent pipe through roof as required.
- 11 Provide 16"x16" floor drain with catch basin and pipe to storm sewer at each tenant space. Floor drain to be no more than 2" below finish floor elevation.
- 12 Residential exhaust fan - vent through bathroom wall up to roof.
- 13 20 gallon single element water heater on bathroom platform with water heater pan. Drain to be piped through wall to floor drain. Basis of Design: Westinghouse® 20 Gallon 6 Year Electric Water Heater, 2000W, Model Number: WER020A1X020N10. See 1/A4.1
- 14 2" Floor drain to be no more than 1/4" below finish floor elevation.

Electrical Notes:

- Note: Electrical Contractor to review drawings and visit site prior to bidding. Electrical Contractor to design-build; provide all materials, labor, taxes, and permitting to achieve scope of work indicated on drawings. Provide required information and drawings necessary for state and local code review/approval and construction coordination.
- All electrical outlets to be 60" A.F.F. U.N.O. Electrical contractor to provide plywood backing at panels.
- 1 Provide Transition Cabinet including (1) 4" Conduit from Transformer to Transition Cabinet. Provide (2) main conduit from Transition Cabinet to Utility 100 feeding (2) 600 Amp Main Breaker/MDPs.
- Transformer and Transition Cabinet to be located adjacent to Building 3 and shared with Building 4. Provide (2) concrete filled steel bollards as required by utility company. Verify route and footage of conduit with utility company.
- 2 Provide (1) 2" PVC communication/data conduit daily changed from Building 1 to Building 3. Daylight conduit into Utility 100 - See Civil Drawings.
- 3 Provide (2) 600 Amp (208/240 Single Phase) main breakers, feeding (22) 100 Amp panels, individually metered. Meters to be located on either side of MDP outside Utility 100 - Verify with utility company and electrical contractor.
- 4 Each tenant space to receive (1) surface mounted 100 Amp panel. Provide 1-1/4" underground conduit to each tenant space, verify location of panel at each tenant space with CM/Owner.
- 5 Utility 100 to receive (1) surface mounted 100 Amp panel, verify location of panel with CM/Owner.
- 6 Provide (1) 3/4" conduit under ground from Utility 100 to each tenant space for future communication/data.
- 7 Provide power to ceiling hung heater. Verify with Mechanical contractor.
- 8 High bay light fixture for general interior shop lighting. Basis of Design: Lithonia Lighting CPHB 12LM MVOLT 50K Contractor Select Compact Pro LED High Bay. Provide minimum lumens requirements to meet code. All shop lighting to be on single circuit. Verify final quantity of fixtures and lighting layout with CM/Owner.
- 9 Provide (1) 4'-0" LED utility fixture surface mounted on wall in Utility 100. Basis of Design: Lithonia Lighting WL LED Wall Surface Mount Bracket, 3000 Lumens, 5000K.
- 10 Provide (1) quad outlet in Utility 100. Verify location with CM/Owner. See interior elevation.
- 11 Provide (2) wall sconce light fixtures at each walk-through door on the North and South elevations and the East and West elevation as shown. Basis of Design: LEONLITE Integrated LED Cylinder Up/Down Outdoor Wall Light, 100V-277V, 20W, 3000K. See A4.0 for locations. All exterior fixtures to be controlled in Utility 100 with single photoeye.

- 12 Provide (1) wall pack light fixture above each garage door on the South elevation. Basis of Design: RAB Lighting LED WP2XFL60. Color Selectable, Bronze Finish. See A4.0 for location. All exterior fixtures to be controlled in Utility 100 with single photoeye.
- 13 Provide (1) downlight light fixture above Utility 100 door on the East elevation. Basis of Design: Lithonia Lighting WVPXO LED Wall Mount, Model #WVPXO LED ALO SWW2 MVOLT PE DDBXD M2. See A4.0 for location. All exterior fixtures to be controlled in Utility 100 with single photoeye.
- 14 Overhead door control location. Provide functions for Open, Close, and Stop.
- 15 Receptacle for overhead door operator - ceiling mount.
- 16 Exhaust fan and light to be controlled on same switch.
- 17 POE security camera layout as shown. Include Cat6 to location and 8TB hard drive in Utility 100. Product: Revu Surveillance Systems. Include wire shelf. Verify final camera selection and location with CM/Owner.
- 18 56" ceiling fan. Basis of Design: Westinghouse Jax Ceiling Fan, White Finish, Model #7812700, no light. Provide variable speed switch at shop door to control shop ceiling fan.
- 19 4" electrical baseboard heater in Utility 100. Basis of Design: Cadet 48 in. 208-volt 1,000/750-watt Electric Baseboard Heater, Finish: White, Model #4F1000W.
- 20 Provide switch at door to control all interior shop lighting.
- 21 40 amp dedicated receptacle for RV Plug-in. Verify power requirements with CM/Owner.

I HEREBY CERTIFY THAT THIS PLAN, SPECIFICATION, OR REPORT WAS PREPARED BY ME OR UNDER MY DIRECT SUPERVISION AND THAT I AM A QUALY REGISTERED ARCHITECT UNDER THE LAWS OF THE STATE OF NORTH DAKOTA.
DATE: 01/31/2024 REGISTRATION NO. 2629
SIGNED: [Signature]



Mechanical and Electrical Design-Build Plan, Notes, Enlarged Plan, ADA Mounting Heights

Material Legend

- 1** - Metal Lap Siding
- Quality Edge, TruCedar Steel Siding
- Profile: Single 6" (Horizontal)
- Color: Solid 425 Statuary Bronze
- 2** - Metal Lap Siding
- Quality Edge, TruCedar Steel Siding
- Profile: Single 6" (Horizontal)
- Color: Solid 469 Fresh Canvas
- 3** - Metal Lap Siding
- Quality Edge, TruCedar Steel Siding
- Profile: 6" Board & Batten (Vertical)
- Color: HD2 Woodgrain M16 Cider Mill
- 4** - Metal Lap Siding
- Versetta Stone, Ledgestone
- Panel Size: 36" x 8"
- Color: Sterling
- Include Stone Cap
- 5** - Stone Veneer
- Panel Size: 36" x 8"
- Color: Sterling
- Include Stone Cap
- 6** - Asphalt Shingles
- CertainTeed Landmark
- Color: Moire Black

Elevation Keynotes

- 1** Prepare to Receive Thru-wall HVAC/ Cooling Unit Mounted Above Door and Canopy. Verify Power Requirements with Electrical Contractor. Provide Custom Color Grill to be Select by Architect/Owner - See A3.1.
- 2** Pre-finished metal canopy by Owner installed by framing contractor - Refer to Detail 5/A4.1.
- 3** 6" Prefinished Metal Gutters and Downspouts. Basis of Design: Klauer Classic Rainware Collection - Color: Terra Bronze - Profile: Square
- 4** Gas and Electric Meters - Verify with Owner for Mounting Locations. Minimize Visual Impact to Extent Possible.
- 5** Light Fixture - See A3.1.
- 6** Light Fixture - See A3.1.
- 7** Light Fixture - See A3.1.

Roof Plan General Notes

- 1. Coordinate with Mechanical Plan for Equipment Locations, Venting & Information

Roof Plan Keynotes

- 1** Ice and water barrier where indicated by hatch 4'-0" Min.
- 2** Asphalt shingles over underlayment and installed per manufacturer's recommendations - Basis of Design: CertainTeed Landmark
- 3** Ridge Vent - Provide and install final quantity recommended by roofing contractor.
- 4** Shear wall/ draft stop in vented attic space. Comply with IBC 718 for access doors in draft stops.
- 5** Pre-manufactured Canopy - See Detail 5/A4.1.





HEREBY CERTIFY THAT THIS PLAN, SPECIFICATION, OR REPORT WAS PREPARED BY ME OR UNDER MY DIRECT SUPERVISION AND THAT I AM A QUALY REGISTERED ARCHITECT UNDER THE LAWS OF THE STATE OF NORTH DAKOTA.
DATE: 01/31/2024 REGISTRATION NO.: 2899
SIGNED: [Signature]



Elevations, Material Legend, Roof Plan, Notes


© Copyright 2024 WILCRG, L.L.C.

Date: 01/31/2024 Sheet
Project Number: 2344
Drawn By: APJ
Checked By: AEK
Approved By: AEK

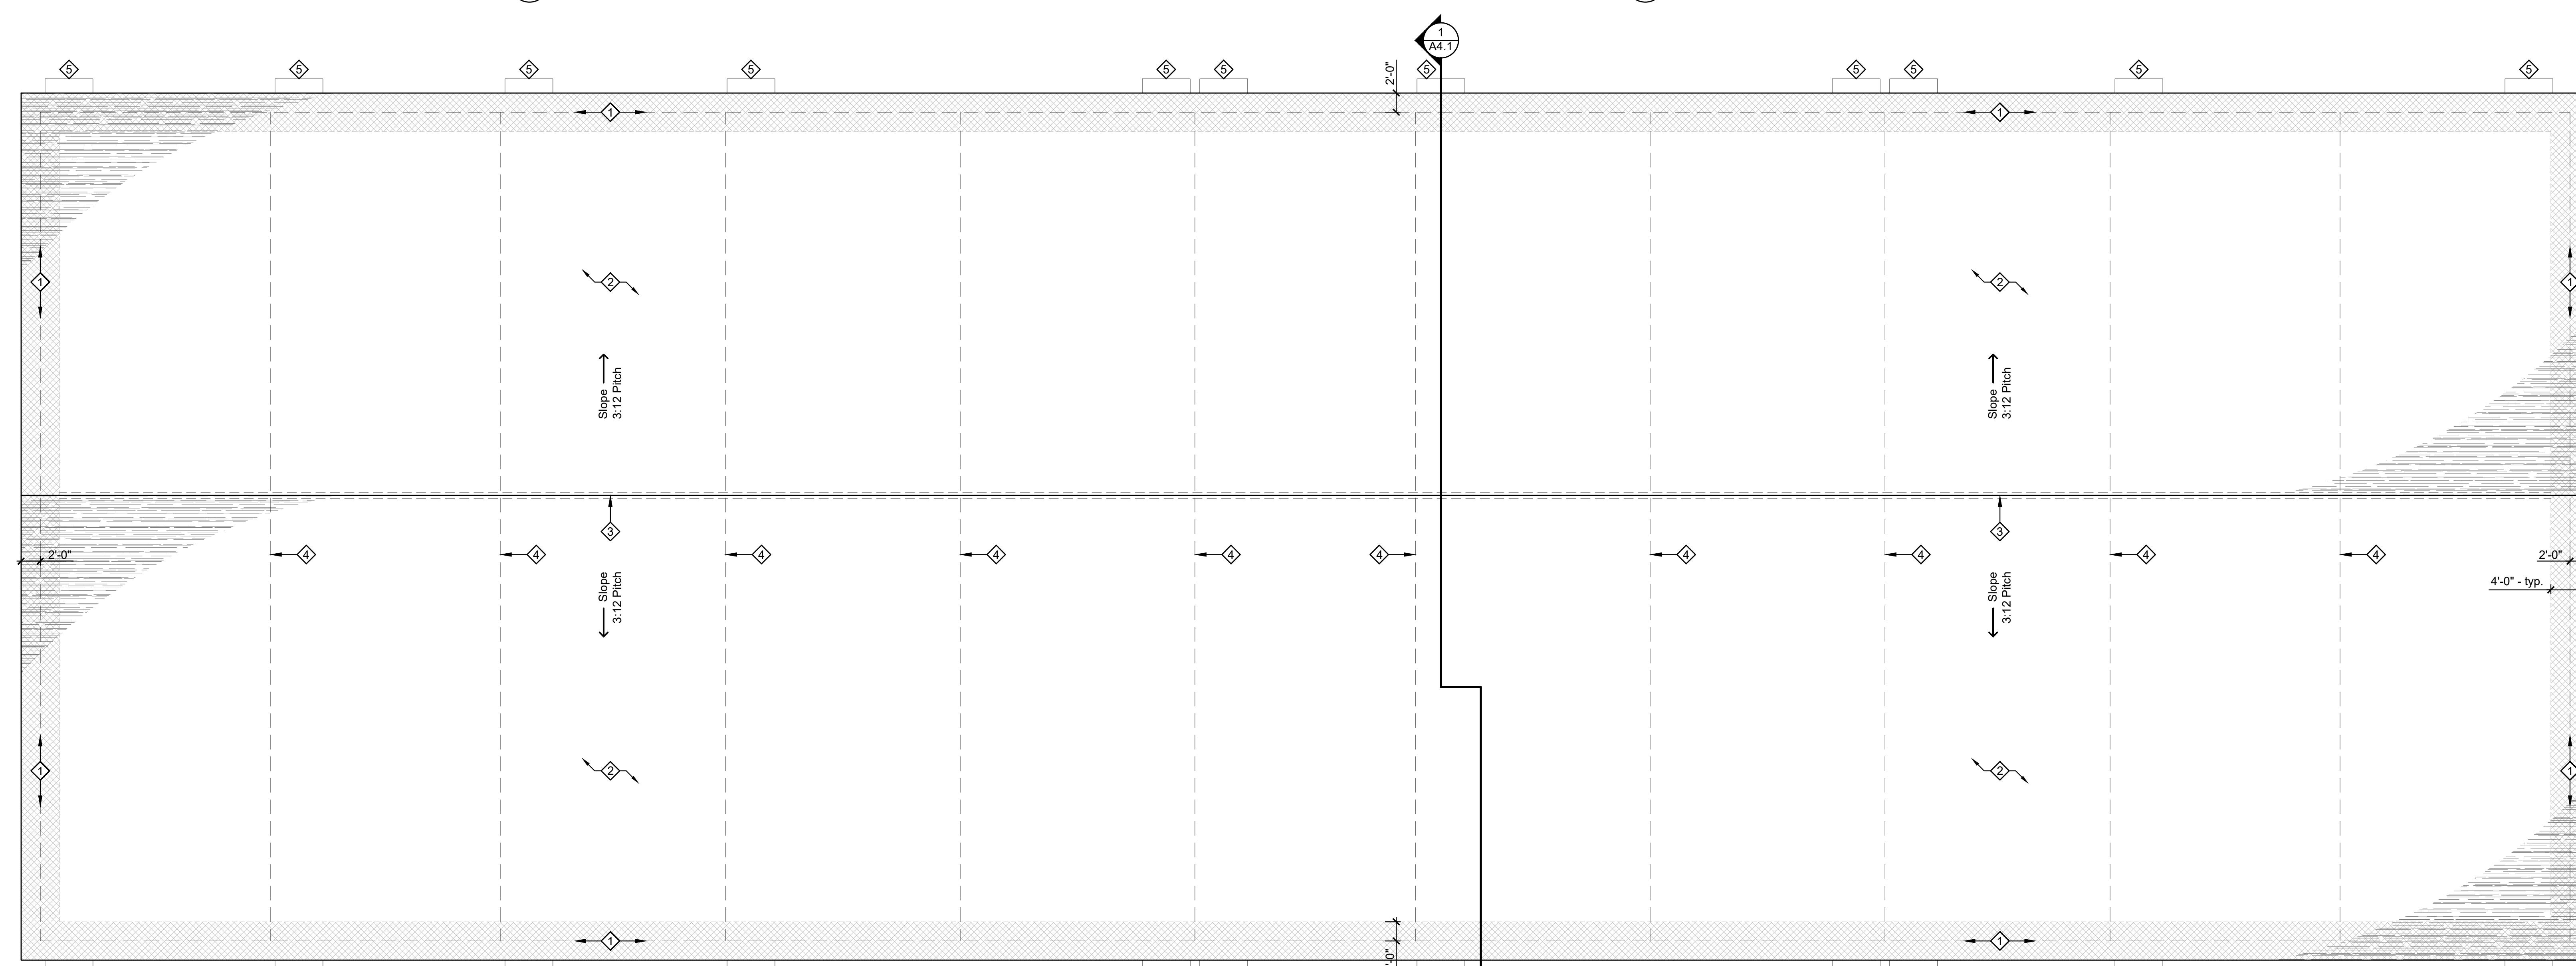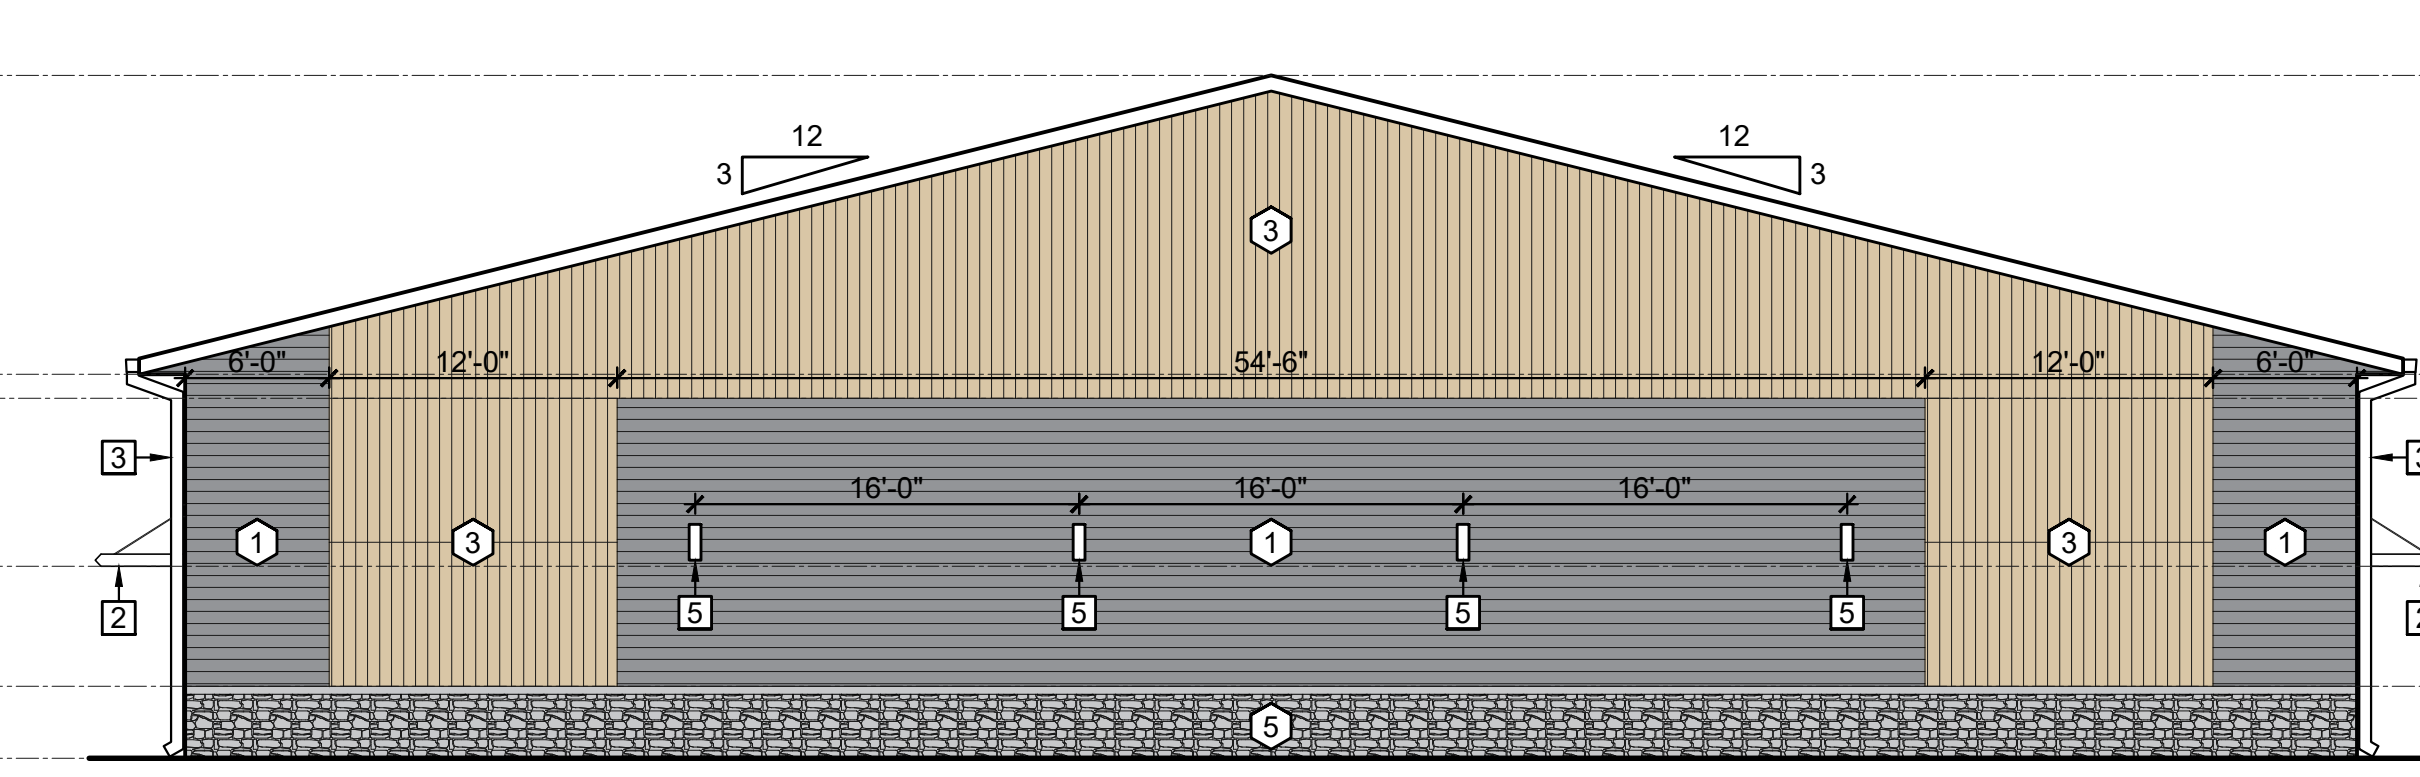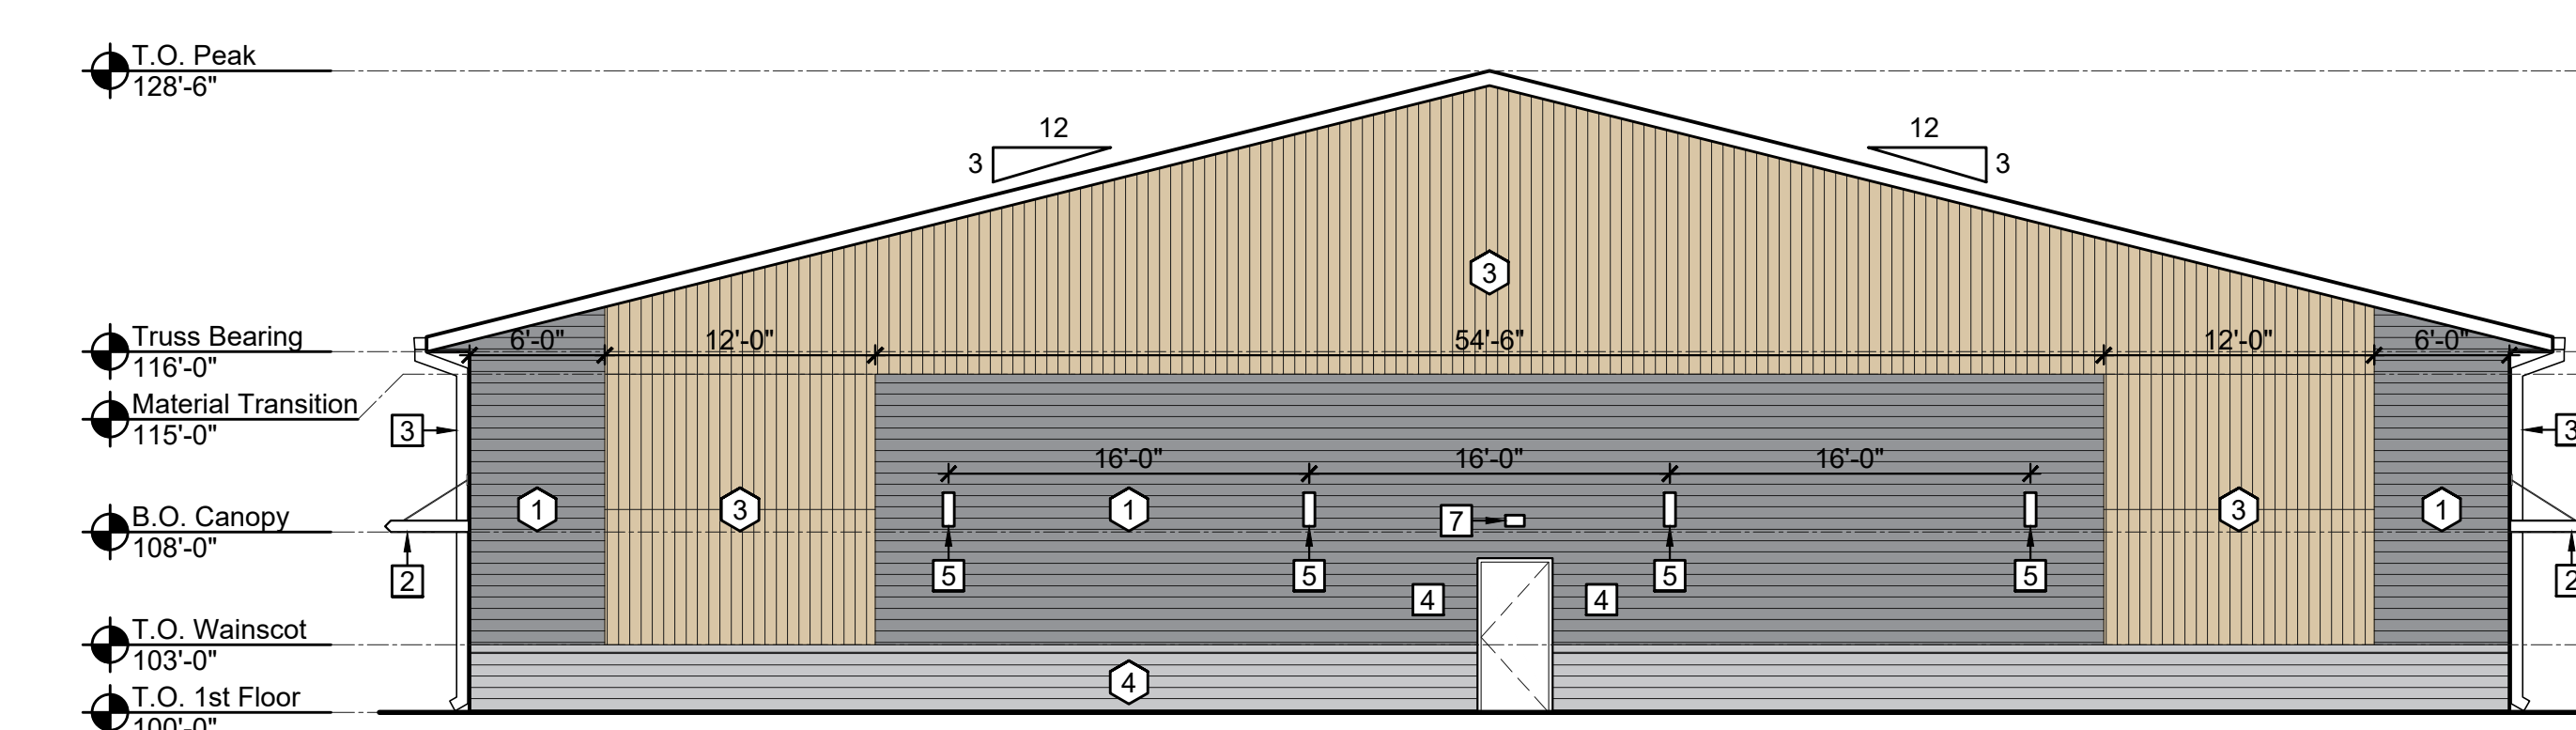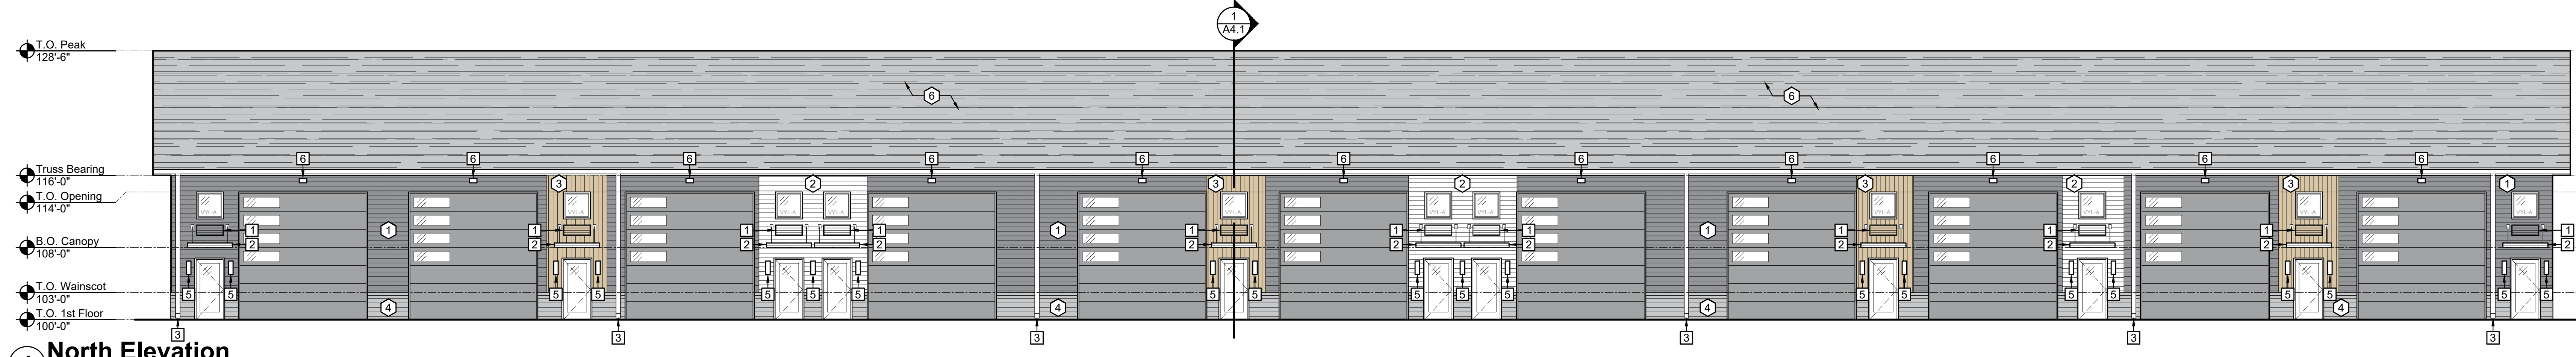


5 Roof Plan
1/8" = 1'-0"


A4.0

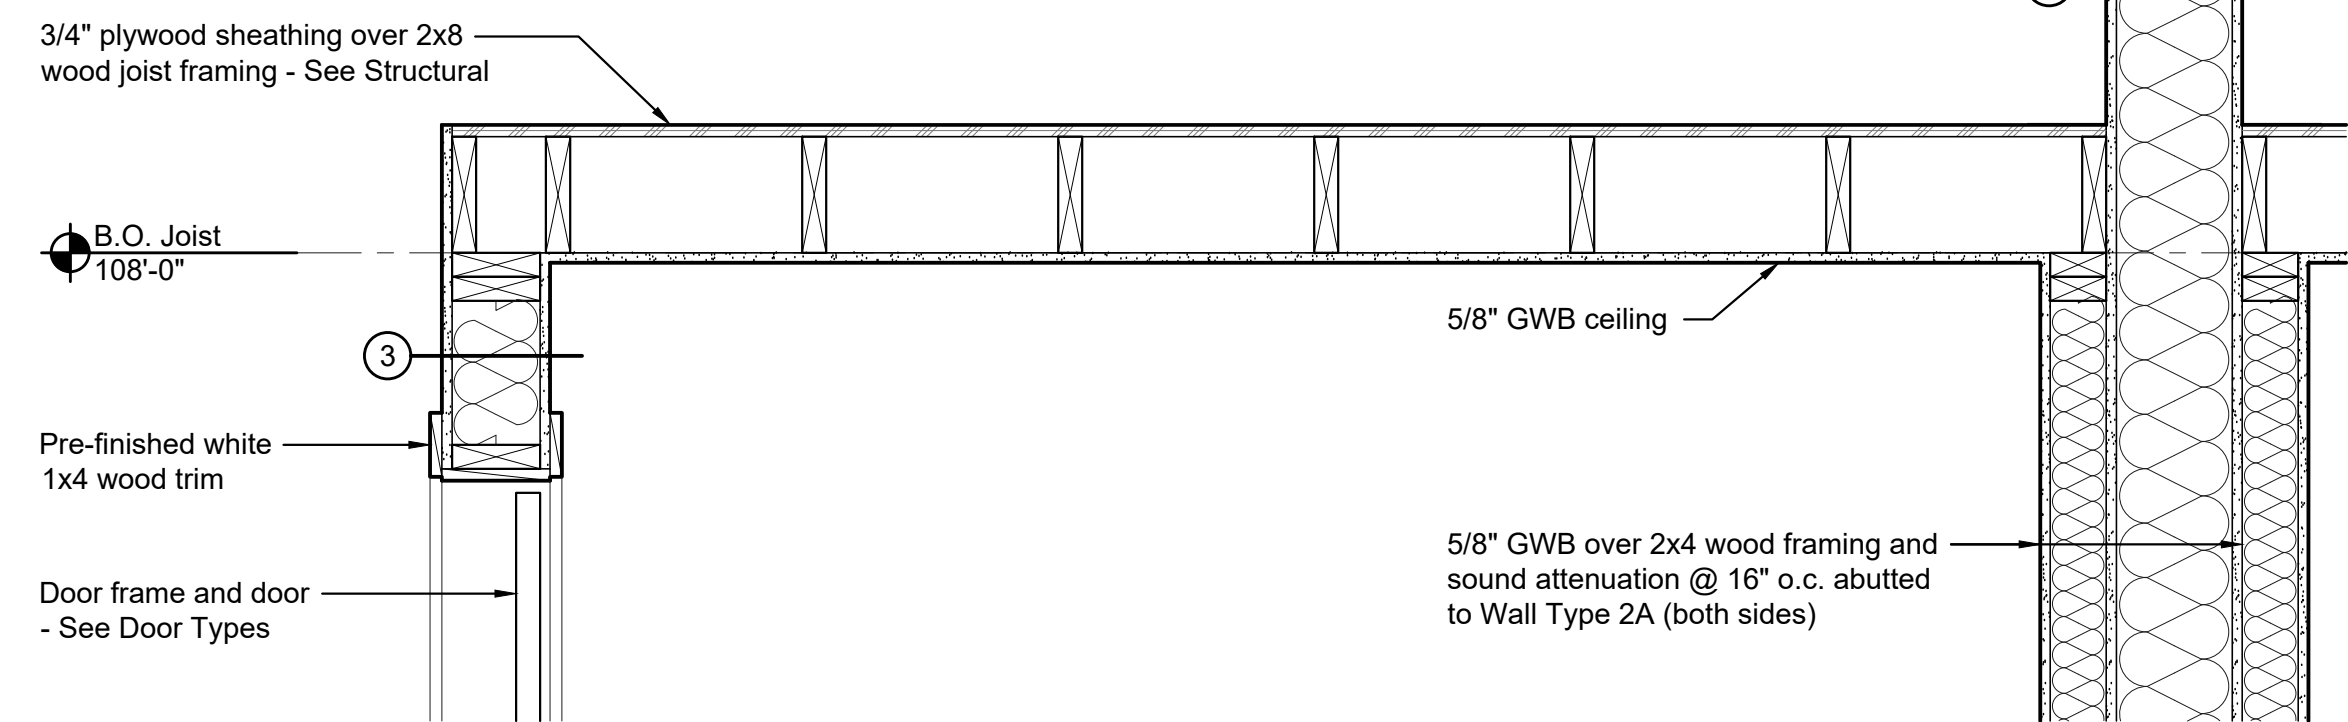


9 Section Detail
1" = 1'-0"

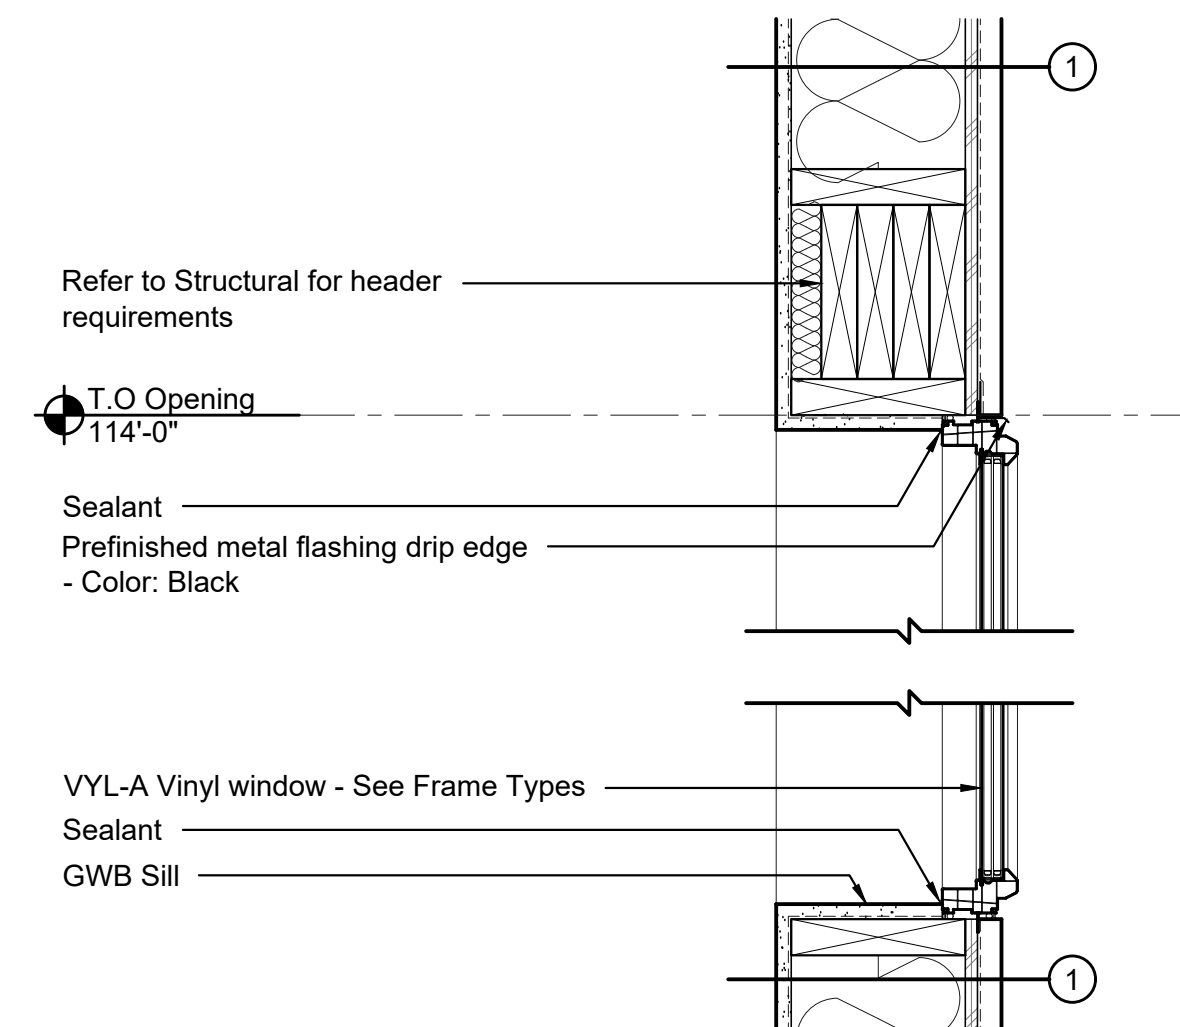


6 Head and Sill Detail
1 1/2" = 1'-0"

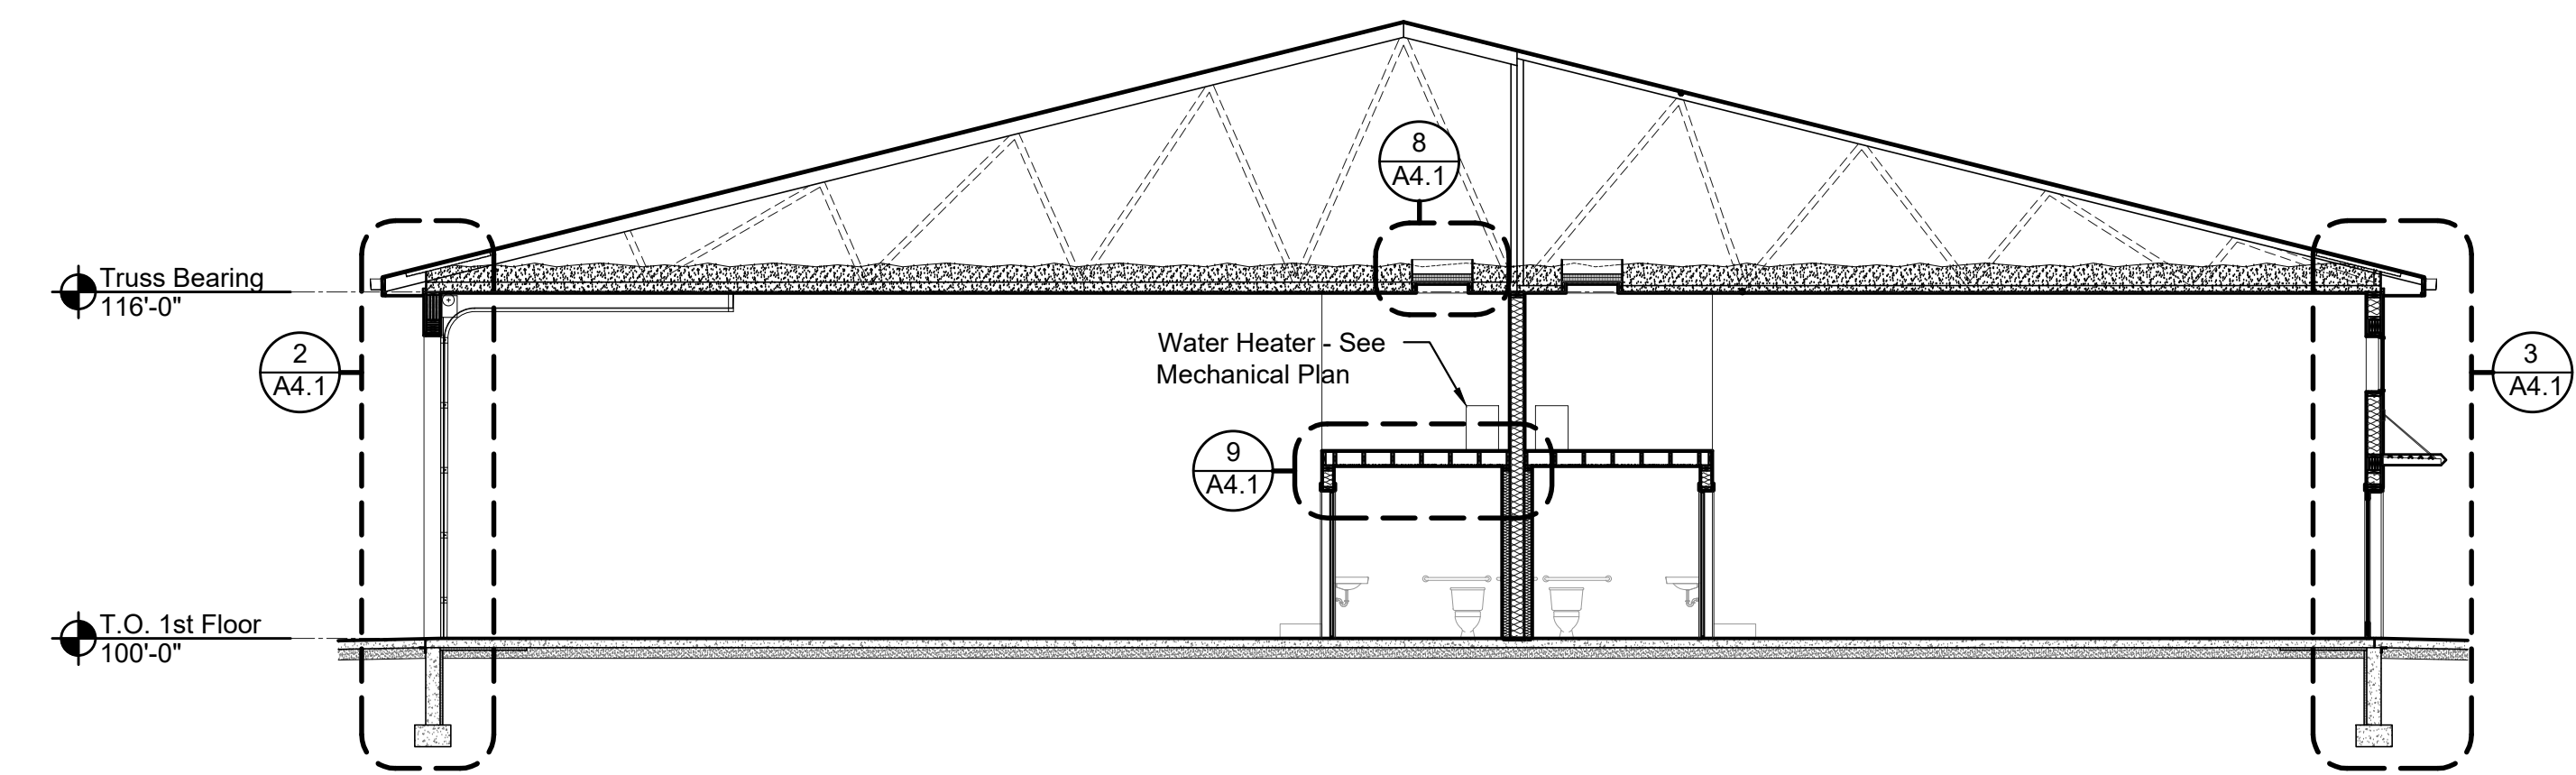


1 Building Section
1/8" = 1'-0"

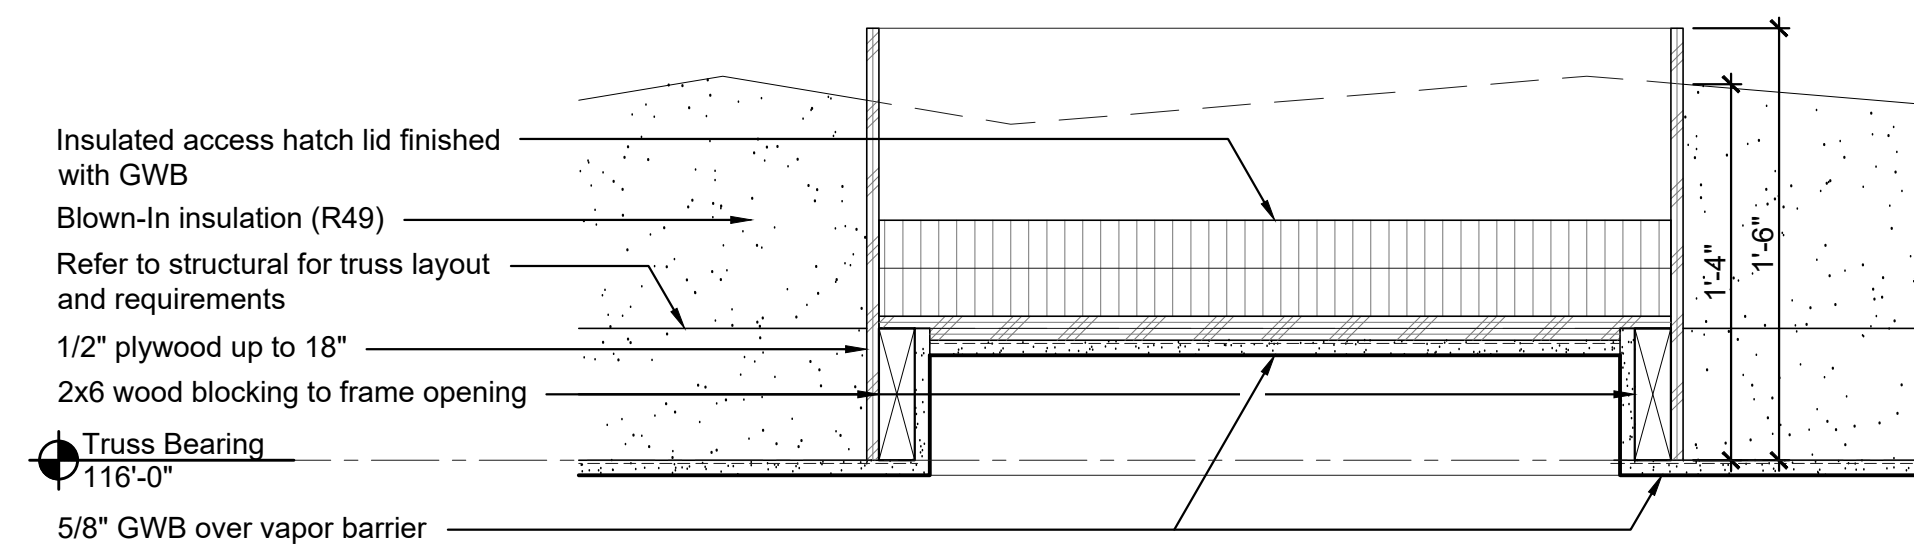

8 Typical Section Detail
1 1/2" = 1'-0"

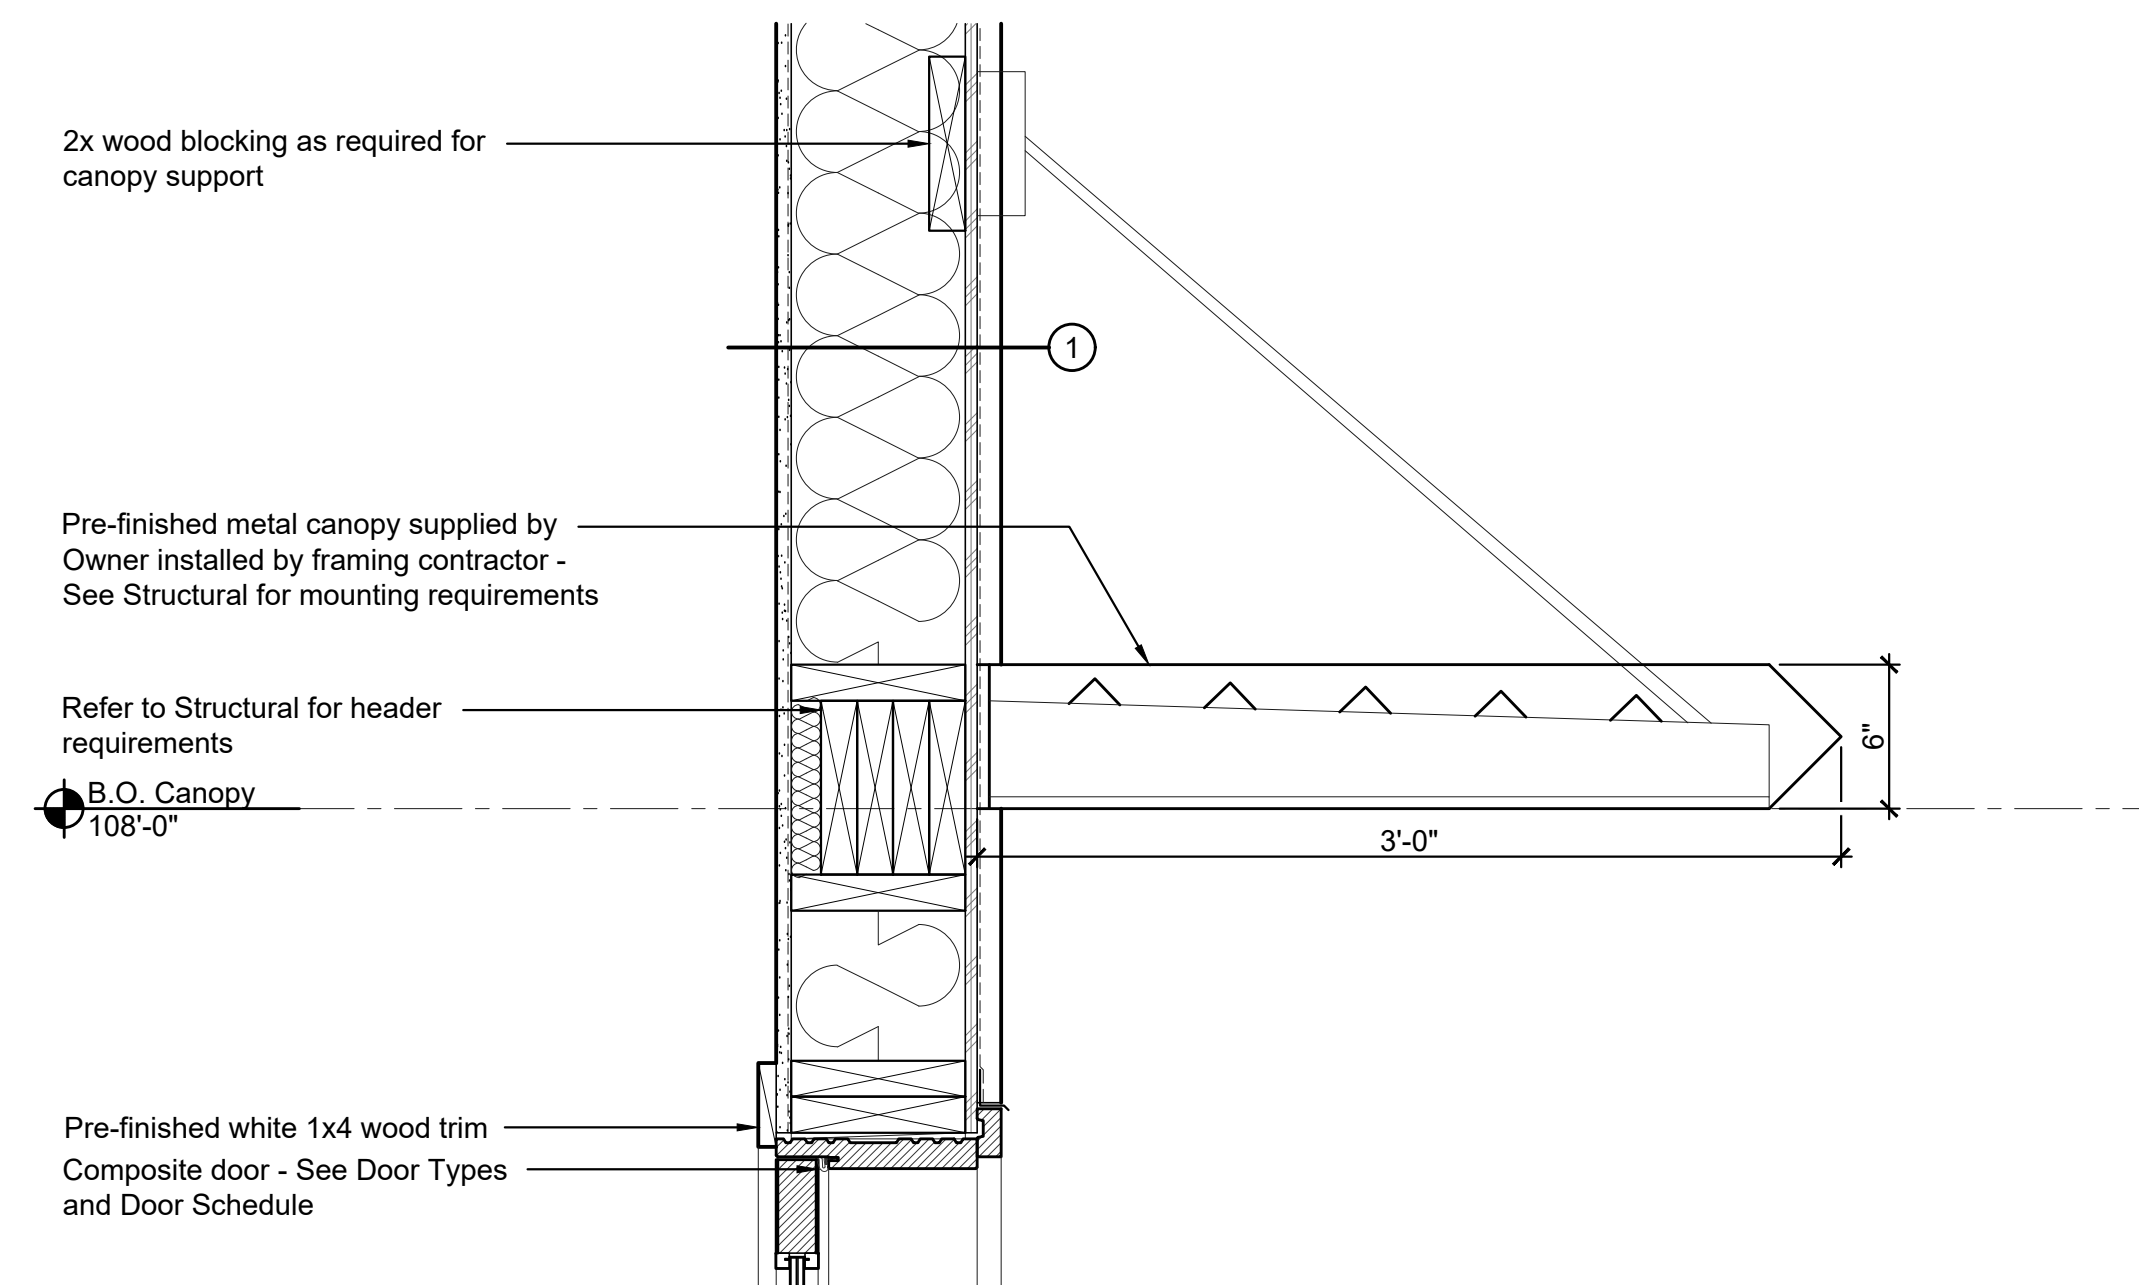


5 Section Detail
1 1/2" = 1'-0"

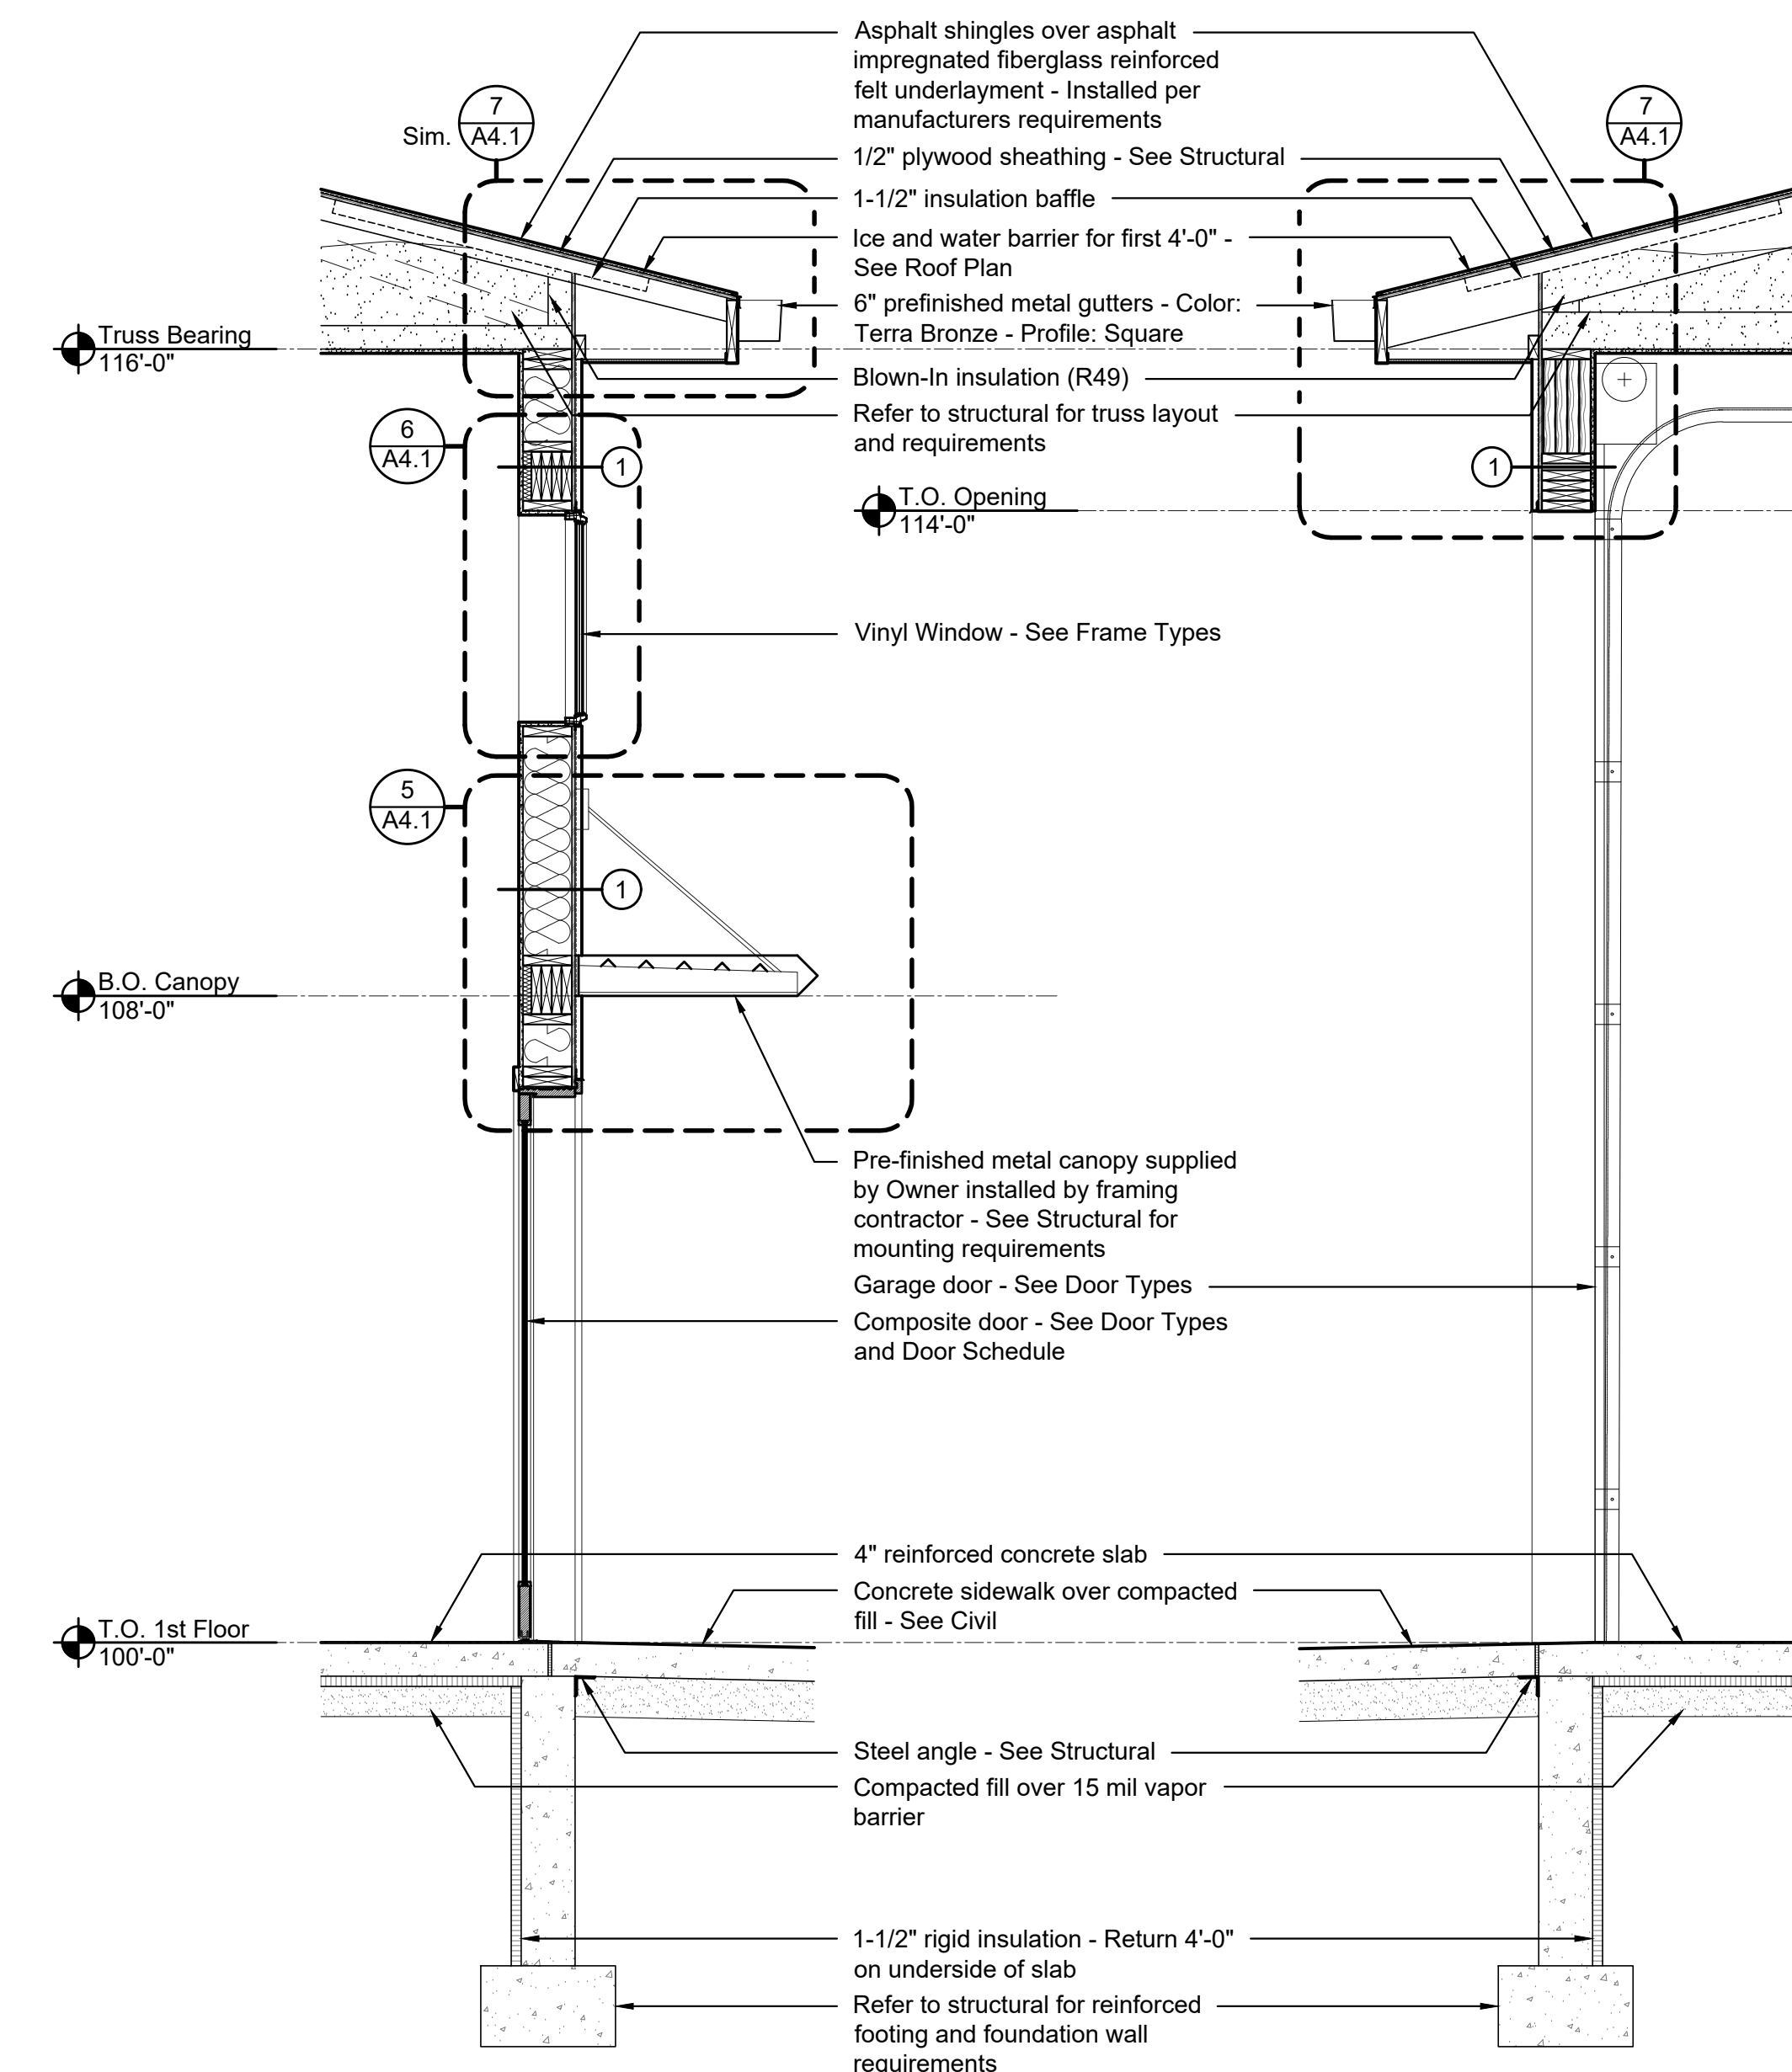


3 Wall Section
3/2" = 1'-0"

2 Wall Section
1/2" = 1'-0"

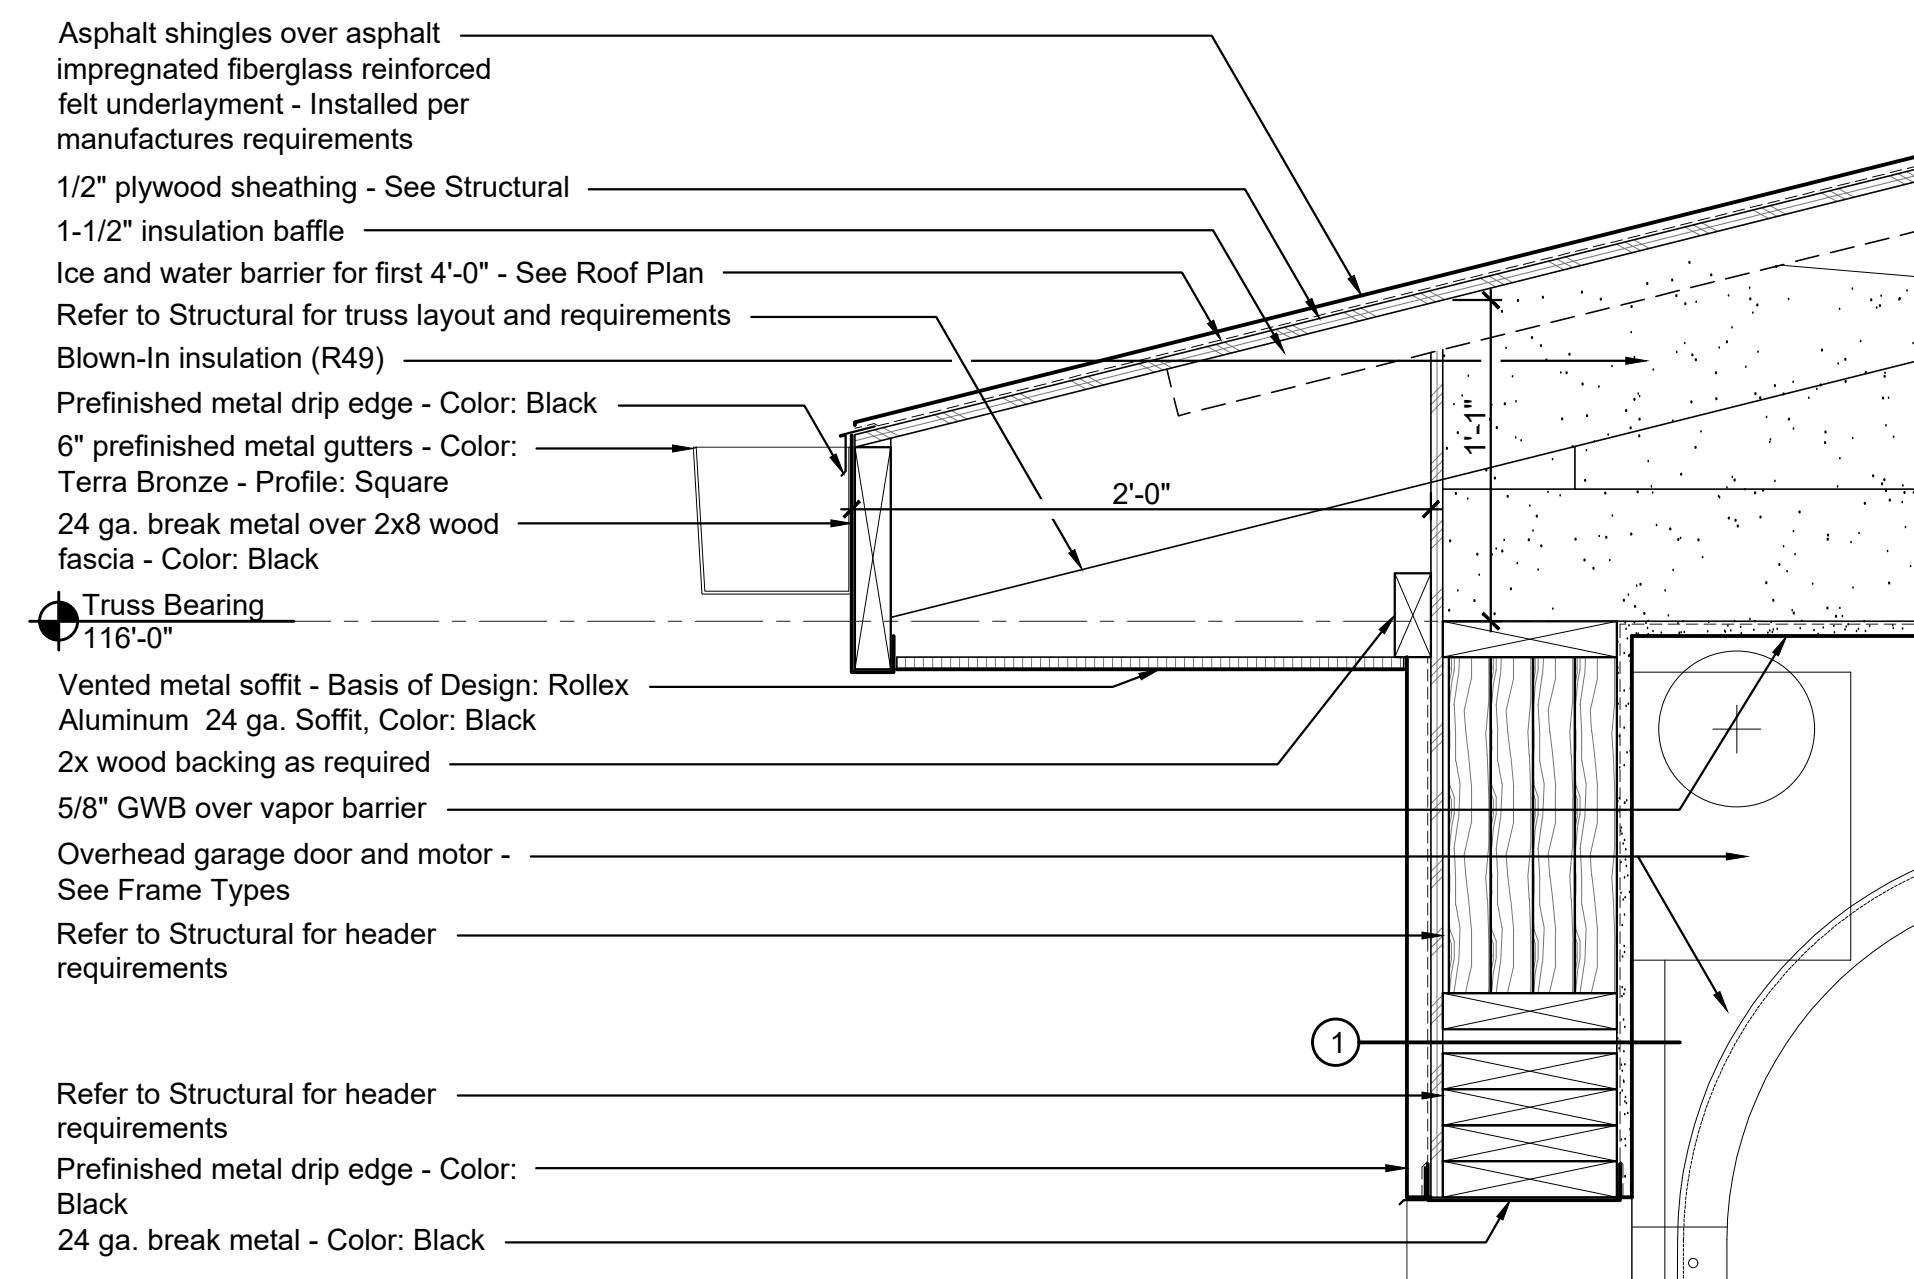

7 Section Detail
1 1/2" = 1'-0"

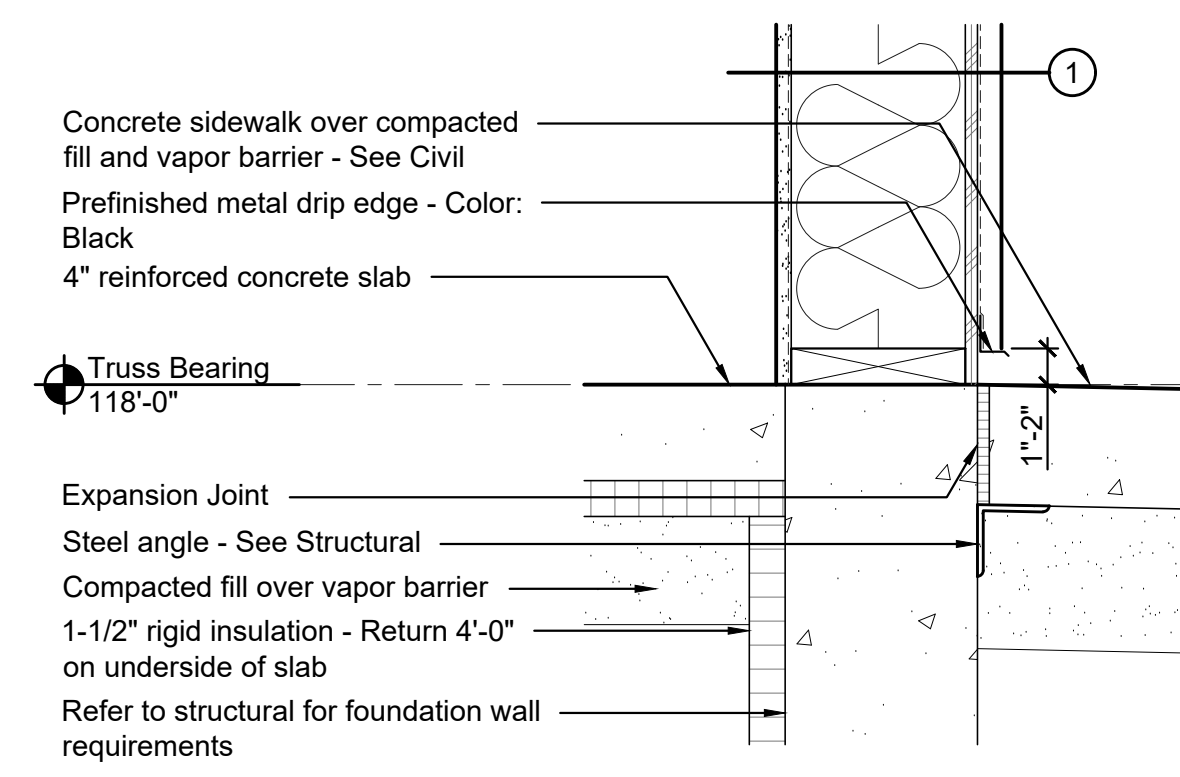

4 Typical Base Detail
1 1/2" = 1'-0"


ANDREW E. ASHLEY
REGISTERED ARCHITECT
STATE OF NORTH DAKOTA
DATE: 01/31/2024 REGISTRATION NO.: 2829
SIGNED: _____

wild | crg
architecture | construction
500 2nd Avenue North, Suite 514
Fargo, North Dakota 58102
Phone 701 | 293 | 8106
wildcrg.com

Building Section, Wall Sections, Section Details

© Copyright 2024 WILDCRG, LLC

Date: 01/31/2024 Project Number: 2344 Drawn By: APJ Checked By: AEK Approved By: AEK SHEET **A4.1**

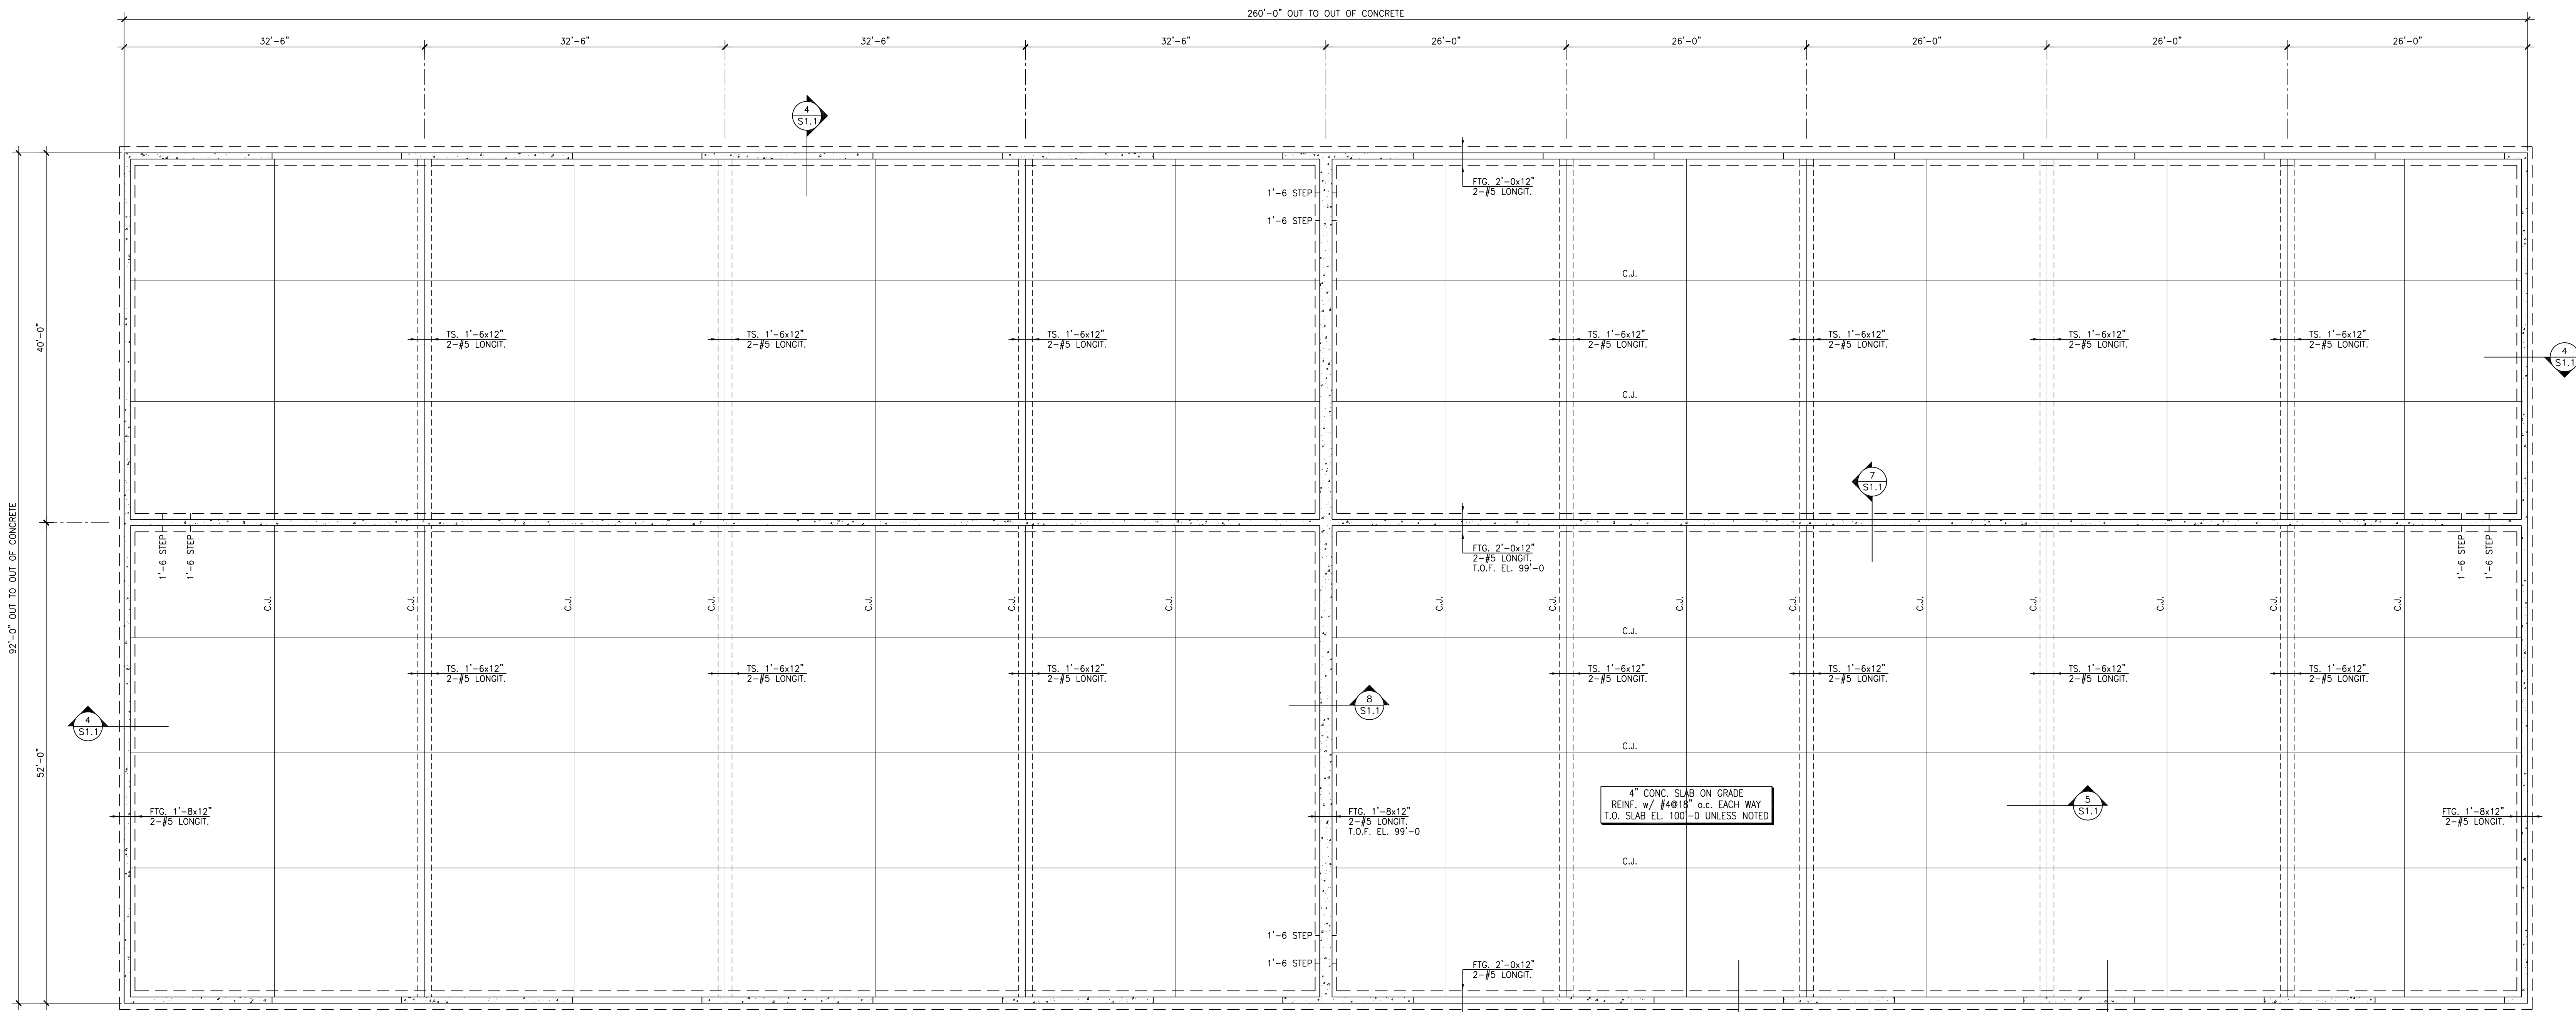

LOWER TOP OF WALL
AT ALL DOORS - TYP.
COORDINATE W/ ARCH.


FOUNDATION PLAN

NOTE: 1). TOP OF FOOTING EL. = 96'-0\"/>


SCALE: 1/8\"/>

GENERAL STRUCTURAL NOTES


- Design Codes Used:
IBC 2021
ACI Concrete Code
AISC Code=ASD
- Design Loads:
Roof Snow Load:
 $P_s = 27 \text{ PSF} + \text{Drift (Balanced)}$
Unbalanced snow load as per ASCE 7-16 Section 7
 $C_p = 1.0$
 $C_s = 1.0$
 $C_t = 1.1$
Wind Load:
 $V_{10} = 115 \text{ MPH}$ Basic Wind Speed
Risk Category = II
Wind Exposure C
Internal Pressure Coefficient ± 0.18
- Design Stresses Used:
Concrete:
- Slabs on Grade 4500 PSI @ 28 days
- Footings and Foundation Walls 3000 PSI @ 28 days
- Exterior exposed 4000 PSI @ 28 days (air entrained)
- Structural Slabs 4000 PSI @ 28 days
- Masonry Strength $f_m = 1500 \text{ PSI}$
Steel:
- W Shapes $F_y = 50 \text{ KSI}$ (ASTM A992)
- Tubes $F_y = 46 \text{ KSI}$ (ASTM A500 Grade B)
- Angles, Channels, Bars $F_y = 36 \text{ KSI}$ (ASTM A36)
- Pipes $F_y = 35 \text{ KSI}$ (ASTM A53)
Reinforcing Steel
Soil Bearing Pressure 1500 PSF (Assumed, Verify w/ Geotechnical Engineer's review of Excavation)
- CONCRETE COVERAGE for reinforcing shall be as follows:
Footings 3 inches
Columns and Piers 1 1/2 inches
Slabs on Grade midheight for a single layer
Walls 1 1/2 inches @ exterior
3/4 inch @ interior
Structural Slabs 3/4 inch unless noted
PROVIDE BAR SUPPORTS AND SPACERS in accordance with the ACI Detailing Manual.
- REINFORCING STEEL to be bent and placed in accordance with ACI code. All splices to be 38 db for #6 bar or smaller, 48db for #7 bar and larger.
- FOOTINGS to rest on undisturbed soil or engineered backfill. It is recommended that the Soils Engineer inspect soil conditions prior to construction. All walls and piers to center on footing unless otherwise noted. All footing elevations are given to the top of footings.
- ALL FOUNDATION WALLS to be laterally supported before backfilling. Vertical construction joints to be keyed.
- OPENINGS in concrete FOUNDATION WALLS shall be reinforced with 2-#5 bars each side, extending 2'-0" past the face of the opening unless otherwise noted.
- FOUNDATIONS SHALL BE BUILT from approved, fully dimensioned shop drawings coordinated with construction documents and field conditions. Foundation shop drawings shall consist of the anchor bolt setting plan, concrete mix design, and concrete reinforcement plan with wall & pier dimensions. All subsequent shop drawings shall be coordinated with approved foundation shop drawings.
- SHOP DRAWINGS
a. Submit electronic copies of the following shop drawings to the architect/engineer for review prior to fabrication.
1. CONCRETE REINFORCING and mix designs for each class of concrete.
b. The contractor shall review and accept full responsibility for dimensional correctness. All shop drawings must bear the approval stamp of the contractor (to include initials, date and disposition), prior to review by the Architect or Engineer. The Engineer will return all shop drawings, unreviewed, that do not bear the approval stamp of the contractor.
- PORTLAND CEMENT to be ASTM C150, Type 1 & 1A.
- CONCRETE to be in accordance with ACI 301. Maximum shale content shall not exceed 0.5% for exposed concrete.
- CONTROL AND CONSTRUCTION JOINTS to be located as shown on the plan or at contractor's option - not to exceed 12'-0" o.c. verify with future slab.
- ROOF TRUSSES to be engineered by the fabricator under the supervision of a professional engineer. Shop drawings to be stamped by the professional engineer. All trusses to have roof sheathing, including areas with scabbed in wood framing above.
- ROOF TRUSSES shall be secured to wall plates with H2.5T Anchors by Simpson or equal at every truss.
- General Contractor shall provide all lateral roof bracing as required by truss plate institute manual "H8-31" or as required by the truss design.
- CARPENTRY
Wood Studs MSR 1650J-1.5E
Beams Hem Fir, SPF #2, or better
LVL's (Laminated Veneer Lumber) $F_b = 2600 \text{ psi}$
Glu-Laminated Beams & Columns $F_b = 2400 \text{ psi}$ (24F-V8 or better)
- Refer to IBC table or MN Building Code for typical nailing not shown. Table 2304.10.2.
- Contractor Field Verify all new lintels in existing walls have the correct plate width.
- SEE MECHANICAL, ELECTRICAL & ARCHITECTURAL DRAWINGS for all openings and inserts not shown on the plan. All opening sizes and locations to be verified with mechanical and electrical contractors.
- CONTRACTOR VERIFY all dimensions with Architectural Plan.

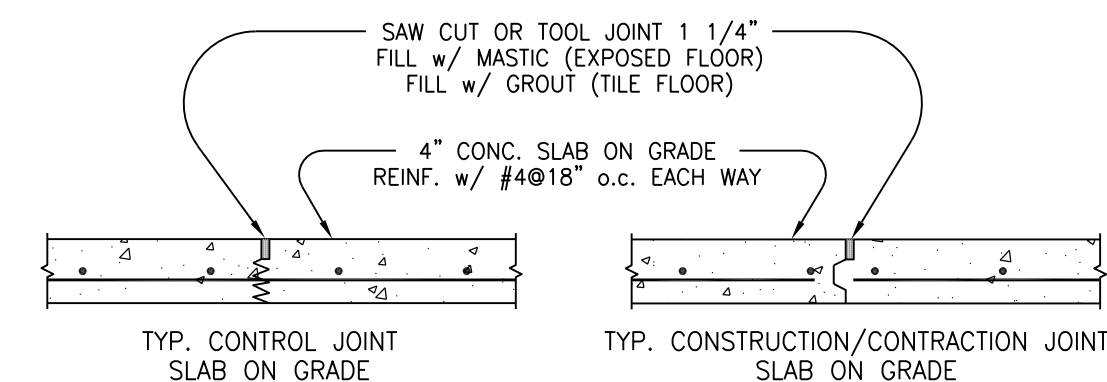


SECTION 1
TYP. CONTROL JOINT SLAB ON GRADE
SCALE: 1/2\"/>

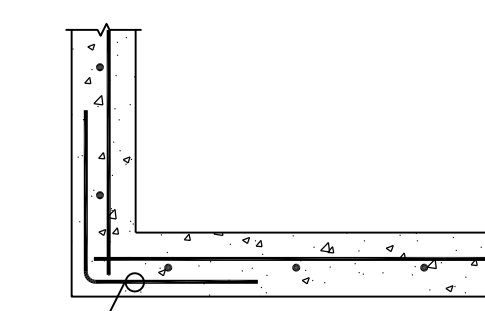


DETAIL 2
TYP. CORNER WALL REINF.
SCALE: 1/2\"/>

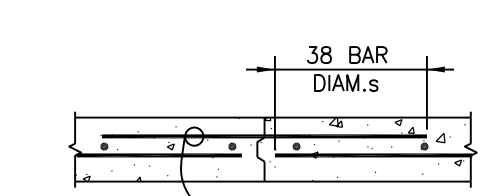


DETAIL 3
TYP. CONSTRUCTION JOINT AT FOUNDATION WALL
SCALE: 1/2\"/>

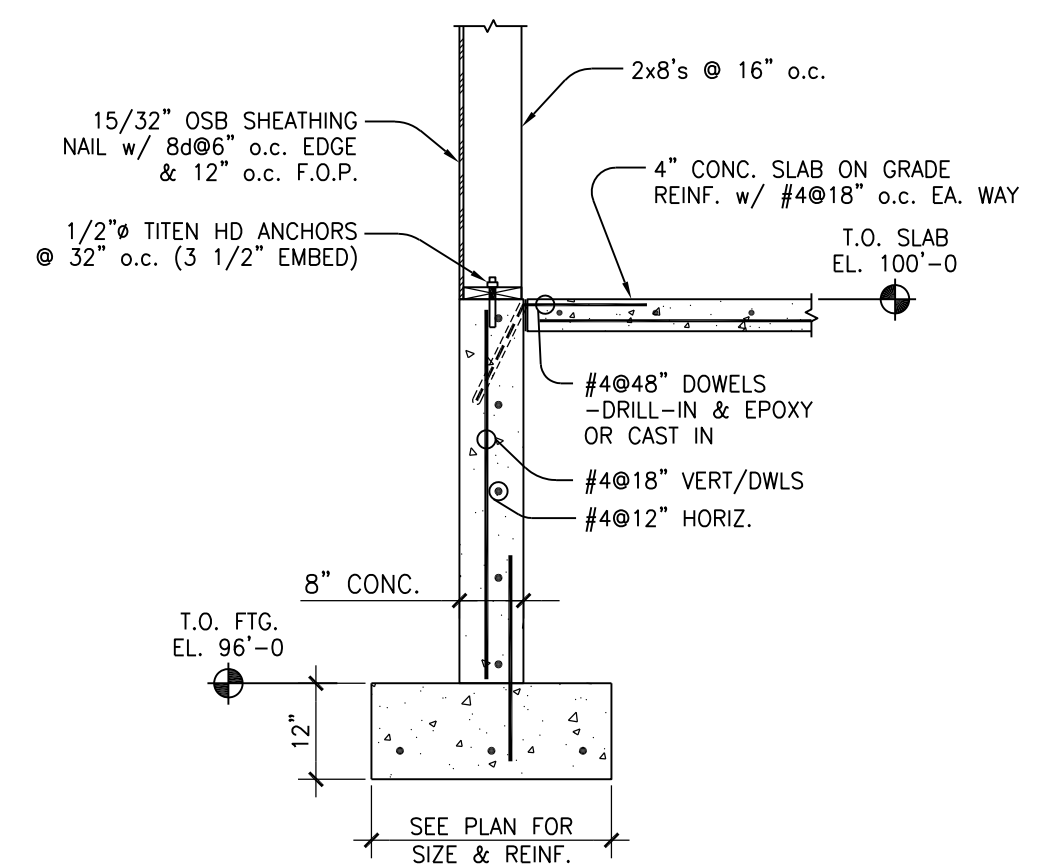


SECTION 4
SCALE: 1/2\"/>

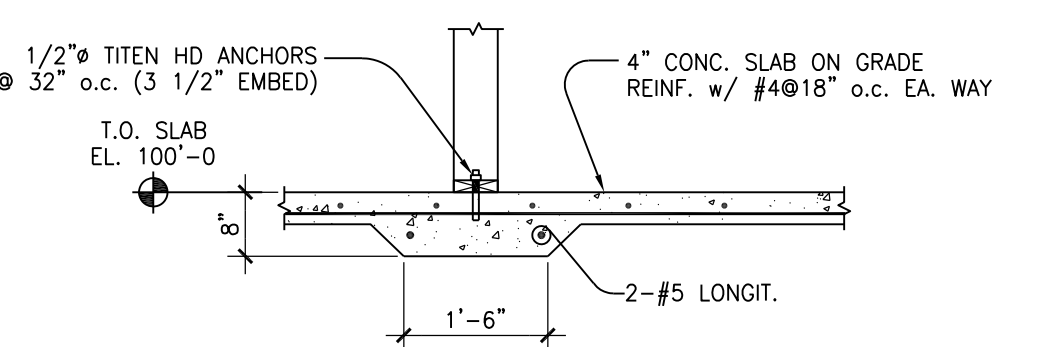


SECTION 5
TYPICAL THICKENED SLAB
SCALE: 1/2\"/>

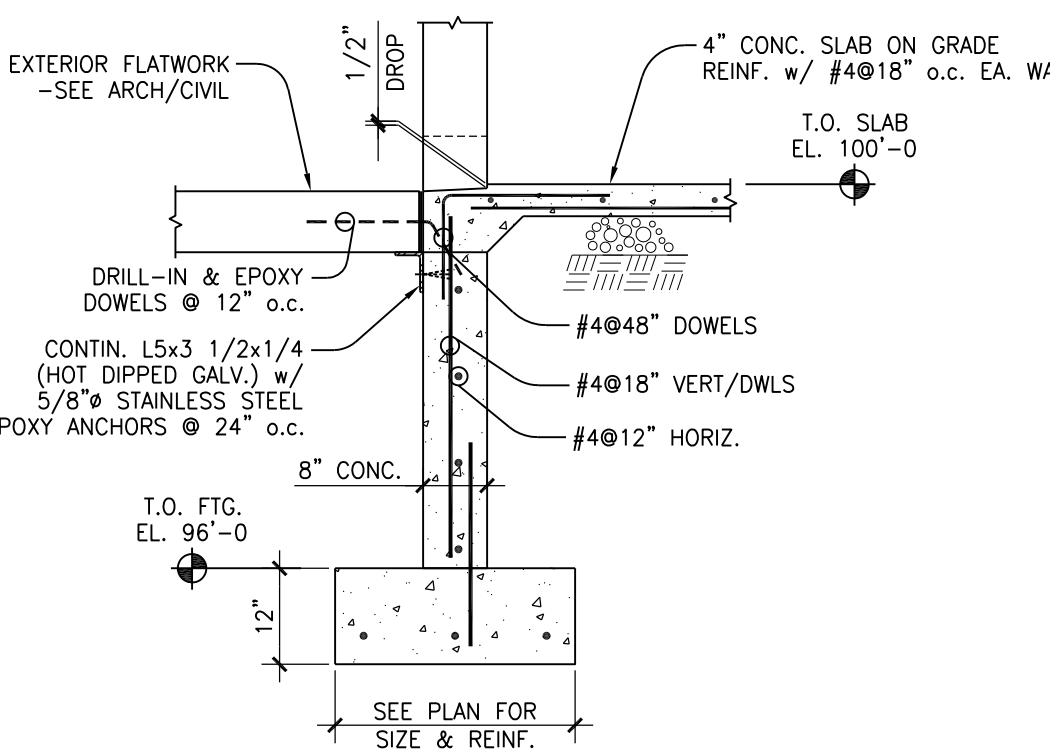


SECTION 6
SCALE: 1/2\"/>

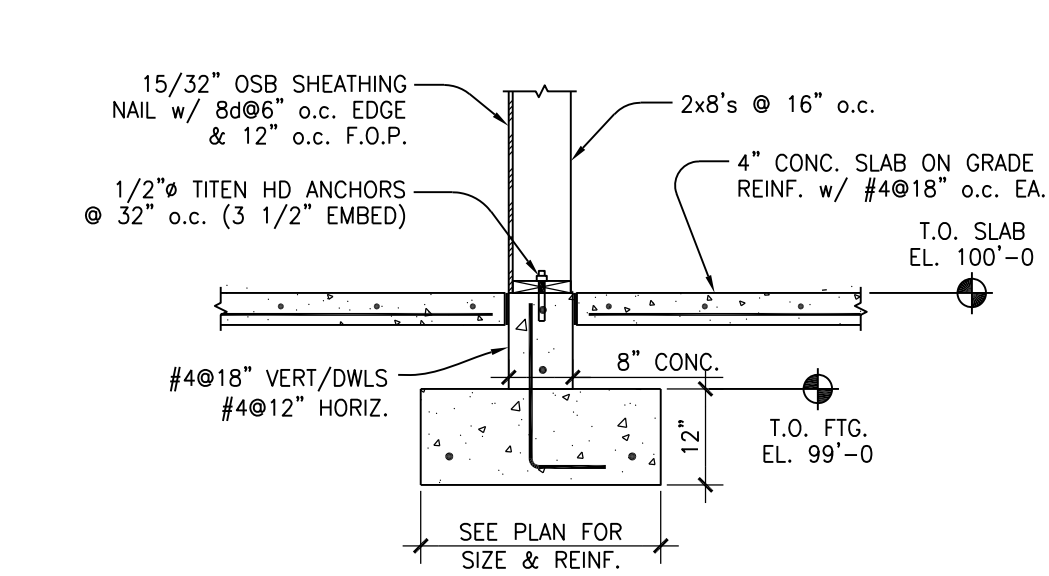


SECTION 7
SCALE: 1/2\"/>

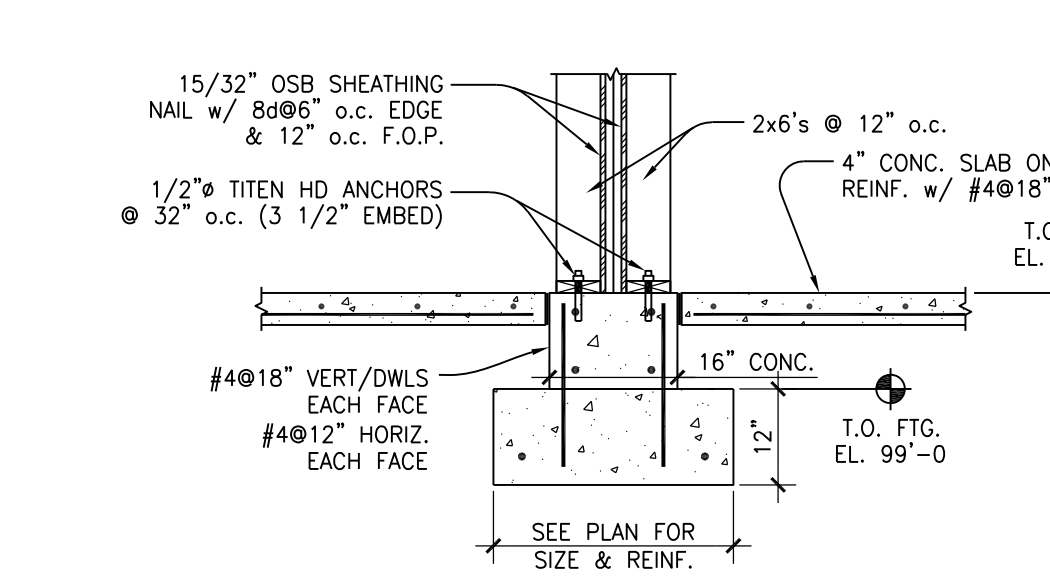

SECTION 8
SCALE: 1/2\"/>

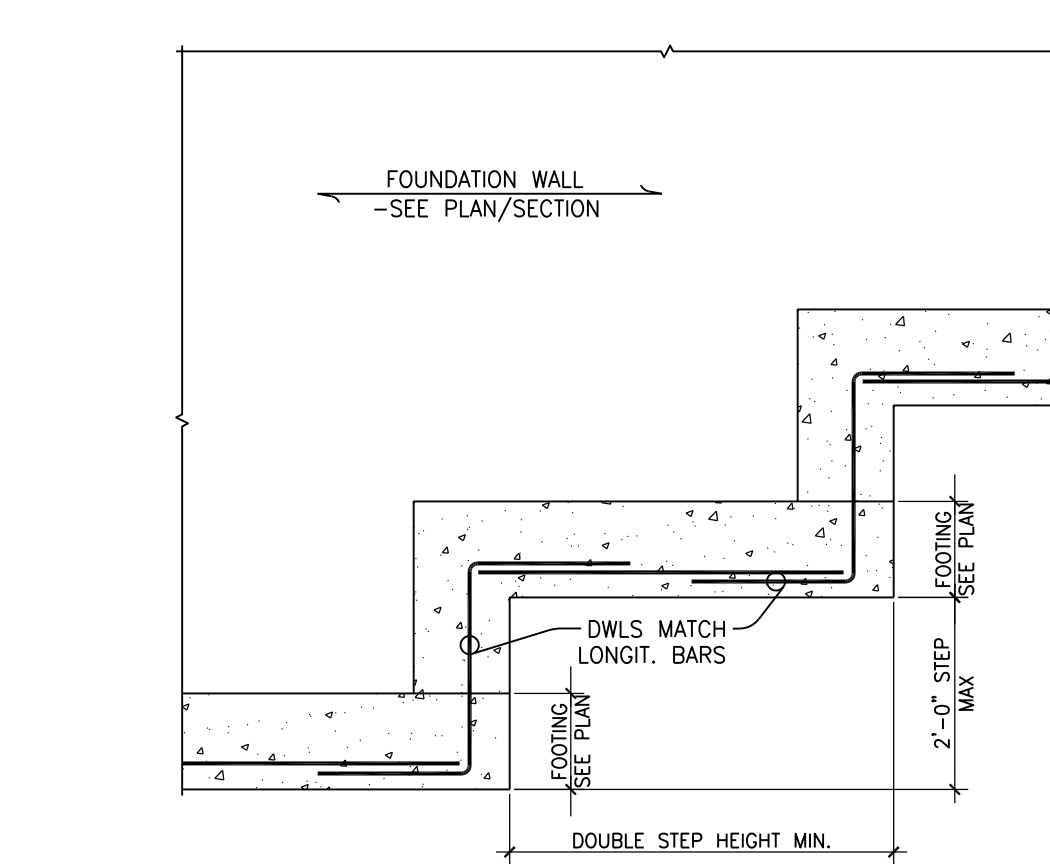


SECTION 10
TYPICAL FOOTING STEP
SCALE: 1/2\"/>

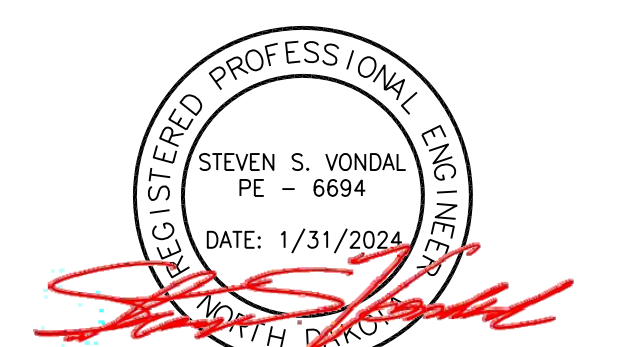

SOLIER & LARSON ENGINEERING
CONSULTING STRUCTURAL ENGINEERS
3330 FIECHTNER DRIVE, SUITE 208
FARGO, NORTH DAKOTA 58103
TELEPHONE (701) 233-5293 FAX (701) 233-5294


wild|crg
architecture | construction
500 2nd Avenue North | Suite 514
Fargo, North Dakota 58102
Phone 701 | 293 | 8106
wildcrg.com

Foundation Plan
General Structural Notes
Sections & Details

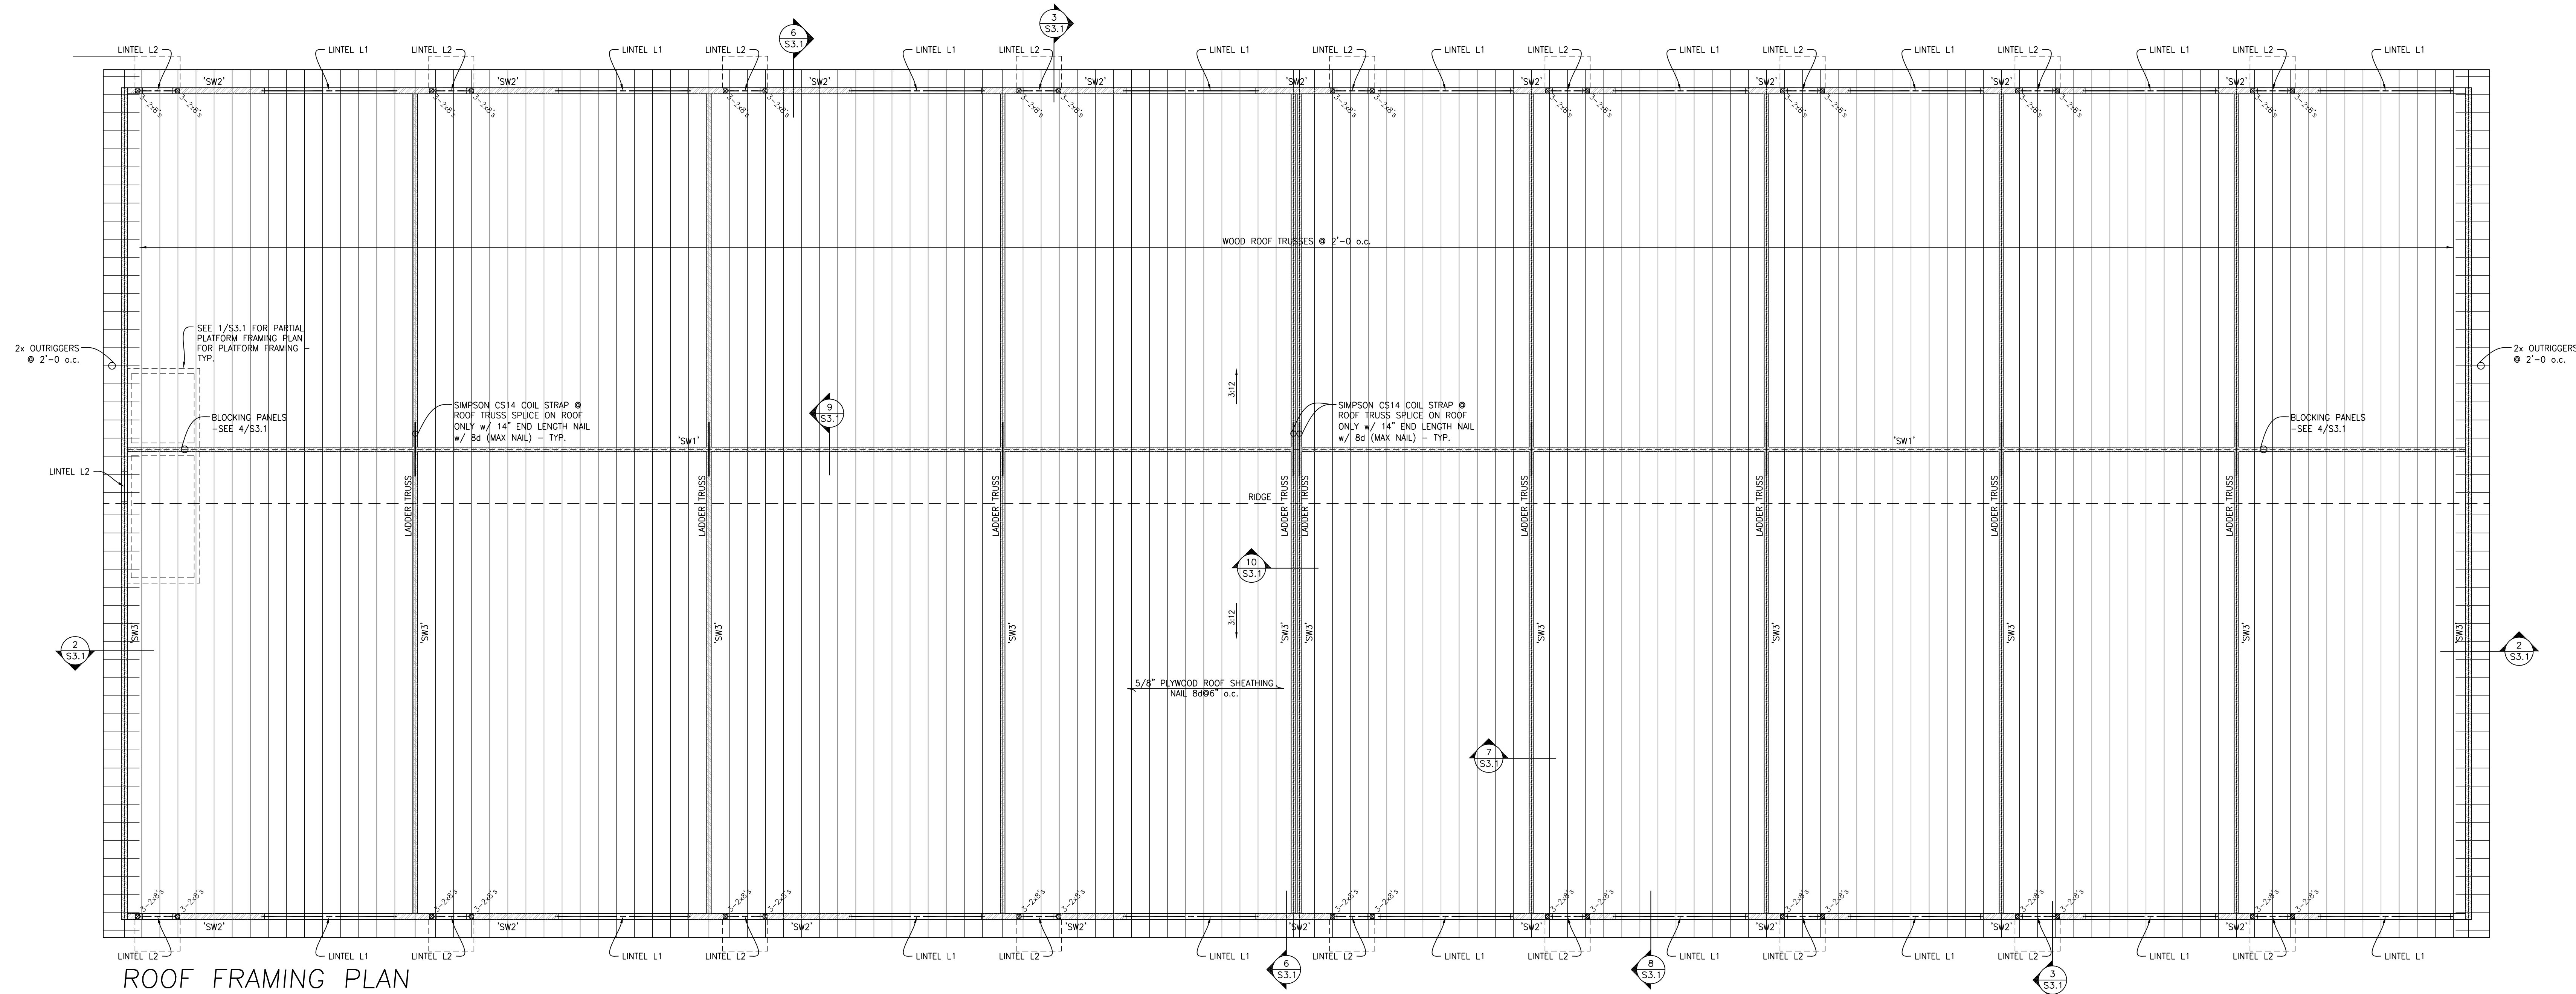

ROOF FRAMING PLAN


SCALE: 1/8"=1'-0"

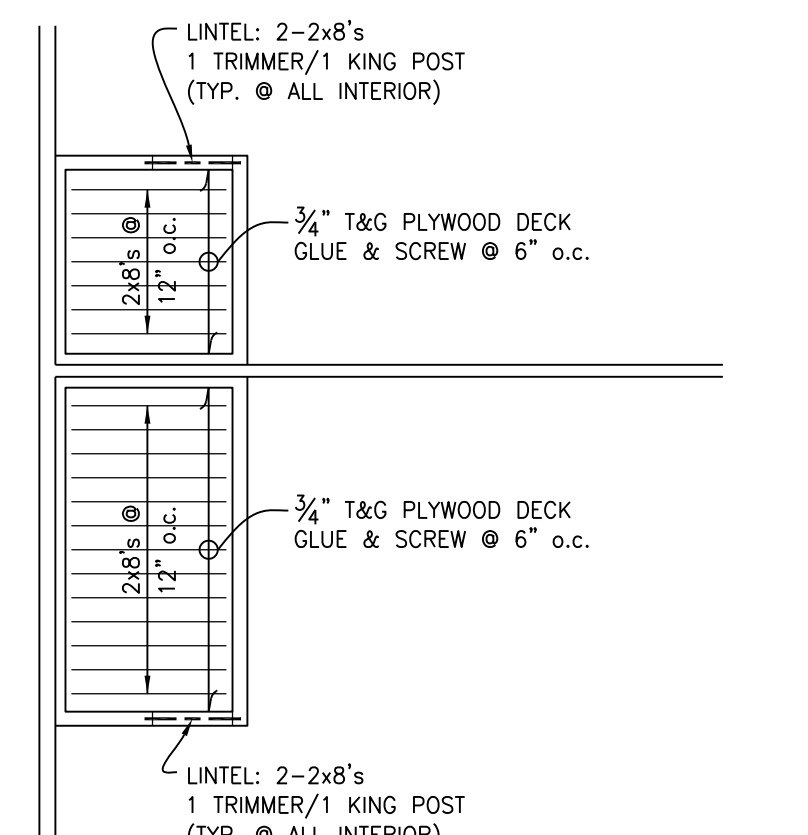

PARTIAL PLATFORM FRAMING PLAN - TYP.


SCALE: 1/8"=1'-0"

NOTE: 1). JOIST BRNG'G EL. = 108'-0" U.N.O.

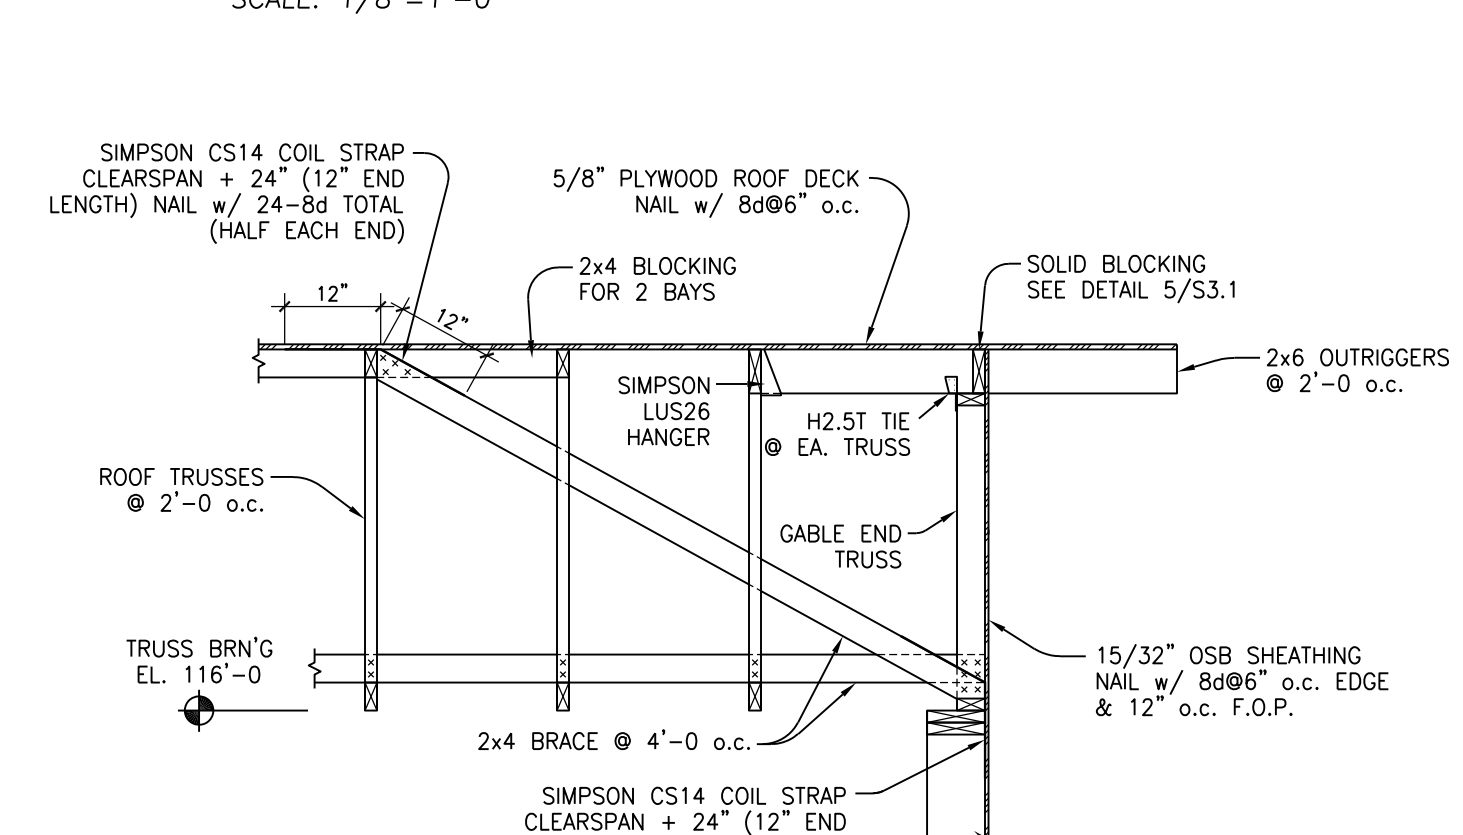


SECTION

SCALE: 1/2" = 1'-0"

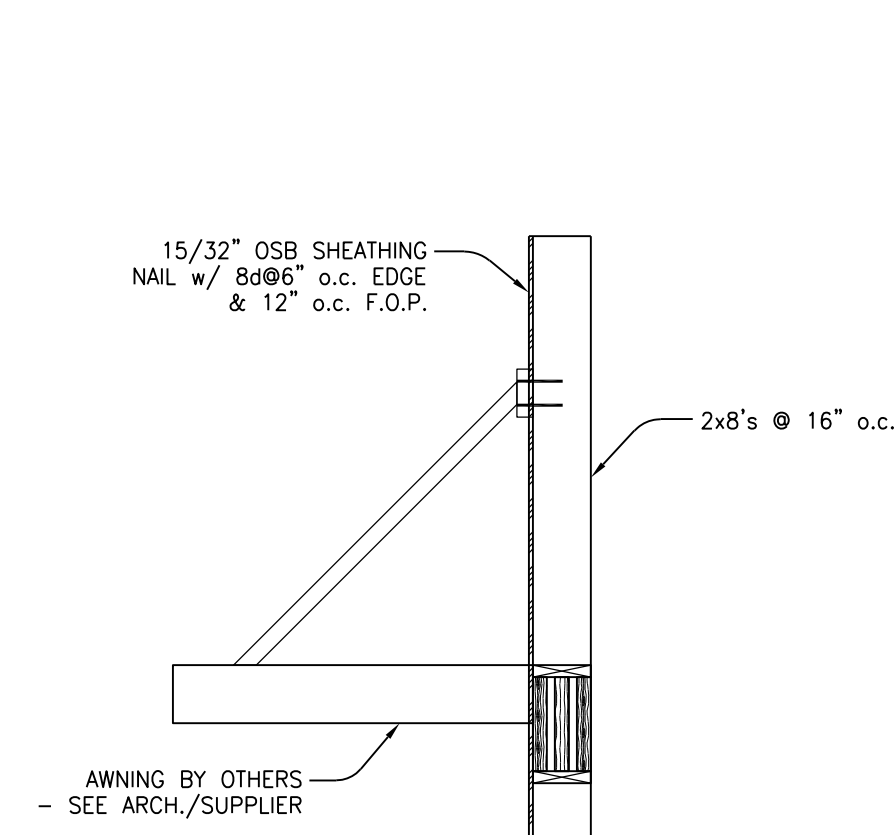


SECTION

SCALE: 1/2" = 1'-0"

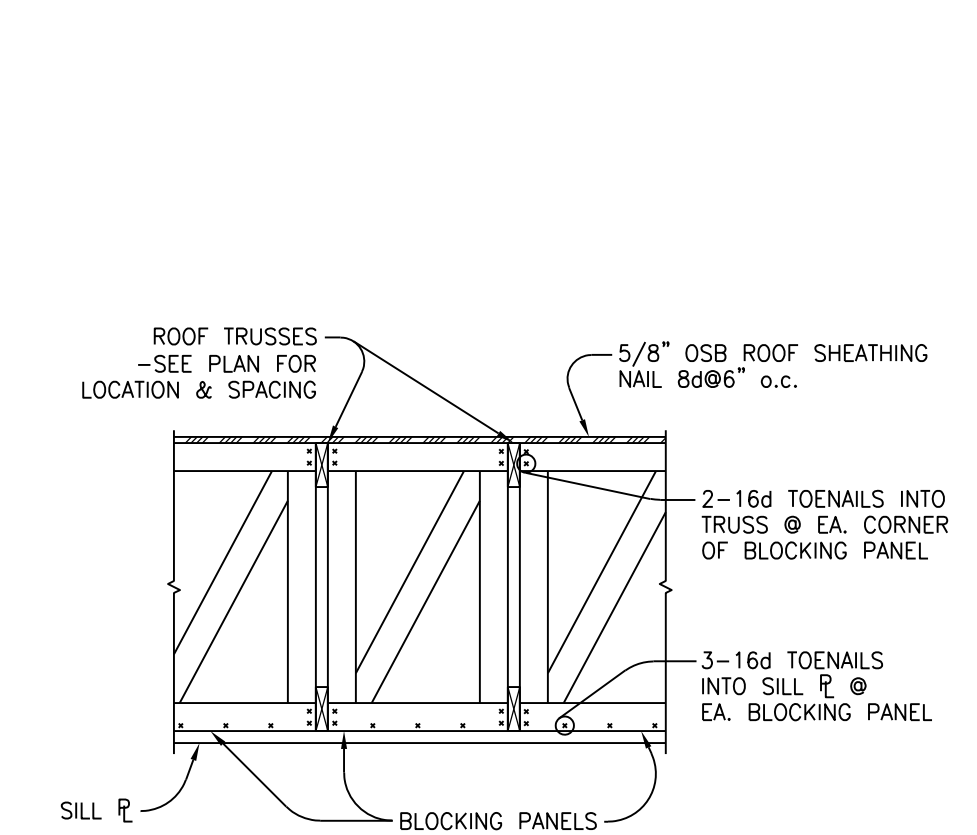


TYP. BLOCKING PANEL DETAIL

SCALE: 1/2" = 1'-0"

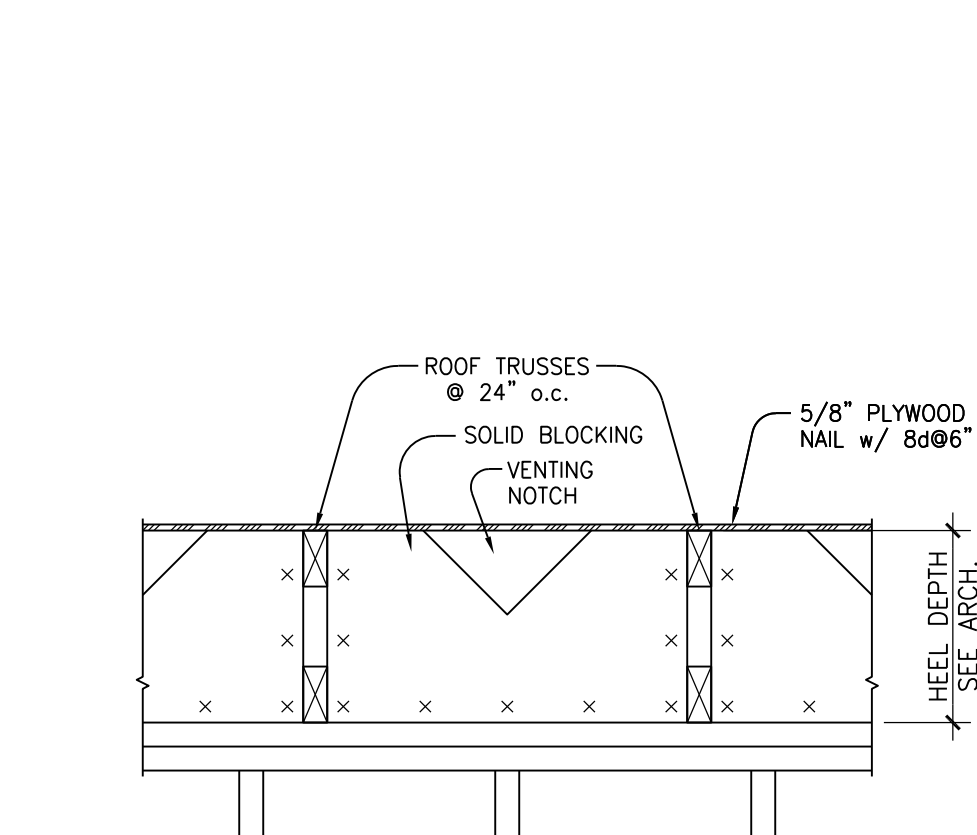


TYP. SOLID BLOCKING DETAIL

SCALE: 1" = 1'-0"

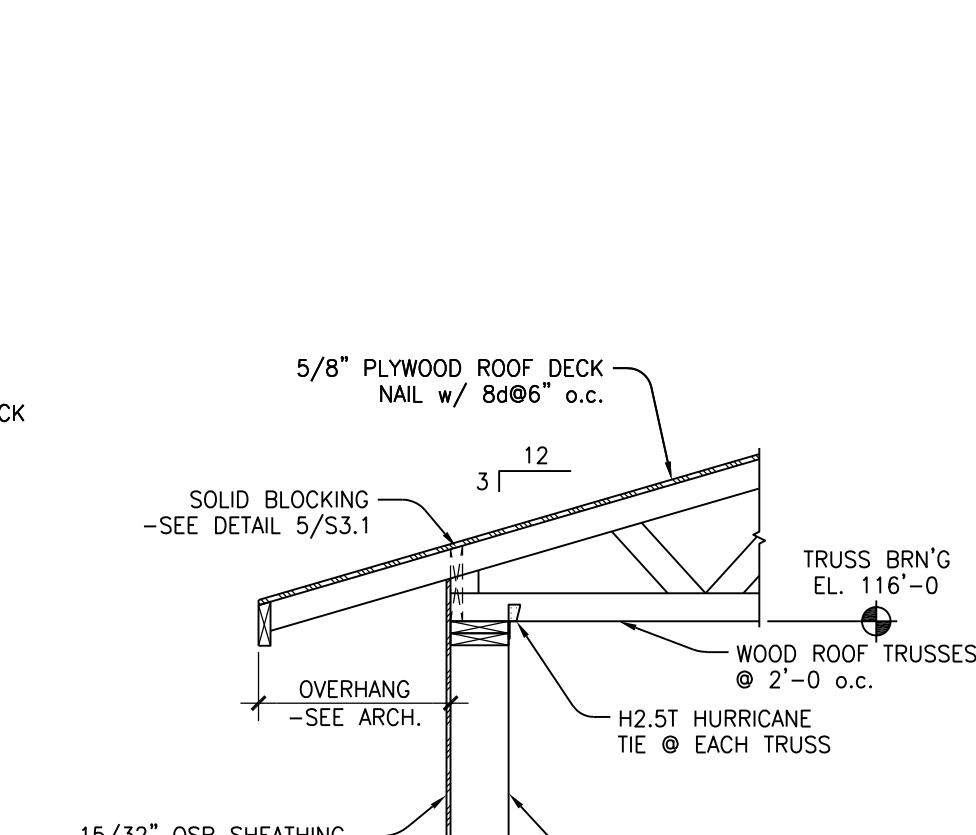


SECTION

SCALE: 1/2" = 1'-0"

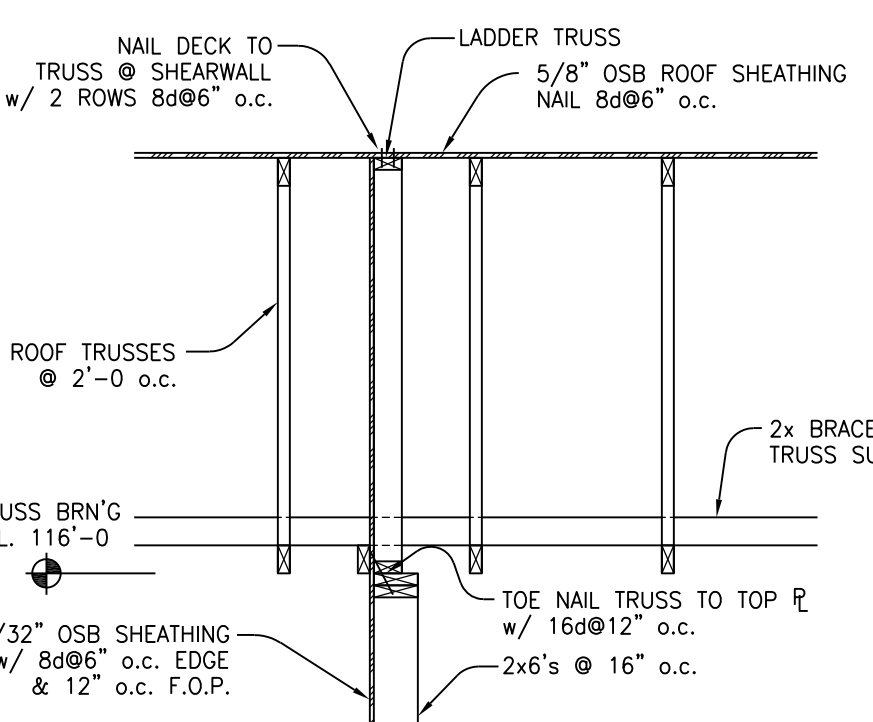


SECTION

SCALE: 1/2" = 1'-0"

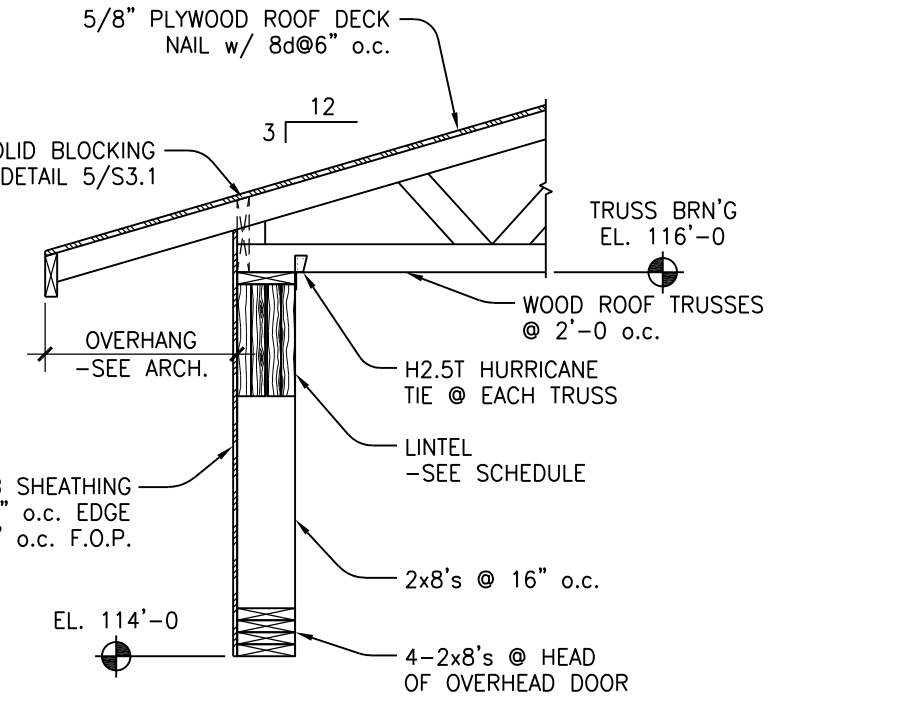


SECTION

SCALE: 1/2" = 1'-0"

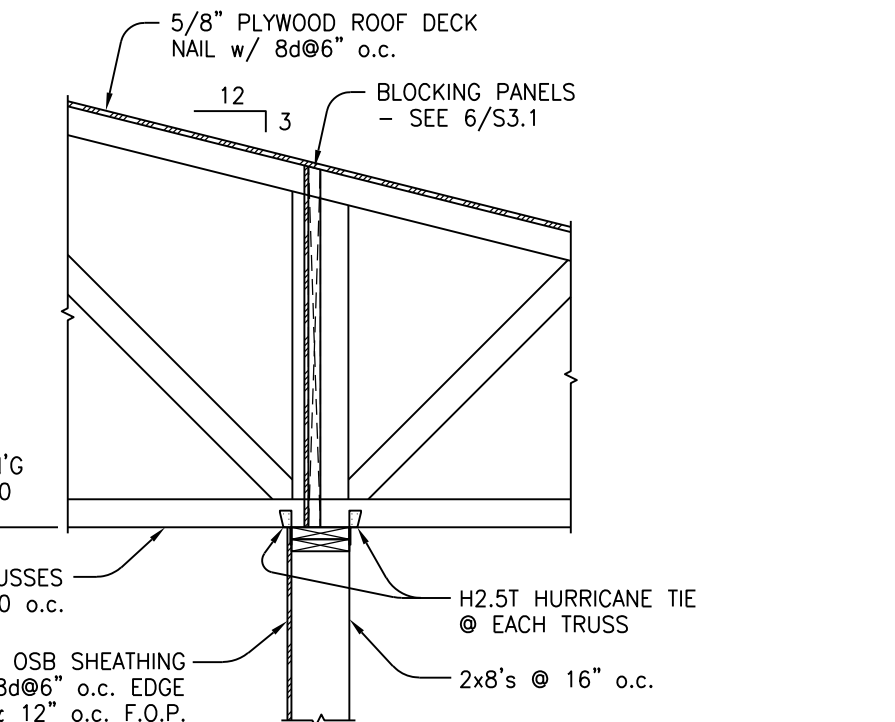


SECTION

SCALE: 1/2" = 1'-0"

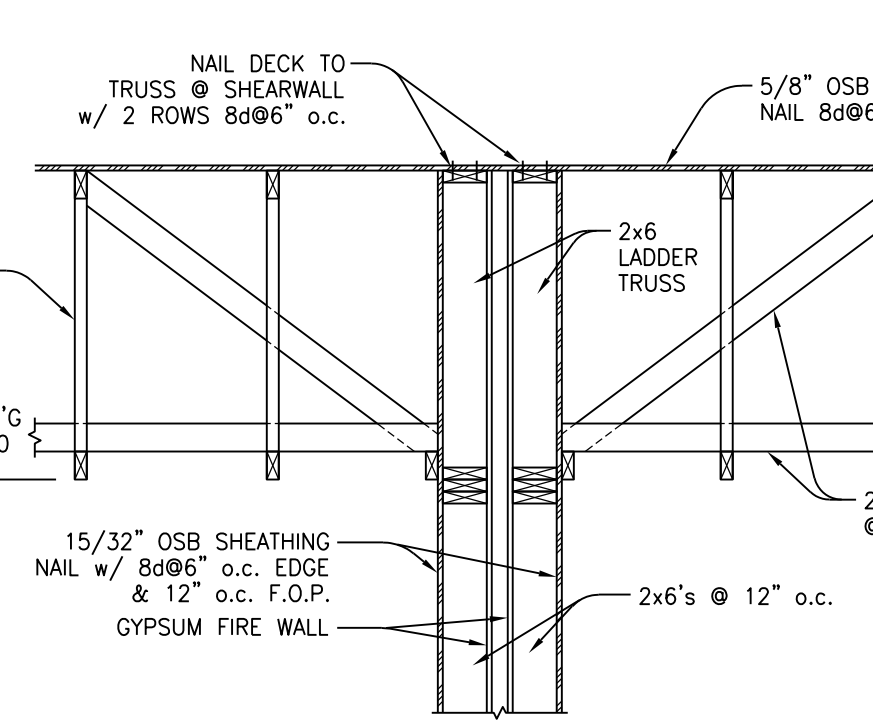


SECTION

SCALE: 1/2" = 1'-0"

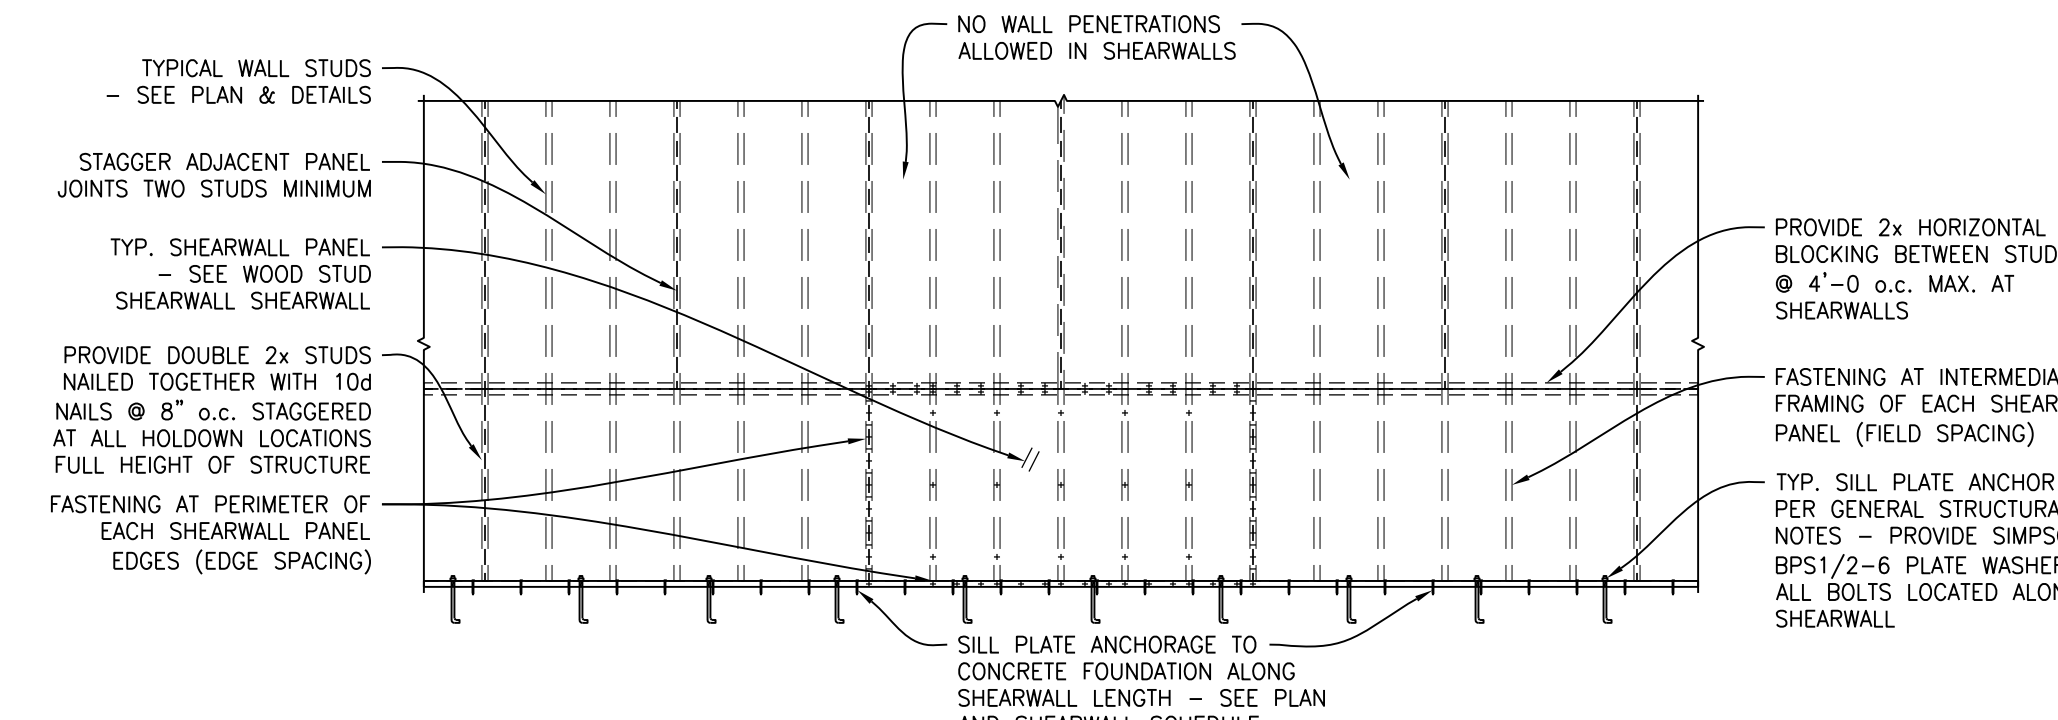

SHEARWALL FASTENING NOTES

SCALE: 1/4" = 1'-0"

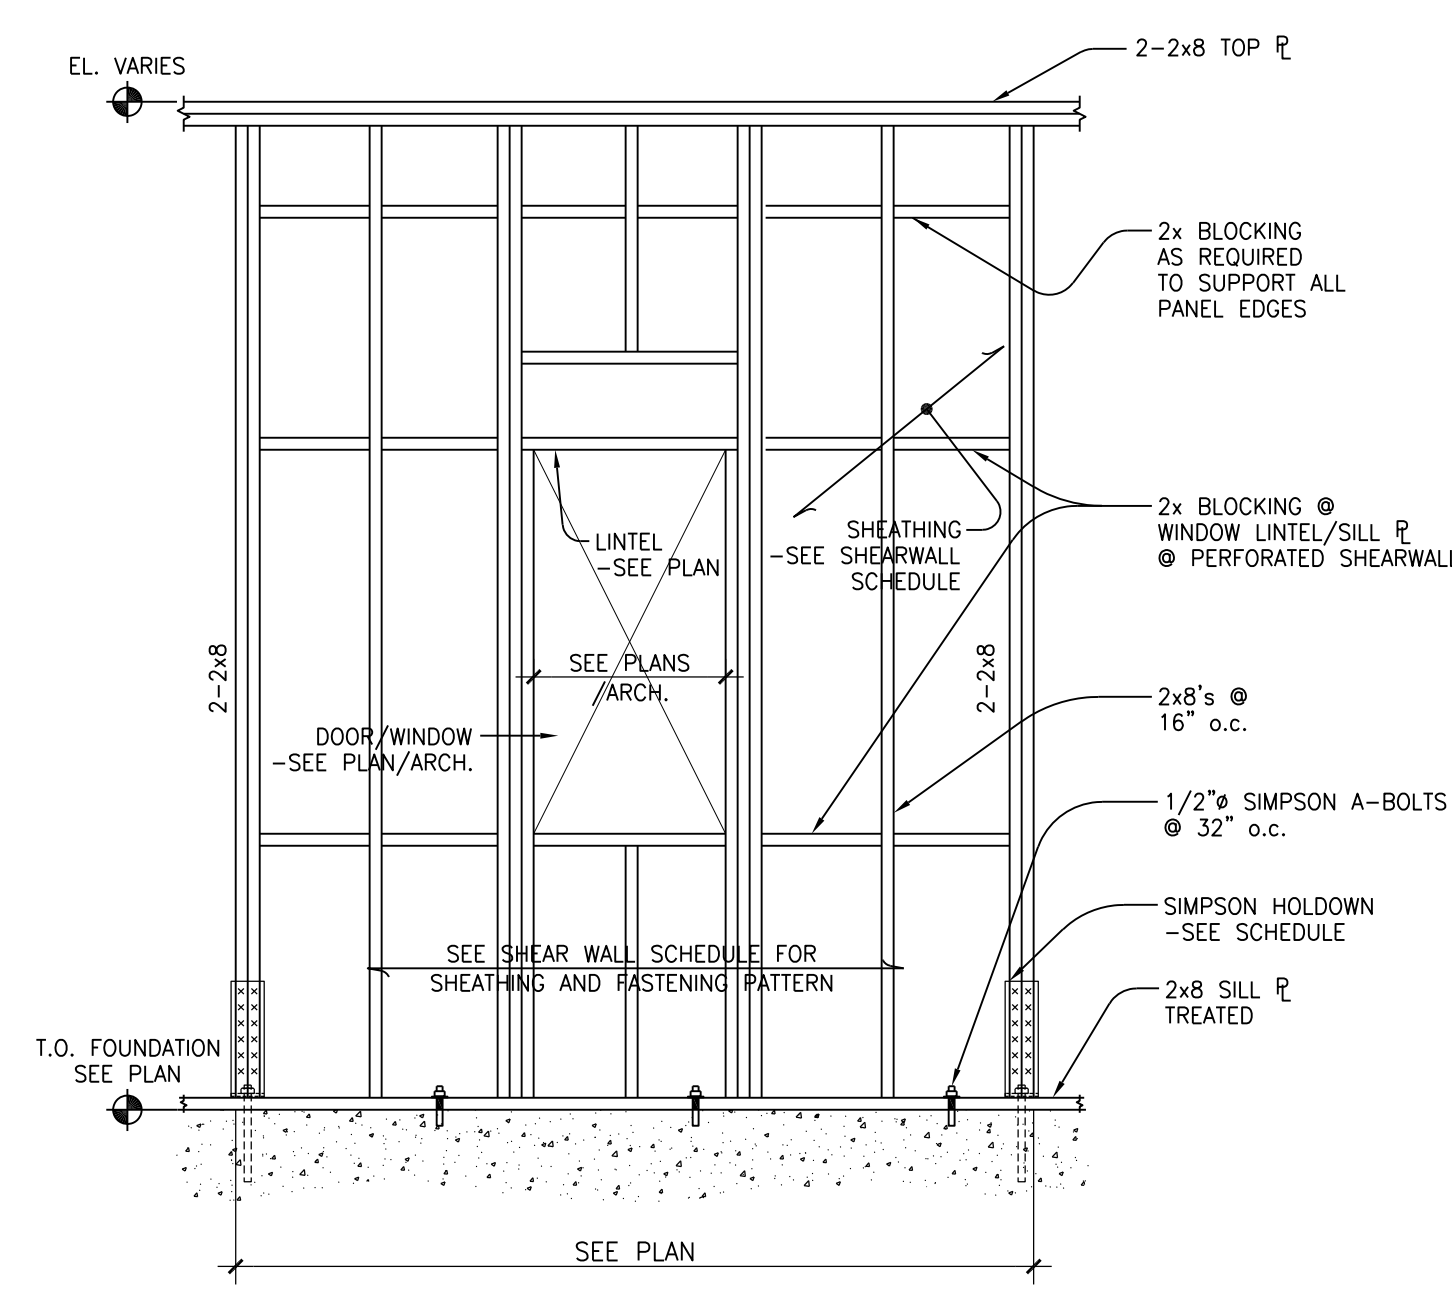

PERFORATED SHEARWALL ELEVATION



SCALE: 1/2" = 1'-0"

LINTEL SCHEDULE			
MARK	LINTEL	R.O.	REMARKS
L1	4 - 1 3/4" x 14" LVL's @ TOP OF WALL 4 - 2x8's @ TOP OF OPENING	14'-0"	LVL's : 2 TRIMMERS/2 KING POSTS SAWN; 2 TRIMMERS/2 KING POSTS
L2	4 - 2x8's	3'0" TO 3'-4"	1 TRIMMER/2 KING POSTS

NOTE: 1). VERIFY ALL LINTEL OPENING WIDTHS, ELEVATIONS, AND LOCATIONS WITH THE ARCHITECTURAL PLANS.

SHEAR WALL SCHEDULE			
NOTATION	'SW1'	'SW2'	'SW3'
APPROXIMATE WIDTH (VERIFY W/ ARCH.)	128'-0"	12'-0"	92'-0"
WALL PANEL AND FASTENING	15/32" O.S.B.-BLOCKED NAIL 8d@6" o.c. EDGE 12" o.c. FIELD OF PANEL	15/32" O.S.B.-BLOCKED NAIL 8d@6" o.c. EDGE 12" o.c. FIELD OF PANEL	15/32" O.S.B.-BLOCKED NAIL 8d@6" o.c. EDGE 12" o.c. FIELD OF PANEL
HOLDOWNS	NOT REQ'D	SIMPSON HD3B	NOT REQ'D
HOLDOWN ANCHOR	NOT REQ'D	1/2" SIMPSON TITEN HD (10" EMBED)	NOT REQ'D
ADDITIONAL ANCHOR BOLTS	1/2" TITEN @ 32" o.c.	1/2" TITEN @ 32" o.c.	1/2" TITEN @ 32" o.c.
COMMENTS	ATTACH TO MIN. 2-2x8's		

NOTE: 1). MINIMUM OF 3 ANCHOR BOLTS FOR EACH SHEAR WALL INCLUDING HOLDOWNS.
2). SIMPSON 1/2" TITEN HD ANCHOR BOLTS @ 32" o.c. ALL OTHER LOCATIONS UNLESS NOTED.
3). TYPICAL EXTERIOR SHALL BE 15/32" O.S.B. SHEATHING NAILED W/ 8d@6" o.c. EDGE & 12" o.c. FIELD OF PANEL. BLOCKED PANEL EDGES UNLESS NOTED OTHERWISE.

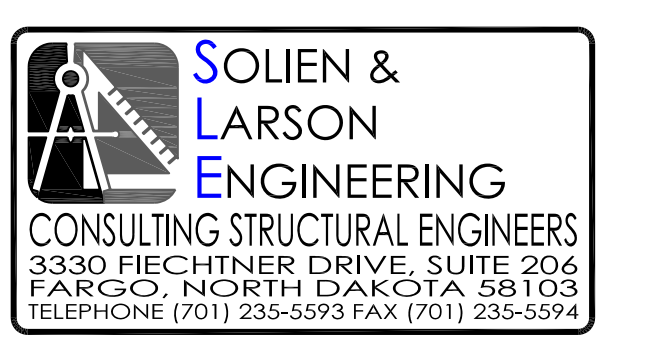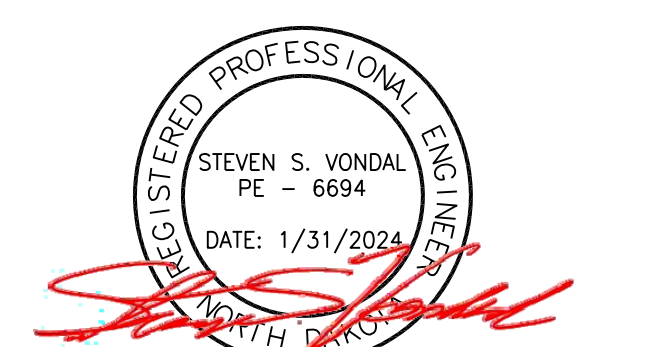


Foundation Plan
General Structural Notes
Sections & Details

Floor Plan General Notes

1. Rough carpentry contractor to provide & install all wood backing/blocking throughout.
2. Contractor to field verify all dimensions shown herein and alert Construction Manager of discrepancies.
3. All contractors to visit site to verify scope of work.
4. All walls to be framed, insulated, & sheathed to structure/structural deck above unless otherwise noted. See Wall Types & Details for additional information.
5. Refer to Structural for all shear wall locations.
6. All GWB to be painted SW 7657 (Zircon) with orange peel texture. Provide Level 3 finish at all GWB.
7. Concrete floor throughout to be 4" reinforced concrete slab - See Structural Drawings


Floor Plan Keynotes

- 100 amp panel at Utility 100.
- 100 amp panel at each tenant space.
- Access hatch in shop ceiling to vented attic. To be framed in drywall with insulated drywall panel - See Detail 8/A4.1.
- Designated area for building services/equipment. Wall and ground mounted - See Civil/Mech/Elect.
- 3 HR Fire Wall - (UL Design No. U454) - See wall types.
- Steel bollard - See Detail 5/A3.0 - Located 1'-0" off each corner of the building (Qty. 4).
- Pre-finished metal canopy by Owner installed by framing contractor - Refer to Detail 5/A4.1.

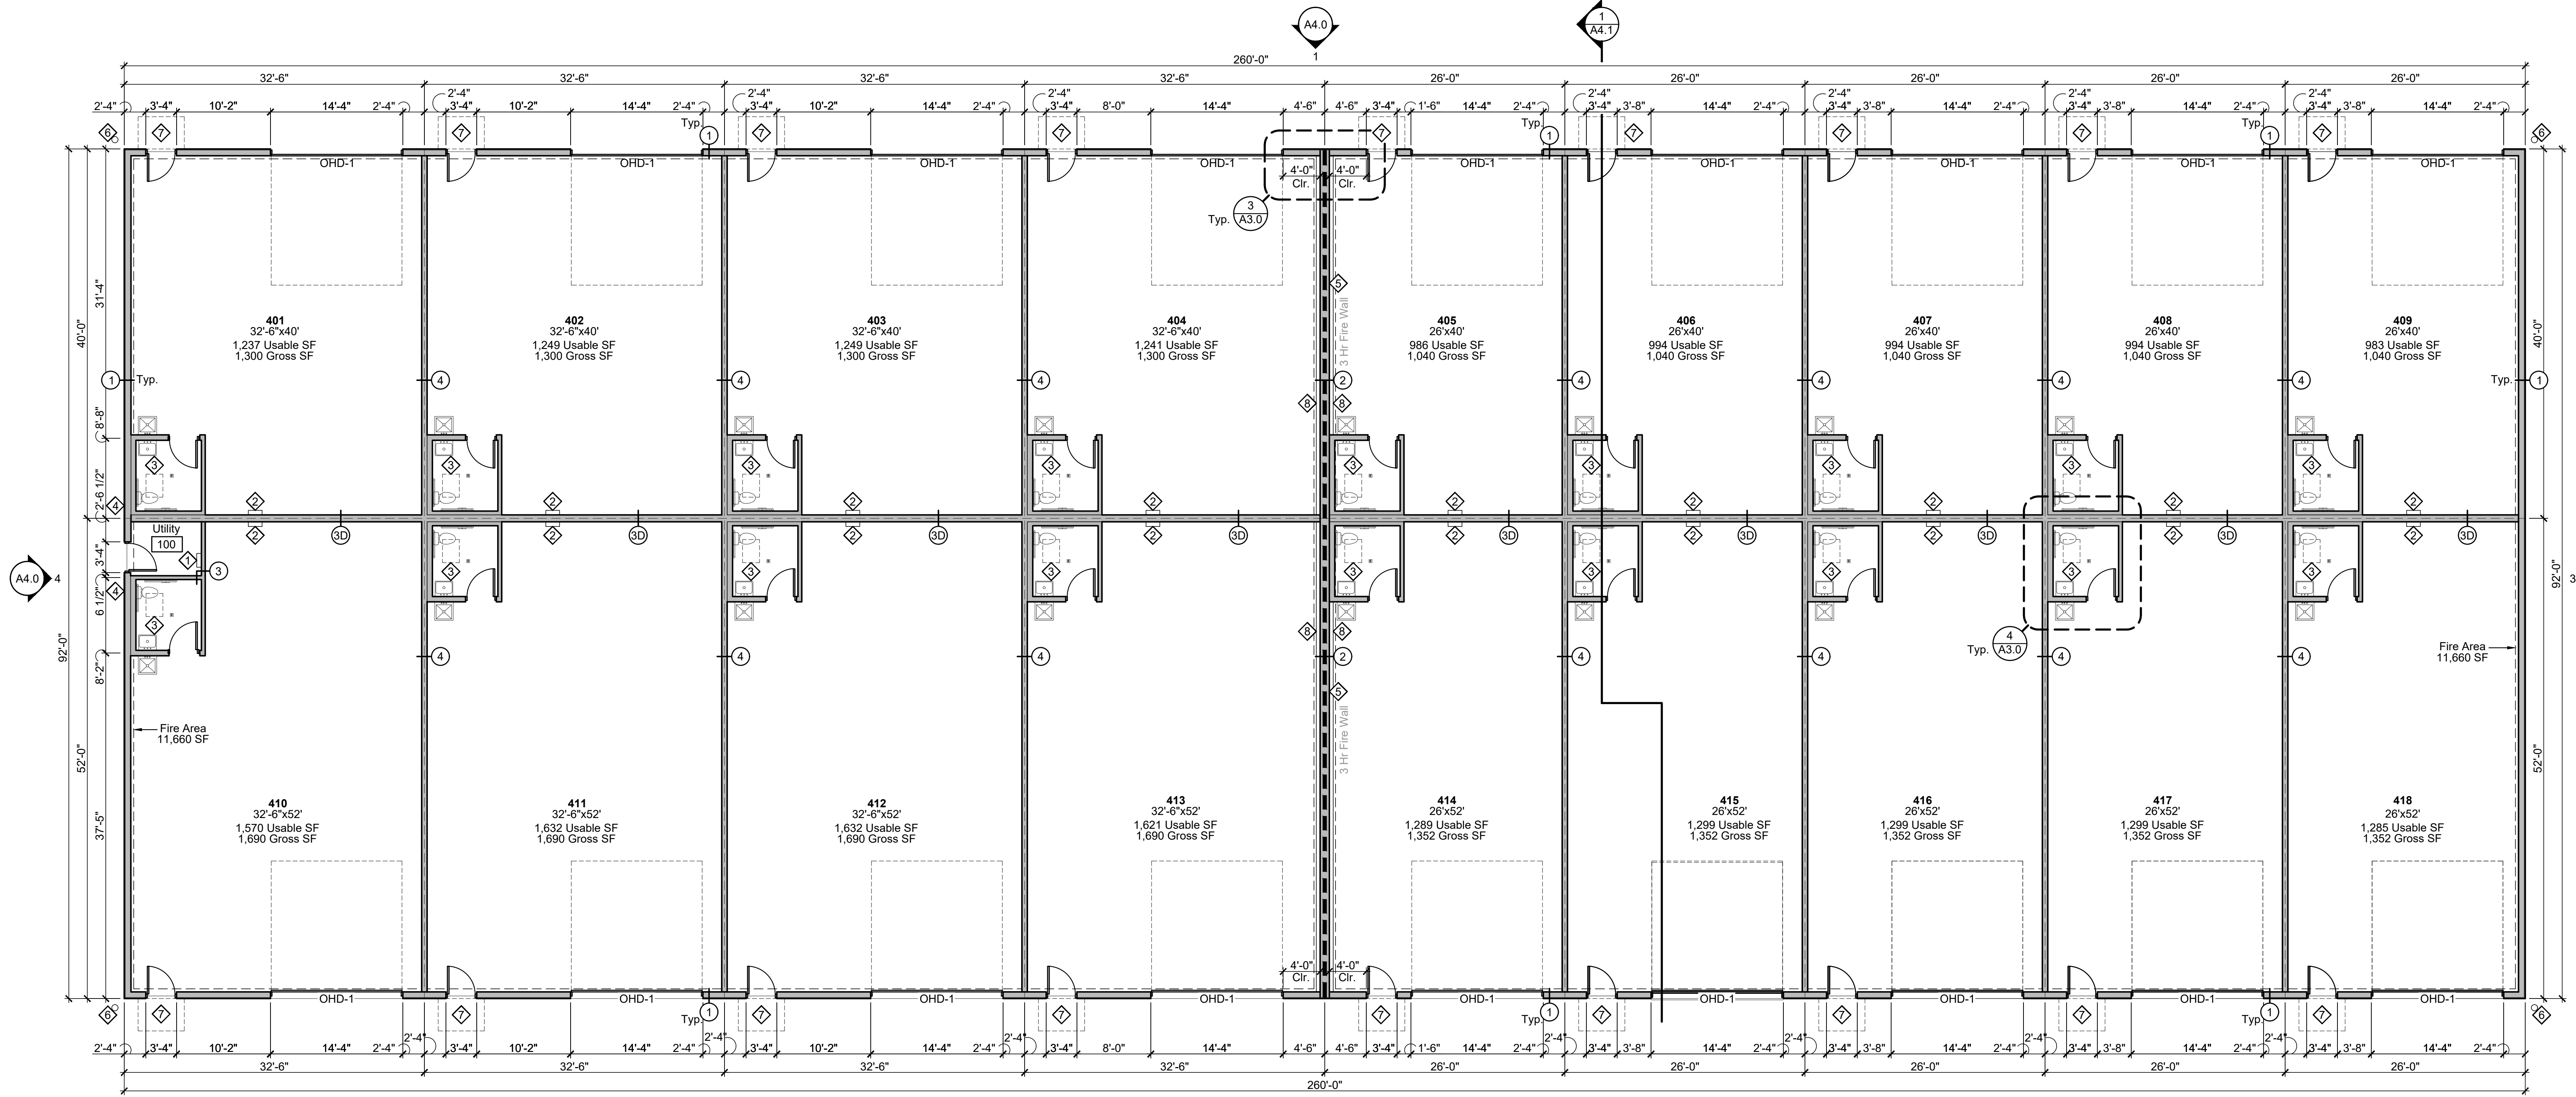


1 Floor Plan
1/8" = 1'-0"


- Fixtures**
- Toilet:** Mansfield Summit3 Elongated Smart Height Magna Flush Toilets (White) CLS-1955 Open Front Toilet Seats (White)
 - Sink:** Mansfield 20"x18" Wall Hung Lavatory (White)
 - Faucet:** Delta 520 Lavatory Faucet (Chrome)
 - Grab Bars:** Bobrick (1) 18", (1) 42", and (1) 36" Utility Sink Faucet: American Standard #8344212.004 With Bucket Hook and Garden Hose Hook Up
 - Mirror:** Bobrick 18"x36" B-290 Series Welded-Frame Mirror

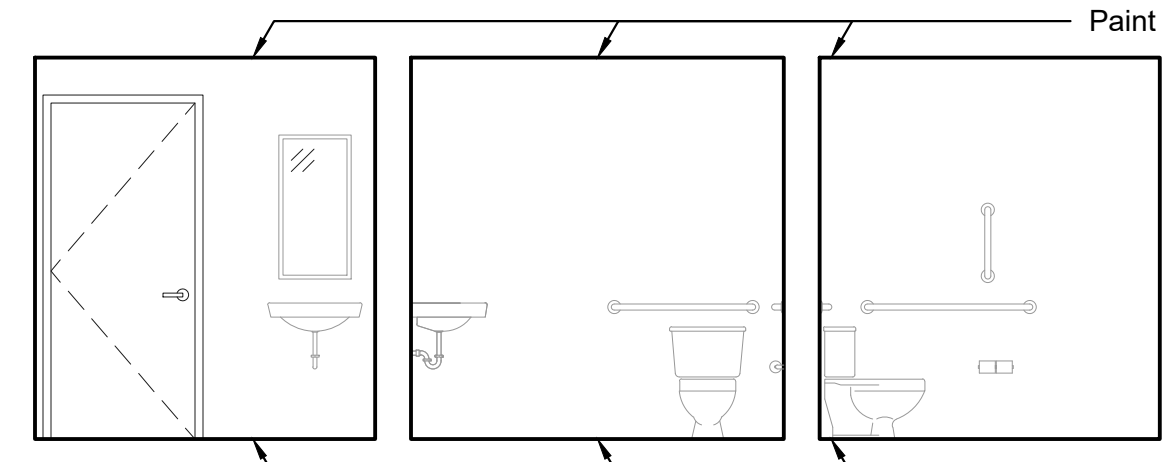


2 Typ. Toilet Room Int. Elev.
1/4" = 1'-0" Note: See A3.1 for ADA mounting requirements.

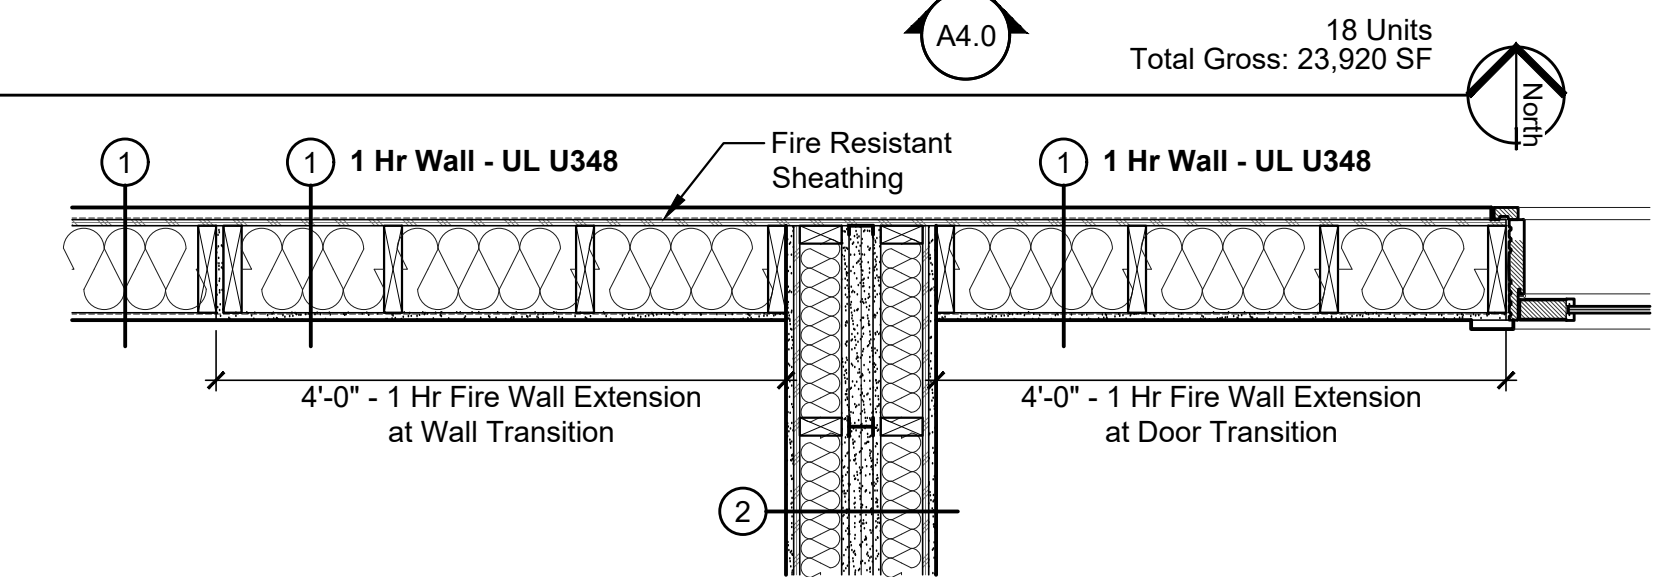

3 Plan Detail
3/4" = 1'-0"

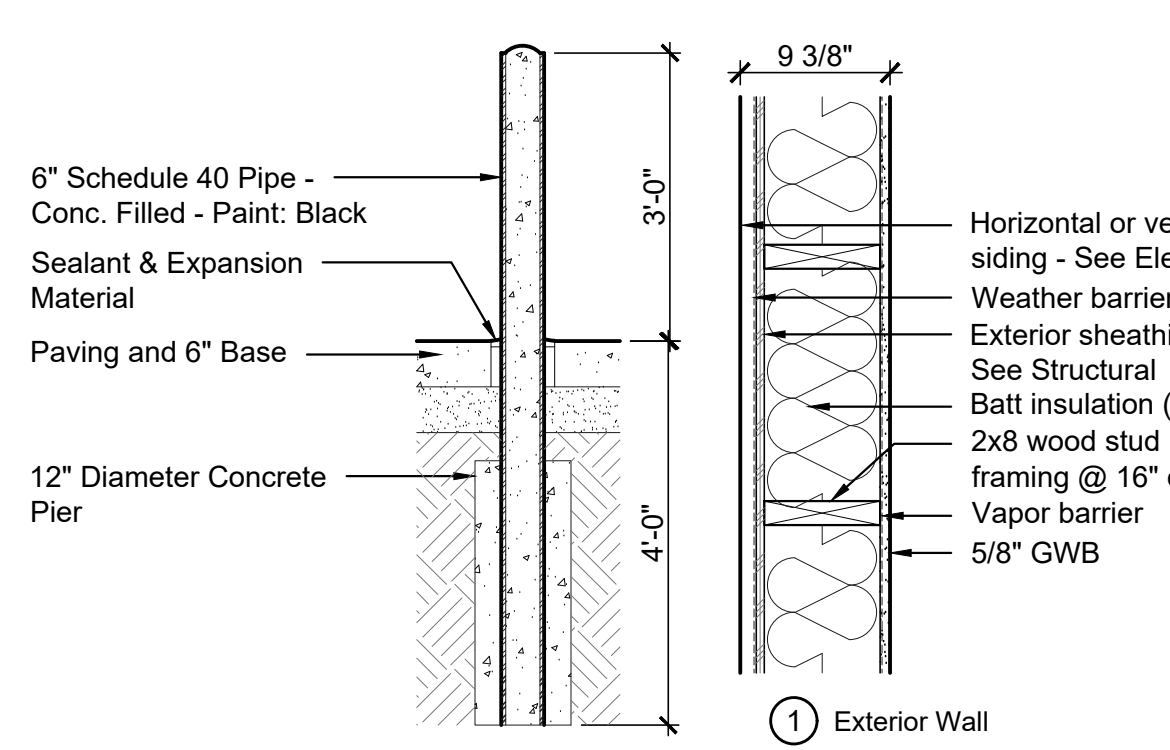

5 Bollard Detail
1/2" = 1'-0"

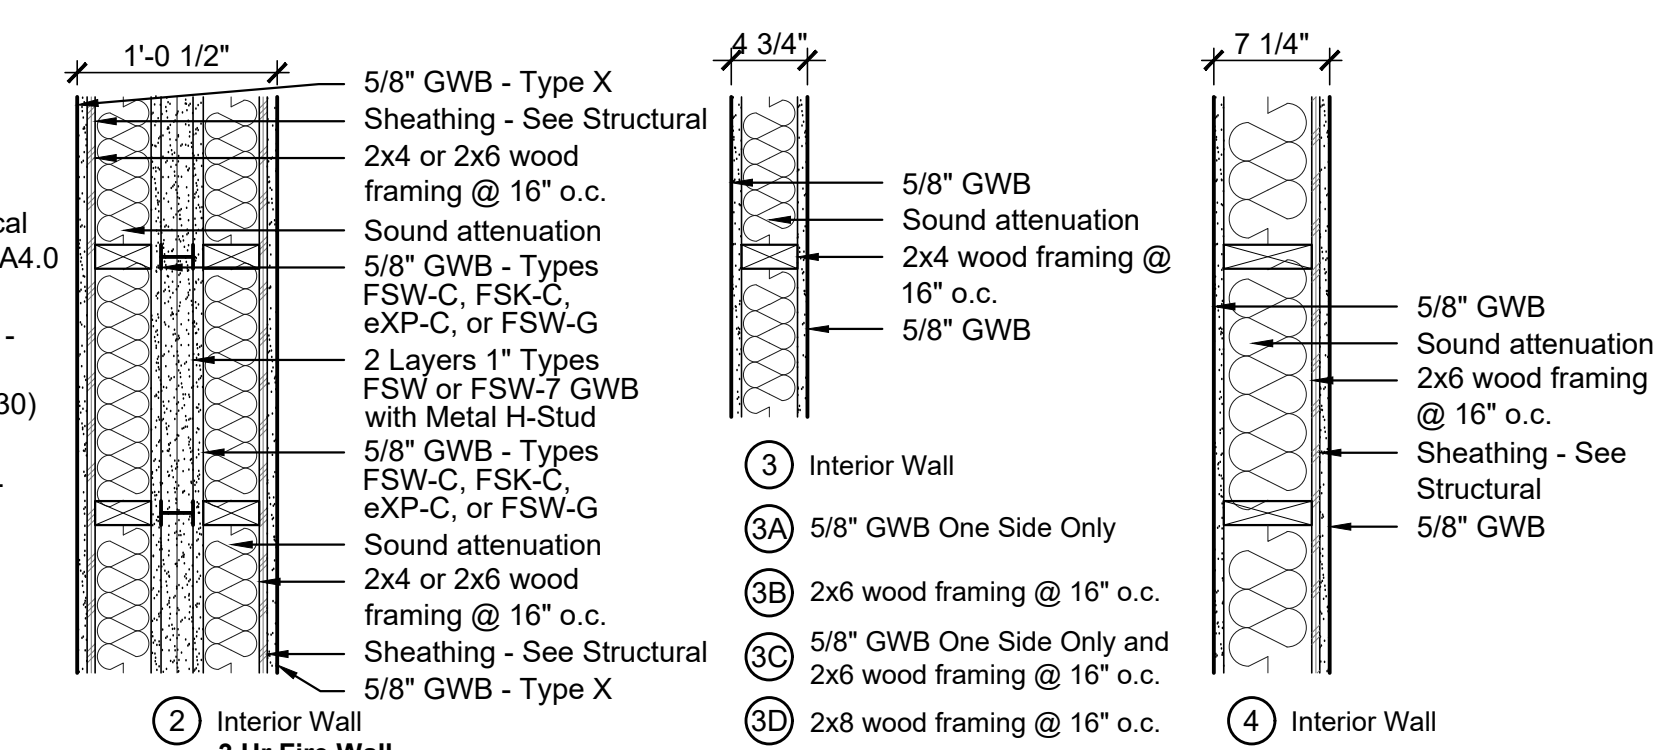


Wall Types
1" = 1'-0"

Door and Frame Schedule

Door Location	Size	Door Type	Rating	Frame Type	Hardware	Remarks
All Units	3'-0" x 6'-8" x 1 3/4"	Door-1	-	Door-1	Entrance Function Lockset and Deadbolt Basis of Design: Schlage AL Jupiter	-
Toilet Rooms	3'-0" x 6'-8" x 1 3/4"	Door-3	-	Door-3	Bathroom Function Lockset Basis of Design: Schlage AL Jupiter	-
Utility Room	3'-0" x 6'-8" x 1 3/4"	Door-2	-	Door-2	Entrance Function Lockset and Deadbolt Basis of Design: Schlage AL Jupiter	-

1. All Hardware to be Brushed Nickel finish unless otherwise noted.

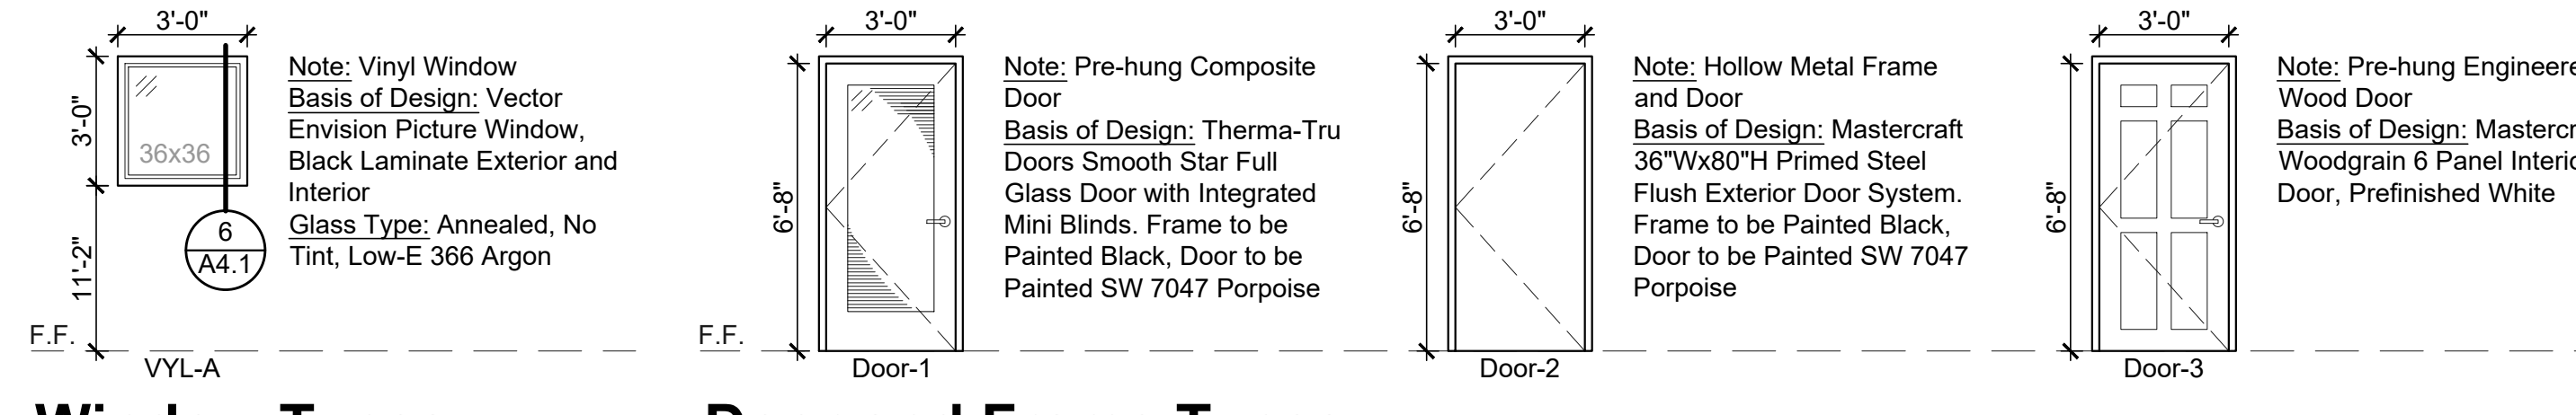


4 Typ. Toilet Room
1/4" = 1'-0"

Planning and Zoning

Information	Reference
City Code Reference	See Civil Drawings
Lot Size	Title 14 and Ordinance no. 6516
Building Size	266,731
Zone	23,920 sq ft (Building 4 of 4)
Maximum Building Coverage	Conditional GC - Conditional Heavy Commercial
Maximum Lot Impervious Area	80%
Landscape Buffer	85%
Front Yard Setback	20' Along South and East property lines
Interior Yard Setback	15'
Street Side Setback	0' as long as building is 2 stories or less
Rear Yard Setback	0' as long as building is 2 stories or less
Building Height Limit	10'
Parking Requirements for Development	3 Stories or 50'
Total Development Size	91,012 sq ft
Parking Calc Factor (Business)	1 Stall per 360 sq ft - 220
On Street Parking	48 Stalls Allowed based on Ordinance and Layout
Number of Stalls Required	253
Total Parking Provided	268

Key Plan

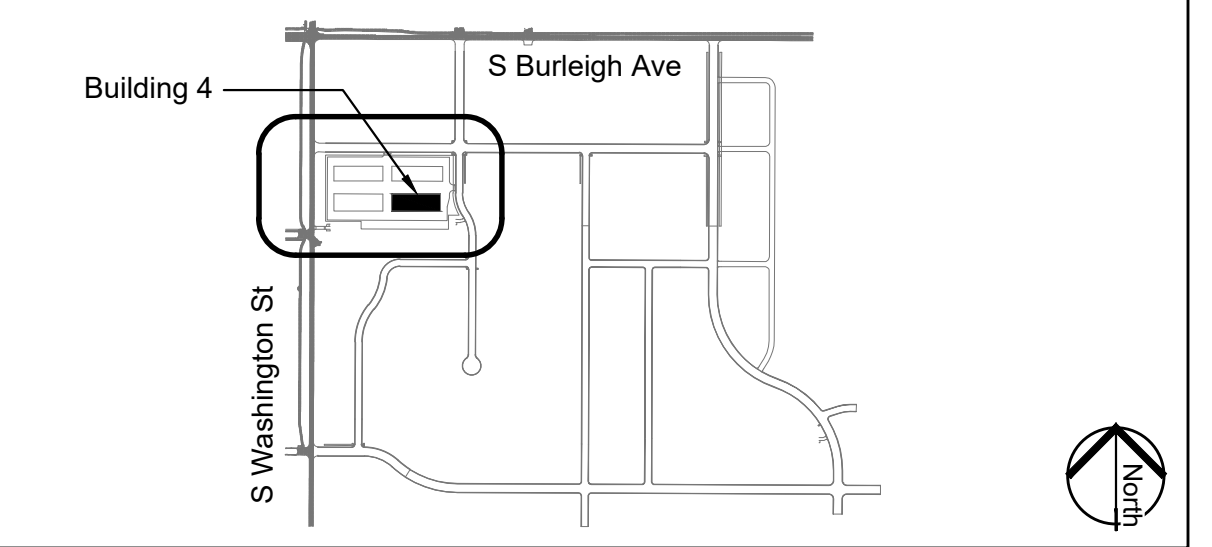


Code Research Summary


2021 International Building Code	Information	Reference
Occupancy	Mixed Use Group - "B" Business, "M" Mercantile, "S-1" Storage	Section 304, 309, 311
Total Square Footage	23,920 sq ft (Building 4 of 4)	See Floor Plans
Sprinkled	No	Section 903
General Building Information		
Height - Maximum Feet	"B" Business: 40 ft, "M" Mercantile: 40 ft, "S-1" Storage: 40 ft	Table 504.3
Height - Maximum Stories	2 Stories, 1 Story, 1 Story	Table 504.4
Area - Base Allowable	9,000 sq ft, 9,000 sq ft, 9,000 sq ft	Table 506.2
Area - Frontage Increase	6,750 sq ft	Section 506.3.3
Area - Factor Increase	Per Table, 100% of building perimeter can be multiplied, with over 30 ft of open space = 0.75	Table 506.3.3
Allowable Area	A ₂ = A ₁ + (NS x L) / A ₁ = 9,000 + (9,000 x .75) / A ₁ = 15,750 sq ft	Table 506.3.3
Total Allowable Area Per Floor	15,750 sq ft (per Fire Area)	Table 506.3.3
Fire Separation Area	3 hours - See Below	
Construction/ Fire Resistive Requirements		
Construction Type	Type V-B (non-sprinkled)	Table 601
Structural Frame	0 hours	Table 601
Exterior Bearing Wall	0 hours	Table 601
Interior Bearing Wall	0 hours	Table 601
Exterior Non-Bearing Wall	0 hours	Table 601
Interior Non-Bearing Wall	0 hours	Table 601
Floor/Ceiling	0 hours	Table 601
Roof/Ceiling	0 hours	Table 601
Fire Rated Resistive Construction		
Maximum Area of Exterior Wall Openings	Not Required since >30' Separation Distance	Section 705.8
Fire Barriers	As Required by Table 508 for Occupancy Separation No Separation Required Between "B", "M", and, "S-1"	Section 706
Fire Walls	No Larger than 12,000 SF per Fire Area and Aggregate of 24,000 SF for Total Building, including future mezzanines. No Commercial Vehicles, Upholstered Furniture, or Mattresses Allowed	Section 903.2
Fire Wall Rating	3 hour Fire Wall Required (most restrictive)	Section 706.4/ 707.3.10
Fire Barriers (Incidental Use Areas)	See Section 707 and 711	Section 509.4
Light, Ventilation, and Sanitation		
Minimum Facilities Required	Standard	
Water Closets	1 Provided, to be determined based on use	Table 2902.1
Lavatories	1 Provided, to be determined based on use	Table 2902.1
Service Sink	1 Provided, to be determined based on use	Table 2902.1
Means of Egress		
Use	To Be Determined	
Occupant Load Factor	To Be Determined	Table 1004.5
Occupant Load - Net Area	To Be Determined	
Total Tenant Occupant Load	To Be Determined	
Number of Exits Required	2 Provided at Each Tenant Space	Section 1006
Minimum Exit Width Required	To Be Determined	
Means of Egress Minimum Height	7 ft 6 in	Section 1003.2
Exit Door Minimum Width	32 in Clear (3'-0" nominal); Maximum: 48"	Section 1010.1.1
Exit Door Minimum Height	6 ft 8 in	Section 1010.1.1
Maximum Exit Access Travel Distance	200 ft (non-sprinkled)	Table 1017.2
Common Path of Egress Travel	75 ft (non-sprinkled)	Table 1006.2.1
Dead Ends	20 ft (non-sprinkled)	Section 1020.4
Common Path of Egress Travel	NA (corridors not utilized)	Table 1018.1

Project Description

The Paradise Business Centre is located in the Paradise Valley Development in South Bismarck off of Fisher Lane and Rutland Drive. There are 4 buildings within the project. This code review reflects Building 4 only. The building is type V-B construction and is not sprinkled. Fire walls will be installed to meet fire area requirements. It is a Mixed-Use occupancy consisting of Business "B", Mercantile "M", and Storage "S-1". There are 18 total units in total. All work is to comply with Title 14 and Ordinance no. 6516. Off-street and on-street parking are being utilized to meet parking requirements.

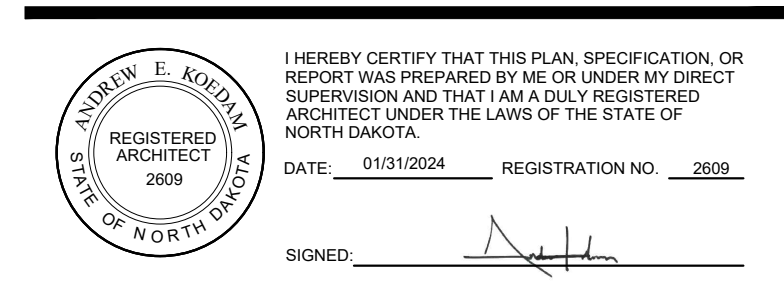



Floor Plan, Typ. Toilet Room, Plan Detail, Wall Types, Door and Frame Schedule, Window/ Door/ Frame Types, Planning and Zoning, Code Research Summary, Notes, Key Plan, Details

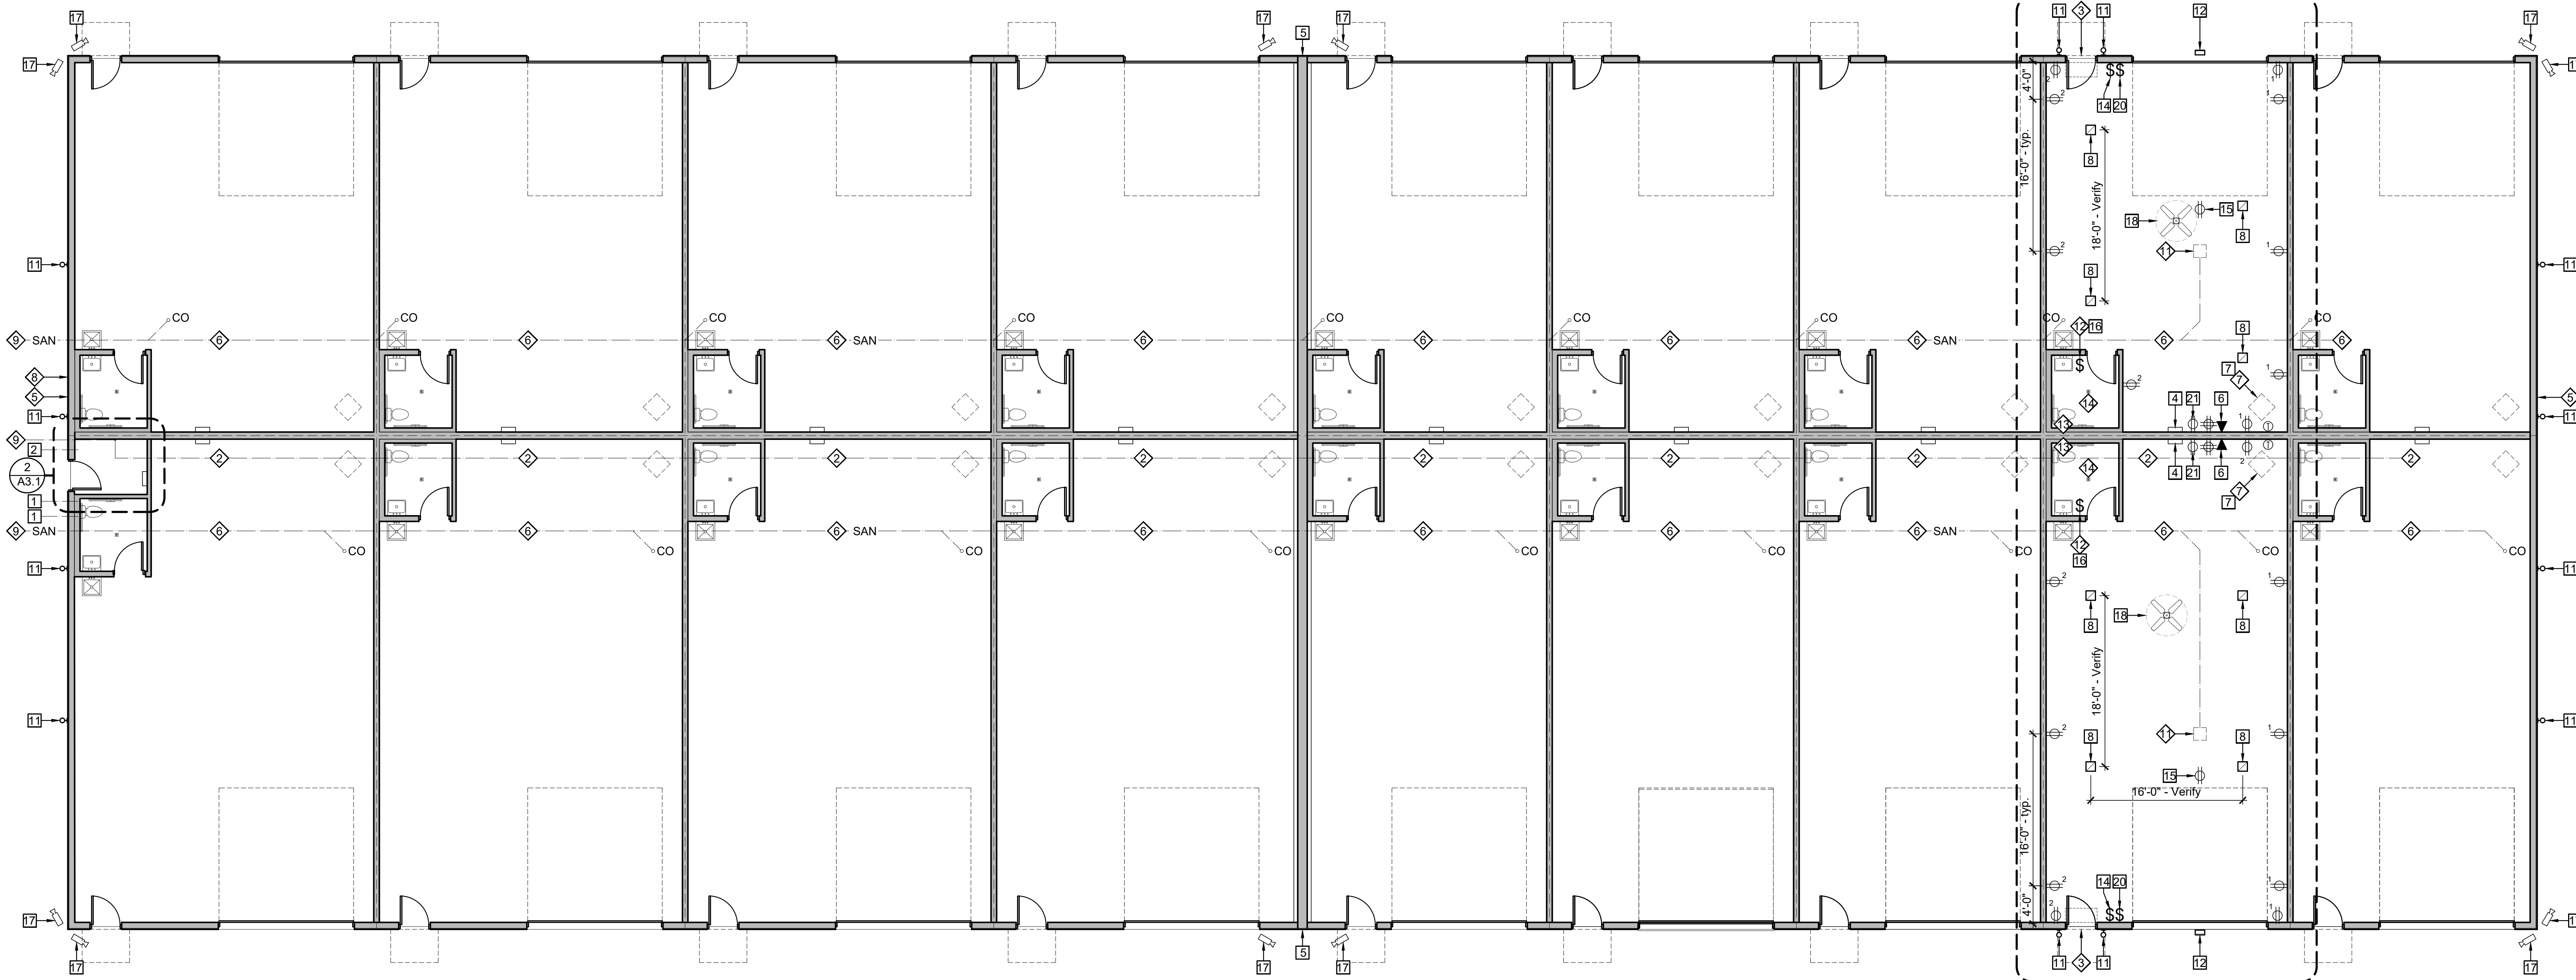

1 Mechanical / Electrical Plan
1/8" = 1'-0"

Note: Mechanical and electrical layout - Typical for all units

ADA Mounting Heights

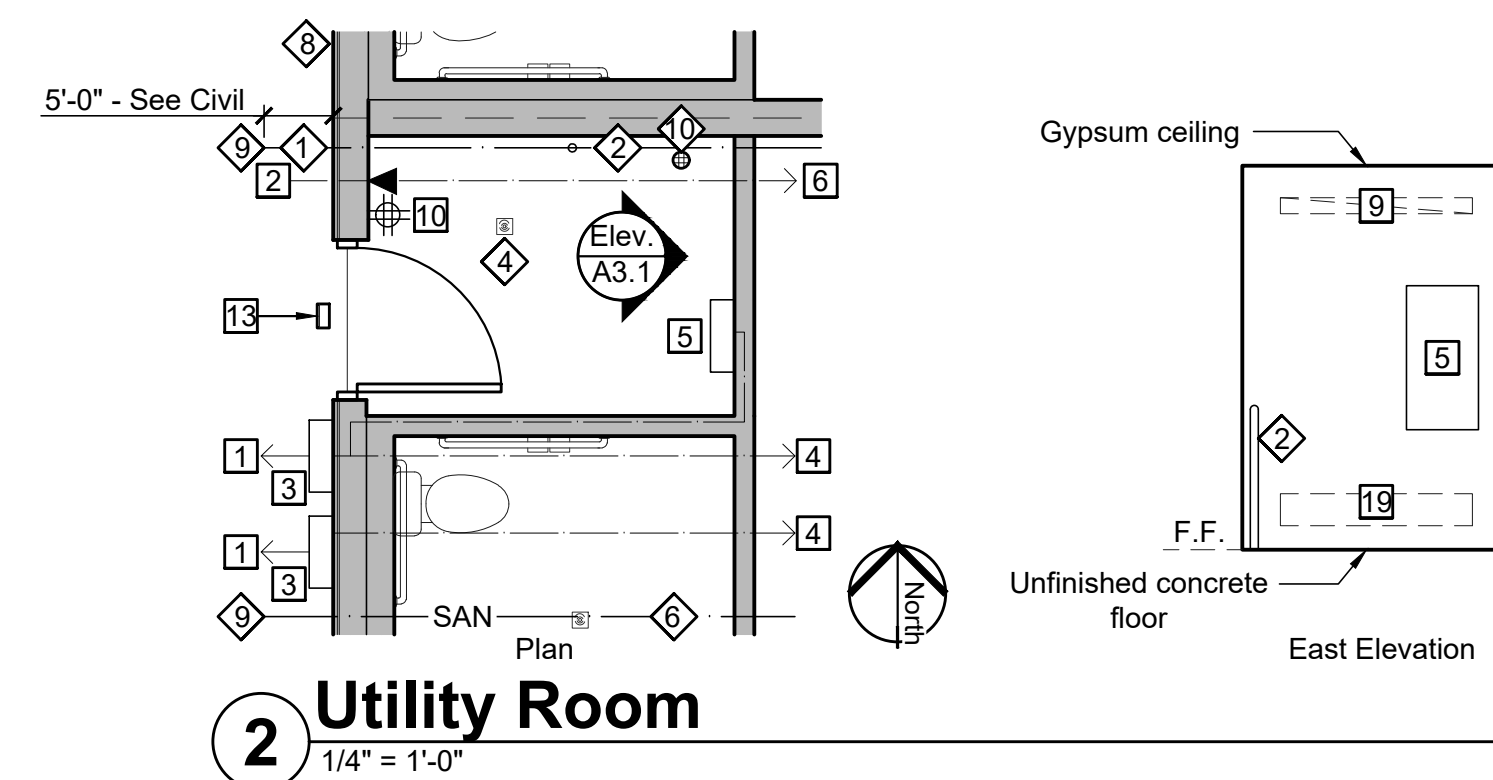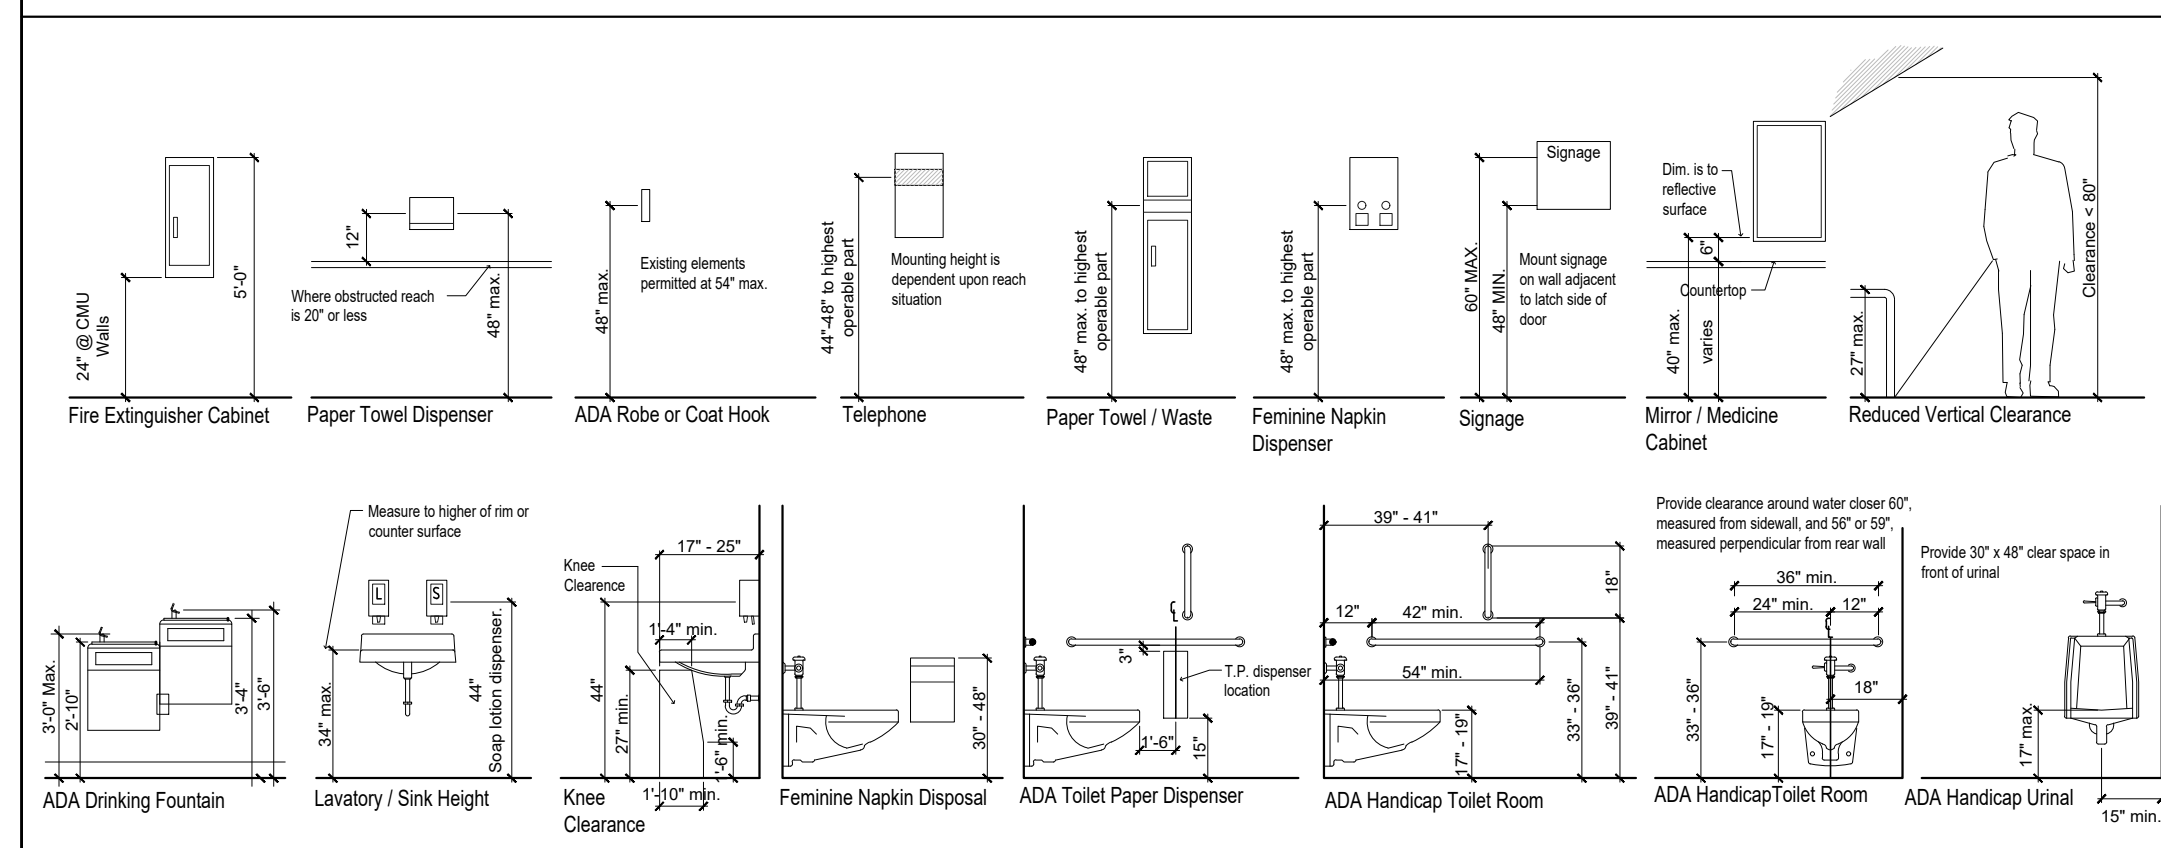

2 Utility Room
1/4" = 1'-0"

Mech/Plumbing Notes:

- Note: Mechanical/Plumbing Contractor to review drawings, and visit site prior to bidding. Mechanical/Plumbing Contractor to design-build; provide all materials, labor, taxes, and permitting to achieve scope of work indicated on drawings. Provide required information and drawings necessary for state and local code review/approval and construction coordination.
- 1 Provide (1) 2" (Domestic) CW Line into Utility 100. Provide water meter as required by code - verify location with CM.
 - 2 Provide (1) 2" (Domestic) CW Line as shown on plan underground. Provide (1) shut off valve at Utility 100. 2 back to back units to share branch off 2" CW. Each unit to have separate shut off valves. Verify location. Verify with City of Bismarck.
 - 3 Thru-wall HVAC/cooling insert installed above canopy. See Elevations for location. Basis of Design for Future Unit: Gree PTAC II GAE15AED3NRNB5GCP. Electrical Contractor to provide dedicated circuit to location for future use and temporary infill enclosure for complete wall assembly. Custom color grill to match adjacent siding. Verify final color selection with Architect/Owner.

- Alternate #1: Provide alternate price to provide and install all 18 units for entire building.
- 4 Provide 2" Floor Drain at Utility 100.
 - 5 Provide (4) exterior Hose Bibs as shown on plan.
 - 6 Provide 4" PVC Sanitary Sewer line and cleanouts as shown on drawings. Cleanouts to be flush with concrete floor. Verify location with Arch/CM. Verify proper line slope - See Civil Drawings.
 - 7 Provide ceiling-hung heater and thermostat for each unit. Basis of Design: Reznor UDX Natural Gas Unit Heater. Include all components to vent thru roof. Direct wired or plug in. Verify heater and thermostat location and height with Arch/CM. Verify total BTUs required per unit with mechanical contractor.
 - 8 Gas Meters provided by utility company - verify location with Owner/CM. Provide gas lines as shown on Plan to each ceiling-hung heater.
 - 9 Final connection to utilities by Mechanical Contractor. Verify locations with Civil Drawings.
 - 10 Plumbing contractor to provide floor drain pipe through roof as required.
 - 11 Provide 16"x16" floor drain with catch basin and pipe to storm sewer at each tenant space. Floor drain to be no more than 2" below finish floor elevation.
 - 12 Residential exhaust fan - vent through bathroom wall up to roof.
 - 13 20 gallon single element water heater on bathroom platform with water heater pan. Drain to be piped through wall to floor drain. Basis of Design: Westinghouse® 20 Gallon 6 Year Electric Water Heater, 2000W, Model Number: WER020A1X020N10. See 1/A4.1
 - 14 2" Floor drain to be no more than 1/4" below finish floor elevation.

Electrical Notes:

- Note: Electrical Contractor to review drawings, and visit site prior to bidding. Electrical Contractor to design-build; provide all materials, labor, taxes, and permitting to achieve scope of work indicated on drawings. Provide required information and drawings necessary for state and local code review/approval and construction coordination.
- All electrical outlets to be 60" A.F.F. U.N.O. Electrical contractor to provide plywood backing at panels.
- 1 Provide Transition Cabinet including (1) 4" Conduit from Transformer to Transition Cabinet. Provide (2) main conduit from Transition Cabinet to Utility 100 feeding (2) 600 Amp Main Breaker/MDPs.
 - 2 Transformer and Transition Cabinet to be located adjacent to Building 3 and shared with Building 4. Provide (2) concrete filled steel bollards as required by utility company. Verify route and footage of conduit with utility company.
 - 3 Provide (1) 2" PVC communication/data conduit/daisy, changed from Building 2 to Building 4. Daylight conduit into Utility 100 - See Civil Drawings.
 - 4 Provide (2) 600 Amp (208/240 Single Phase) main breakers, feeding (16) 100 Amp panels, individually metered. Meters to be located on either side of MDP outside Utility 100 - Verify with utility company and electrical contractor.
 - 5 Each tenant space to receive (1) surface mounted 100 Amp panel. Provide 1-1/4" underground conduit to each tenant space, verify location of panel at each tenant space with CM/Owner.
 - 6 Utility 100 to receive (1) surface mounted 100 Amp panel, verify location of panel with CM/Owner.
 - 7 Provide (1) 3/4" conduit under ground from Utility 100 to each tenant space for future communication/data.
 - 8 Provide power to ceiling hung heater. Verify with Mechanical contractor.
 - 9 High bay light fixture for general interior shop lighting. Basis of Design: Lithonia Lighting CPHB 12LM MVOLT 50K Contractor Select Compact Pro LED High Bay. Provide minimum lumens requirements to meet code. All shop lighting to be on single circuit. Verify final quantity of fixtures and lighting layout with CM/Owner.
 - 10 Provide (1) 4'-0" LED utility fixture surface mounted on wall in Utility 100. Basis of Design: Lithonia Lighting WL LED Wall Surface Mount Bracket, 3000 Lumens, 5000K.
 - 11 Provide (1) quad outlet in Utility 100. Verify location with CM/Owner. See interior elevation.
 - 12 Provide (2) wall sconce light fixtures at each walk-through door on the North and South elevations and the East and West elevation as shown. Basis of Design: LEONLITE Integrated LED Cylinder Up/Down Outdoor Wall Light, 100V-277V, 20W, 3000K. See A4.0 for locations. All exterior fixtures to be controlled in Utility 100 with single photoeye.
 - 13 Provide (1) wall pack light fixture above each garage door on the South elevation. Basis of Design: RAB Lighting LED WP2XFU60, Color Selectable, Bronze Finish. See A4.0 for location. All exterior fixtures to be controlled in Utility 100 with single photoeye.
 - 14 Provide (1) downlight light fixture above Utility 100 door on the East elevation. Basis of Design: Lithonia Lighting WXP0 LED Wall Mount, Model #WXP0 LED ALO SWW2 MVOLT PE DDBXD M2. See A4.0 for location. All exterior fixtures to be controlled in Utility 100 with single photoeye.
 - 15 Overhead door control location. Provide functions for Open, Close, and Stop.
 - 16 Receptacle for overhead door operator - ceiling mount.
 - 17 Exhaust fan and light to be controlled on same switch.
 - 18 POE security camera layout as shown. Include Cat6 to location and 8TB hard drive in Utility 100. Product: Revu Surveillance Systems. Include wire shelf. Verify final camera selection and location with CM/Owner.
 - 19 56" ceiling fan. Basis of Design: Westinghouse Jax Ceiling Fan, White Finish, Model #7812700, no light. Provide variable speed switch at shop door to control shop ceiling fan.
 - 20 4" electrical baseboard heater in Utility 100. Basis of Design: Cadet 48 in. 208-volt 1,000/750-watt Electric Baseboard Heater, Finish: White, Model #4F1000W.
 - 21 Provide switch at door to control all interior shop lighting.
 - 22 40 amp dedicated receptacle for RV Plug-in. Verify power requirements with CM/Owner.

WE CERTIFY THAT THIS PLAN SPECIFICATION OR REPORT WAS PREPARED BY ME OR UNDER MY DIRECT SUPERVISION AND THAT I AM A QUALY REGISTERED ARCHITECT UNDER THE LAWS OF THE STATE OF NORTH DAKOTA.

DATE: 01/31/2024 REGISTRATION NO: 2629

SIGNED: [Signature]



Mechanical and Electrical Design-Build Plan, ADA Mounting Heights, Enlarged Plan, Notes

Material Legend

- 1 - Metal Lap Siding
- Quality Edge, TruCedar Steel Siding
- Profile: Single 6" (Horizontal)
- Color: Solid 425 Statuary Bronze
- 2 - Metal Lap Siding
- Quality Edge, TruCedar Steel Siding
- Profile: Single 6" (Horizontal)
- Color: Solid 469 Fresh Canvas
- 3 - Metal Lap Siding
- Quality Edge, TruCedar Steel Siding
- Profile: 6" Board & Batten (Vertical)
- Color: HD2 Woodgrain M16 Cider Mill
- 4 - Metal Lap Siding
- Quality Edge, TruCedar Steel Siding
- Profile: Single 6" (Horizontal)
- Color: Solid 410 Thatch
- 5 - Stone Veneer
- Versetta Stone, LedgeStone
- Panel Size: 36" x 8"
- Color: Sterling
- Include Stone Cap
- 6 - Asphalt Shingles
- CertainTeed Landmark
- Color: Moire Black

Elevation Keynotes

- 1 Prepare to Receive Thru-wall HVAC/cooling Unit Mounted Above Door and Canopy. Verify Power Requirements with Electrical Contractor. Provide Custom Color Grill to be Selected by Architect/Owner - See A3.1.
- 2 Pre-finished metal canopy by Owner installed by framing contractor - Refer to Detail 5/A4.1.
- 3 6" Prefinished Metal Gutters and Downspouts. Basis of Design: Klauer Classic Rainware Collection - Color: Terra Bronze - Profile: Square
- 4 Gas and Electric Meters - Verify with Owner for Mounting Locations. Minimize Visual Impact to Extent Possible.
- 5 Light Fixture - See A3.1.
- 6 Light Fixture - See A3.1.
- 7 Light Fixture - See A3.1.

Roof Plan General Notes

- 1. Coordinate with Mechanical Plan for Equipment Locations, Venting & Information

Roof Plan Keynotes

- 1 Ice and water barrier where indicated by hatch 4'-0" Min.
- 2 Asphalt shingles over underlayment and installed per manufacturer's recommendations - Basis of Design: CertainTeed Landmark
- 3 Ridge Vent - Provide and install final quantity recommended by roofing contractor.
- 4 Shear wall/ draft stop in vented attic space. Comply with IBC 716 for access doors in draft stops.
- 5 Pre-manufactured Canopy - See Detail 5/A4.1.

ANDREW E. ASSALTA
REGISTERED ARCHITECT
DATE: 01/31/2024 REGISTRATION NO.: 2809
SIGNED: _____








Elevations, Material Legend, Roof Plan, Notes


© Copyright 2024 WILCRG, LLC

Date: 01/31/2024
Project Number: 2344
Drawn By: APJ
Checked By: AEK
Approved By: AEK


Sheet

A4.0

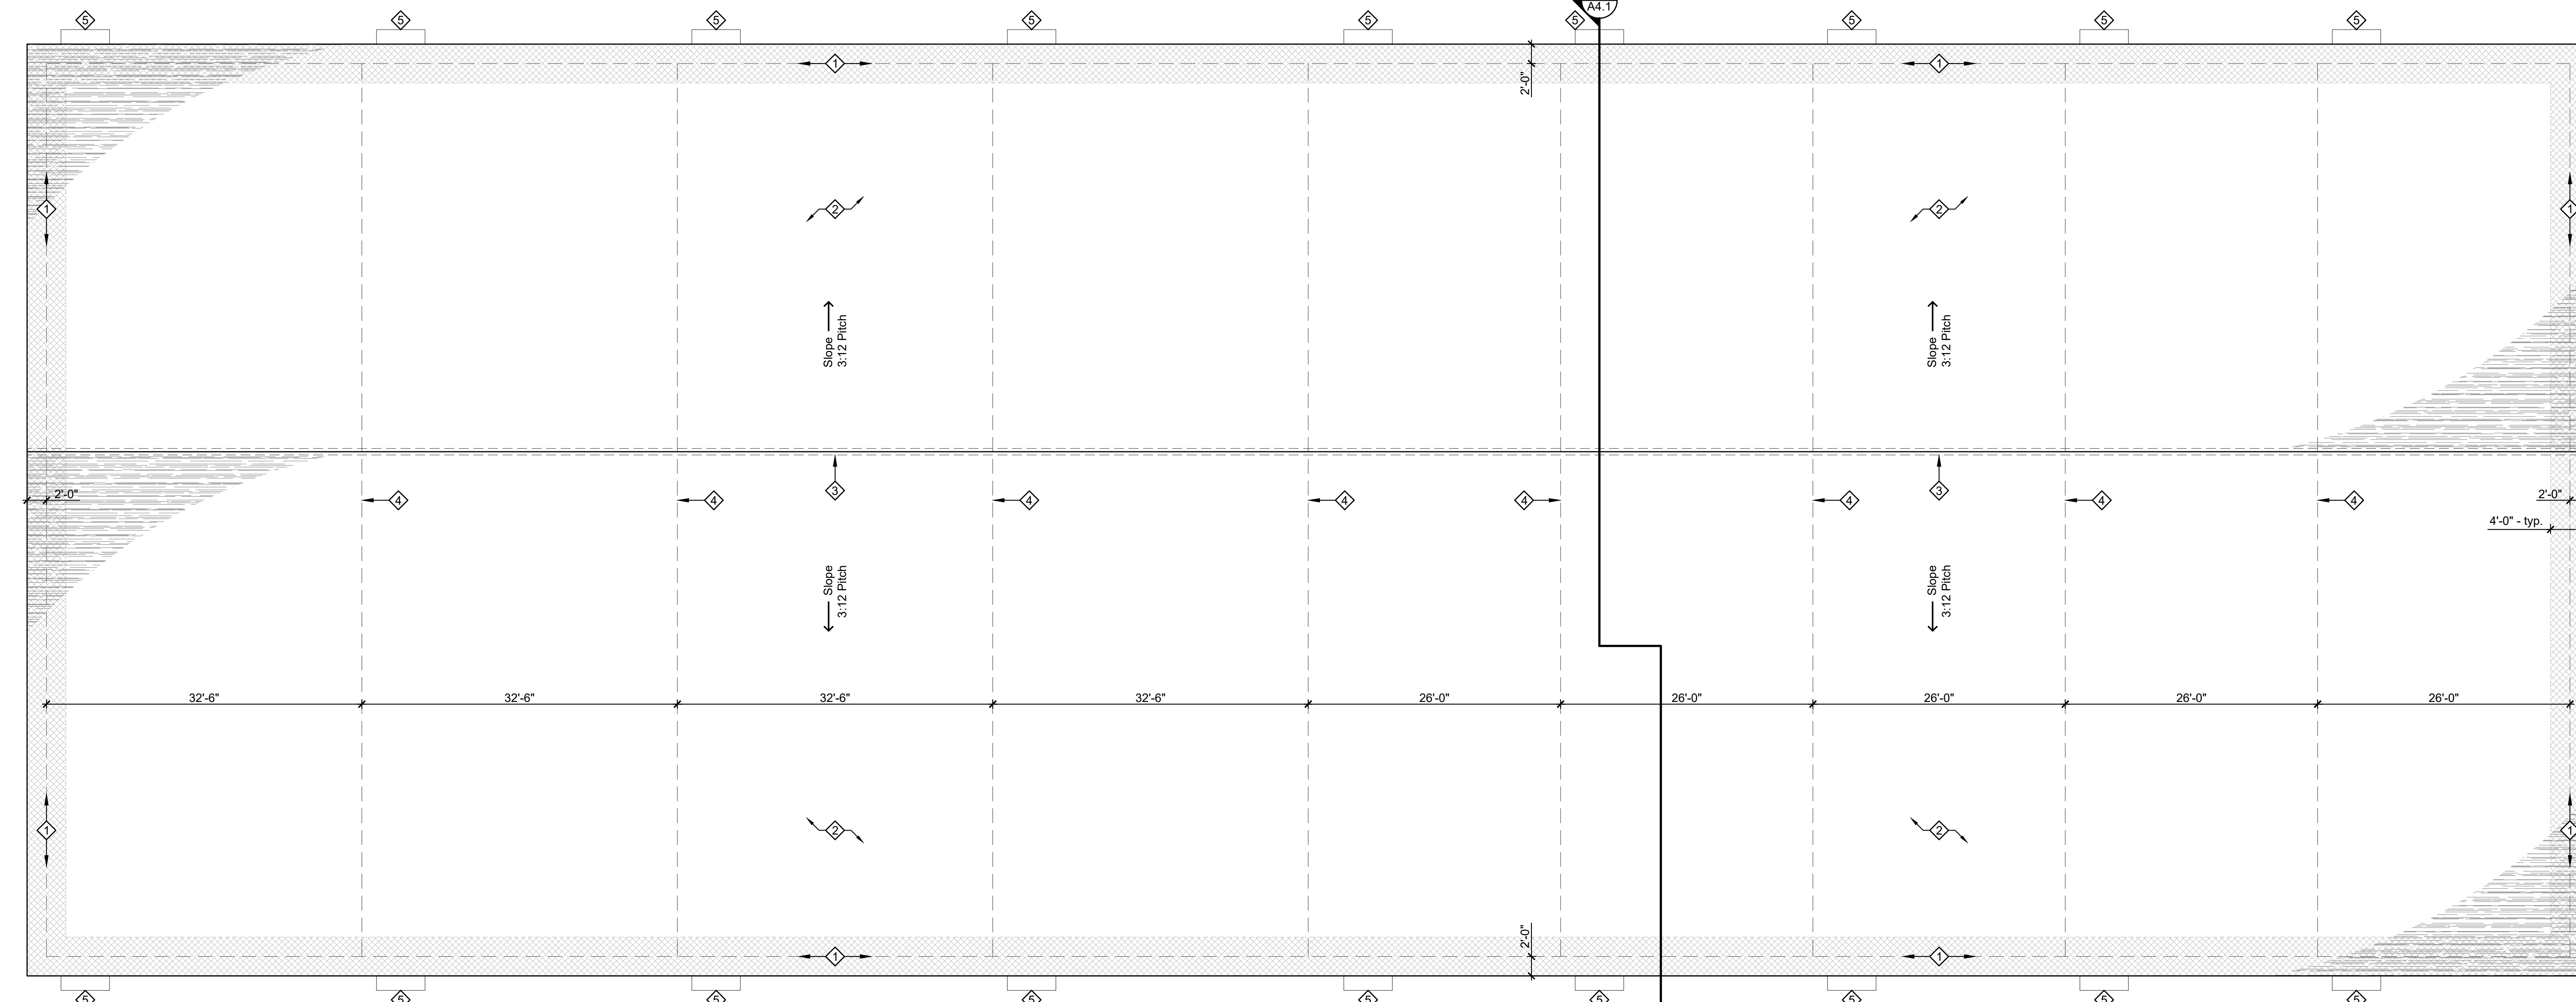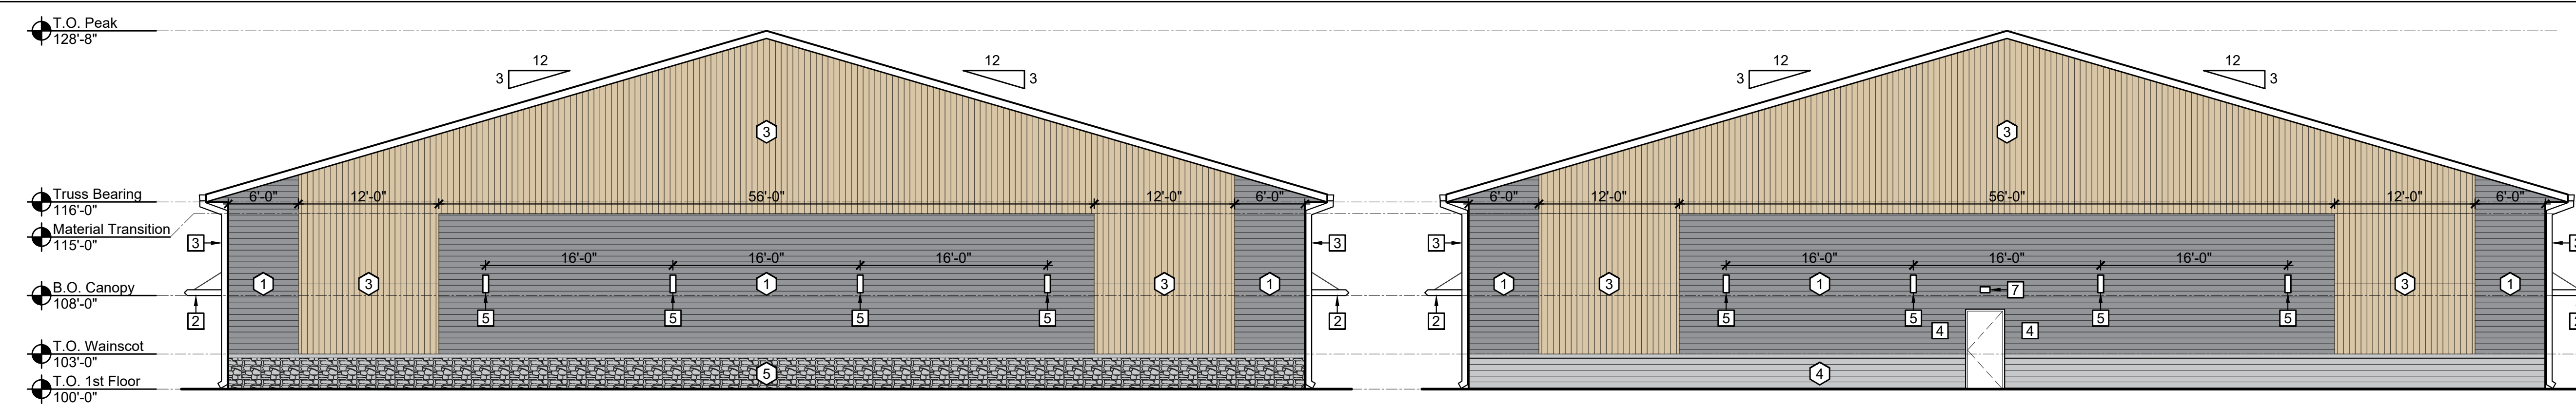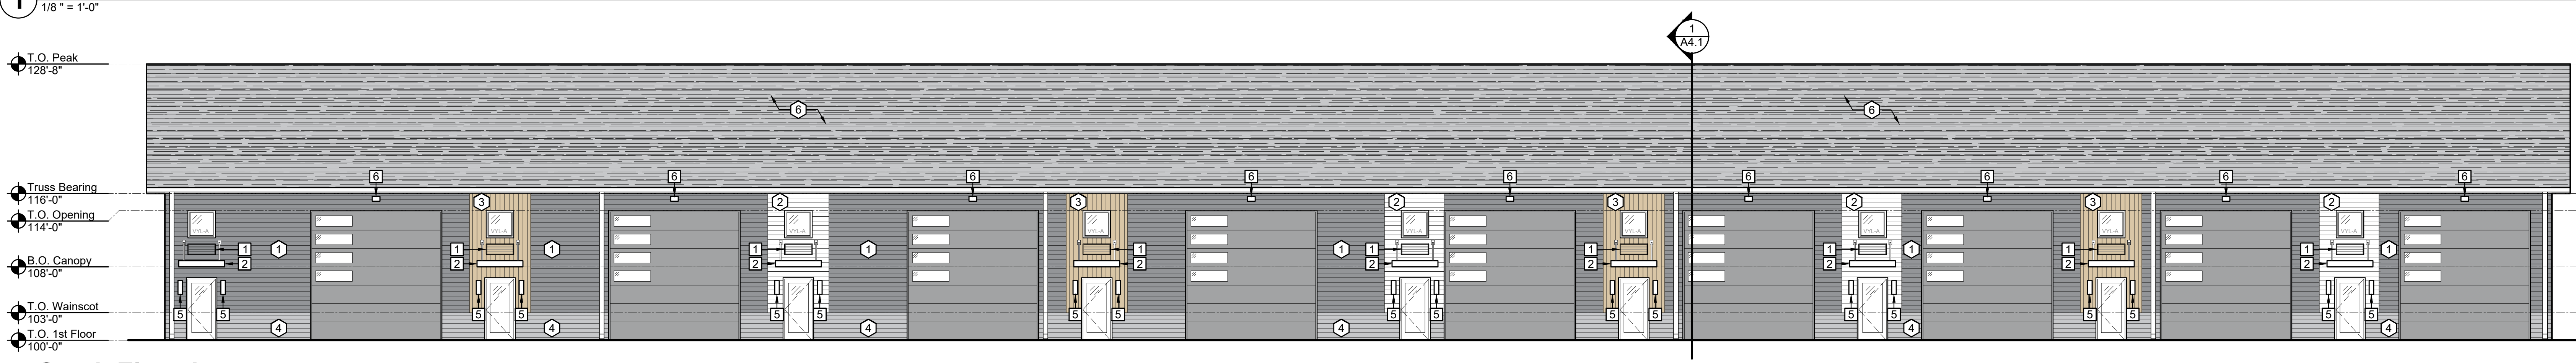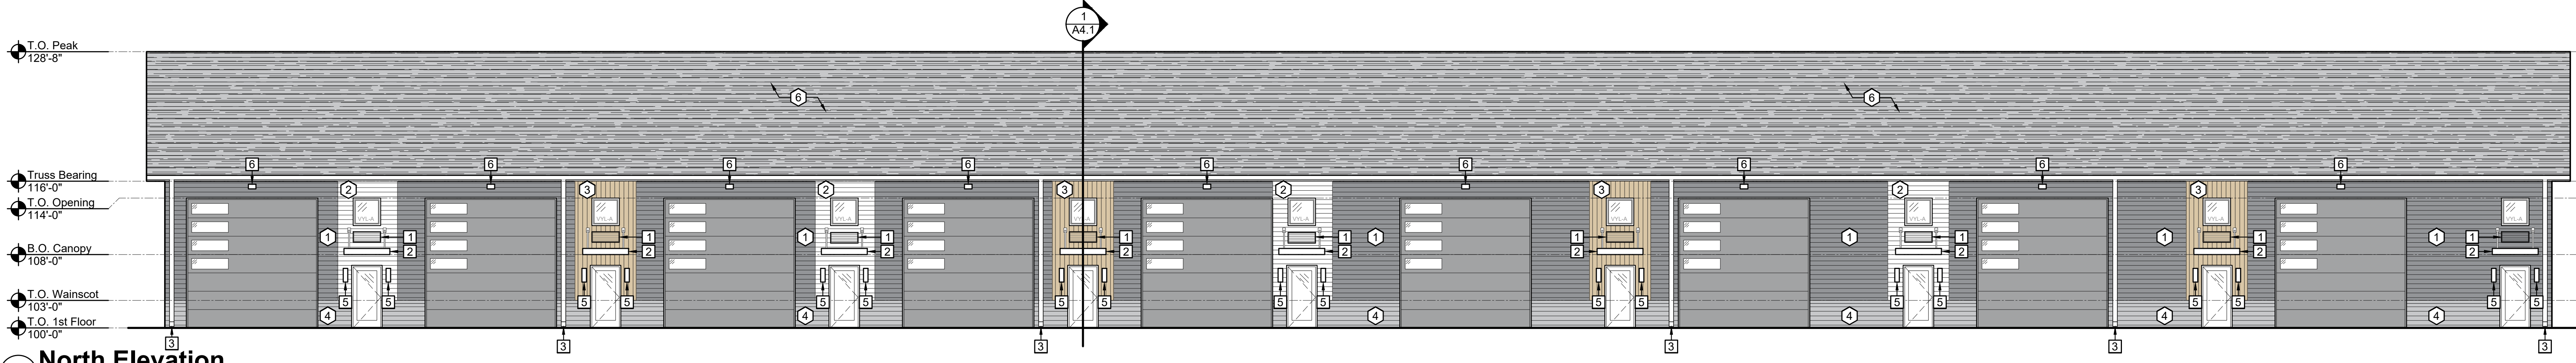


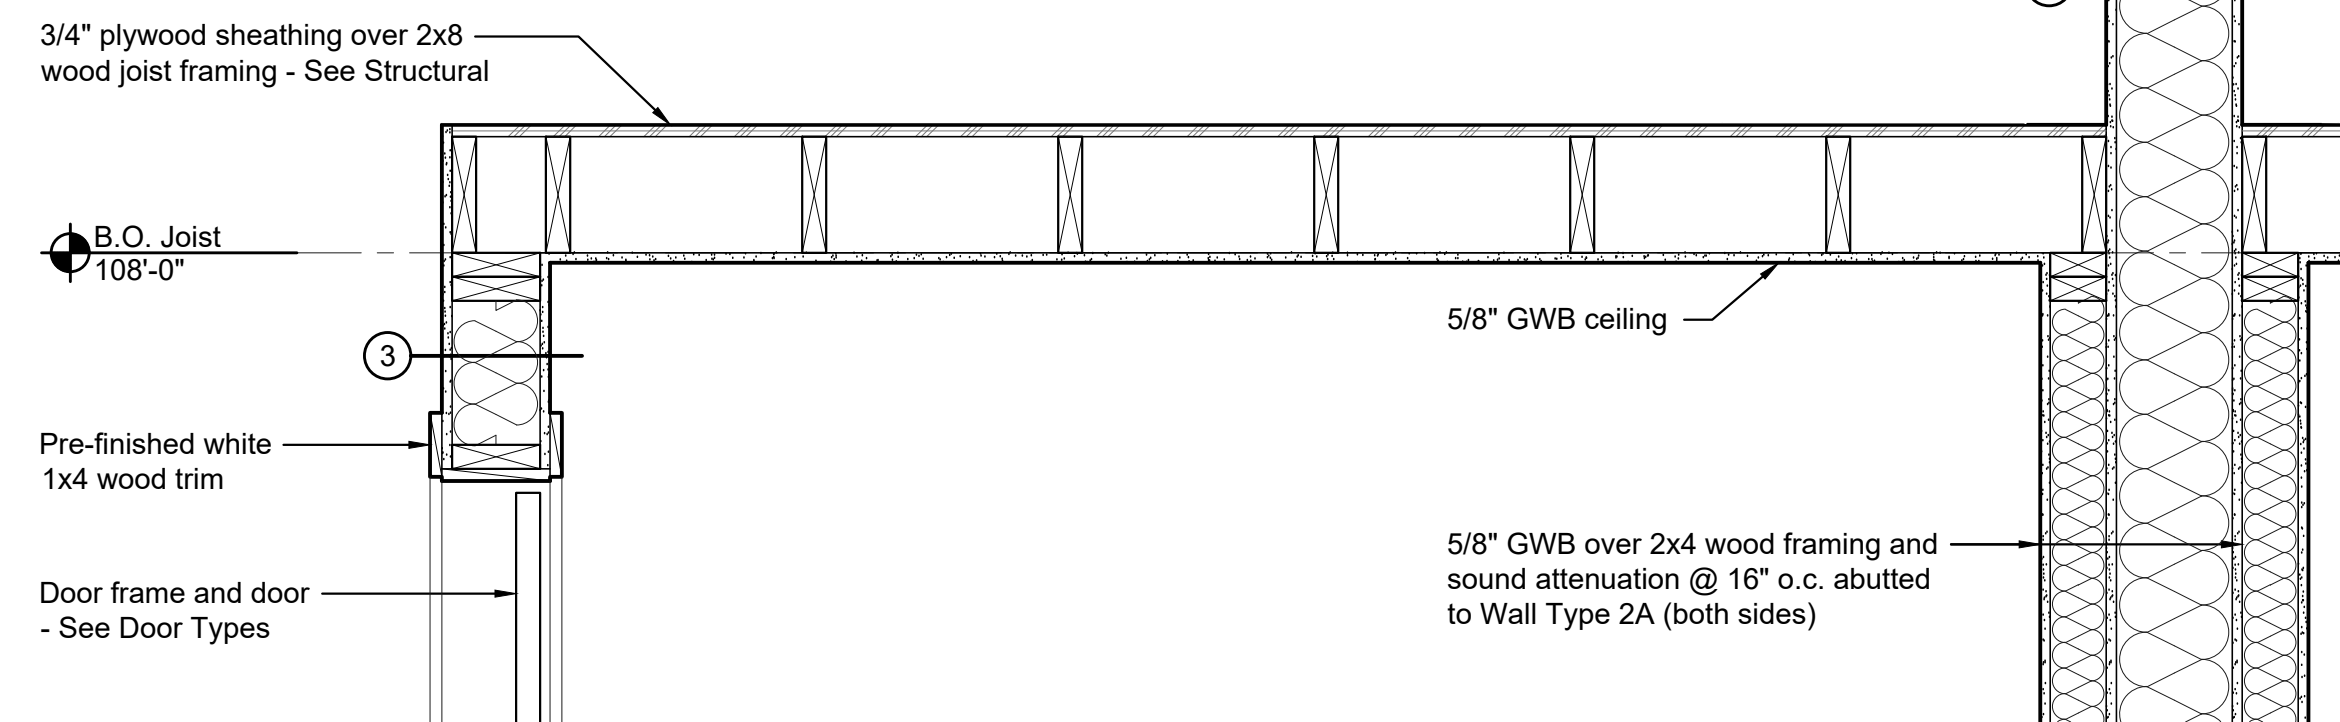


9 Section Detail
1" = 1'-0"

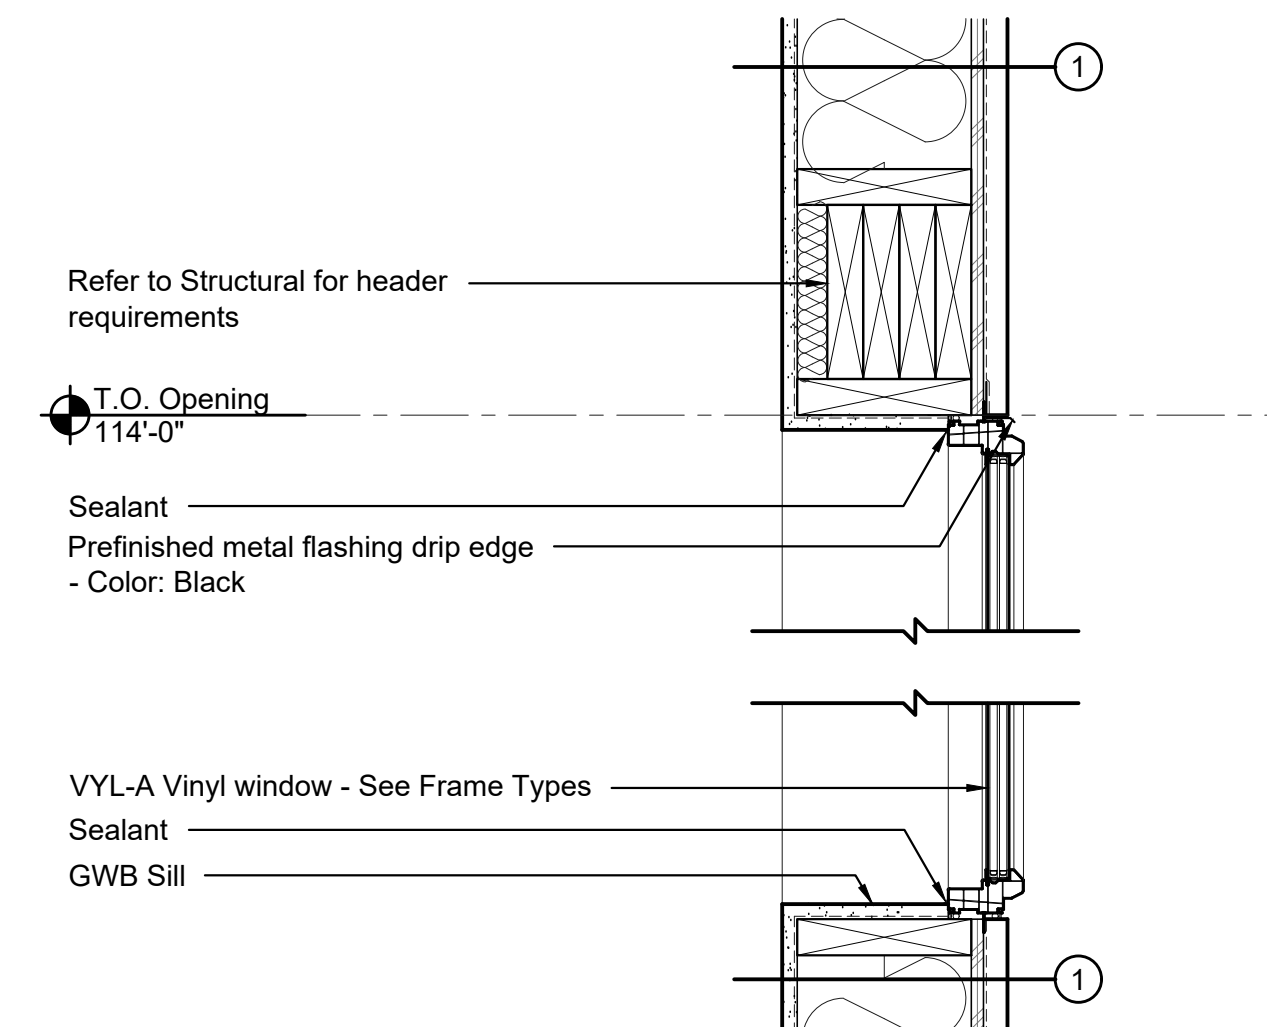


6 Head and Sill Detail
1 1/2" = 1'-0"

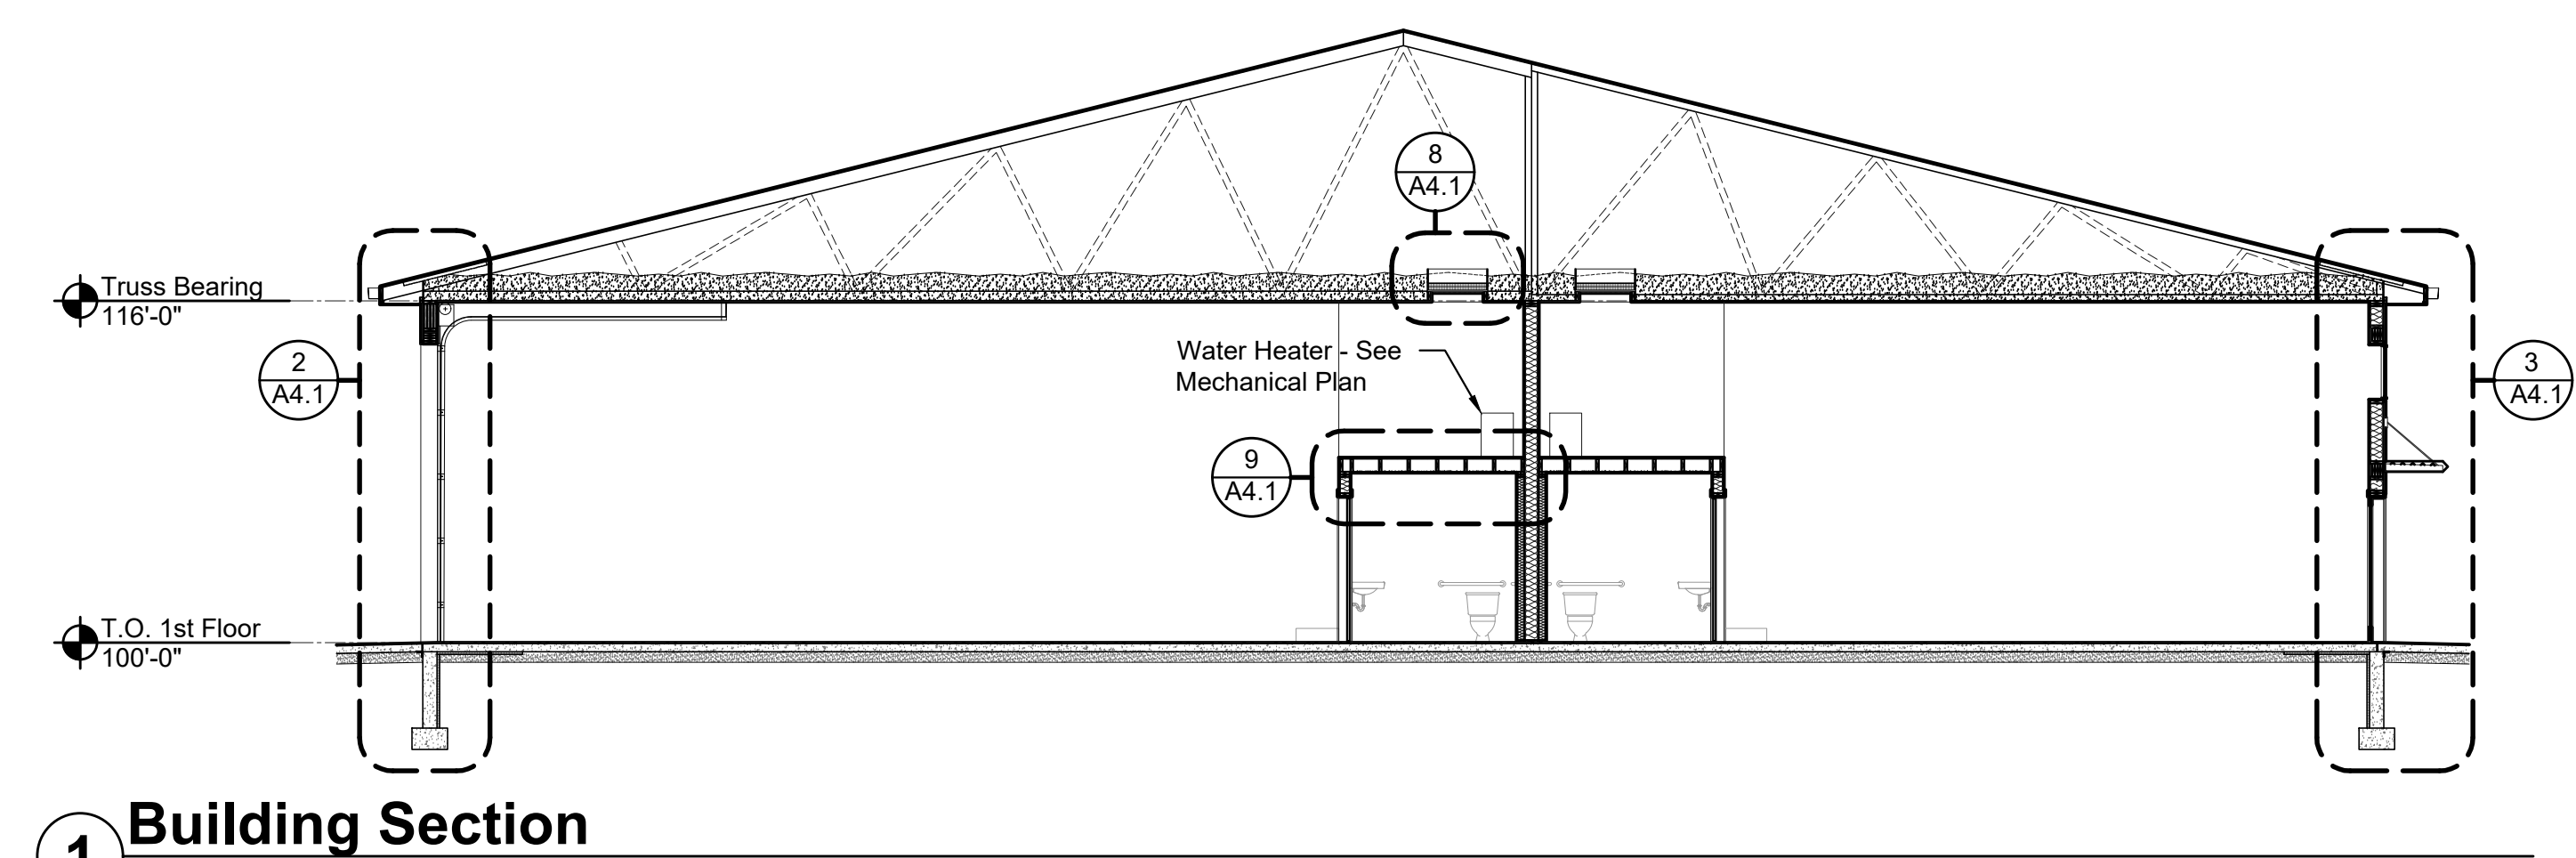


1 Building Section
1/8" = 1'-0"

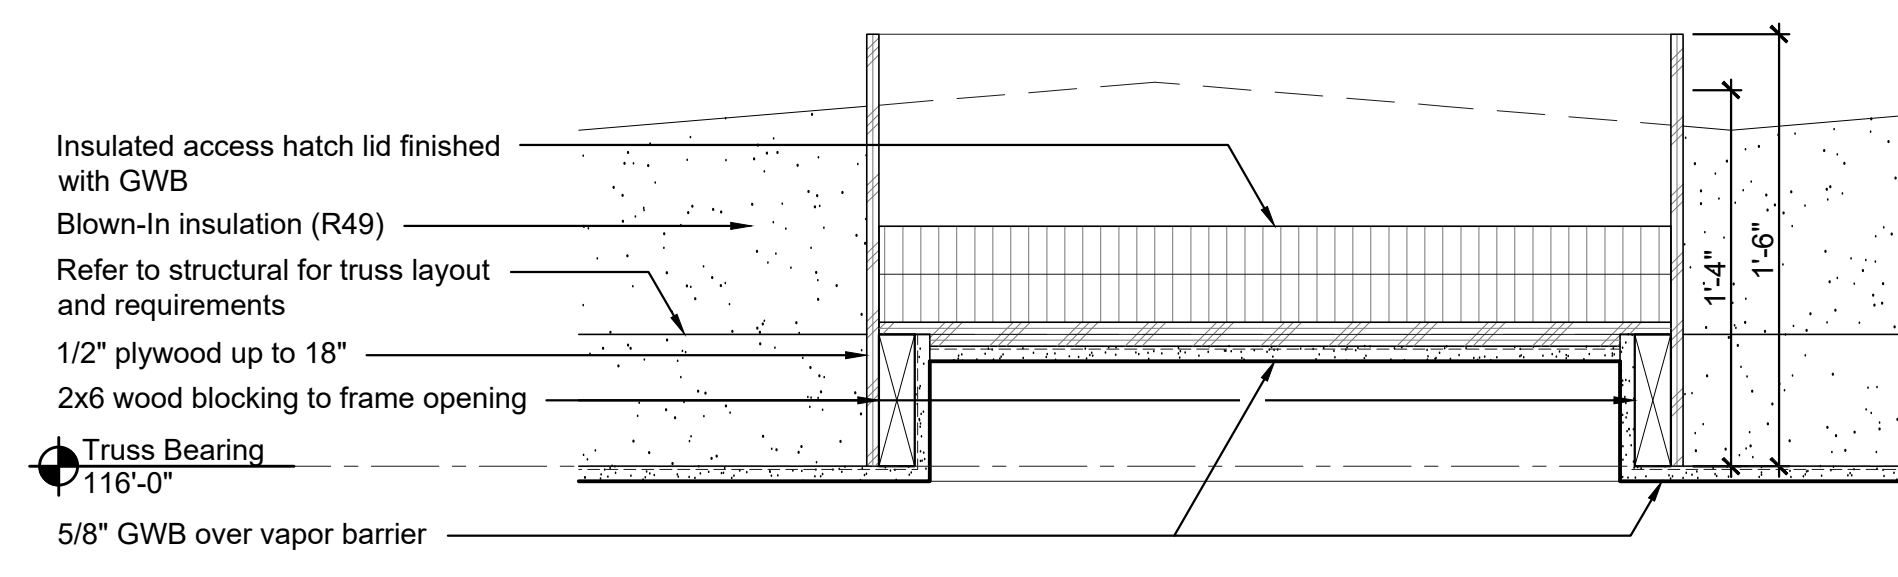


8 Typical Section Detail
1 1/2" = 1'-0"

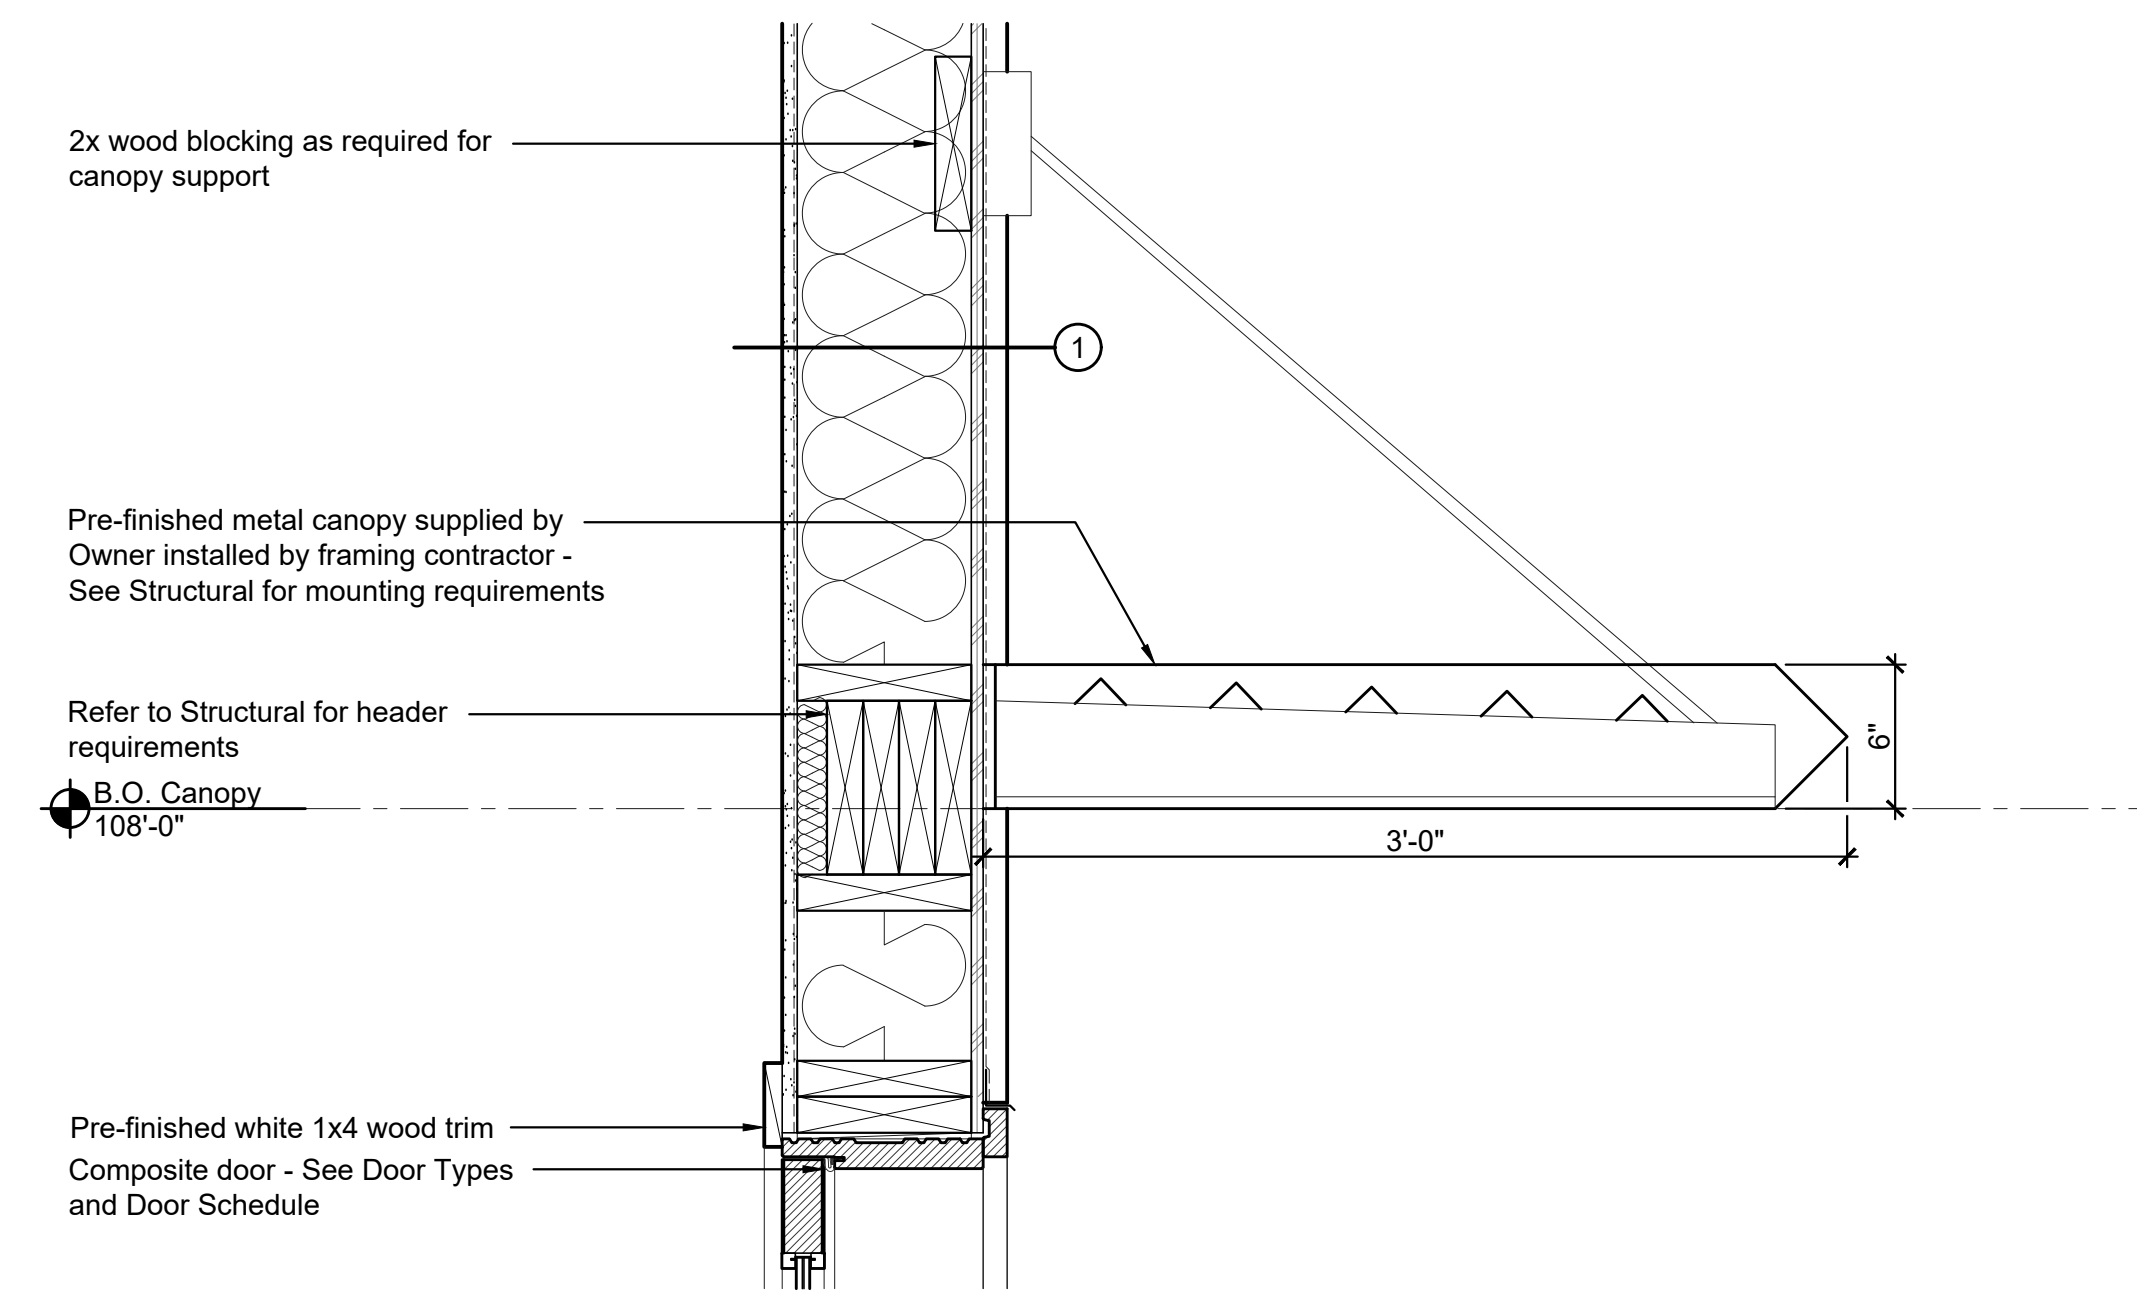


5 Section Detail
1 1/2" = 1'-0"

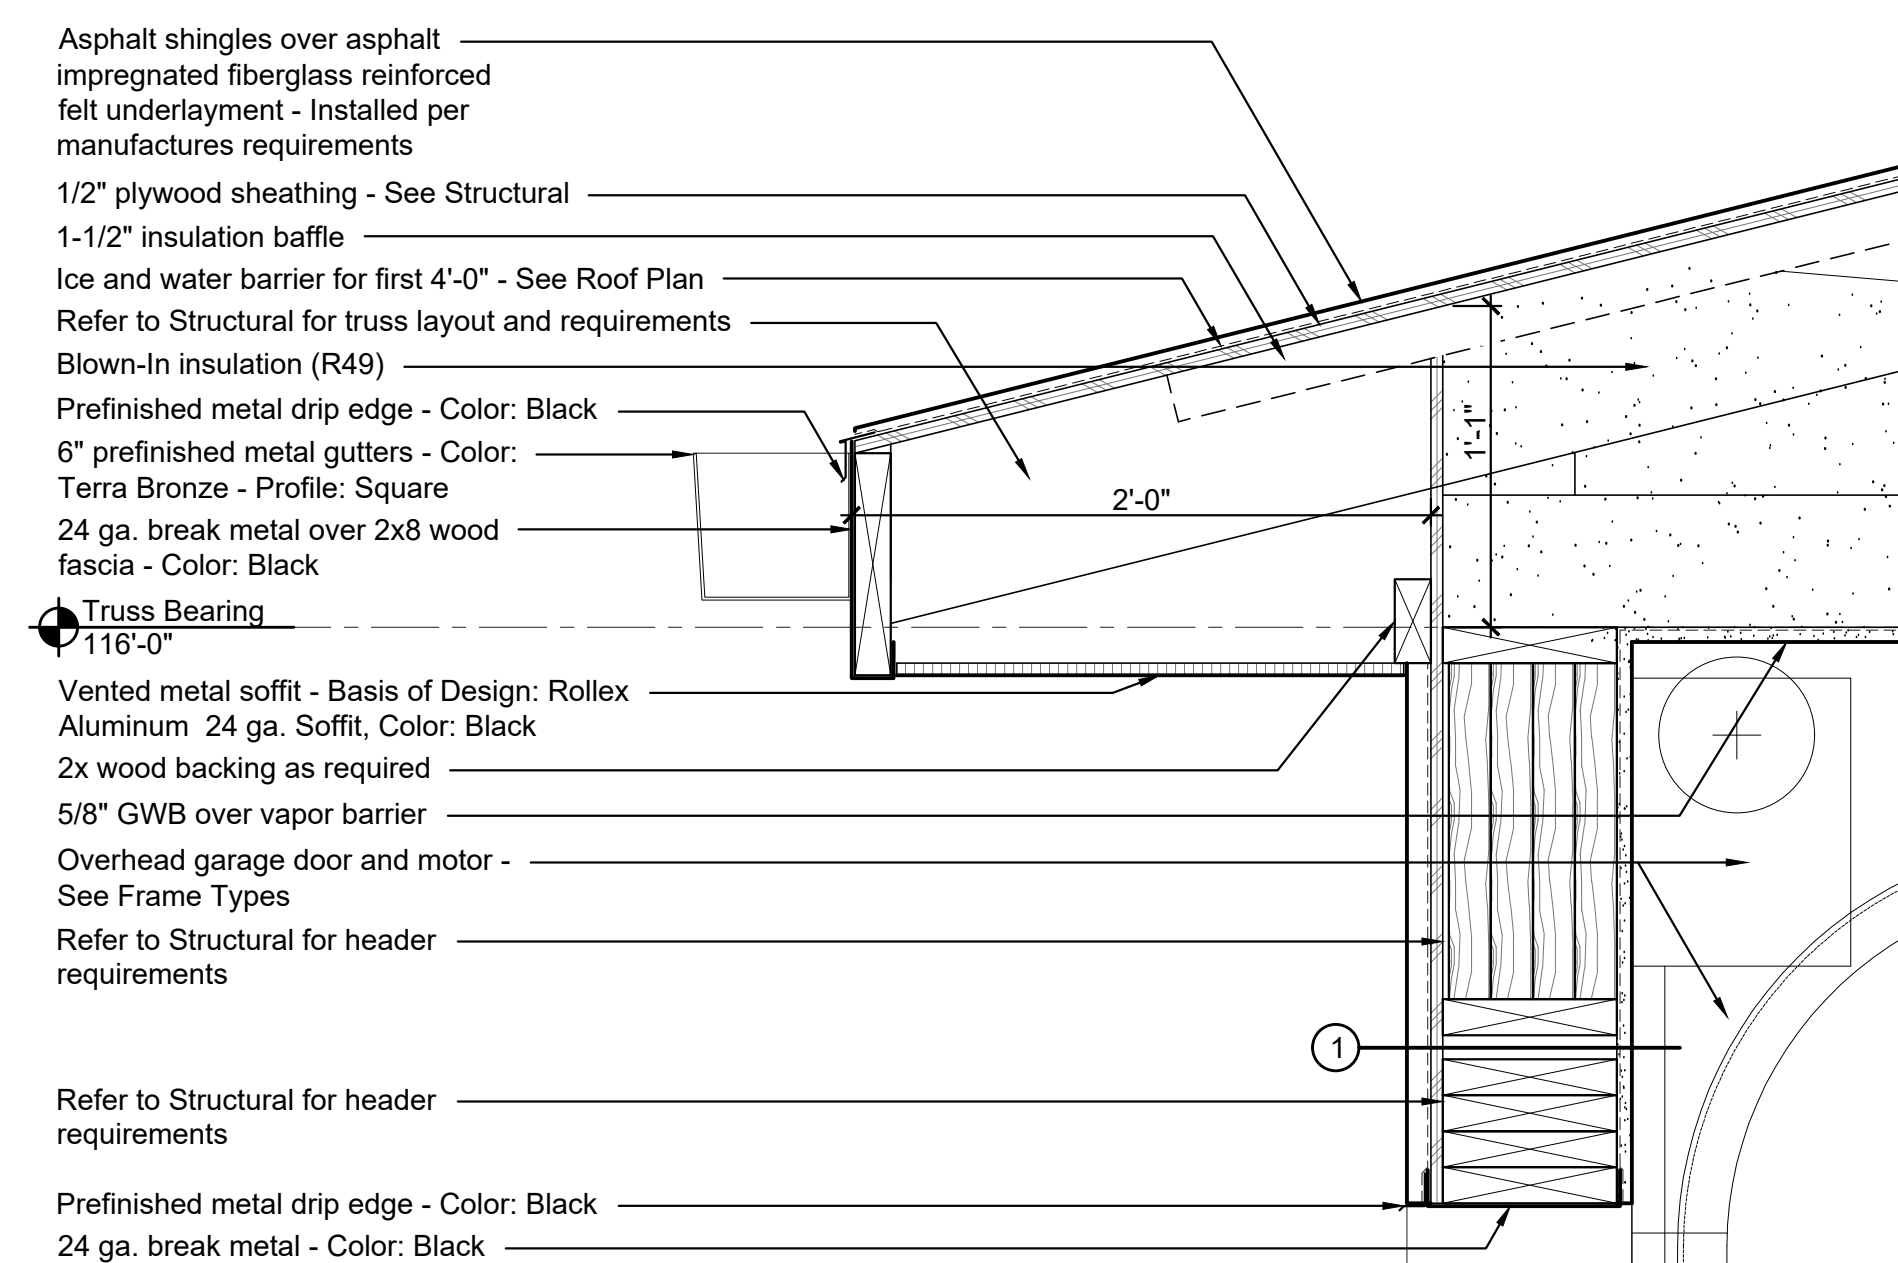

7 Section Detail
1 1/2" = 1'-0"

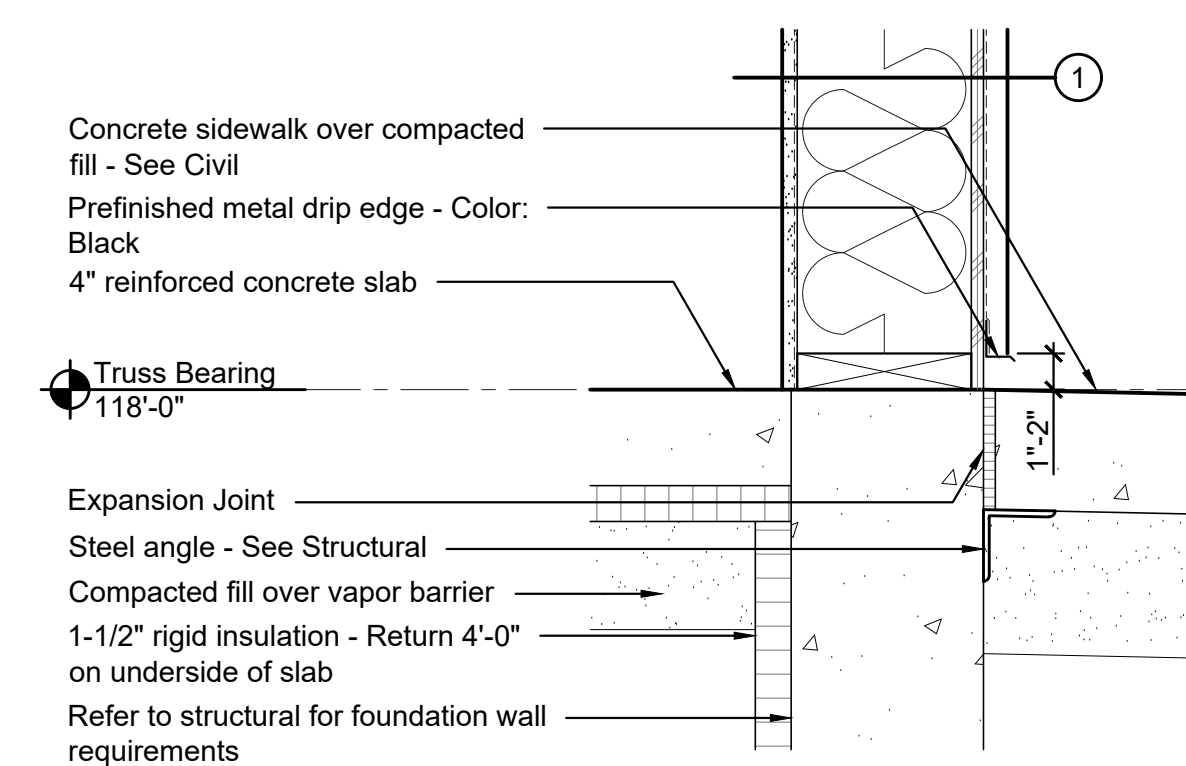

4 Typical Base Detail
1 1/2" = 1'-0"

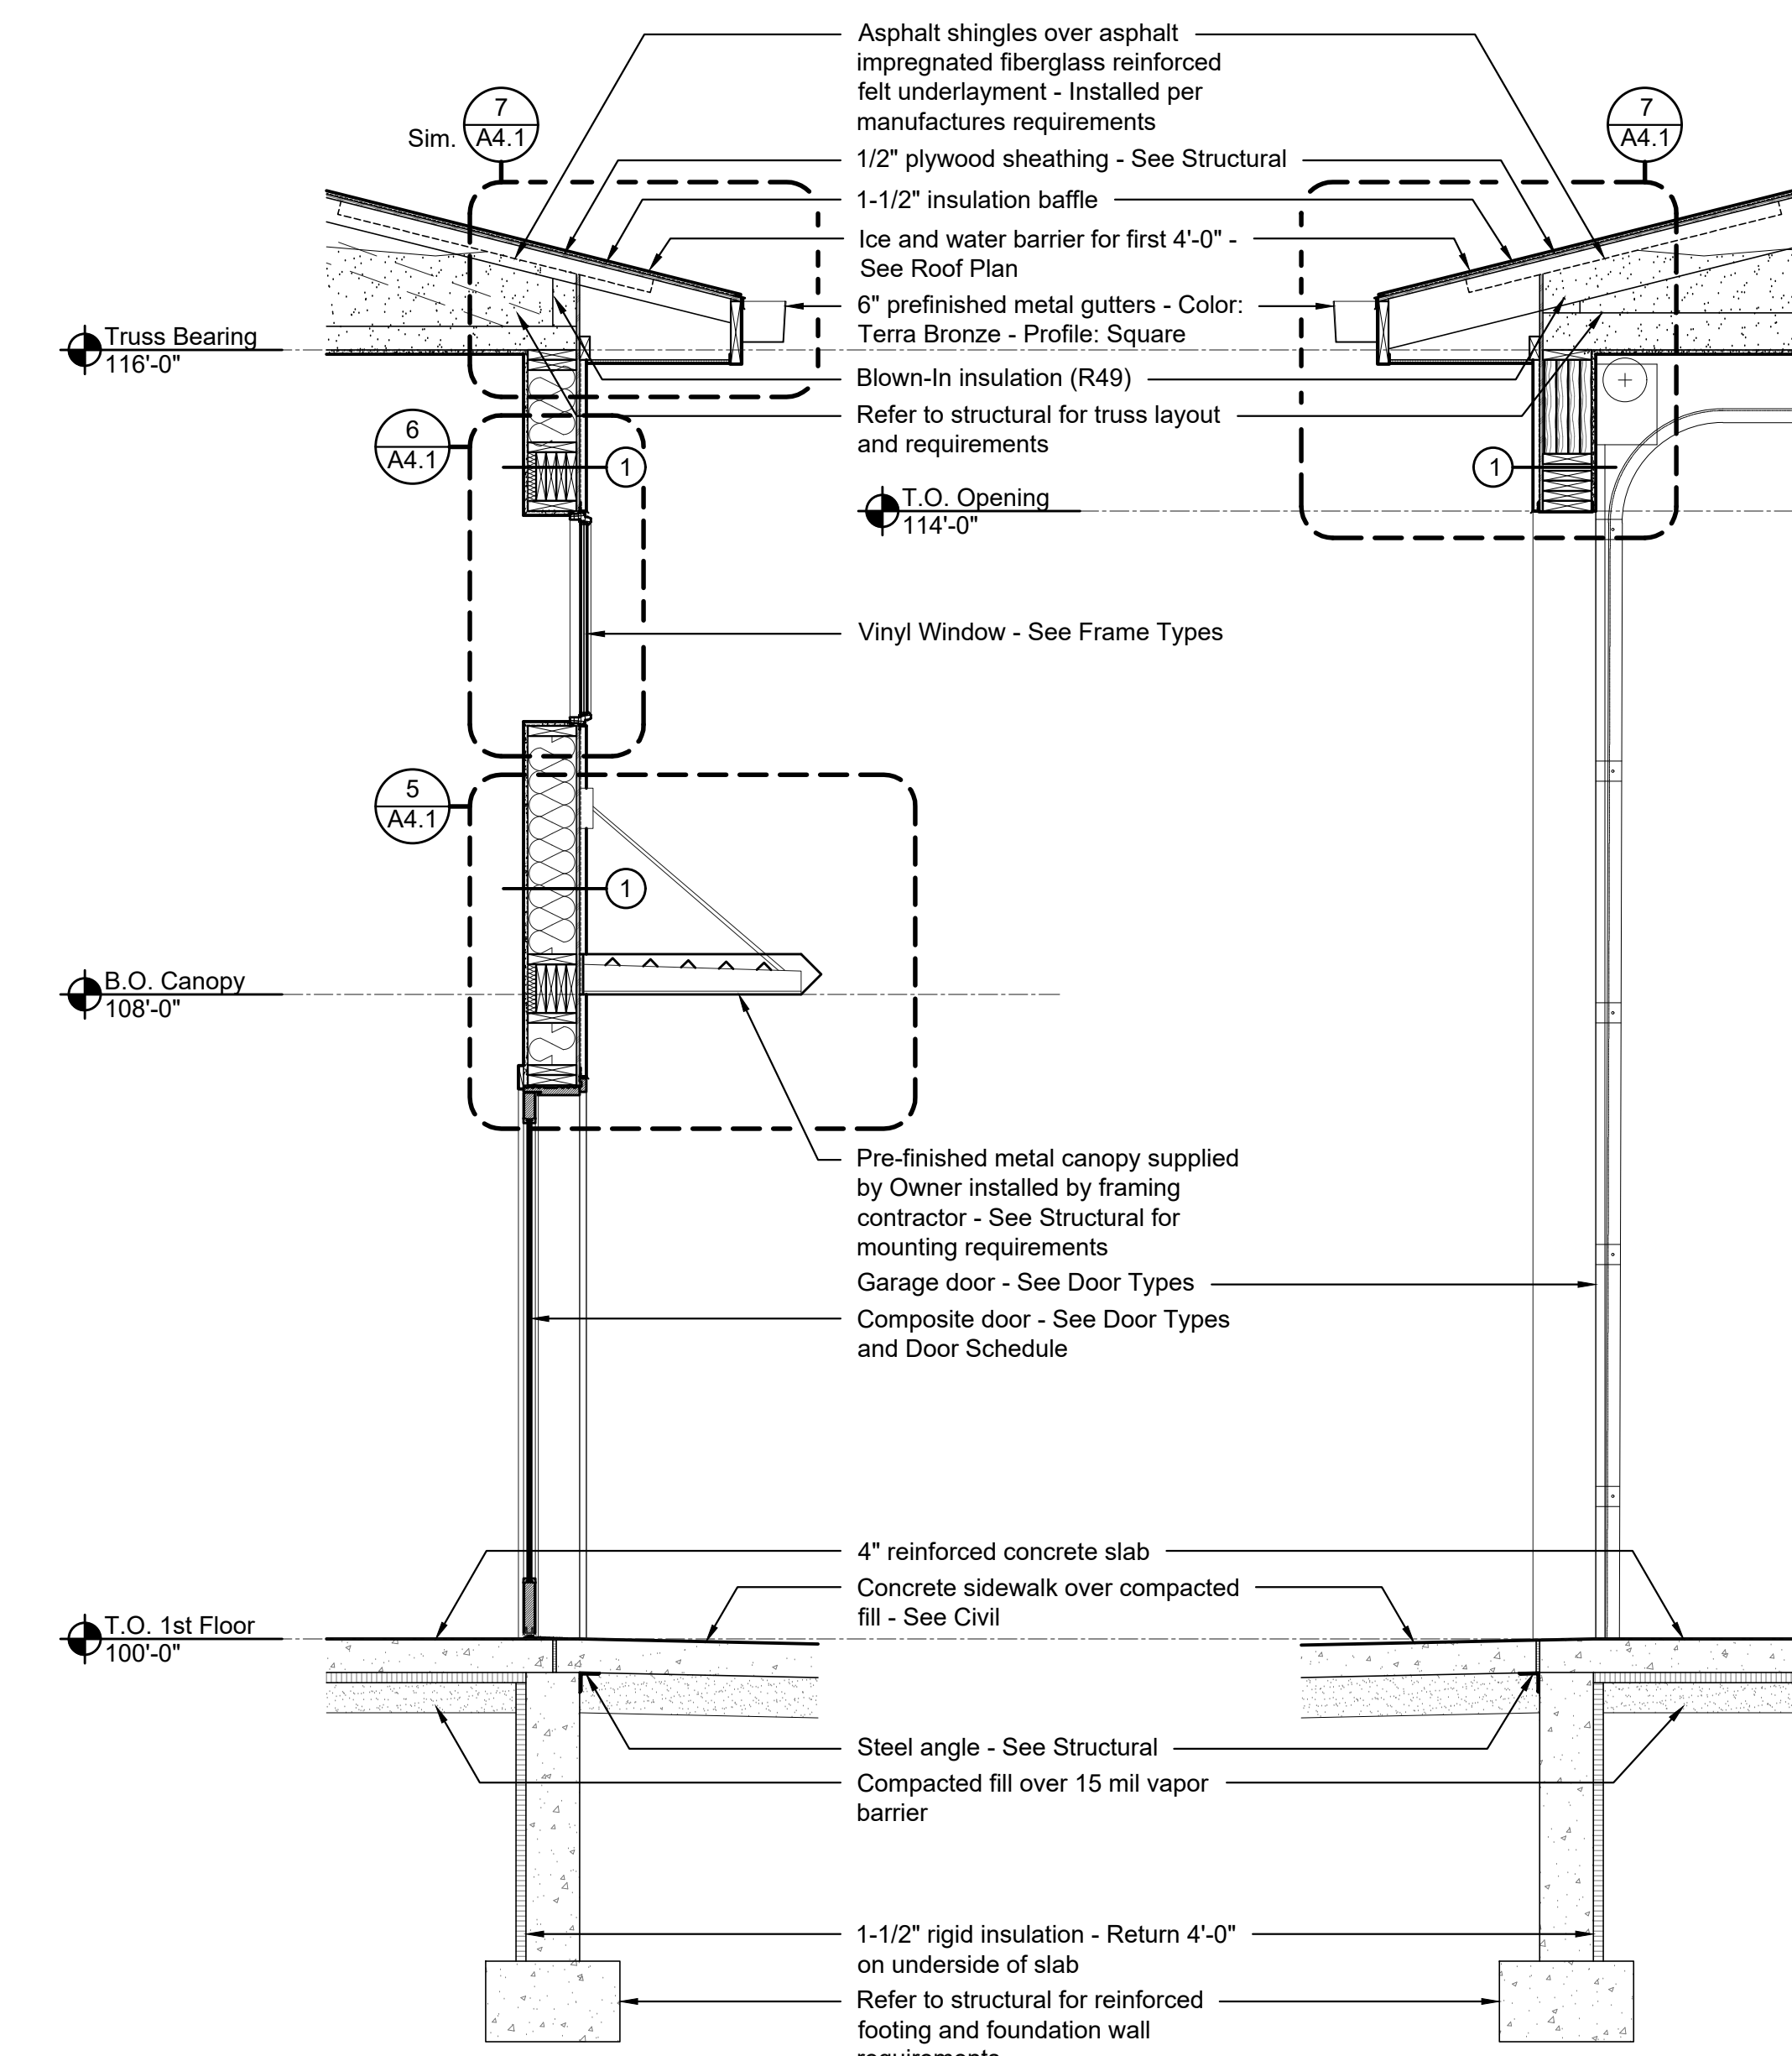

3 Wall Section
1/2" = 1'-0"

2 Wall Section
1/2" = 1'-0"

ANDREW E. ASHLEY
REGISTERED ARCHITECT
STATE OF NORTH DAKOTA
DATE: 01/31/2024 REGISTRATION NO.: 2829
SIGNED: _____

wild | crg
architecture | construction
500 2nd Avenue North, Suite 514
Fargo, North Dakota 58102
Phone 701 | 293 | 8106
wildcrg.com

Building Section, Wall Sections, Section Details

© Copyright 2024 WILDCRG, LLC

Date: 01/31/2024 Sheet
Project Number: 2344
Drawn By: APJ
Checked By: AEK
Approved By: AEK

A4.1